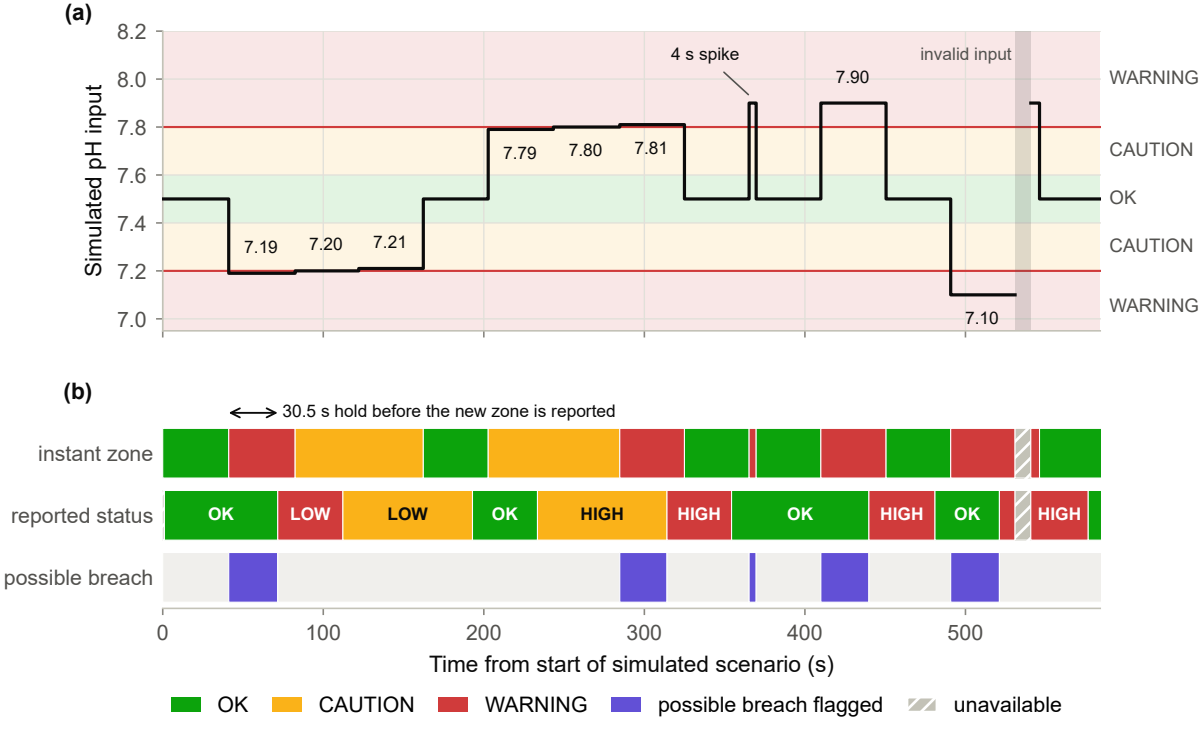
(a)
Simulated pH input
8.2
8.0
7.8
7.6
7.4
7.2
7.0
4 s spike
invalid input
7.90
7.79
7.80
7.81
7.19
7.20
7.21
7.10
WARNING
CAUTION
OK
CAUTION
WARNING
(b)
30.5 s hold before the new zone is reported
instant zone
reported status
possible breach
OK
LOW
LOW
OK
HIGH
HIGH
OK
HIGH
OK
HIGH
0
100
200
300
400
500
Time from start of simulated scenario (s)
OK
CAUTION
WARNING
possible breach flagged
unavailable