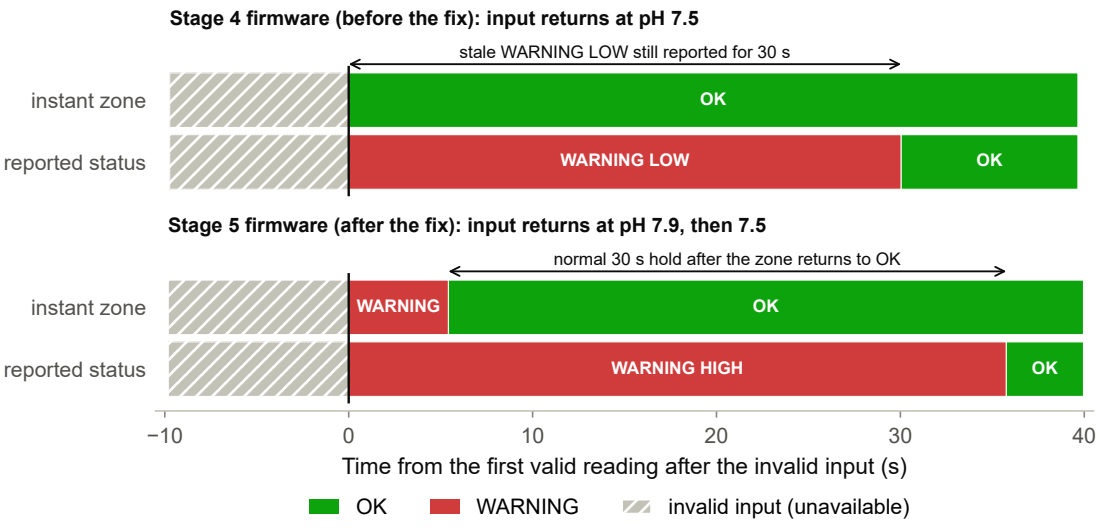
Stage 4 firmware (before the fix): input returns at pH 7.5
stale WARNING LOW still reported for 30 s
instant zone
reported status
OK
WARNING LOW
OK
Stage 5 firmware (after the fix): input returns at pH 7.9, then 7.5
normal 30 s hold after the zone returns to OK
instant zone
reported status
WARNING
OK
WARNING HIGH
OK
−10
0
10
20
30
40
Time from the first valid reading after the invalid input (s)
OK
WARNING
invalid input (unavailable)