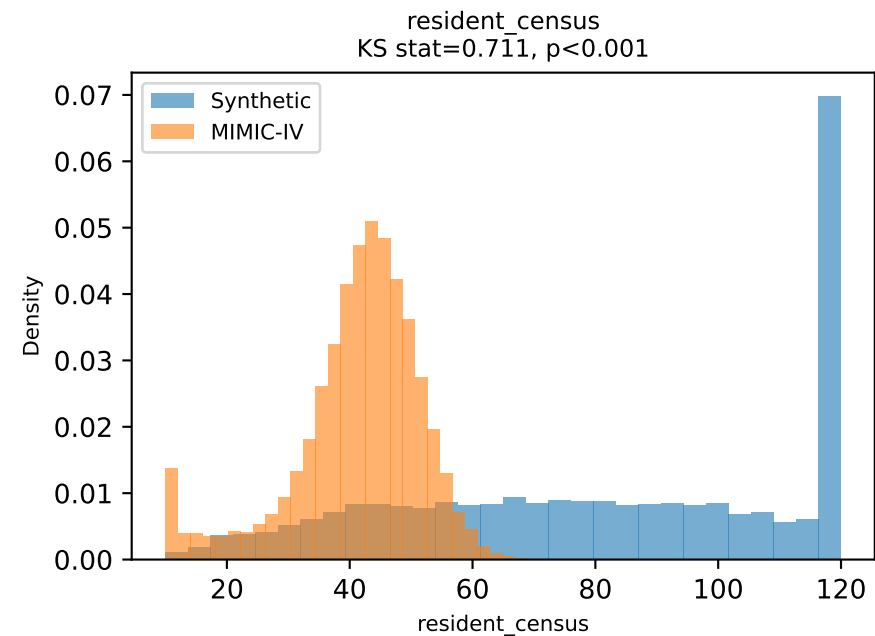
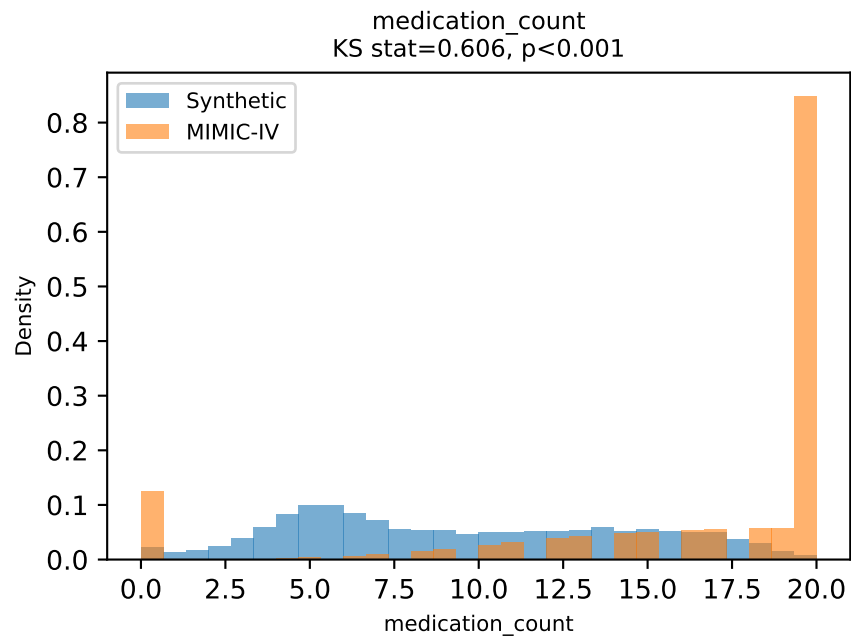
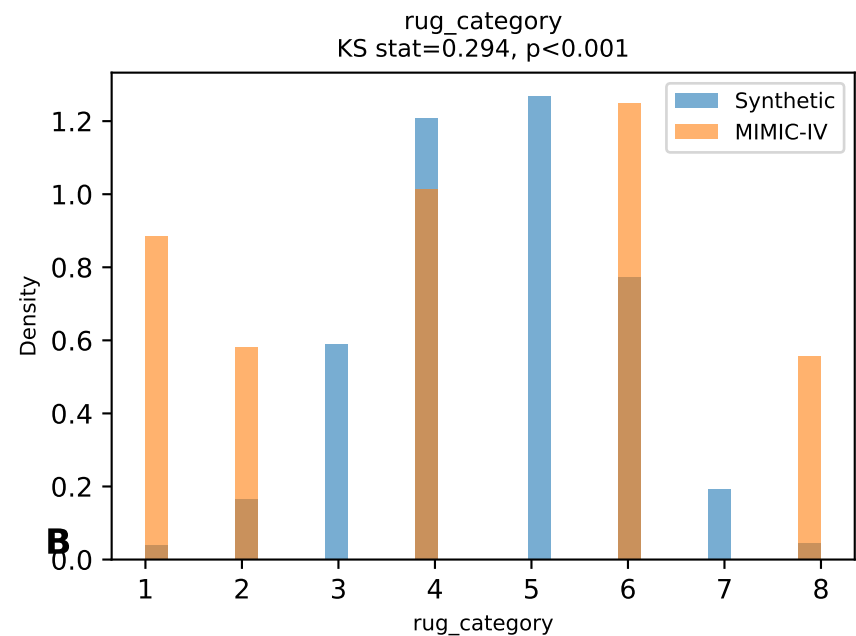


A

Figure 2 -- MIMIC-IV Validation of Synthetic LTC Data (C2)

(A) Cross-domain distribution overlay, 3 mappable features (B) Within-MIMIC-IV cohort calibration: LTC-bound vs non-LTC discharge

**B**