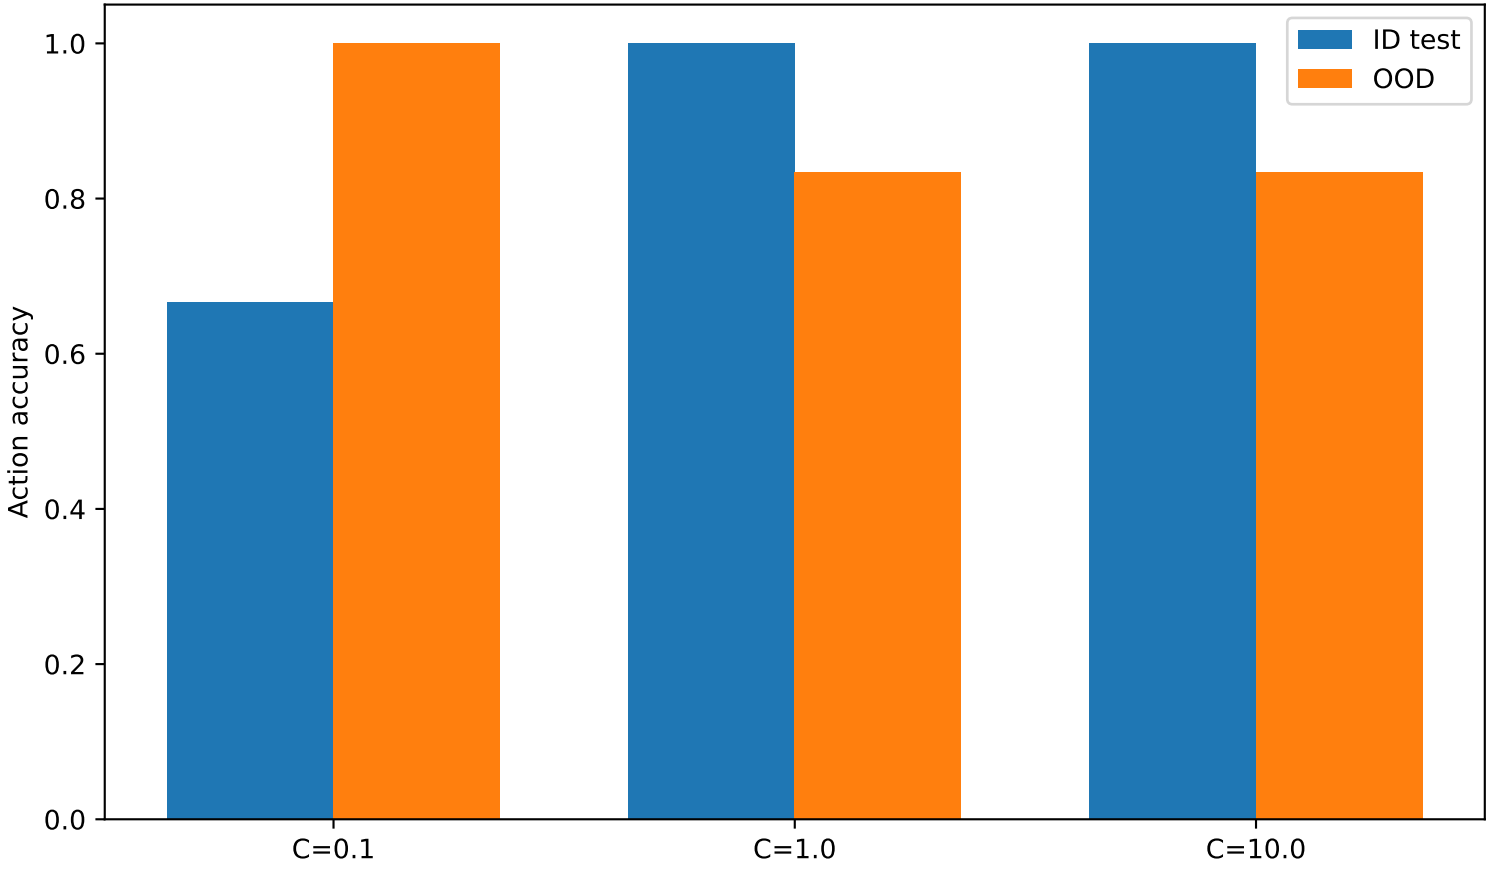
Post-Augmentation ID–OOD Tradeoff
ID test
OOD
Action accuracy
1.0
0.8
0.6
0.4
0.2
0.0
C=0.1
C=1.0
C=10.0