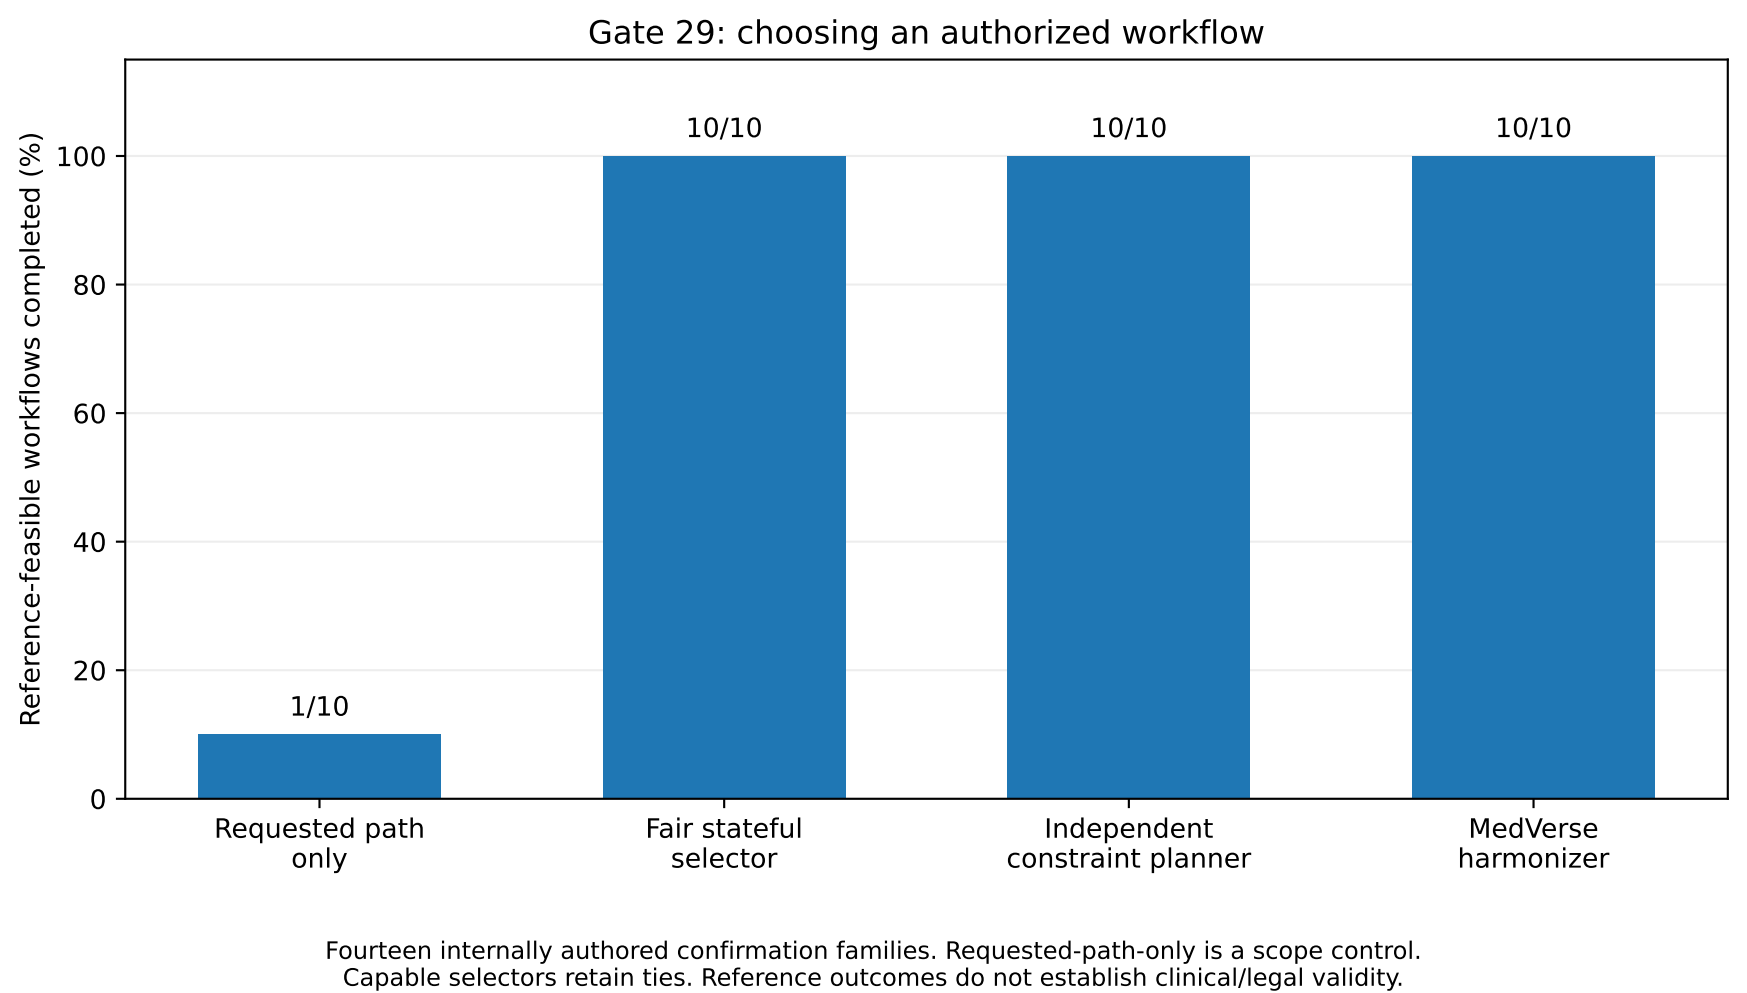
Gate 29: choosing an authorized workflow
Reference-feasible workflows completed (%)
0
20
40
60
80
100
1/10
10/10
10/10
10/10
Requested path only
Fair stateful selector
Independent constraint planner
MedVerse harmonizer
Fourteen internally authored confirmation families. Requested-path-only is a scope control.
Capable selectors retain ties. Reference outcomes do not establish clinical/legal validity.