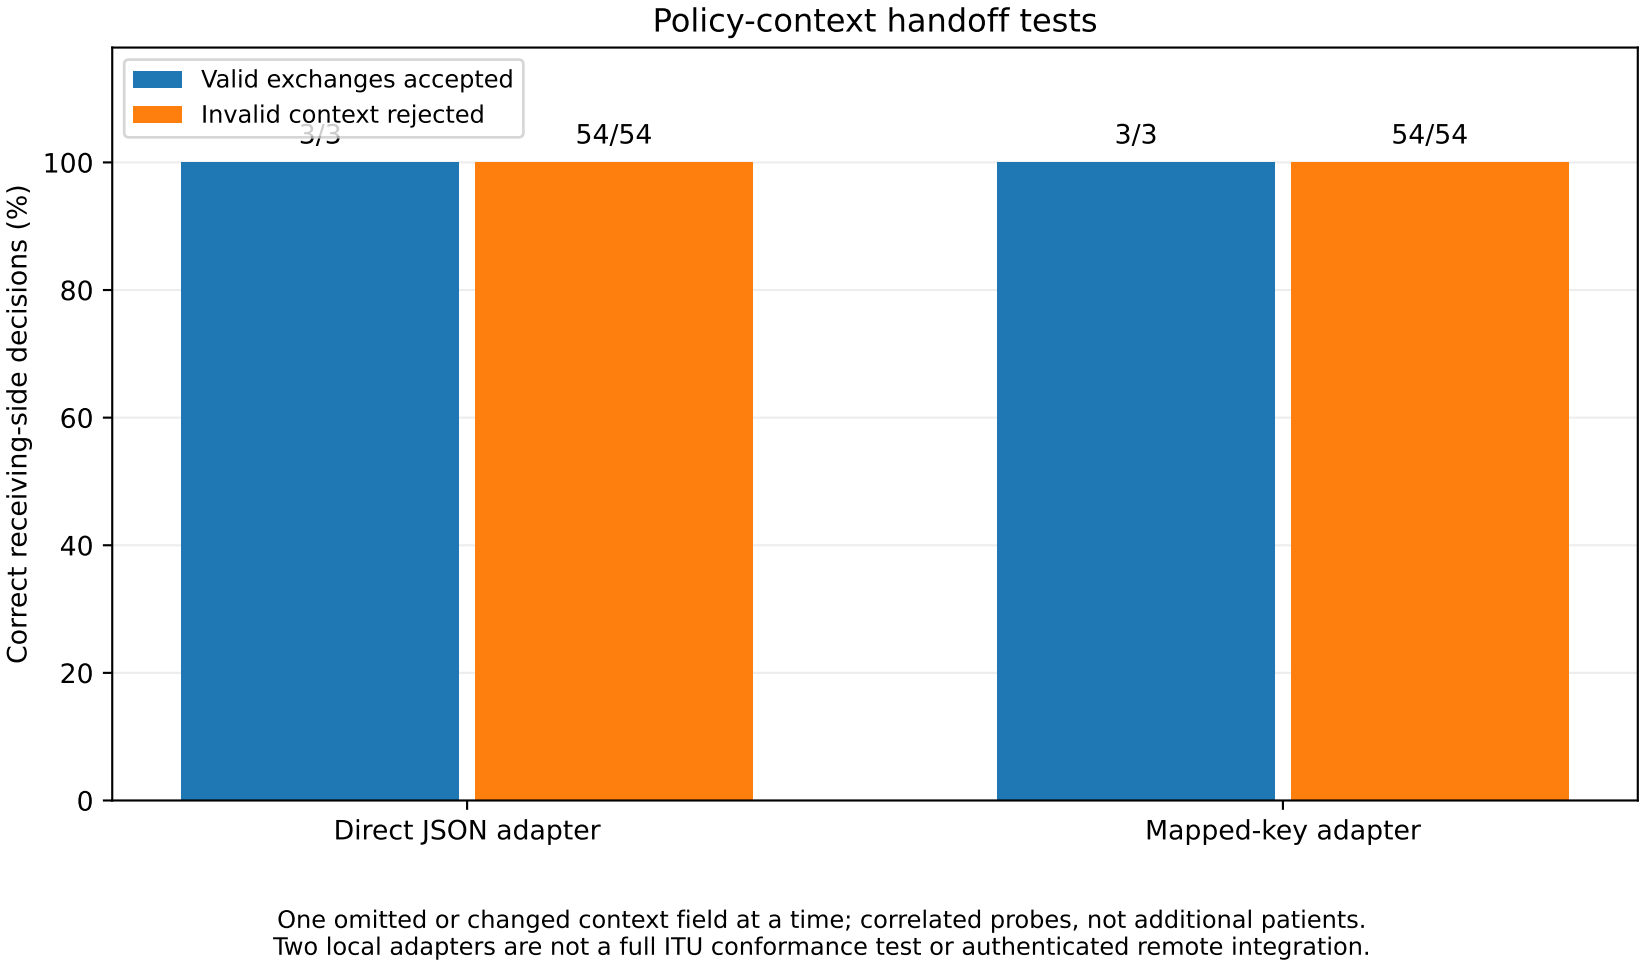
Policy-context handoff tests
Valid exchanges accepted
Invalid context rejected
Correct receiving-side decisions (%)
0
20
40
60
80
100
3/3
54/54
3/3
54/54
Direct JSON adapter
Mapped-key adapter
One omitted or changed context field at a time; correlated probes, not additional patients.
Two local adapters are not a full ITU conformance test or authenticated remote integration.