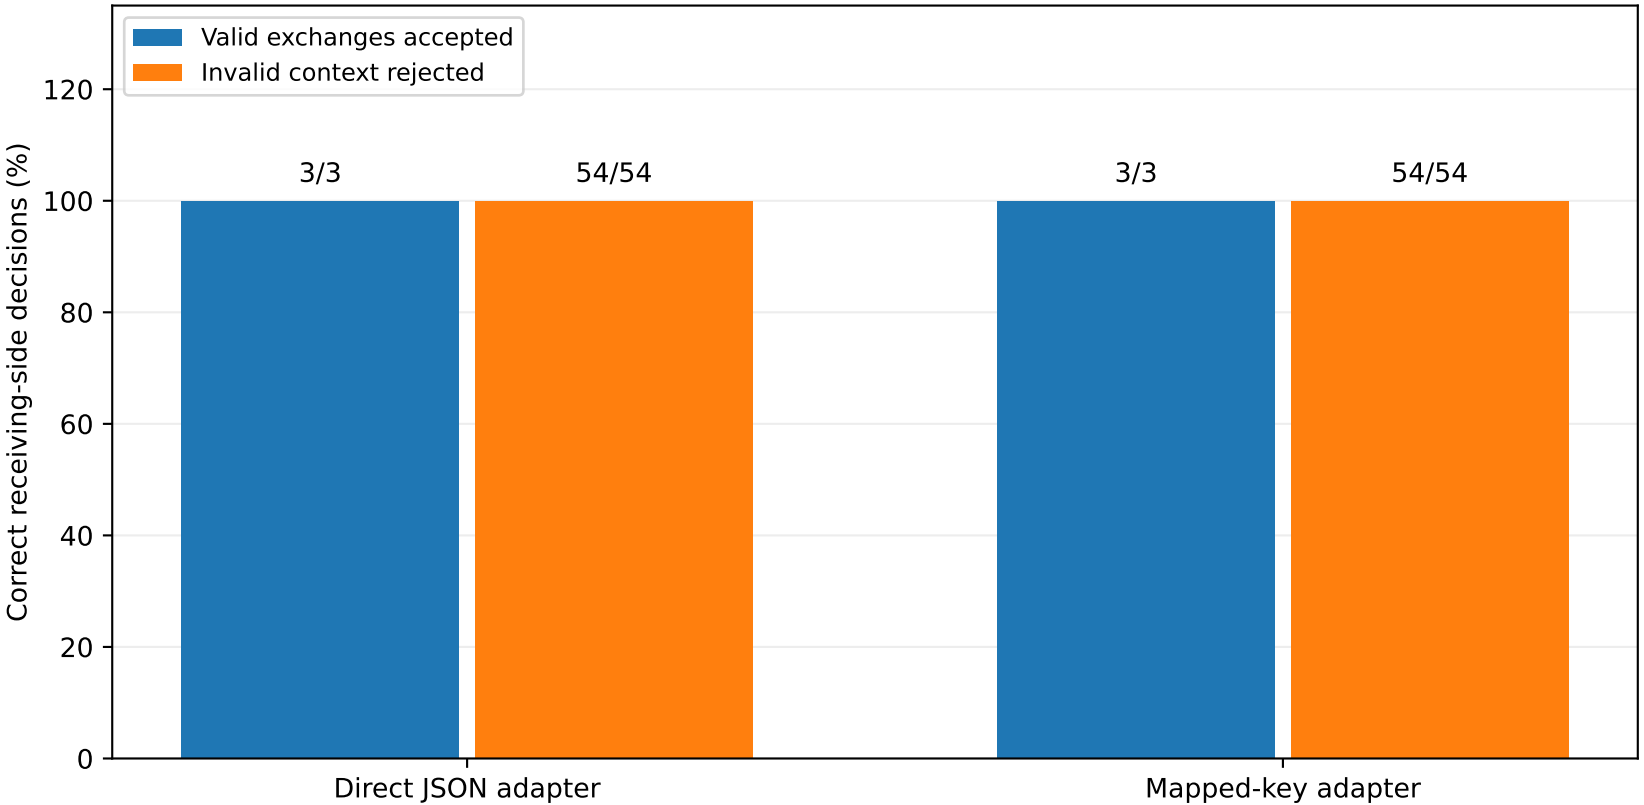

One omitted or changed context field at a time; correlated probes, not additional patients.
Two local adapters are not a full ITU conformance test or authenticated remote integration.