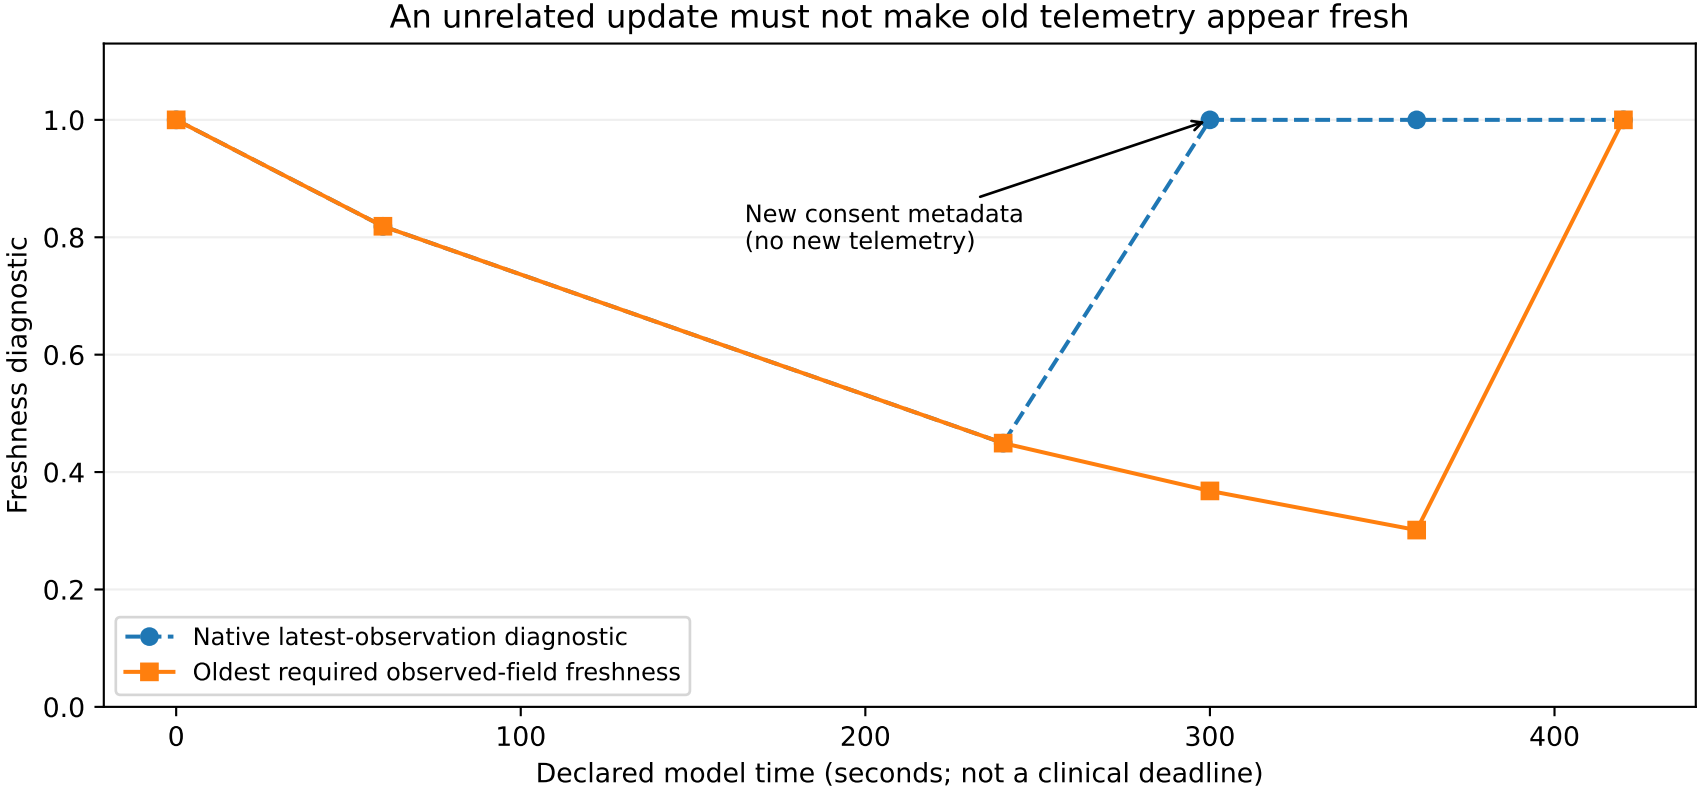

Explicit S1 development fixture. Native rules unchanged; adapter tracks per-field provenance.
No real patient observations, diagnosis, or action permission is established.