
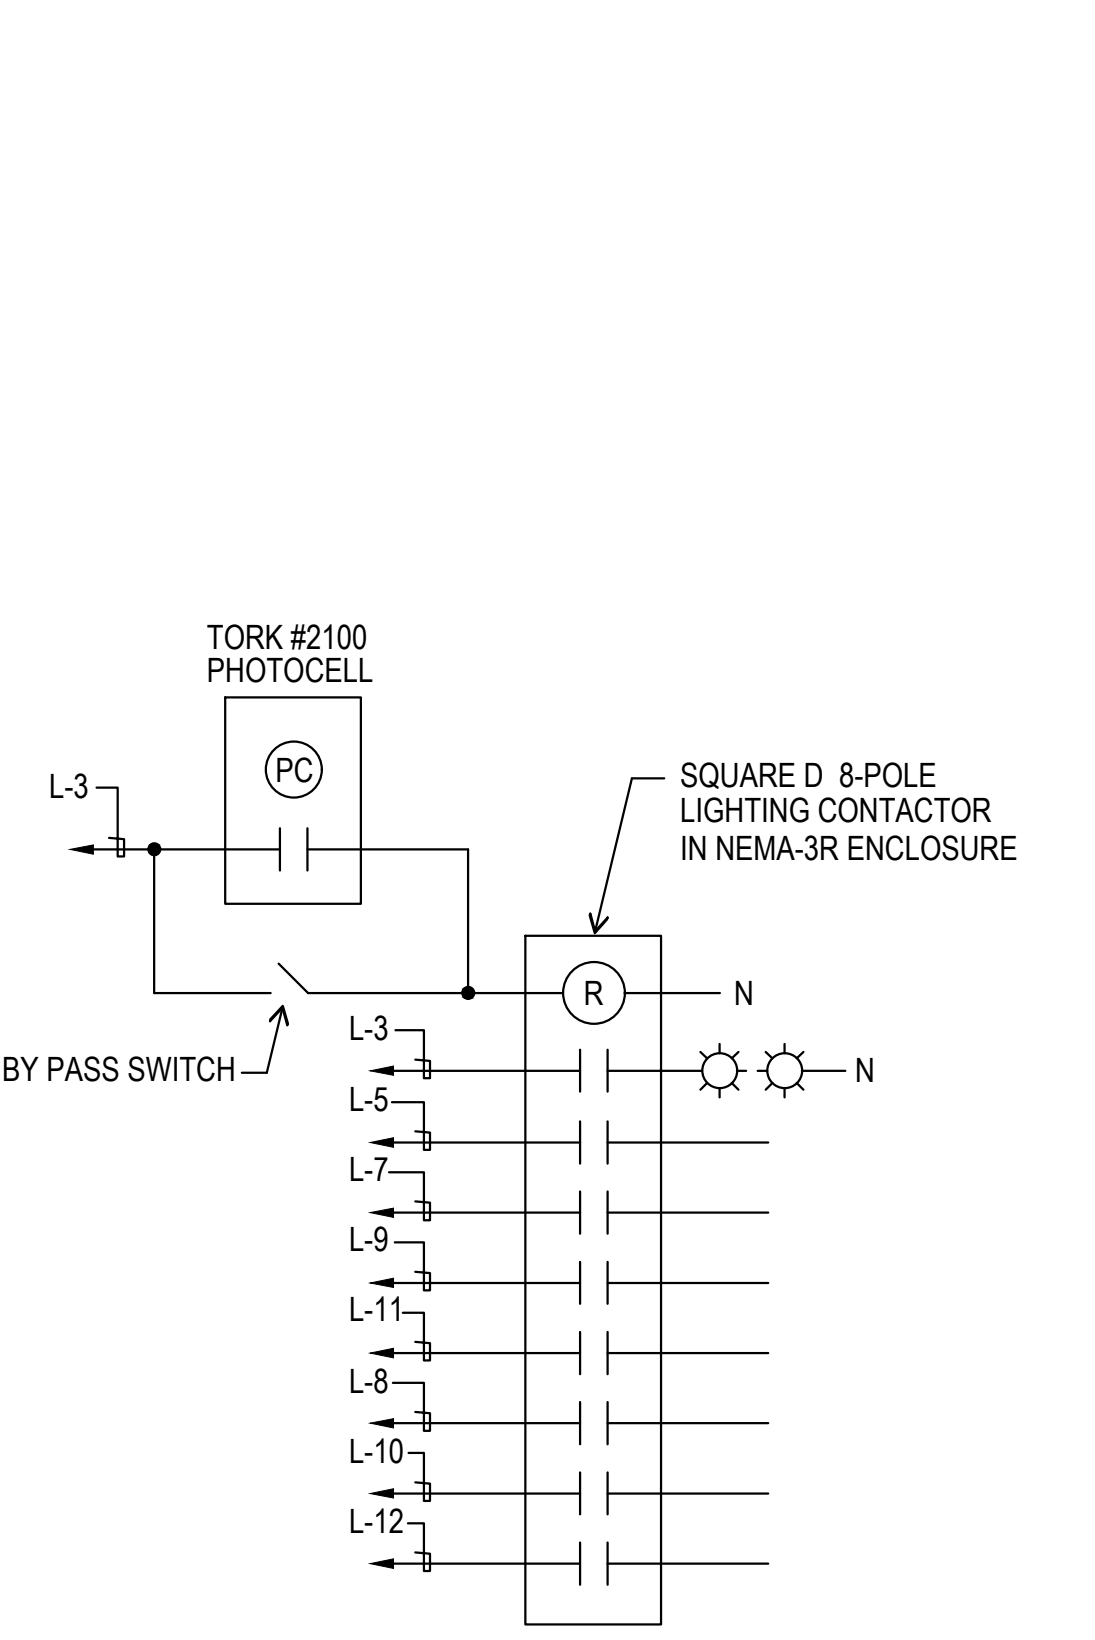
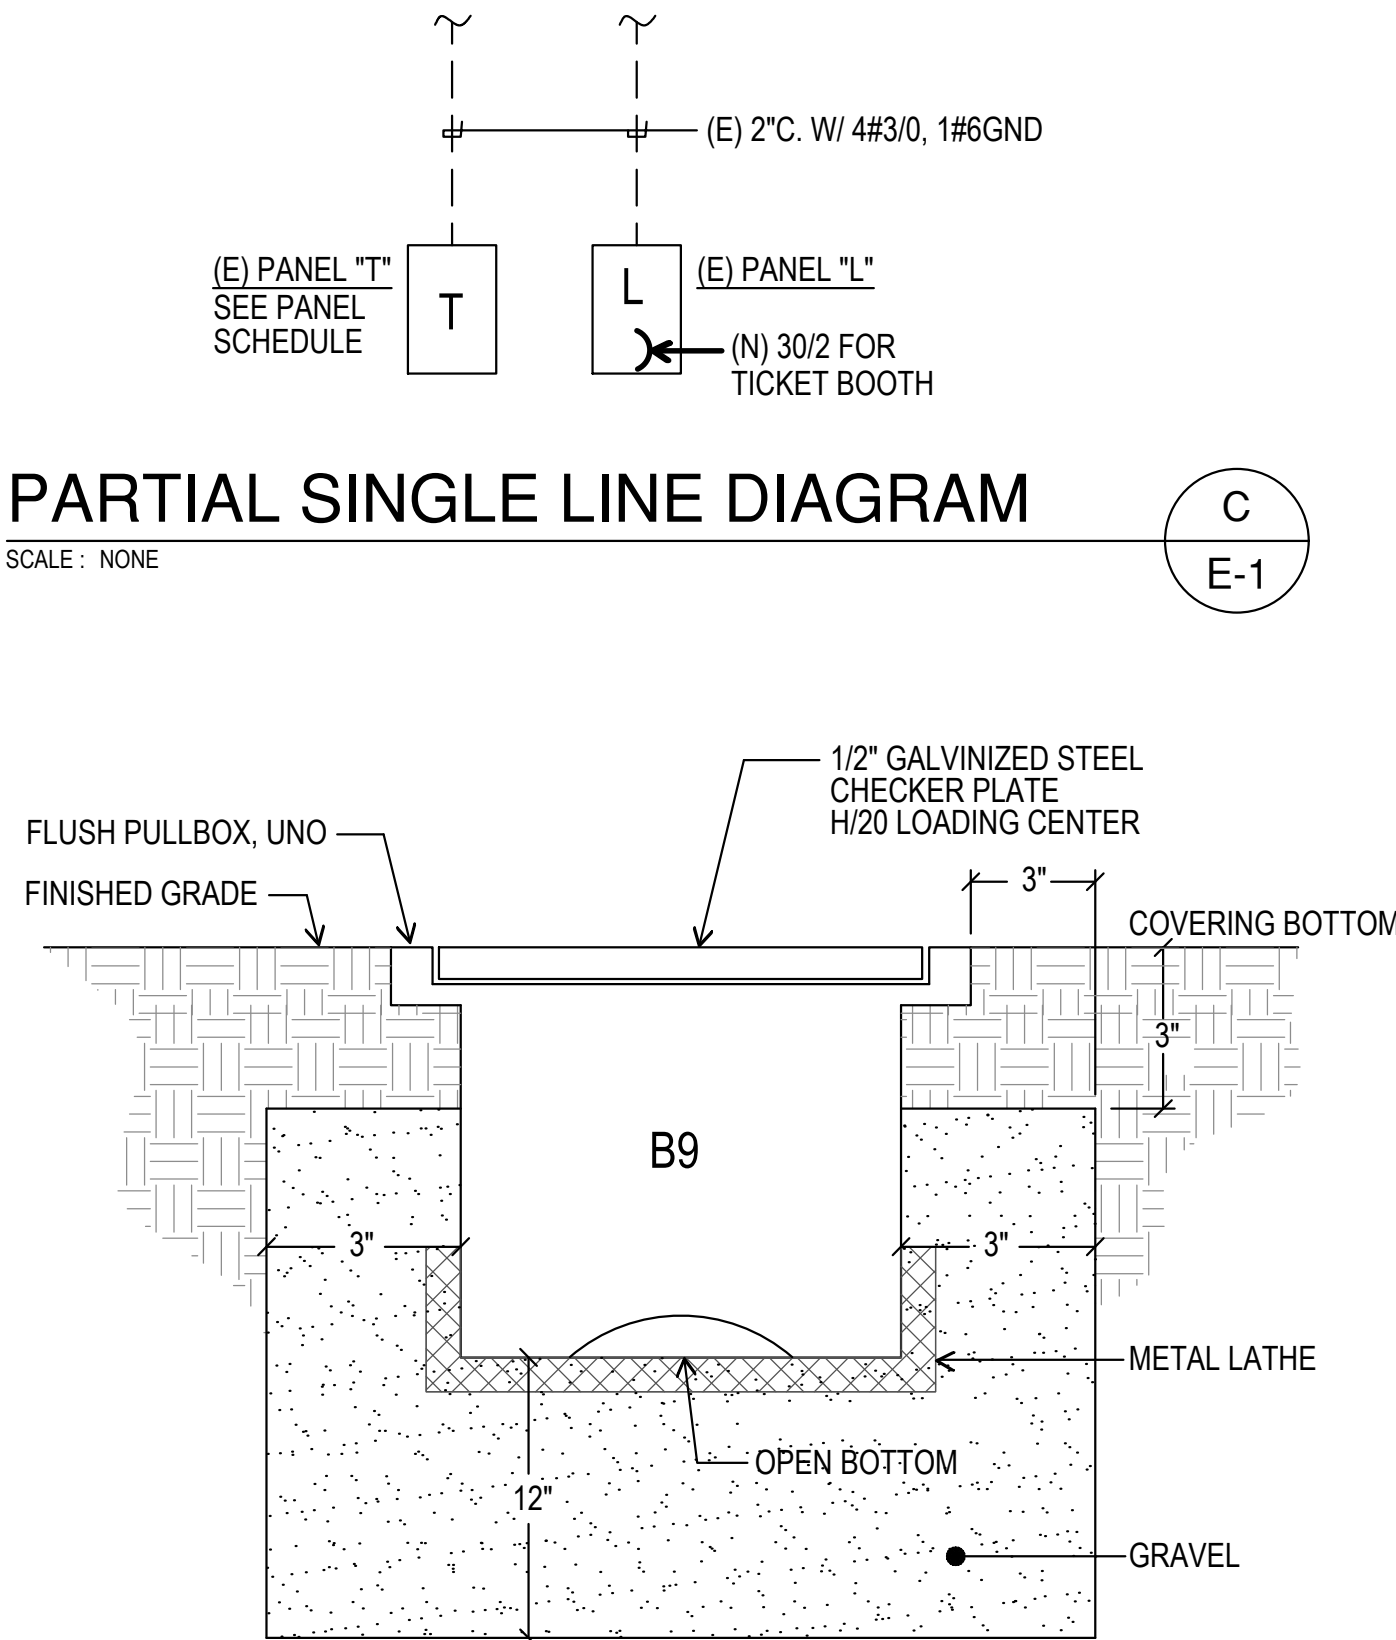


LED FIXTURE SCHEDULE							
		LED MODULE					
TYPE	MANUFACTURER AND CATALOG NUMBER	TYPE	COLOR TEMP	WATTS	DRIVER	OPTIC/LENS	REMARKS
S4 1030	US ARCHITECTURAL RZR-PLD-III-W-80LED-1050MA-40K-277-4-90- RAL8019-T-RPA		4000K	1030	0-10V	FLAT, CLEAR	FULL CUT-OFF RAZOR PKG LOT FIXTURES
	US POLE RTS35 7-3B-DM49AS-RAL8019-T					4 FIXTURES/POLE	35 FT POLE
S4F 987	LITHONIA LIGHTING (4) RSXF2 LED P6 40K WFL MVOLT IS DDBXD/BS28 T25 BS49 DDBXD-BULLHORN		4000K	987		FLAT, CLEAR	(4) FLOOD LIGHTS TO MATCH EXISTING
	LITHONIA RTS 38 7-3B T24(2 7/8") DDBXD						35 FT POLE

(E) PANEL SCHEDULE "T"															
SERVICE: 120/208V 3Ø 4W				MAIN BKR.: MLO				BUS: 225A				LOC.: SEE PLAN			
SQUARE D				NEMA 3R				QO LOAD CENTER				MTG.: SURFACE			
REMARKS	LOAD			R	L	M	P	T	C	C	T	P	R	M	REMARKS
	ΦA	ΦB	ΦC	E	T	I	S	O	L	R	I	L	E	I	
SPACE											1	2	20	1	SPARE
NEW PKG LOT LTS		3090			3	1	30	3	(N)		4	20	1		"
"			3090		3	1	30	5	(N)		6	20	1		"
"	3090				3	1	30	7	(N)		8	30	1	3	NEW PKG LOT LTS
"		3090			3	1	30	9	(N)		10	30	1	3	"
"			3090		3	1	30	11	(N)		12	30	1	3	"
SPARE								2	70	13	14				SPACE
"								X	X	15	16				SPACE
TICKET BOOTH								1	20	17	18	20	1		WEST LIGHTS
"								1	20	19	20	20	1		
EAST LIGHTS								1	20	21	22	20	1		
"								1	20	23	24	20	1		CENTER LIGHTS
SPARE								2	50	25	26	20	1		
"								X	X	27	28	20	1		WEST LIGHTS
TEMP LIGHTS								1	20	29	30	20	1		TEMP LIGHTS
TOTAL WATTS=				ΦA= 6180				ΦB= 9270				ΦC= 9270			
AMPS= 77 A ADDED LOAD								MINIMUM BKR				A.I.C. RATING= 10,000 AMPS SYM			

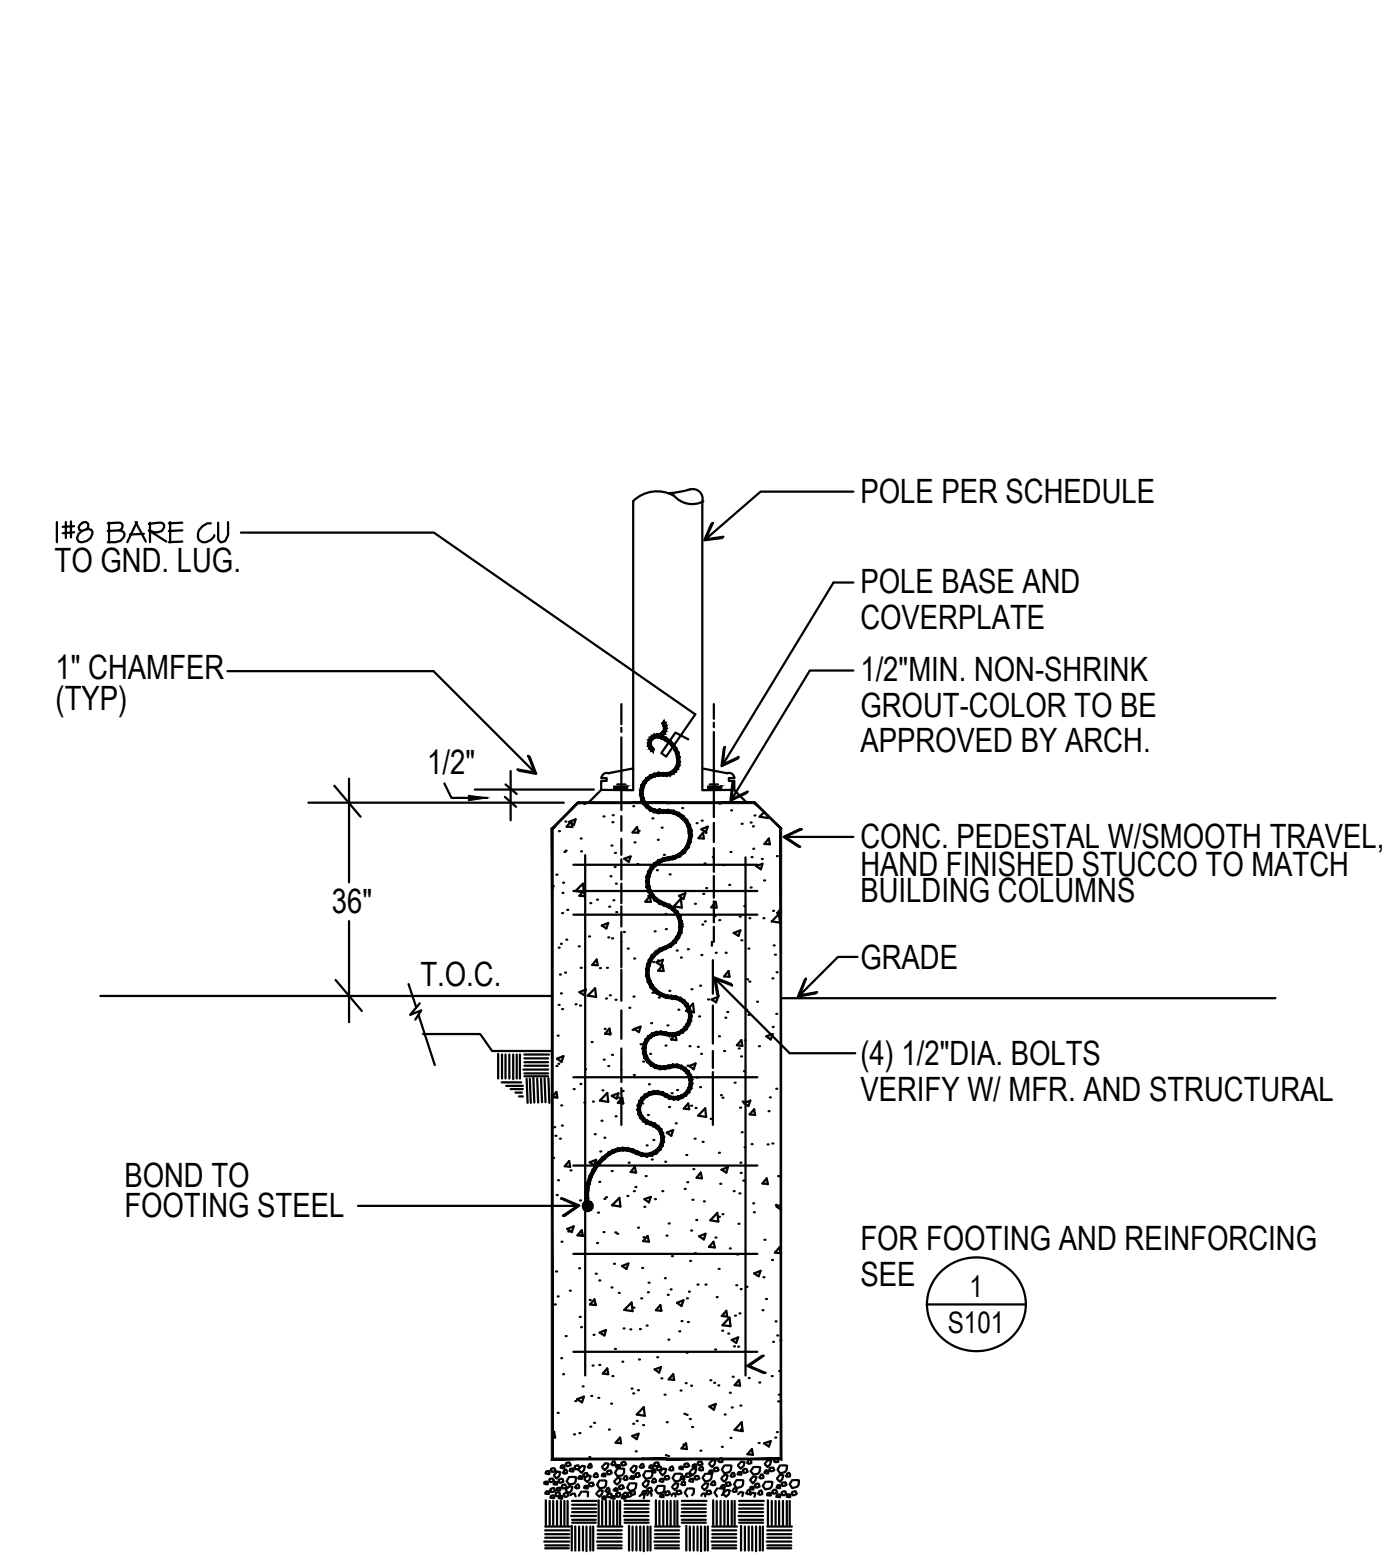

SYMBOLS	
	CONDUIT EXISTING
	CONDUIT CONCEALED IN WALL OR CEILING
	CONDUIT CONCEALED UNDER FLOOR OR BELOW GRADE
	CONDUIT STUBBED OUT AND CAPPED
	CONDUIT TURNED UP
	CONDUIT TURNED DOWN
	HATCH MARKS INDICATE NO. OF #12 WIRES IN CODE SIZED CONDUIT (3) MAX. IN 1/2" C., (5) MAX. IN 3/4" C., (8) MAX. IN 1" C., NO MARKS = 2#12
	HOME RUN: LETTER INDICATES PANEL, NUMBER(S) INDICATES CIRCUIT(S).
	SAWCUT
	GROUND CONNECTION
	DISTRIBUTION SWITCHBOARD OR PANEL
	PANEL, BRANCH CIRCUIT TYPE, SURFACE AND FLUSH SIGNAL TERMINAL CABINET, SURFACE & FLUSH
	LINEAR SURFACE FIXTURE
	OUTLET DATA: BAR INDICATES WALL MOUNT, LETTER INDICATES SWITCH CONTROL, NO. INDICATES CIRCUIT.
	SURFACE FIXTURE ON FLUSH OUTLET.
	RECESSED FIXTURE WITH JUNCTION BOX FOR THRU WIRING
	EXIT LIGHT WITH ARROWS AS SHOWN ON PLANS, WALL AND CEILING MOUNT.
	LOW LEVEL EXIT SIGN, +6" AFF, +4" FROM DOOR JAMB
	LIGHT FIXTURE DESIGNATION, LETTER INDICATES TYPE, NO. INDICATES WATTAGE. SEE FIXTURE SCHEDULE.
	MECHANICAL EQUIPMENT DESIGNATION. SEE MECHANICAL DRAWINGS.
	SPECIAL RECEPTACLE - SEE PLAN
	METER
	FLUSH FLOOR RECEPTACLE
	RECEPTACLE, DUPLEX, 15A, 125V, NEMA 5-15R +18" U.N.O.
	DUPLEX RECEPTACLE MTD. ABOVE BACKSPASH
	DUPLEX RECEPTACLE W/LOWER HALF SWITCHED
	GROUND FAULT CIRCUIT INTERRUPTING RECEPTACLE
	DOUBLE DUPLEX RECEPTACLE
	CEILING RECEPTACLE
	RECEPTACLE, DUPLEX, 20A, 125V, NEMA 5-20R +18" U.N.O.
	JUNCTION BOX 4" SQUARE, 1-1/2" DEEP U.N.O.
	THERMOSTAT F.B.O. +48"
	MOTOR, NO. INDICATES HORSEPOWER
	CLOCK OUTLET +7-8" U.N.O.
	DISCONNECT SWITCH, NON-FUSED
	DISCONNECT SWITCH FUSED HORSEPOWER RATED OR SIZED AS NOTED
	COMBINATION MAGNETIC STARTER WITH DISCONNECT SWITCH AND FUSES
	MAGNETIC MOTOR STARTER W/OVERLOADS IN EACH PHASE
	DIMMER W/INTEGRAL "ON-OFF" SW.
	PUSHBUTTON
	PHOTOCELL
	SMOKE DETECTOR
	TELEPHONE/COMPUTER/DATA OUTLET, TWO GANG BOX W/1 GANG COVERPLATE & GROMMETED OPENING +18" U.N.O.
	CABLE TV OUTLET +18" U.N.O.
	MOTION SENSOR
	EXISTING SWITCH
	SINGLE POLE SWITCH
	DOUBLE POLE SWITCH
	THREE WAY SWITCH
	SWITCH W/PILOT LT.
	MANUAL MOTOR STARTER
	FIRE ALARM CONTROL PANEL
	GROUND FAULT CIRCUIT INTERRUPTING
	LABOR SAVING TANDEM
	MAIN LUGS ONLY
	CONDUIT ONLY
	WEATHERPROOF
	FURNISHED BY OTHERS, INSTALL & CONNECT
	UNLESS NOTED OTHERWISE
	NATIONAL ELECTRICAL CODE
	NOT IN CONTRACT
	EXISTING
	NEW
	REMOVE
	RELOCATE
	SURFACE MOUNT
	UNDERGROUND
	COLD WATER PIPE
	ABOVE FINISHED FLOOR
	HEATING AND AIR CONDITIONING RATED CIRCUIT BREAKER
	NIGHT LIGHT
NOTE: NOT ALL SYMBOLS SHOWN ARE USED ON THIS PROJECT.	

JMPE
ELECTRICAL ENGINEERING
LIGHTING DESIGN
CA REGISTRATION NO E13083

627 OLIVE STREET
SANTA BARBARA CA 93101
(805) 569-9216
FAX (805) 569-2405
email : mduwey@jmpe.net
www.jmpe.net


24255

NEW ELECTRICAL SERVICE FOR:
ANTELOPE VALLEY FAIRGROUNDS
PARKING LOT LIGHTING

GENERAL NOTES, SYMBOLS,
SCHEDULES & DETAILS

PROJECT DATE	2025-08-19
SCALE	AS NOTED


E-1

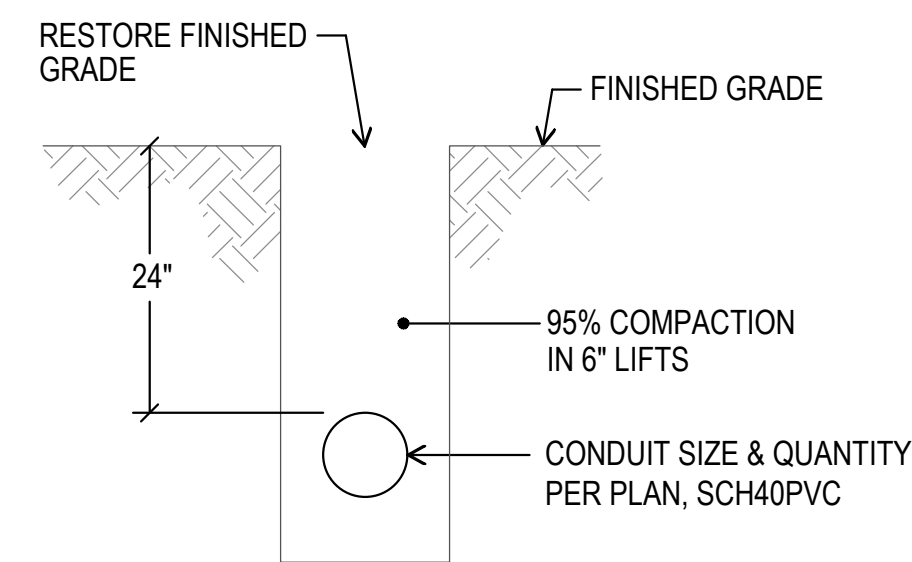

TRENCH DETAIL


SCALE : NONE

A
E-2

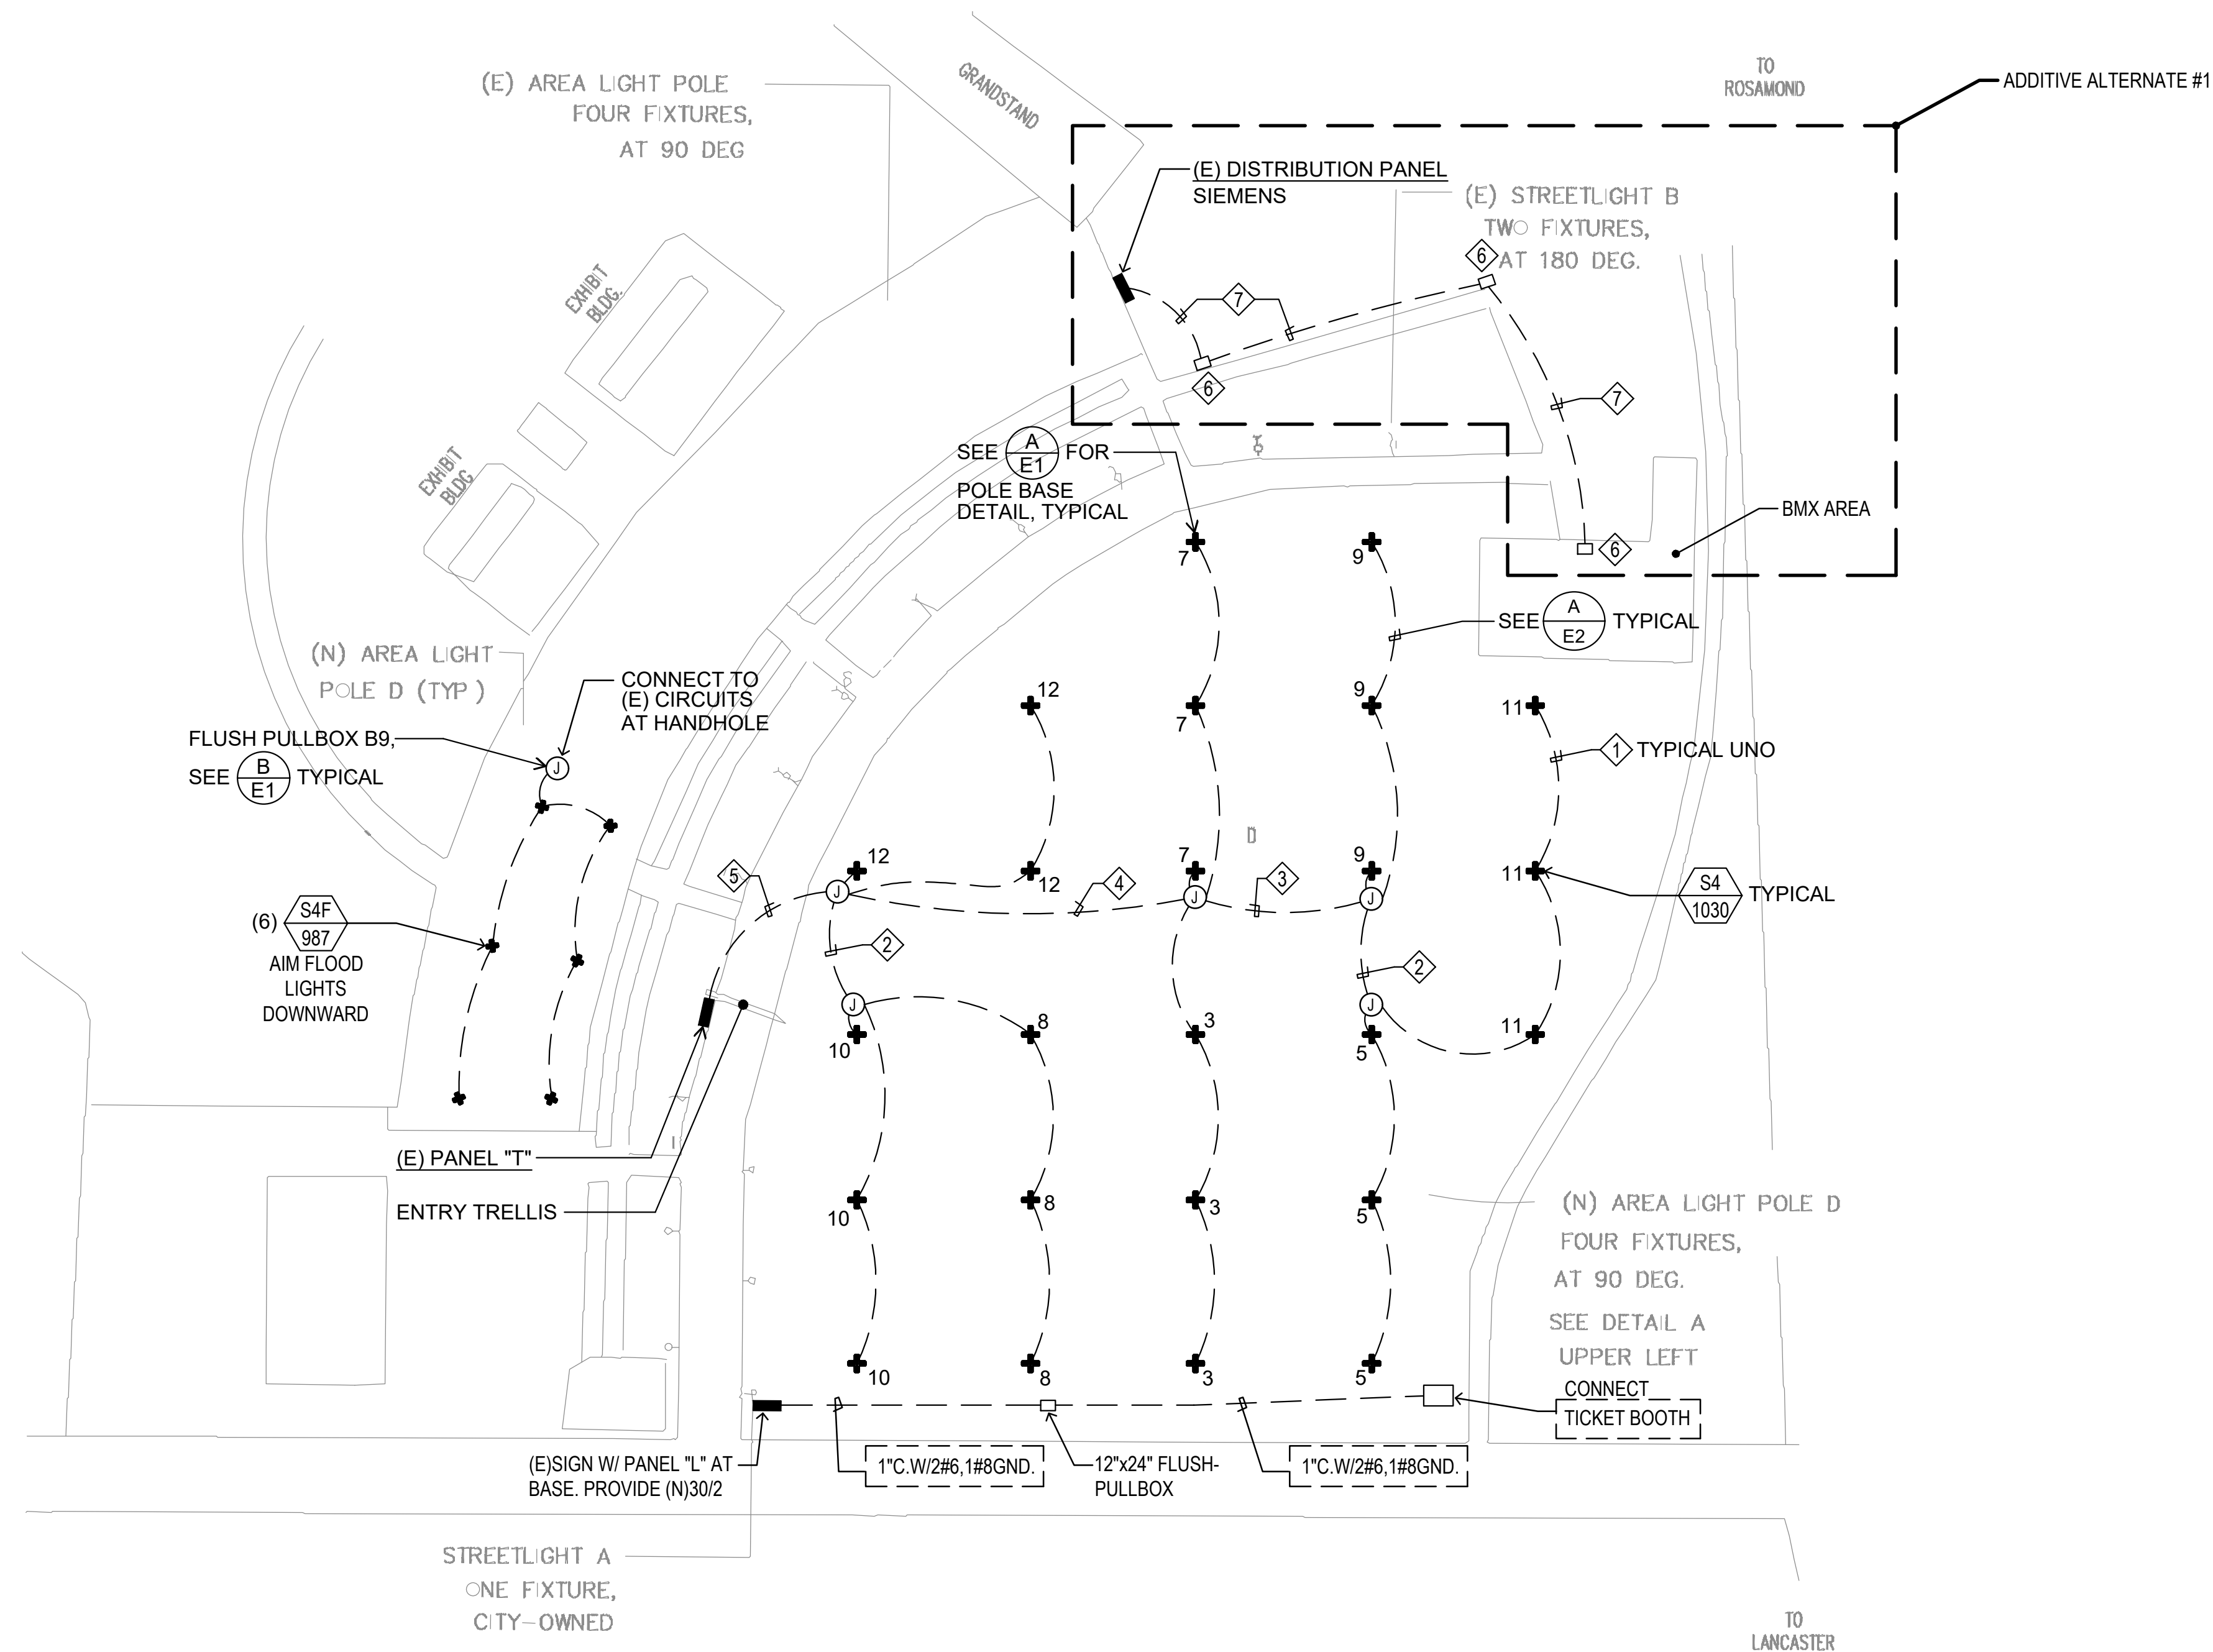

LIGHTING NOTES

- ① 1"C. W/ 2#8, 1#10GND
- ② 1-1/2"C. W/ 4#8, 1#10GND
- ③ 1-1/2"C. W/ 6#8, 1#10GND
- ④ 1-1/2"C. W/ 10#8, 1#10GND
- ⑤ 2"C. W/ 16#8, 1#10GND
- ⑥ 12x24 FLUSH PULLBOX
- ⑦ 3"C.O.

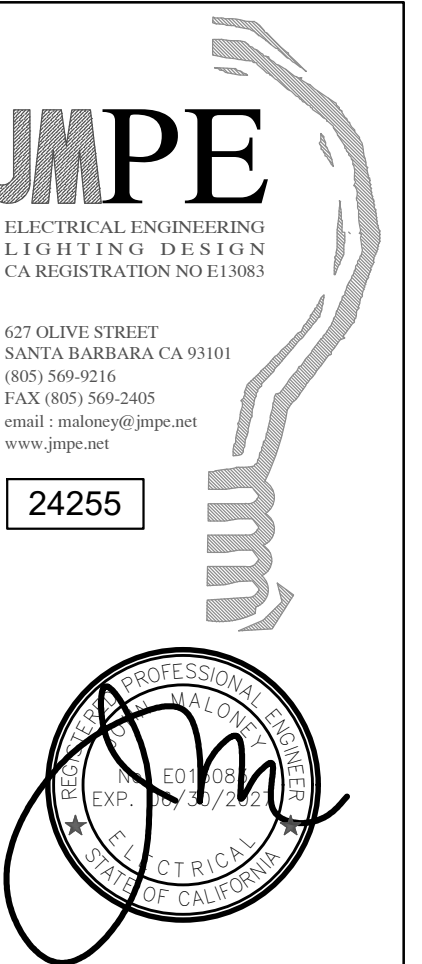

NEW ELECTRICAL SERVICE FOR:
ANTELOPE VALLEY FAIRGROUNDS
PARKING LOT LIGHTING

SITE LIGHTING PLAN

PROJECT DATE	2025-08-19
SCALE	AS NOTED

E-2


SITE LIGHTING PLAN

SCALE : 1" = 150'-0"

Schedule										
Symbol	Label	QTY	Manufacturer	Catalog	Description	Number Lamps	Lamp Output	LLF	Input Power	Polar Plot
	S4	24	U.S. ARCHITECTURAL LIGHTING	RZR-PLD-III-W-80LED- 1050mA-40K-XXX 4-90 RAL-XXXX-T-RPA/ RTS 38-11 4-90 COLOR DRLL FOR RZR	CAST BLACK PAINTED FINNED METAL HOUSING.	80	367	0.92	1025.6	
	S4F	6	Lithonia Lighting	(4) RSXF2 LED P6 40K WFL MVOLT IS DXXXD/ BS28 T25 BS49 DXXXD- BULLHORN/RTS 38 7-38 T25(2 7/8") DXXXD- FINSH T8D	RSXF Flood Fixture Size 2 P6 Lumen Package 4000K CCT Type WFL Distribution with UV Shield	1	25054	0.92	986.5388	

STATISTICS

Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min	UG
SITE AREA 2	+	3.0 fc	14.5 fc	0.3 fc	48.3:1	10.0:1	7.4
SITE AREA 1	+	2.1 fc	15.6 fc	0.0 fc	N/A	N/A	-1.0

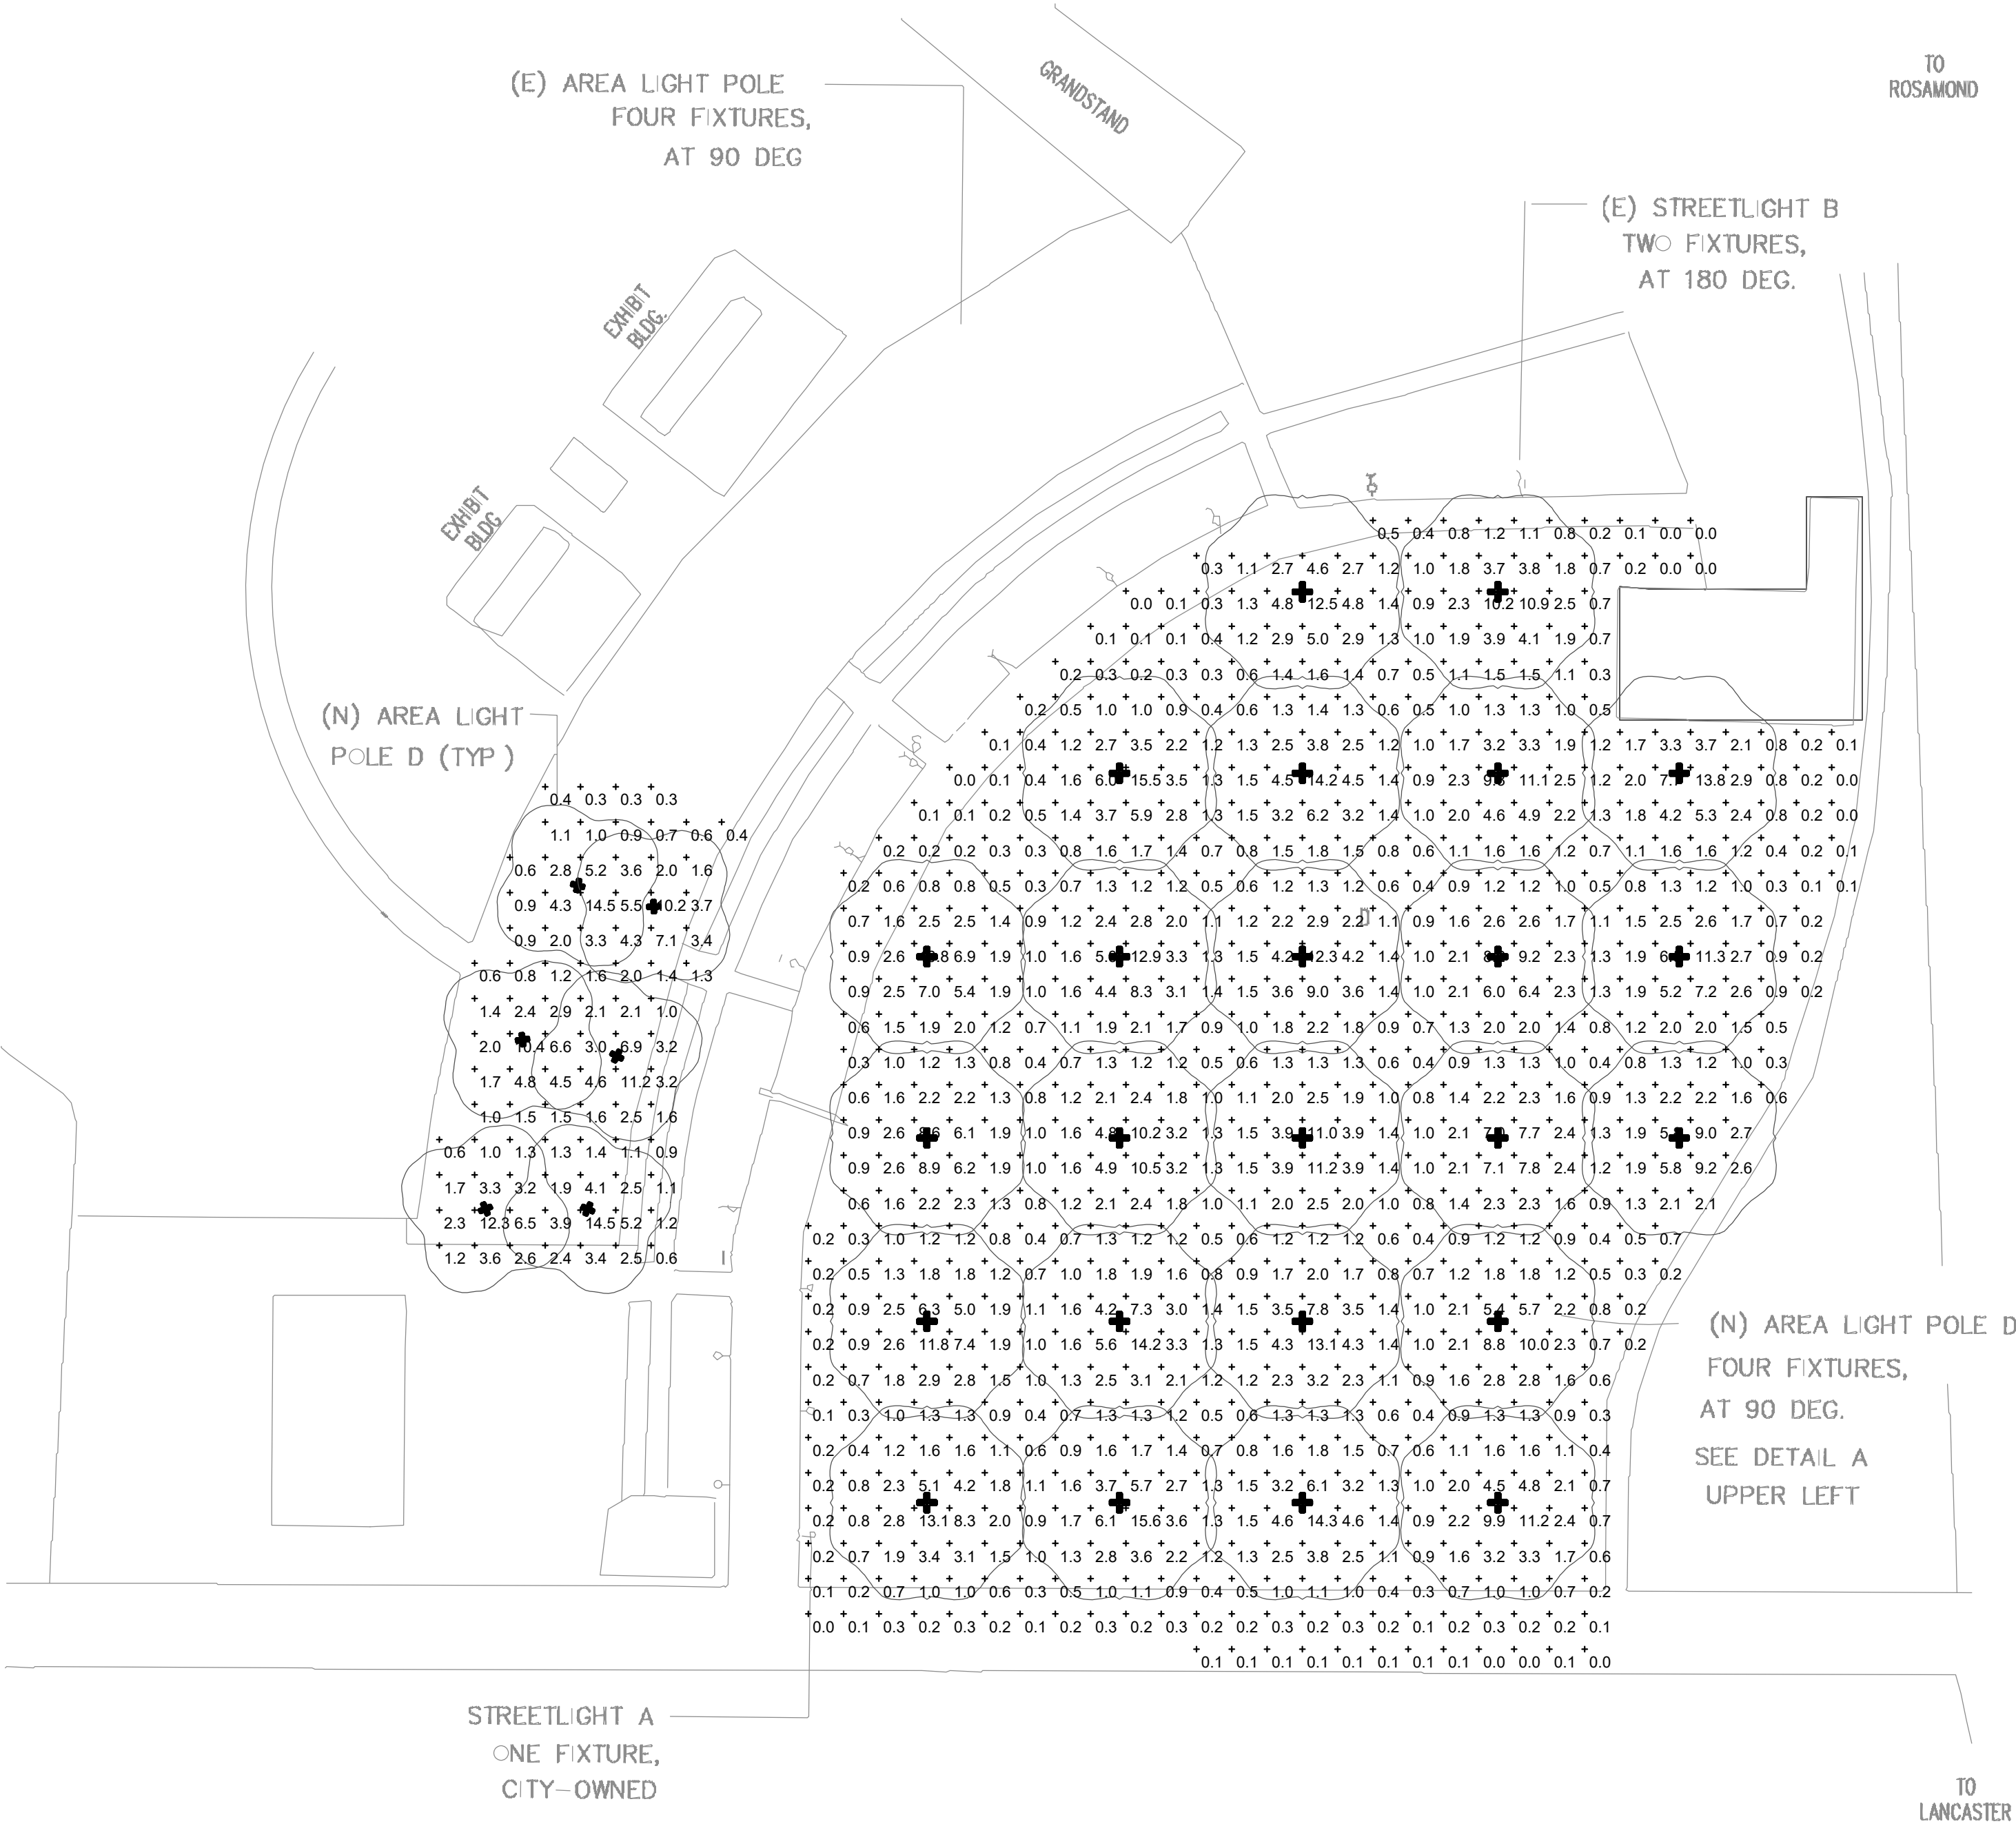

SITE LIGHTING PHOTOMETRIC PLAN

SCALE: 1" = 150'-0"



ELECTRICAL ENGINEERING
LIGHTING DESIGN
CA REGISTRATION NO E13083

627 OLIVE STREET
SANTA BARBARA CA 93101
(805) 569-9216
FAX (805) 569-2405
email : makovey@jmpe.net
www.jmpe.net

24255



NEW ELECTRICAL SERVICE FOR:
ANTELOPE VALLEY FAIRGROUNDS
PARKING LOT LIGHTING

SITE LIGHTING
PHOTOMETRIC PLAN

PROJECT DATE	2025-08-19
SCALE	AS NOTED

E-3