




(a) Detection trade-off

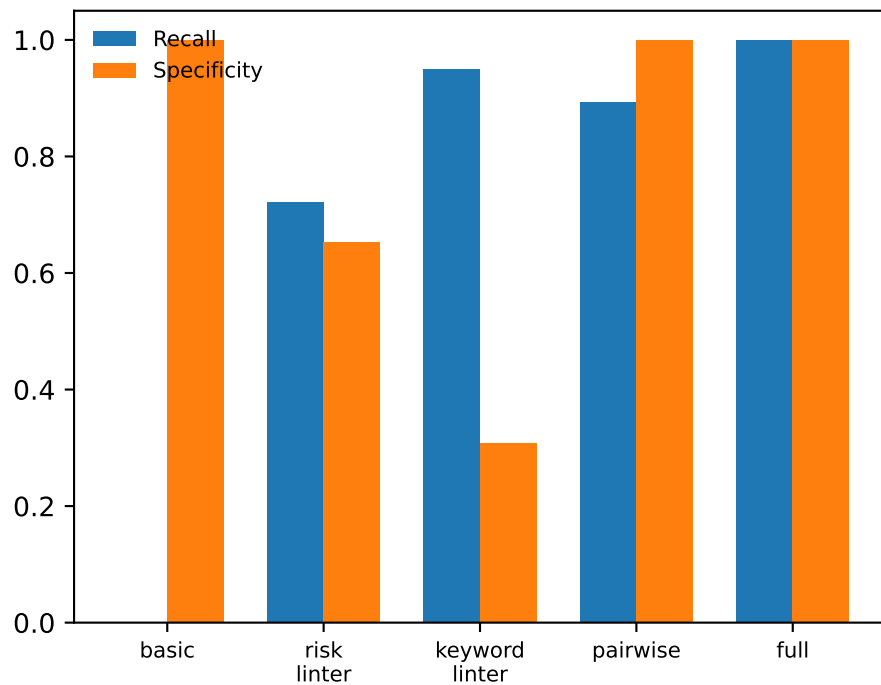

(b) Benign false alarms

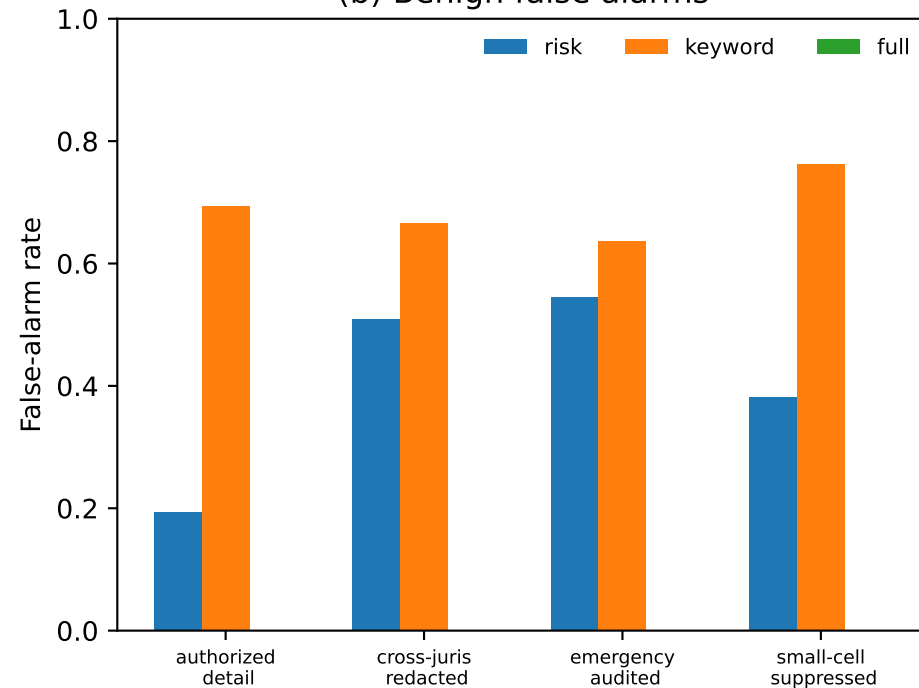

(c) Recall by fault family

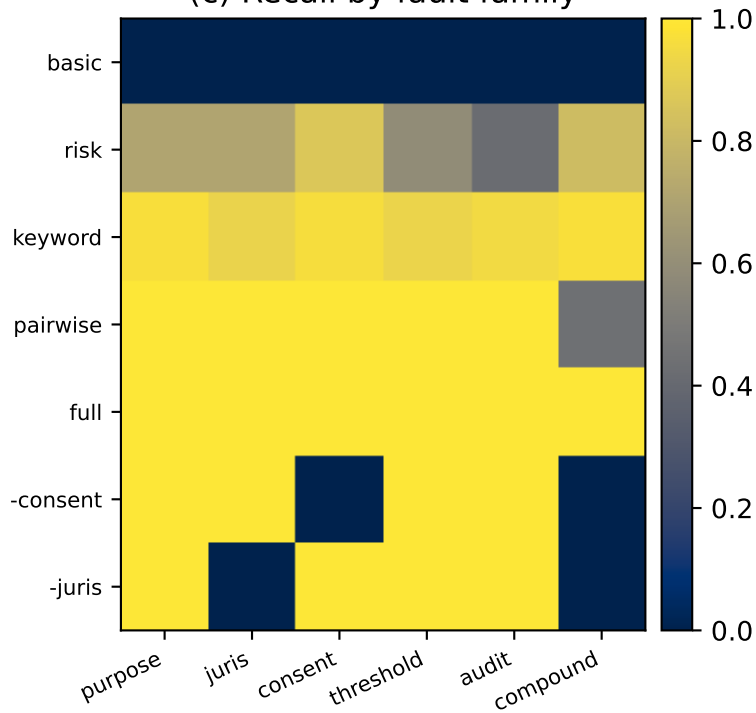

(d) RWR retained after ablation

