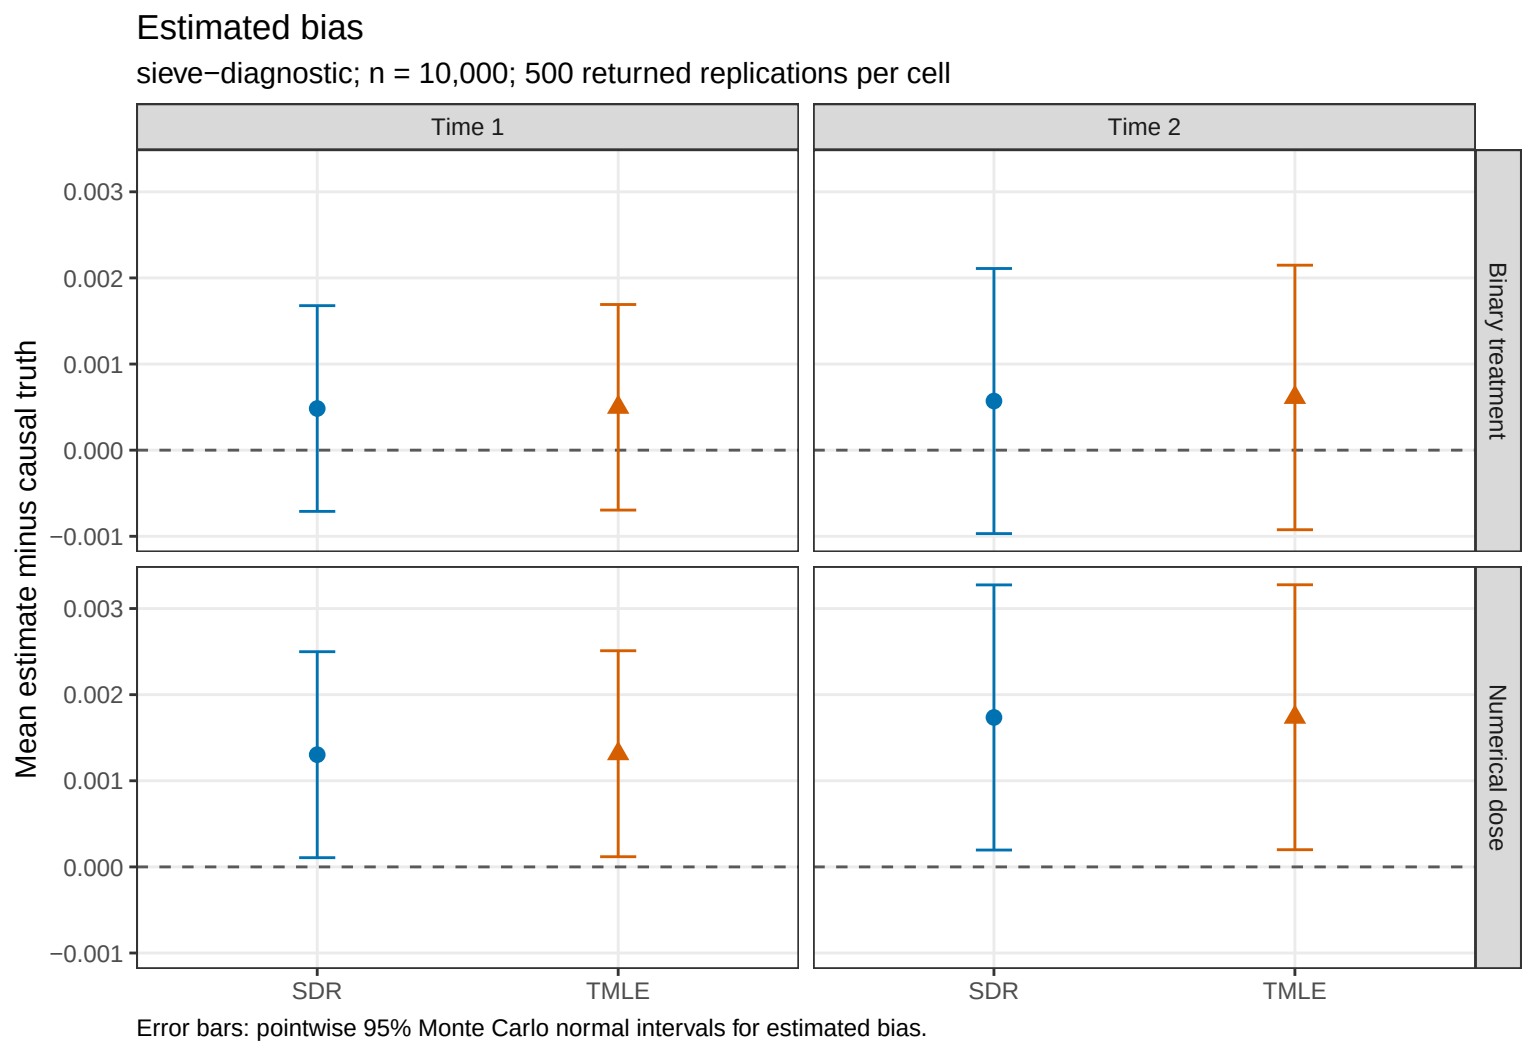
Estimated bias
sieve−diagnostic; n = 10,000; 500 returned replications per cell
Time 1
Time 2
Binary treatment
Numerical dose
Mean estimate minus causal truth
0.003
0.002
0.001
0.000
−0.001
SDR
TMLE
Error bars: pointwise 95% Monte Carlo normal intervals for estimated bias.