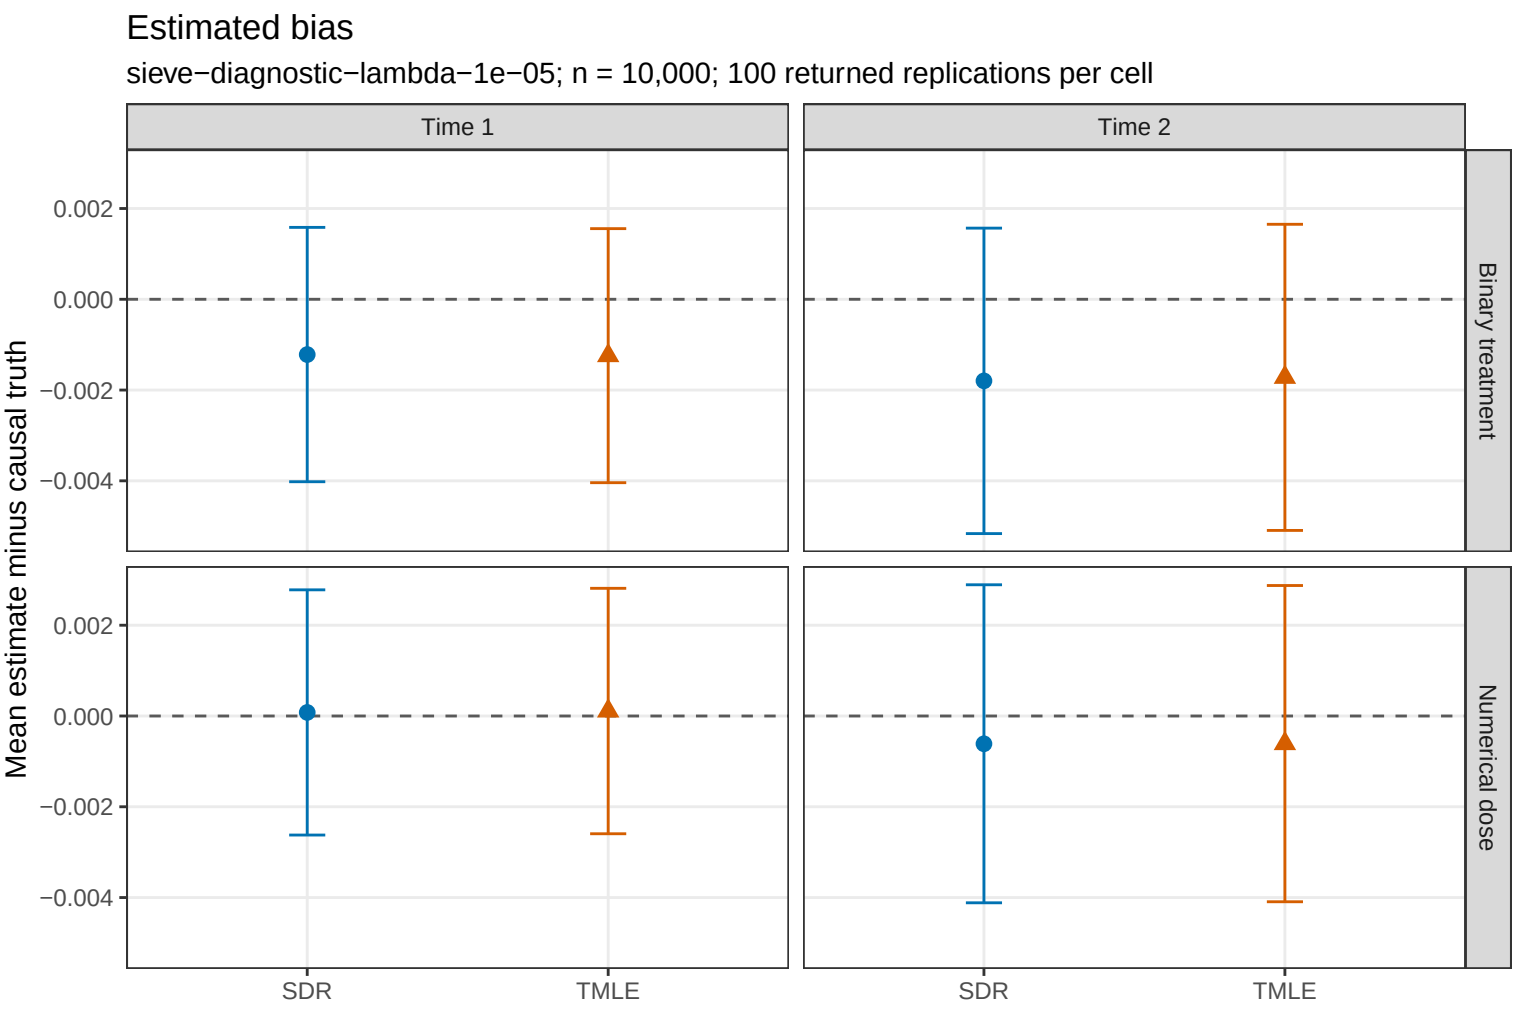
Estimated bias
sieve−diagnostic−lambda−1e−05; n = 10,000; 100 returned replications per cell
Time 1
Time 2
Binary treatment
Numerical dose
Mean estimate minus causal truth
0.002
0.000
−0.002
−0.004
SDR
TMLE
Error bars: pointwise 95% Monte Carlo normal intervals for estimated bias.