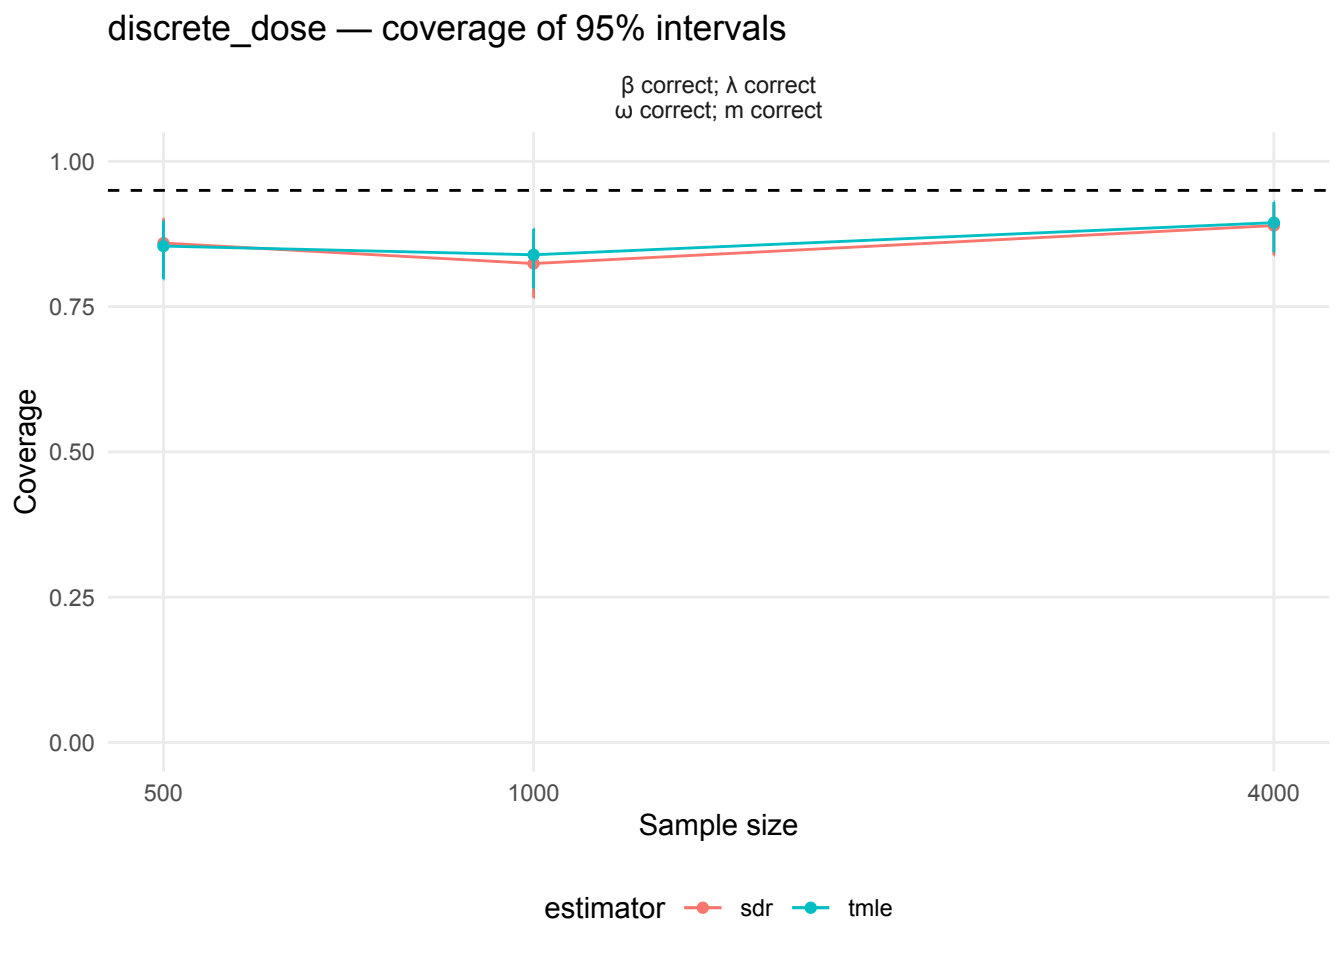
discrete_dose — coverage of 95% intervals
β correct; λ correct
ω correct; m correct
1.00
0.75
0.50
0.25
0.00
Coverage
500
1000
4000
Sample size
estimator
sdr
tmle