




20230608-112612_7_Reference-Hotel - market_active_power_in_kilowatts

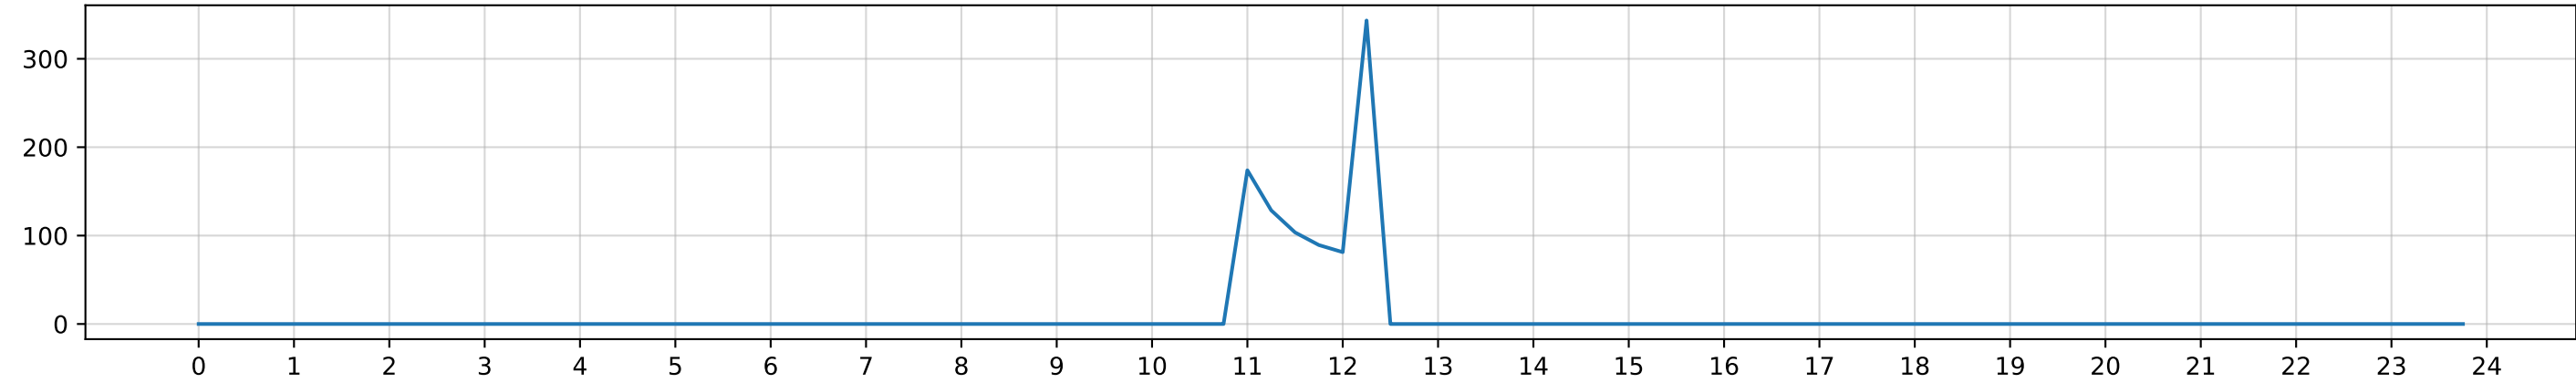


20230608-112612_7_Reference-Hotel - market_reactive_power_in_kilovolt_ampere_reactive

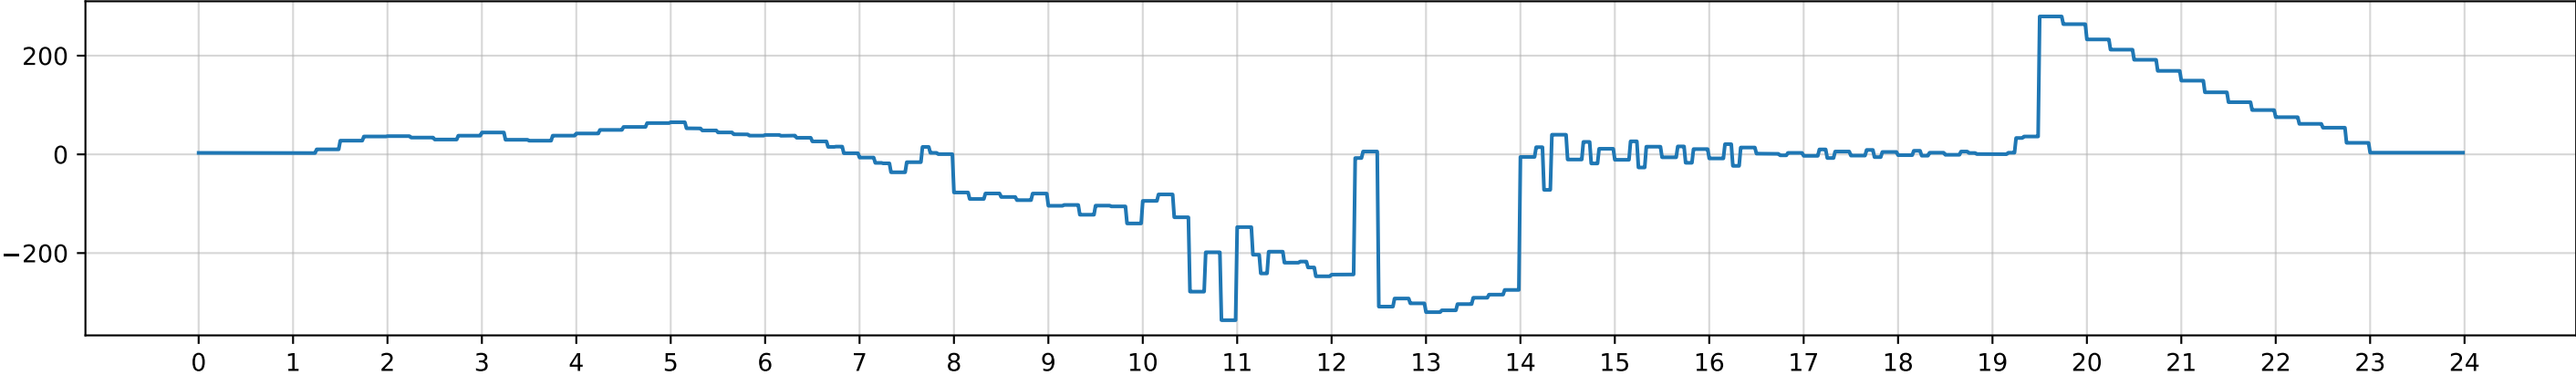

20230608-112612_7_Reference-Hotel - active_power_demand_in_kilowatts

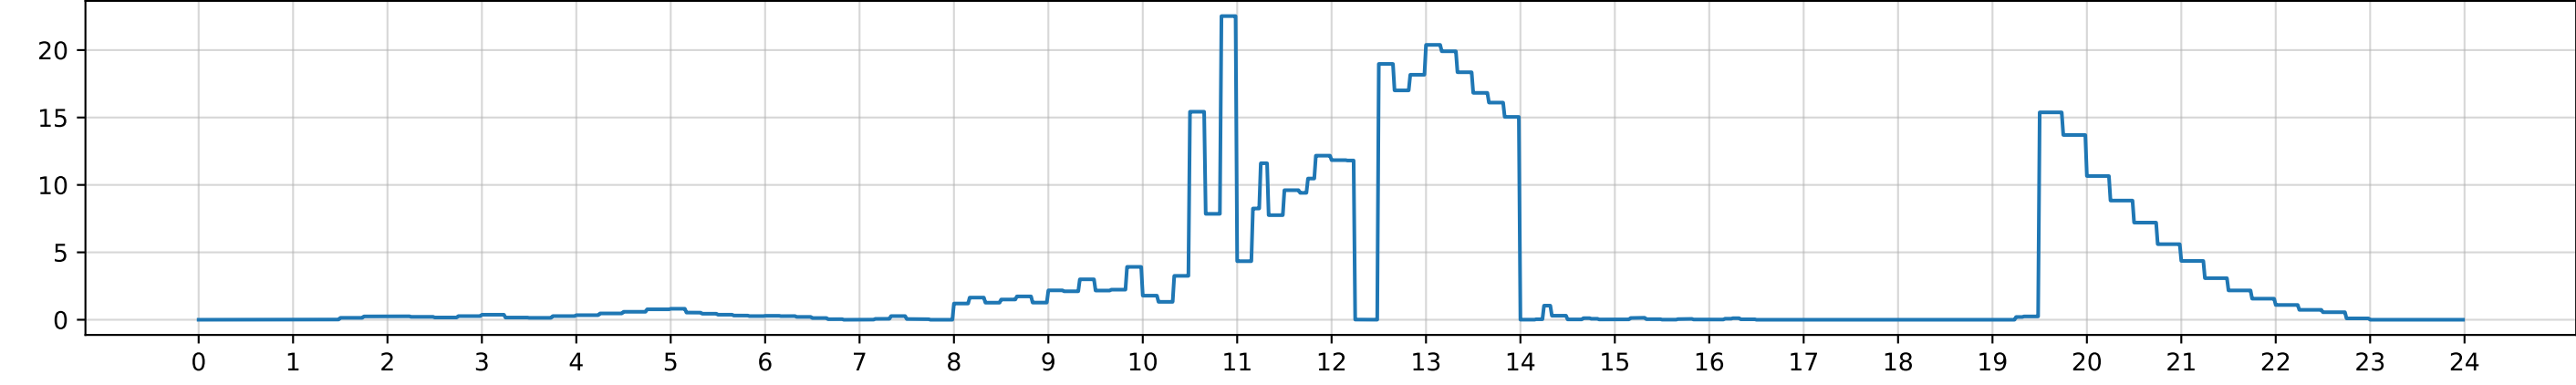

20230608-112612_7_Reference-Hotel - active_power_demand_base_in_kilowatts

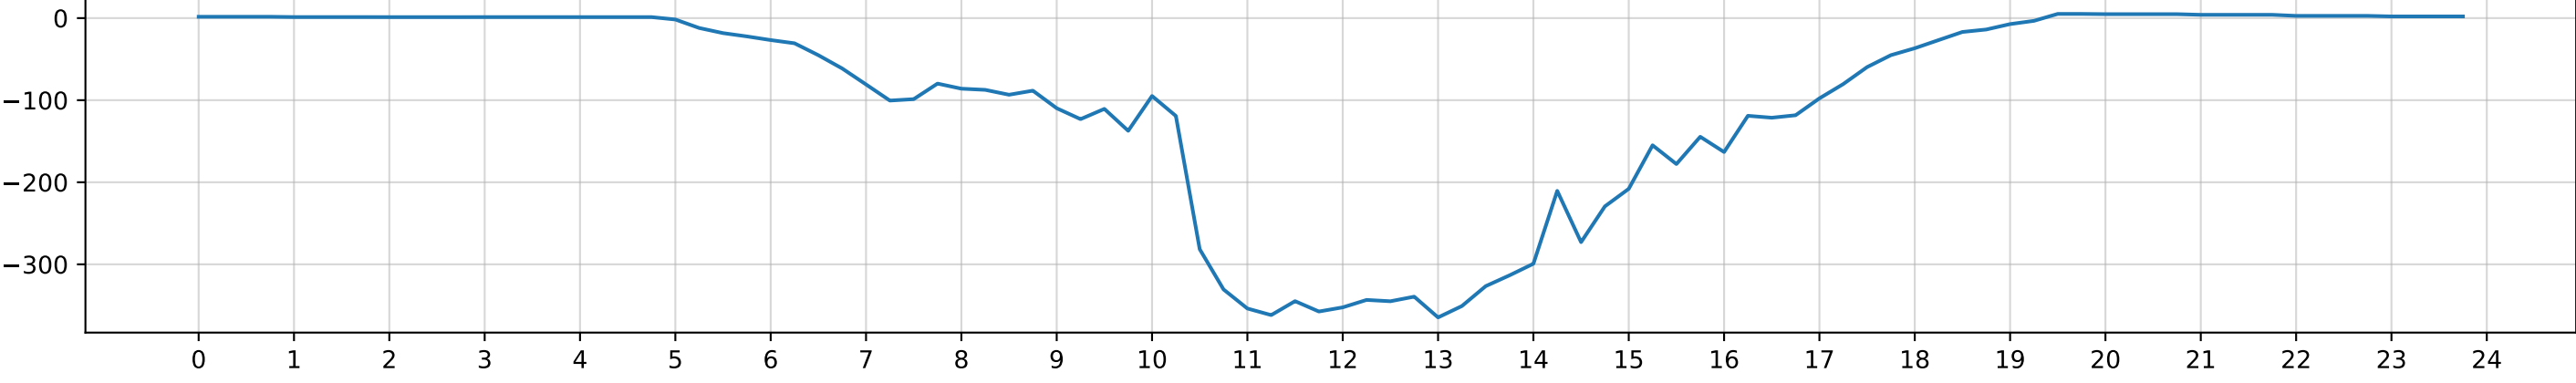


20230608-112612_7_Reference-Hotel - imported_active_power_in_kilowatts




20230608-112612_7_Reference-Hotel - exported_active_power_in_kilowatts




20230608-112612_7_Reference-Hotel - building_power_consumption_in_kilowatts

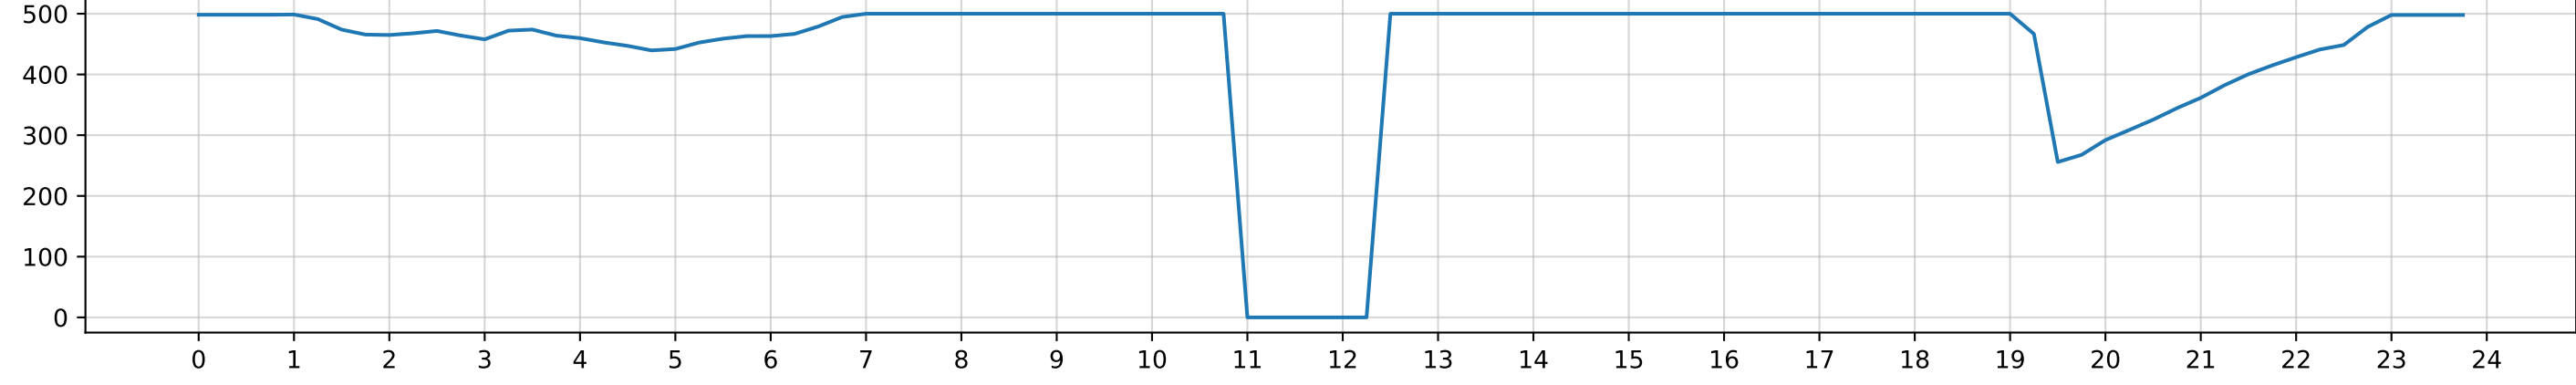


20230608-112612_7_Reference-Hotel - ambient_temperature_in_degree_celsius

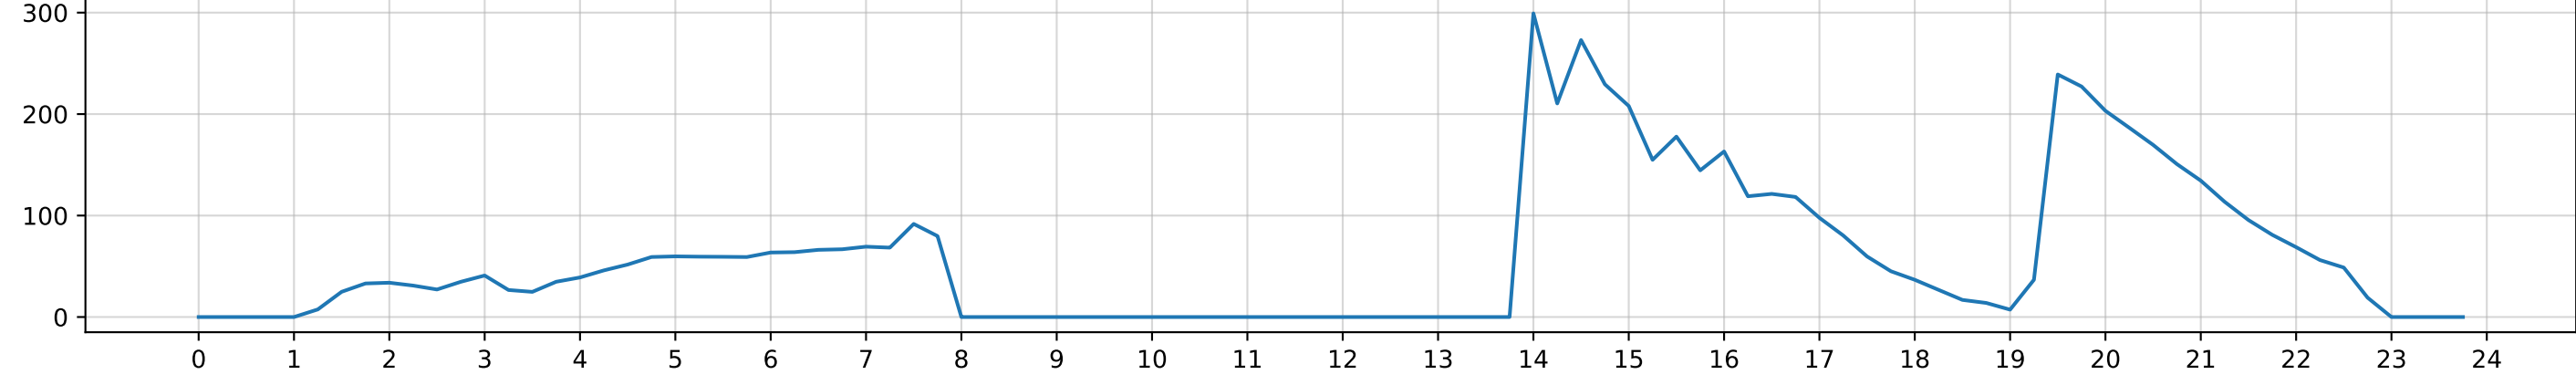


20230608-112612_7_Reference-Hotel - building_internal_temperature_in_celsius_degrees

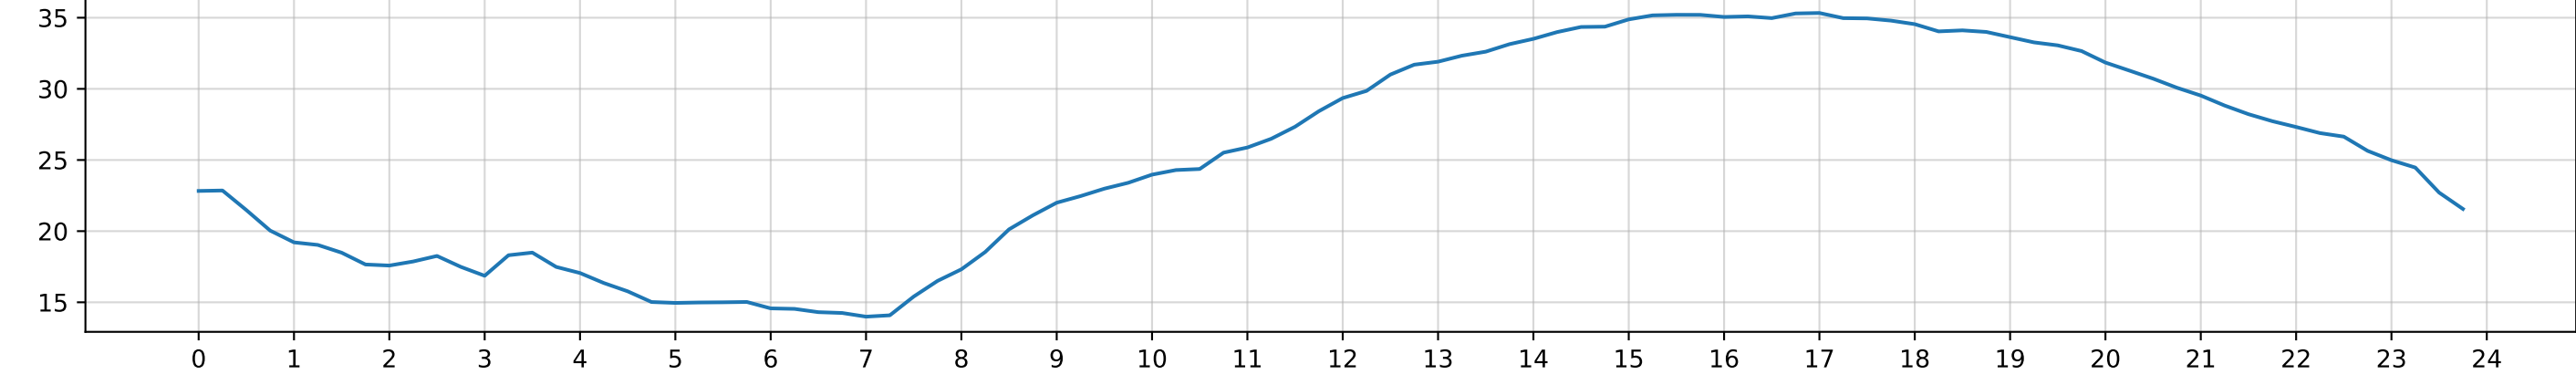

20230608-112612_7_Reference-Hotel - hvac_active_power_in_kilowatts

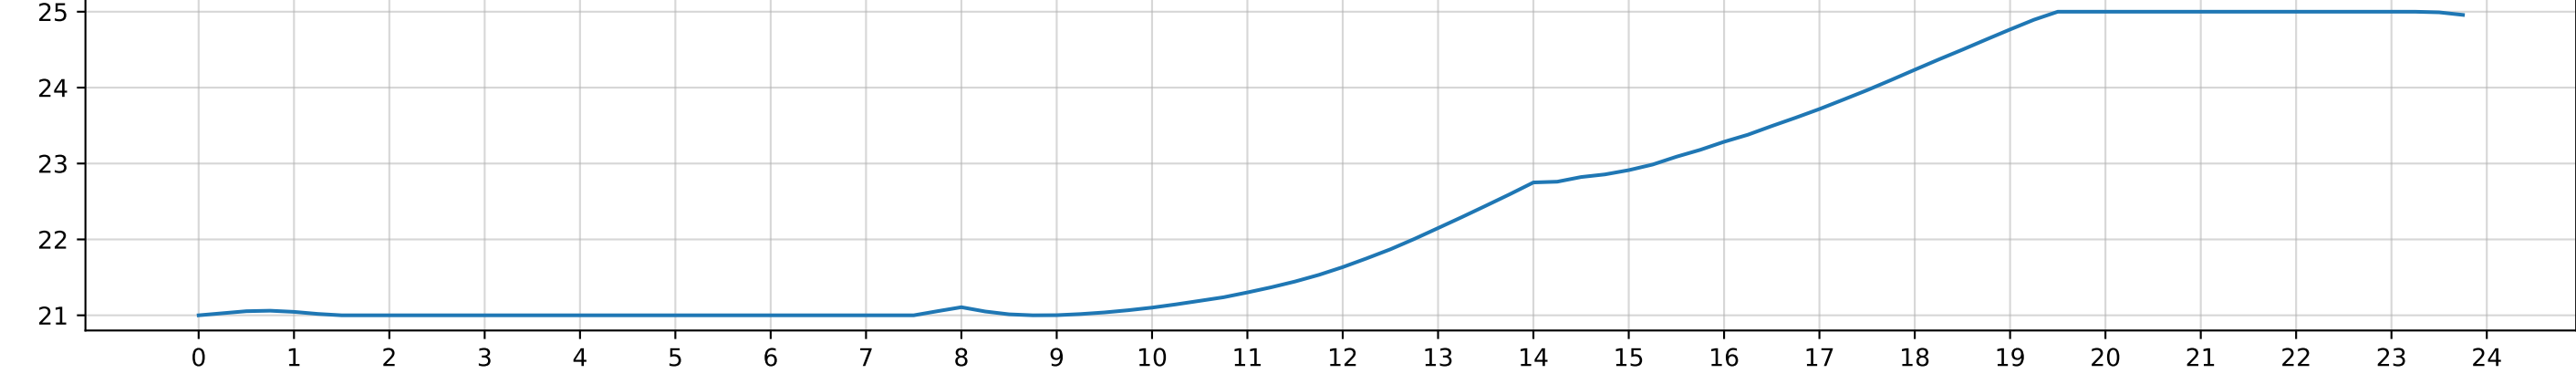

20230608-112612_7_Reference-Hotel - storage_asset_accumulated_power_in_kilowatts

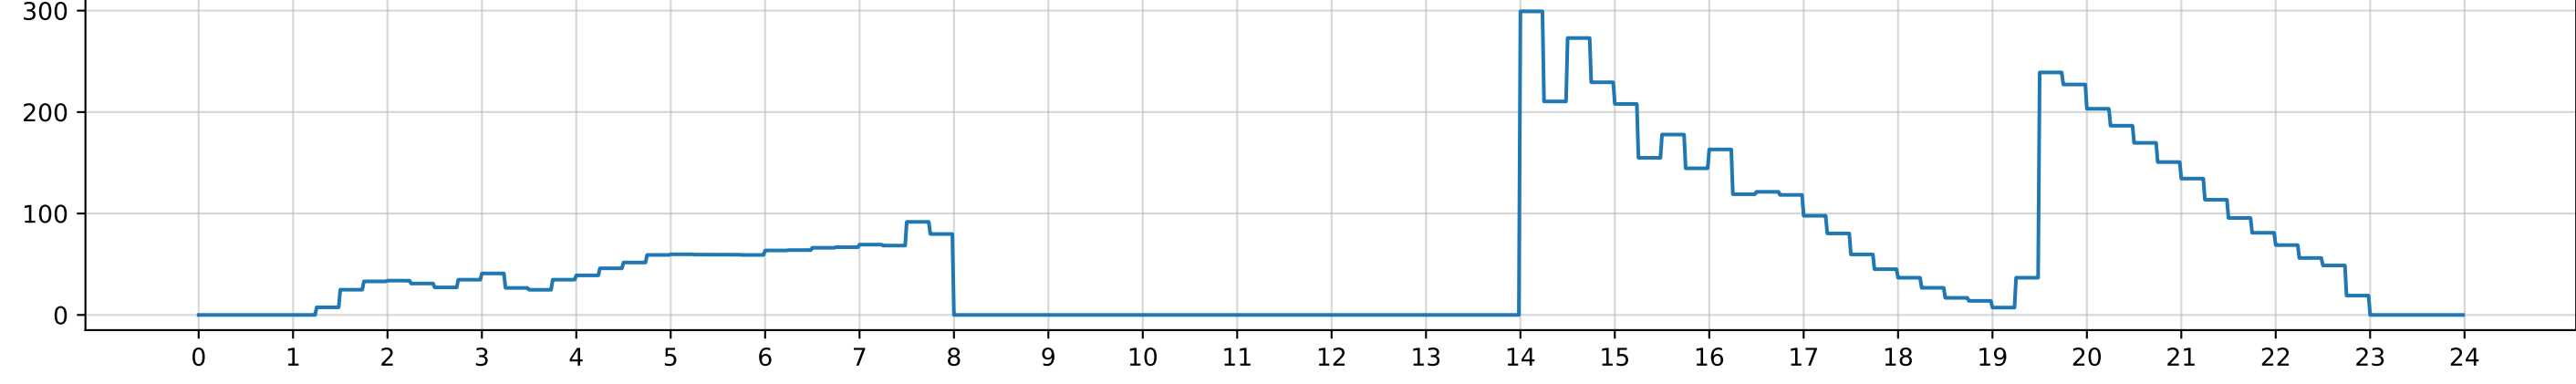

20230608-112612_7_Reference-Hotel - storage_asset_charge_or_discharge_power_in_kilowatts

