




20230608-113305_7_Reference-Office - market_active_power_in_kilowatts

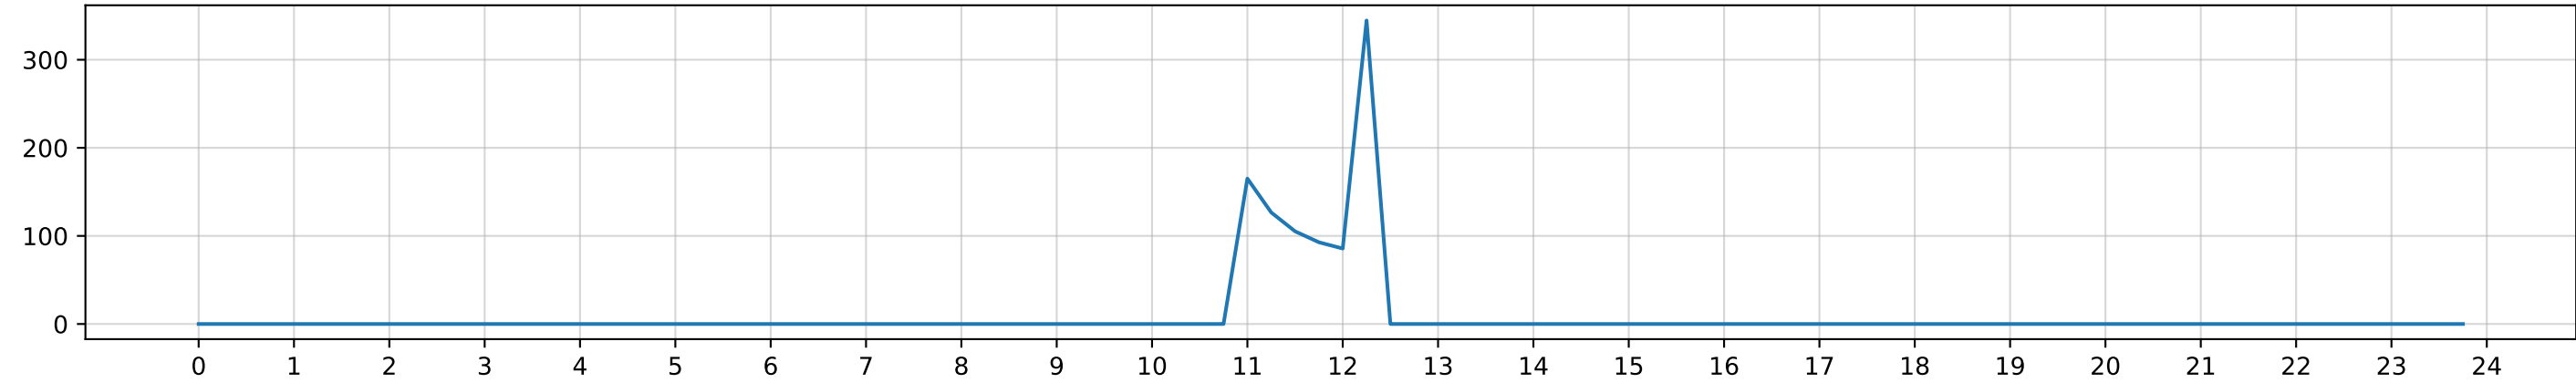


20230608-113305_7_Reference-Office - market_reactive_power_in_kilovolt_ampere_reactive

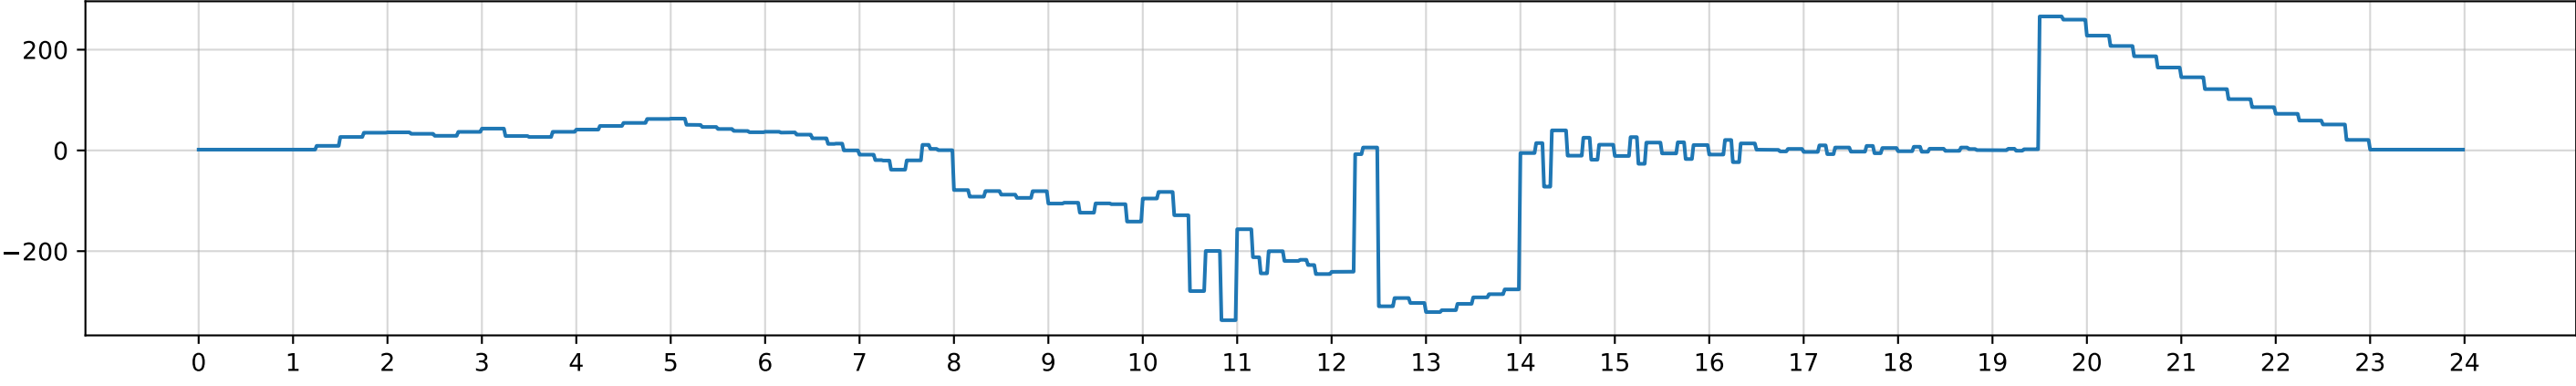

20230608-113305_7_Reference-Office - active_power_demand_in_kilowatts

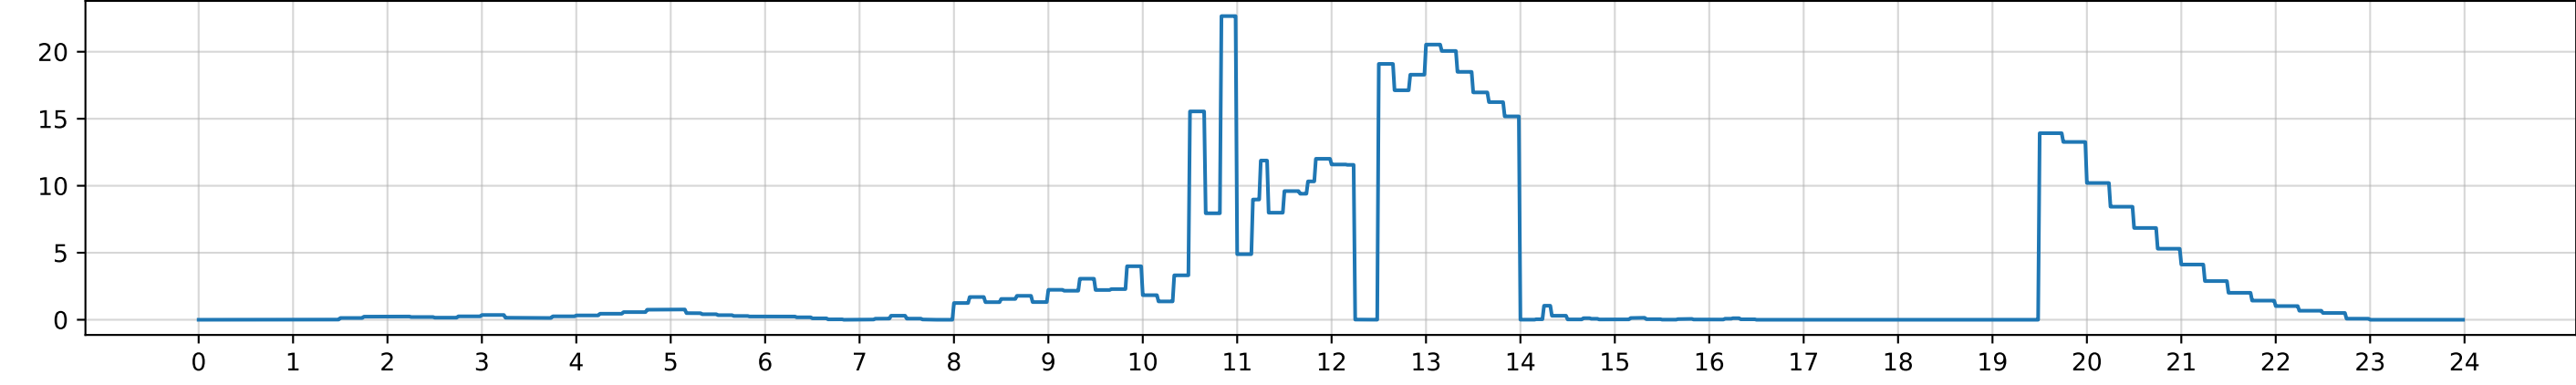

20230608-113305_7_Reference-Office - active_power_demand_base_in_kilowatts

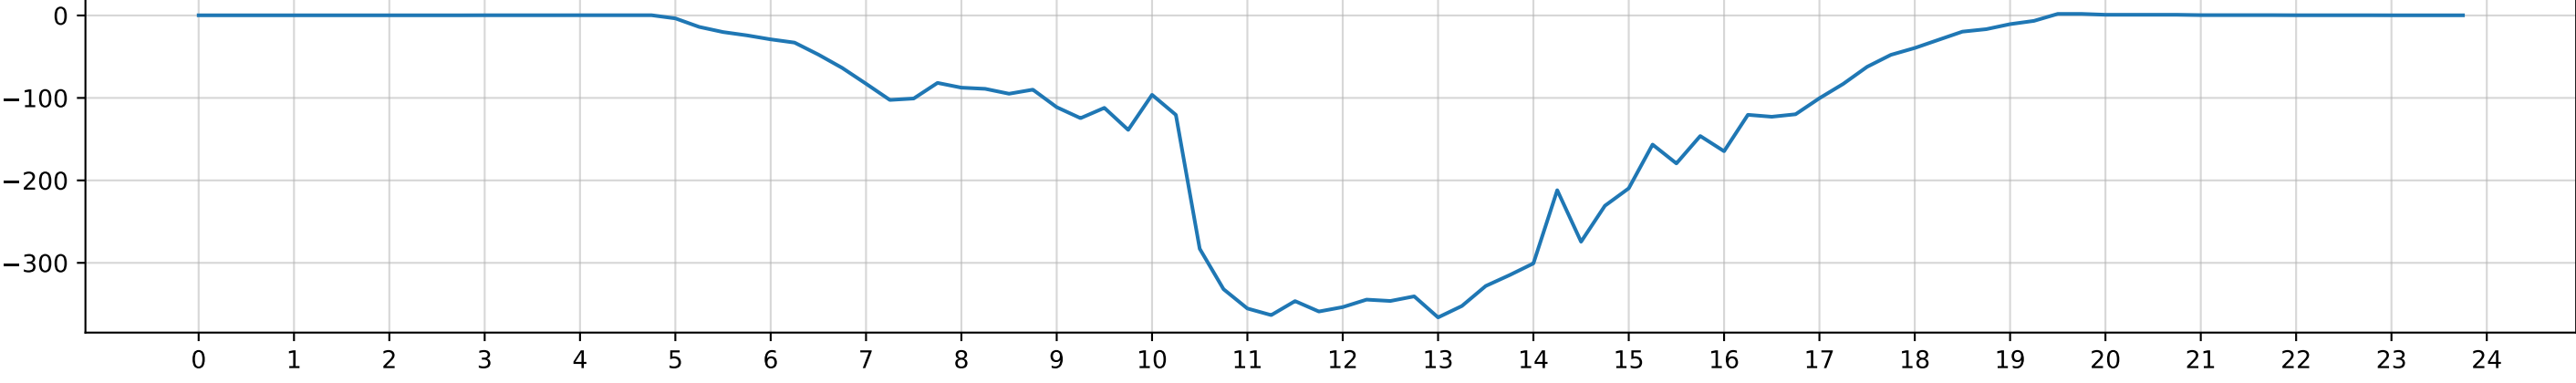


20230608-113305_7_Reference-Office - imported_active_power_in_kilowatts




20230608-113305_7_Reference-Office - exported_active_power_in_kilowatts




20230608-113305_7_Reference-Office - building_power_consumption_in_kilowatts

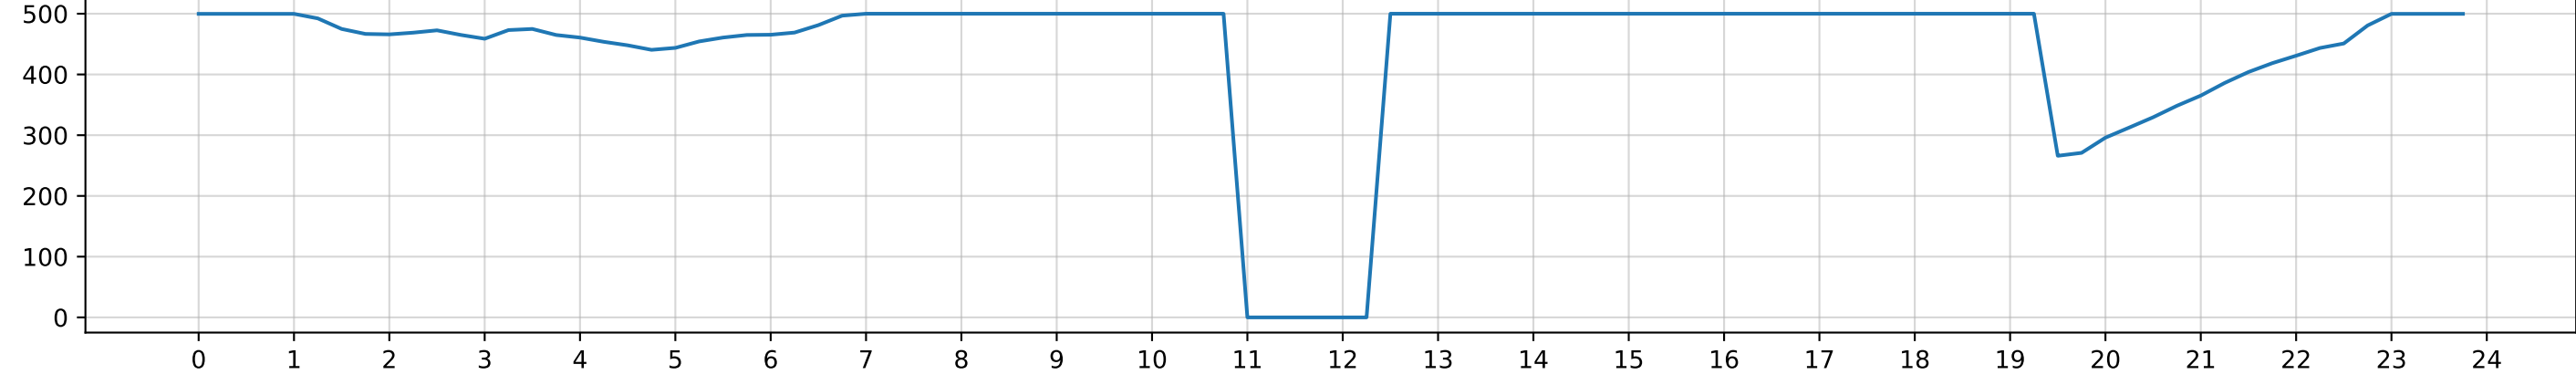


20230608-113305_7_Reference-Office - ambient_temperature_in_degree_celsius

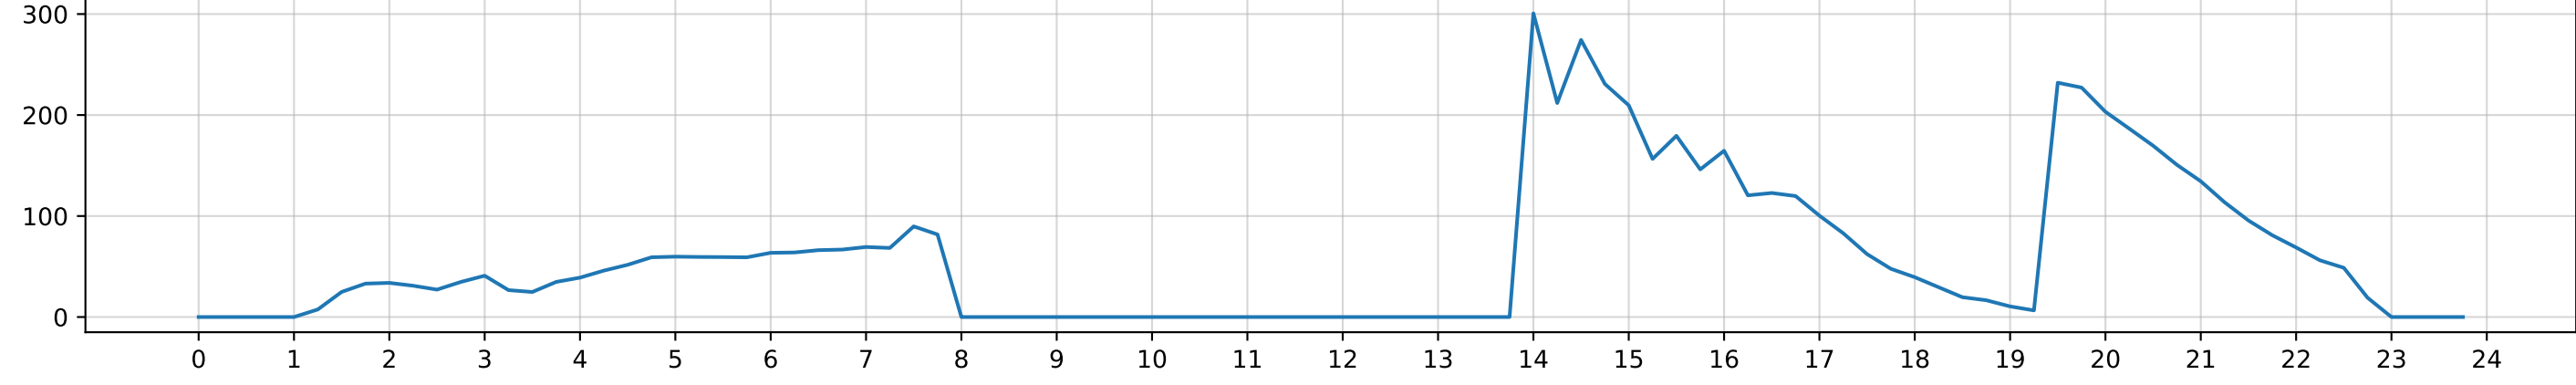


20230608-113305_7_Reference-Office - building_internal_temperature_in_celsius_degrees

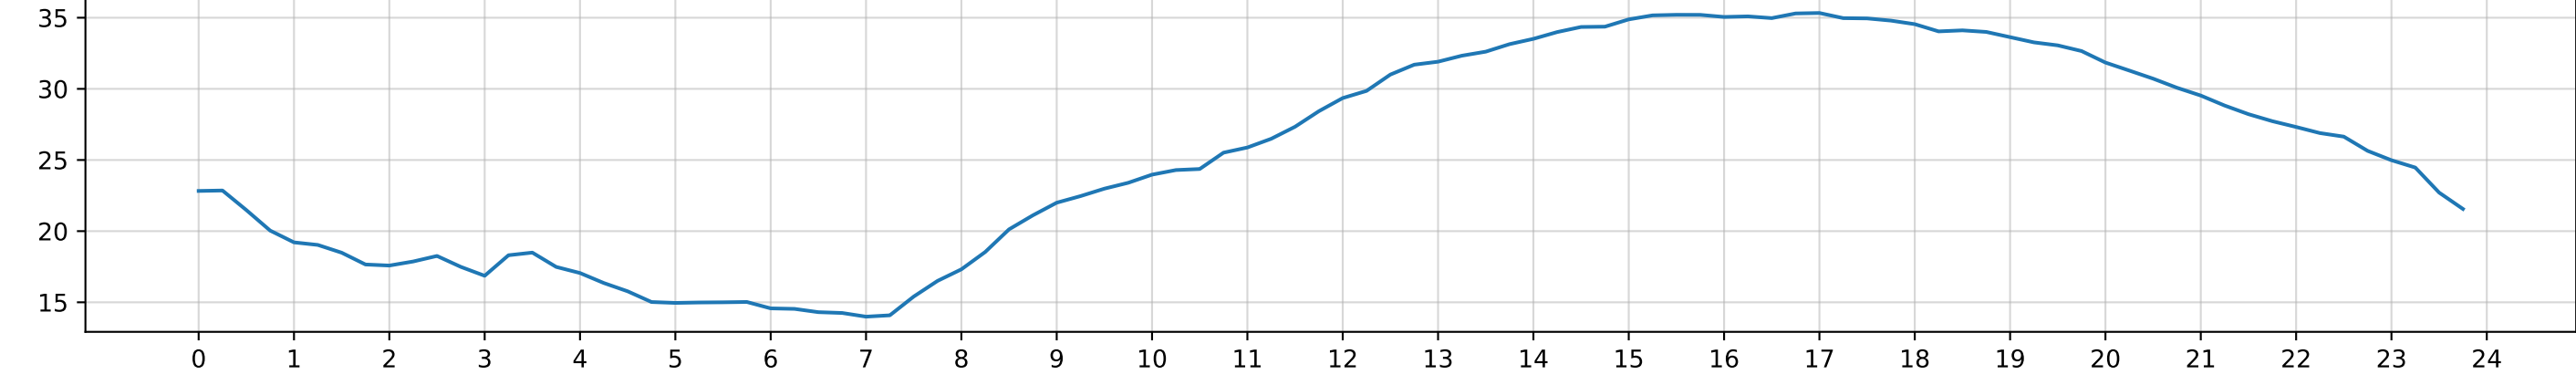

20230608-113305_7_Reference-Office - hvac_active_power_in_kilowatts

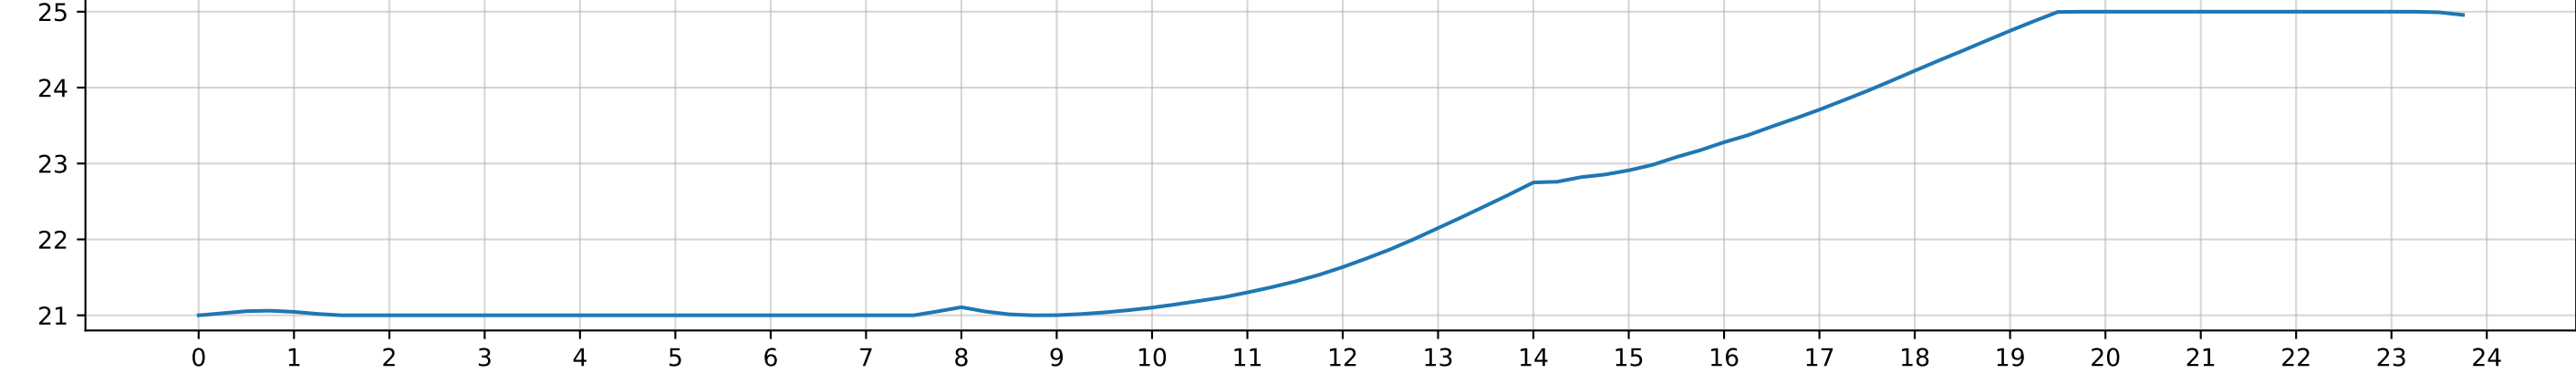

20230608-113305_7_Reference-Office - storage_asset_accumulated_power_in_kilowatts

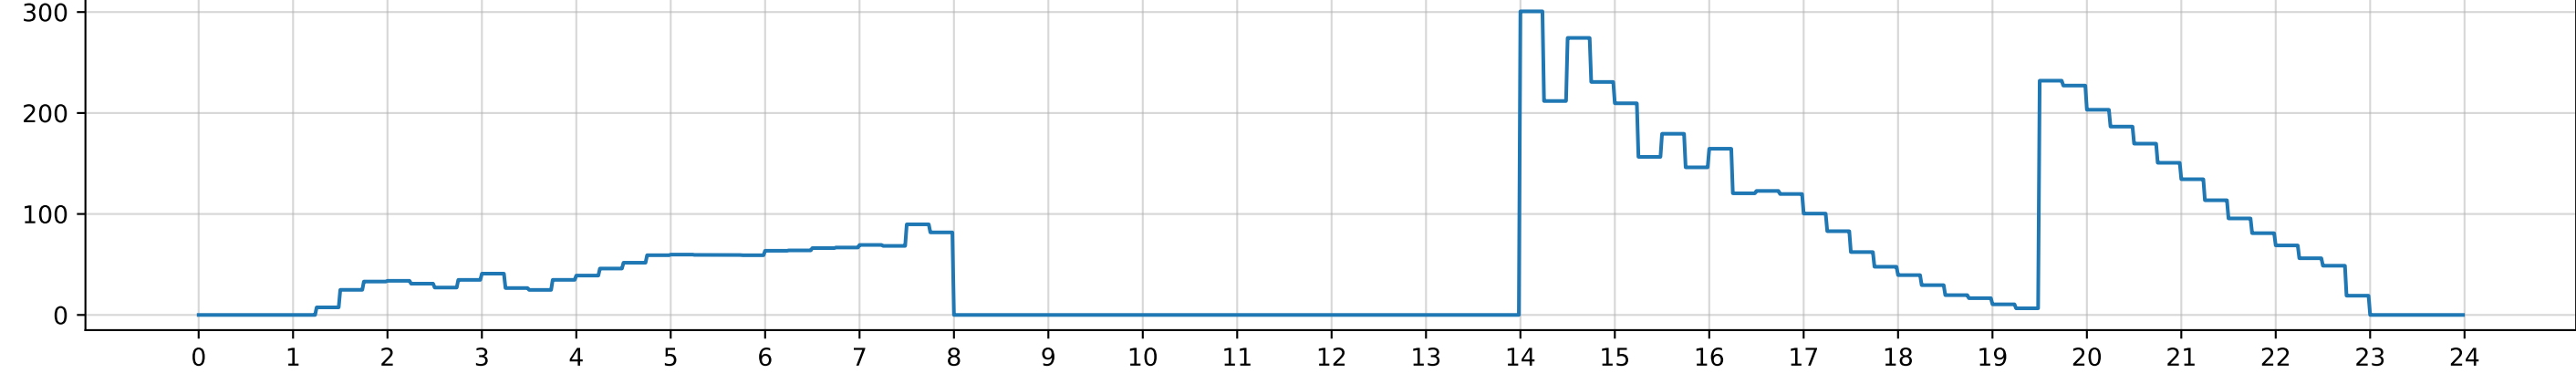

20230608-113305_7_Reference-Office - storage_asset_charge_or_discharge_power_in_kilowatts

