




Commercial-450-bed Hospital - Market Active Power (July)

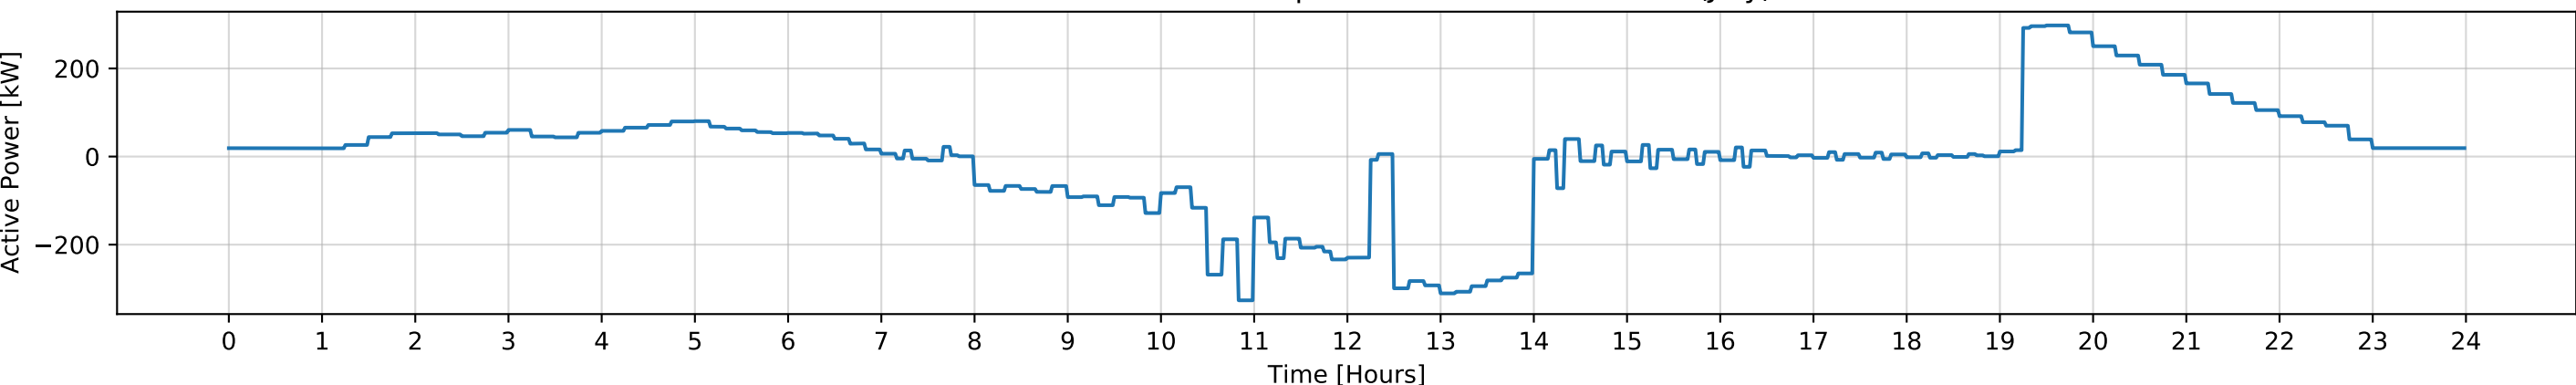


Commercial-450-bed Hospital - Market Reactive Power (July)

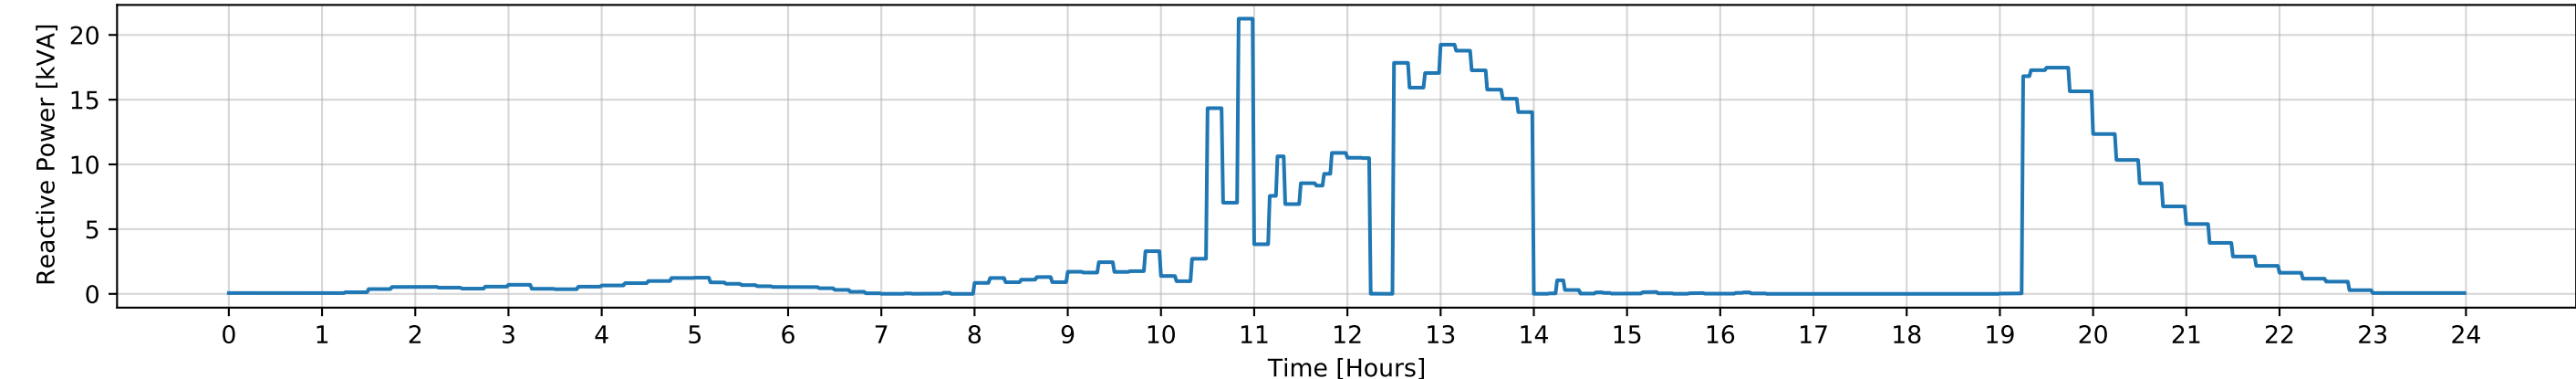


Commercial-450-bed Hospital - Solar PV generation (July)

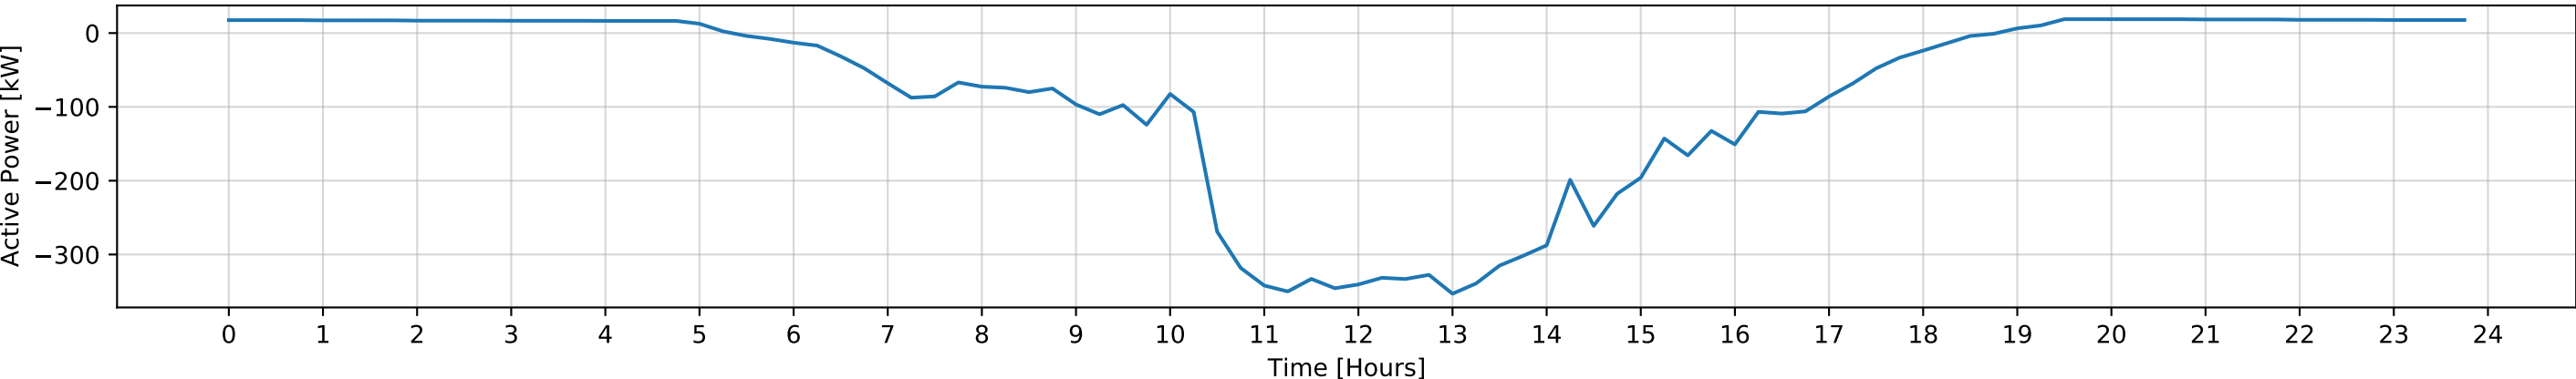


Commercial-450-bed Hospital - Solar PV generation (July)

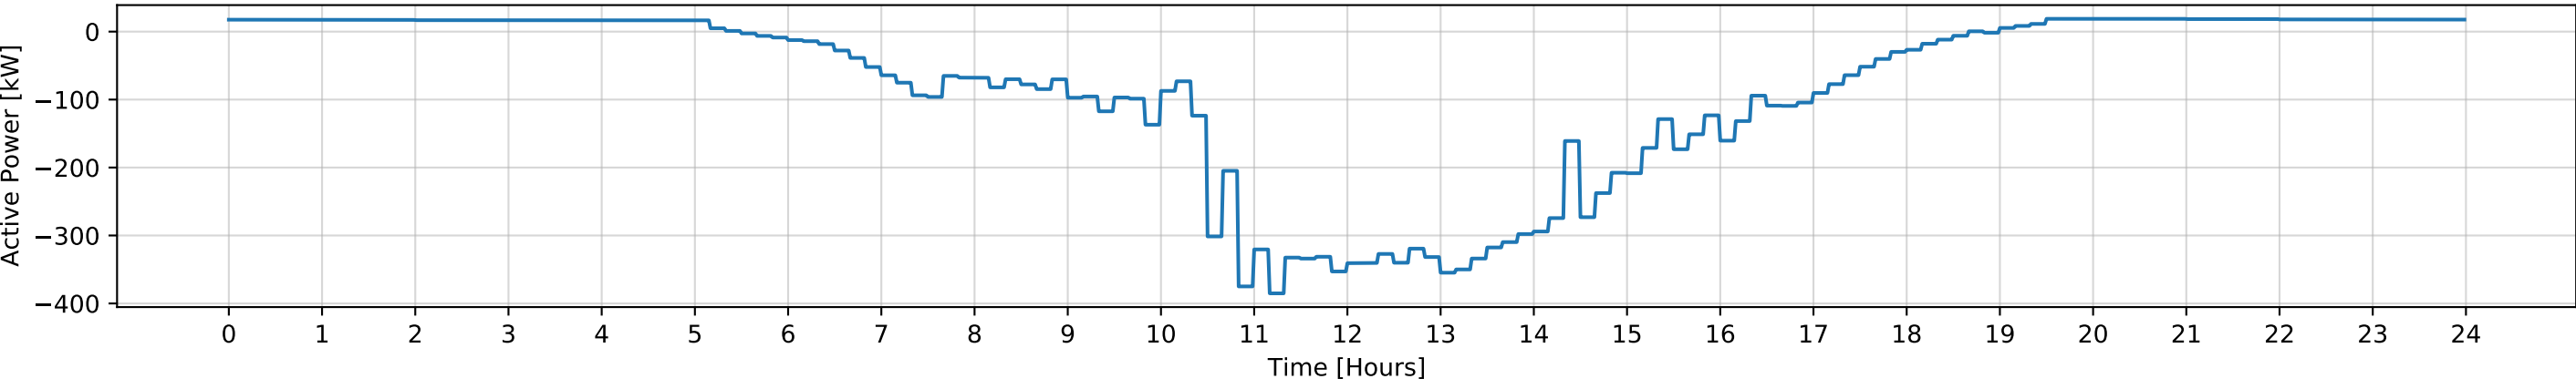


Commercial-450-bed Hospital - Imported Active Power (July)

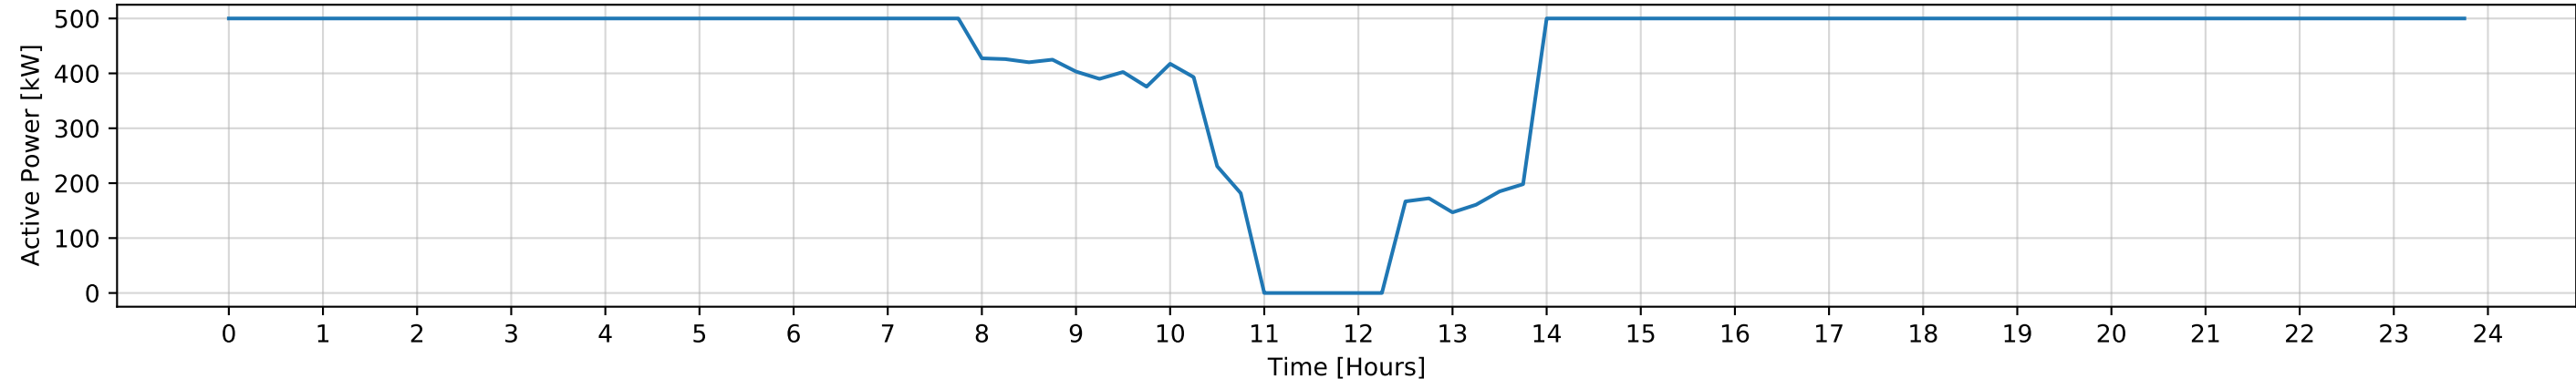


Commercial-450-bed Hospital - Exported Active Power (July)

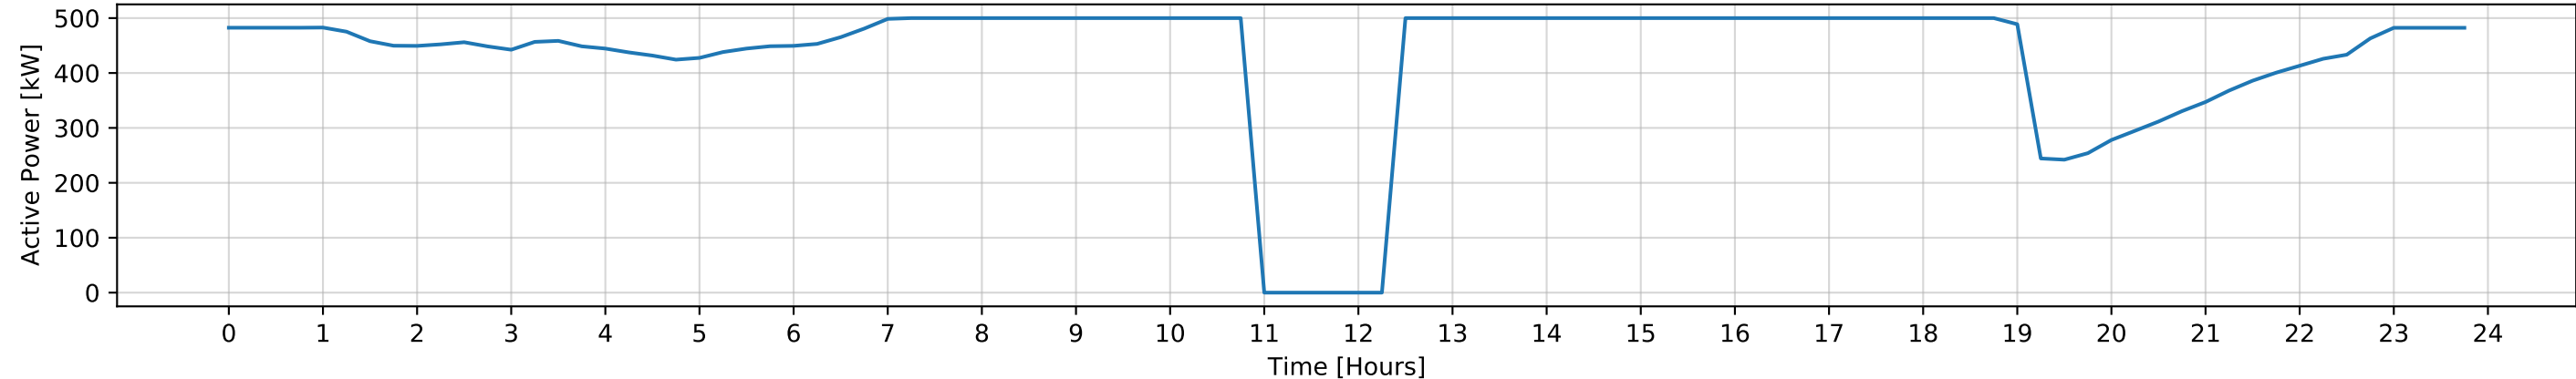


Commercial-450-bed Hospital - Building Electrical Consumption (July)

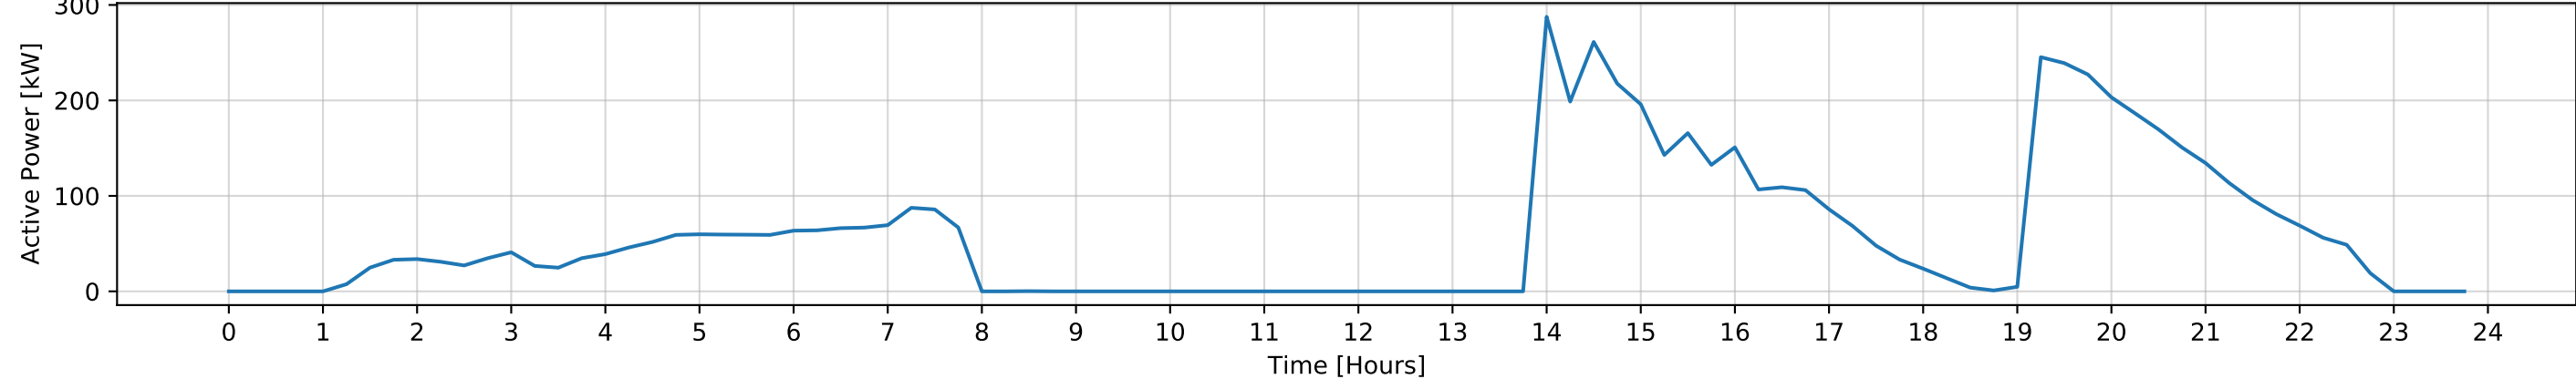


Commercial-450-bed Hospital - Ambient Temperature (July)

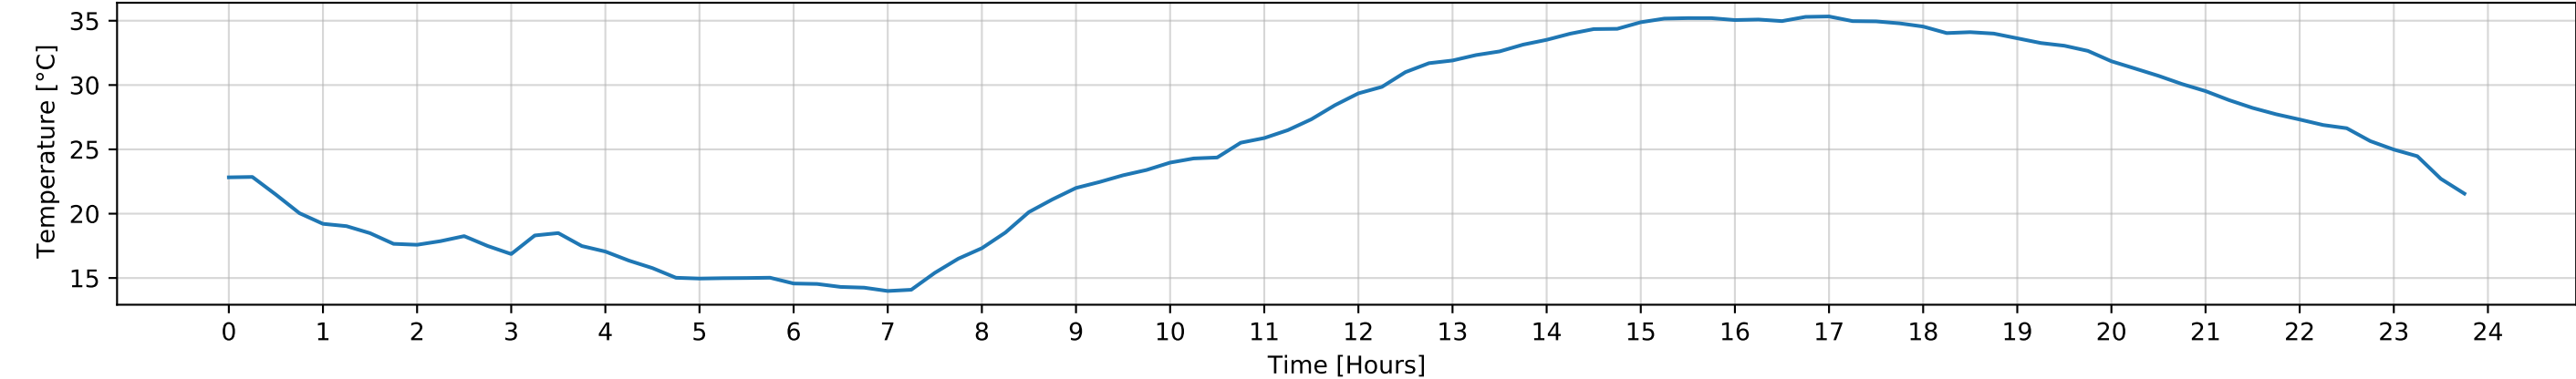


Commercial-450-bed Hospital - Building Internal Temperature (July)

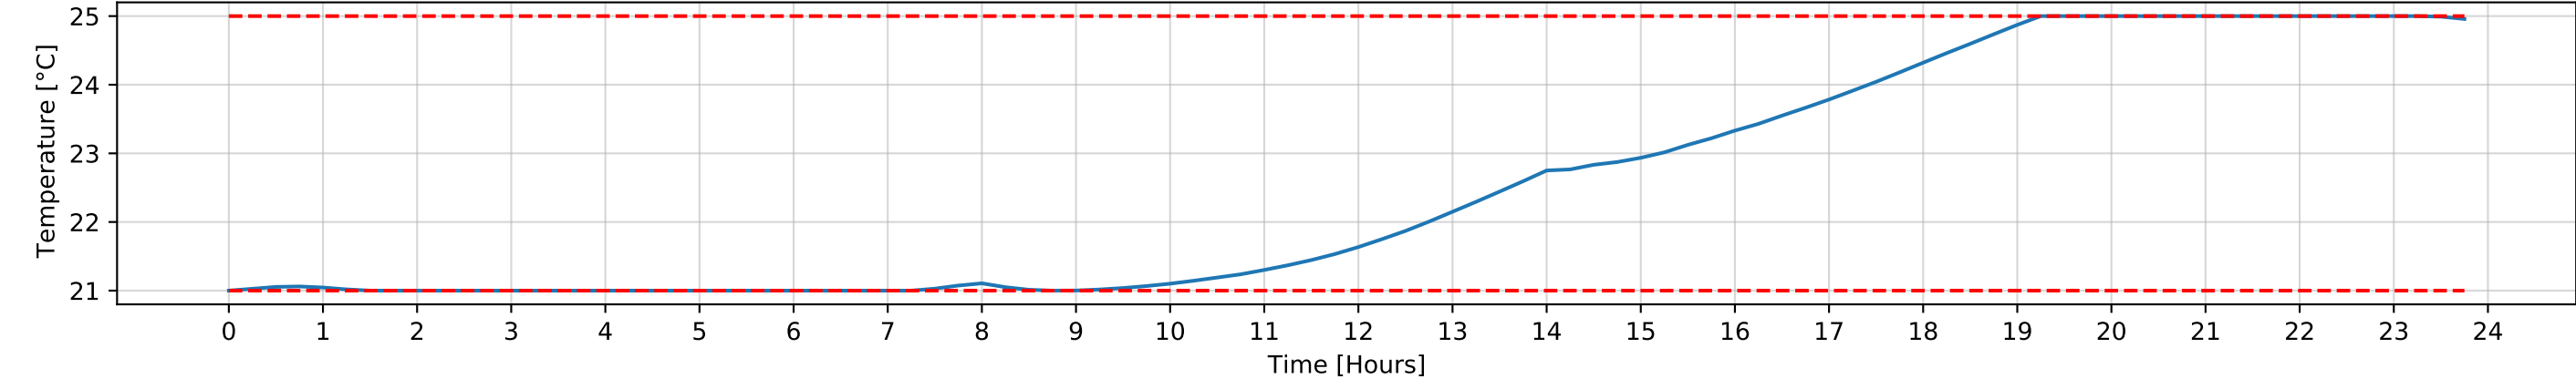

Commercial-450-bed Hospital - HVAC consumption (July)

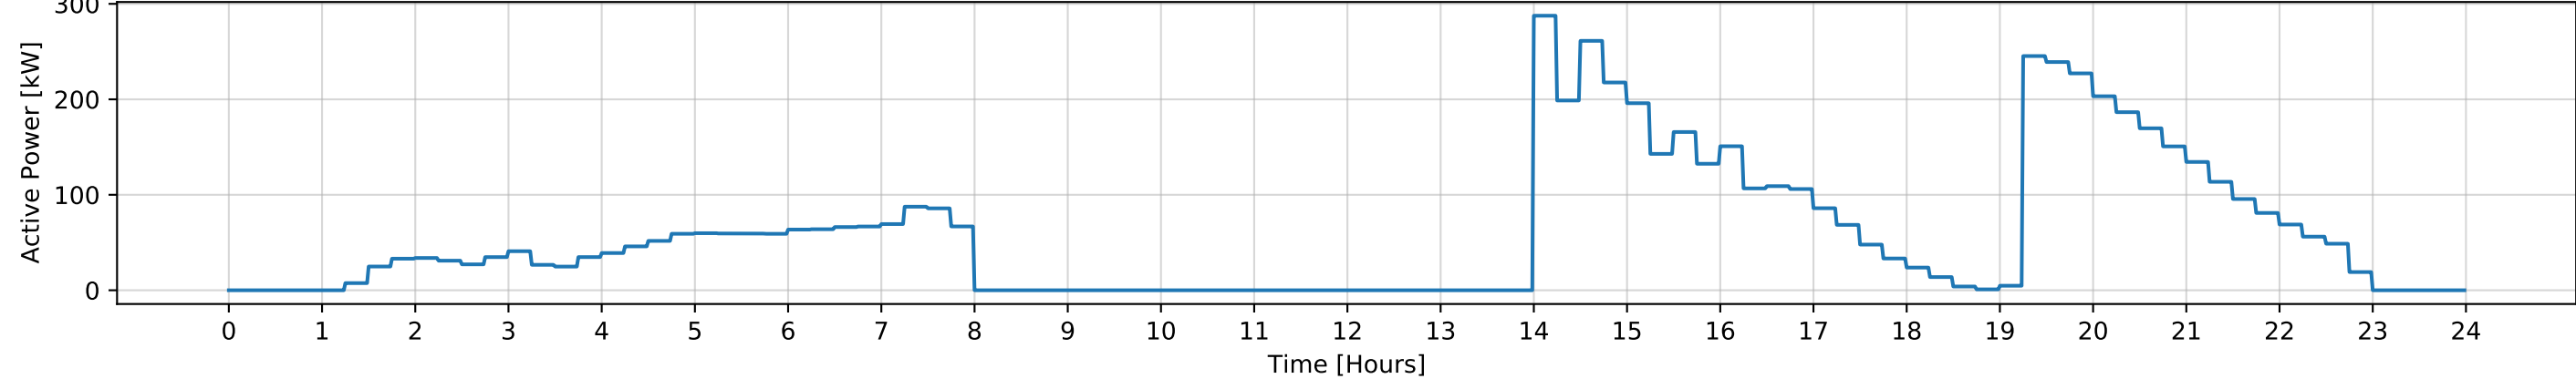

Commercial-450-bed Hospital - Stored Power (July)

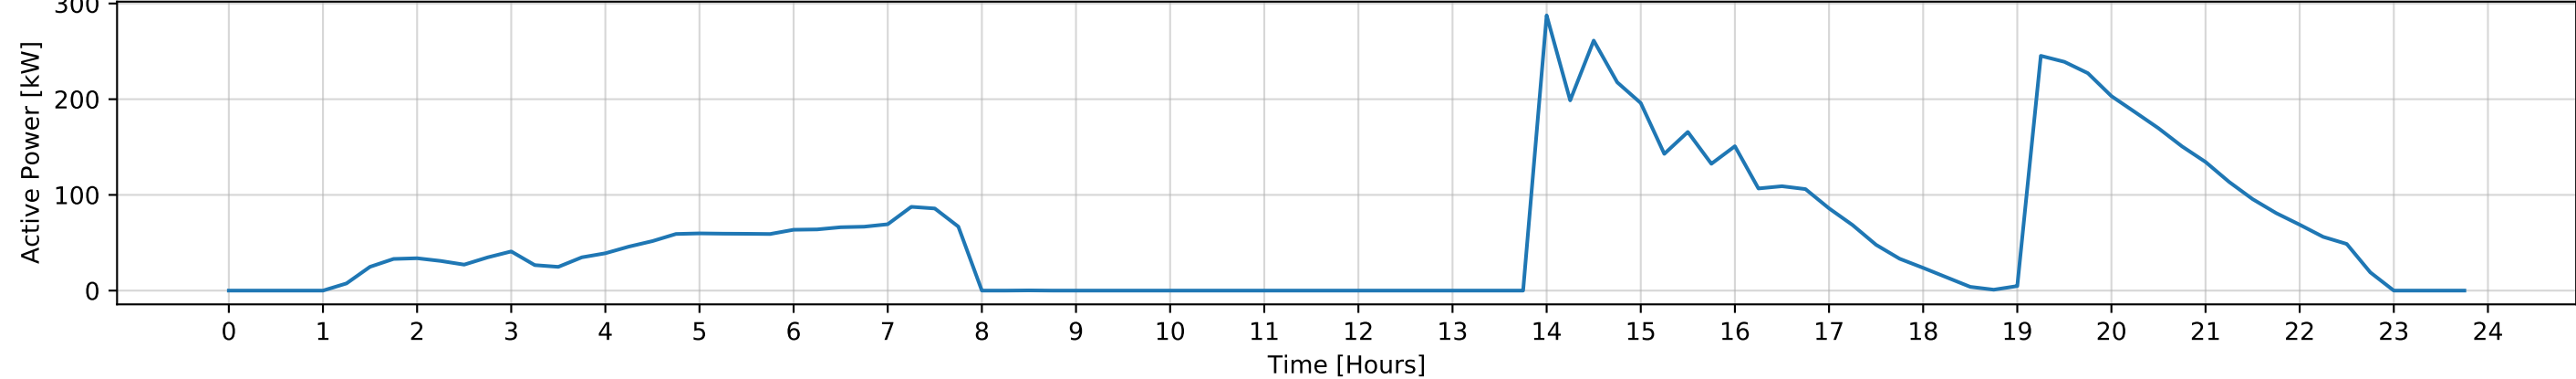

Commercial-450-bed Hospital - Storage Asset System Charged and Discharged Power (July)

