




20230608-104817_1_Commercial-450-bed Hospital - market_active_power_in_kilowatts

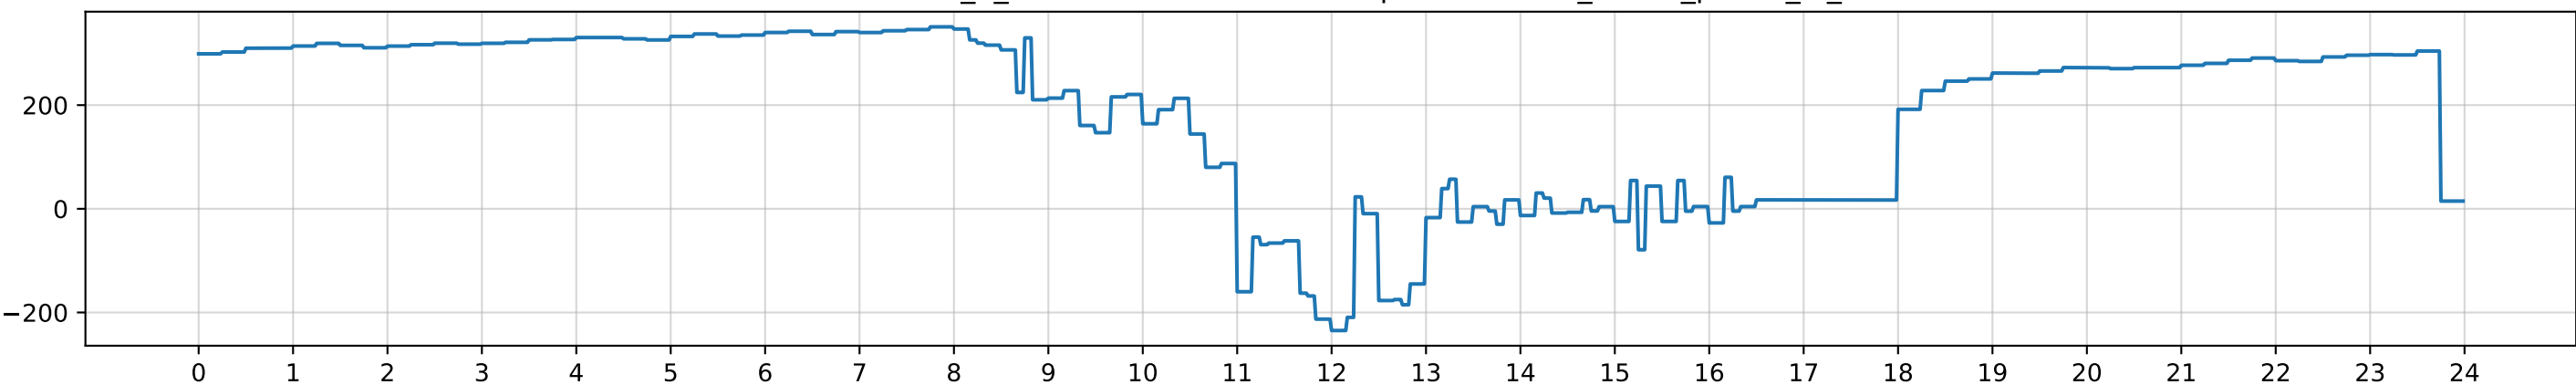


20230608-104817_1_Commercial-450-bed Hospital - market_reactive_power_in_kilovolt_ampere_reactive

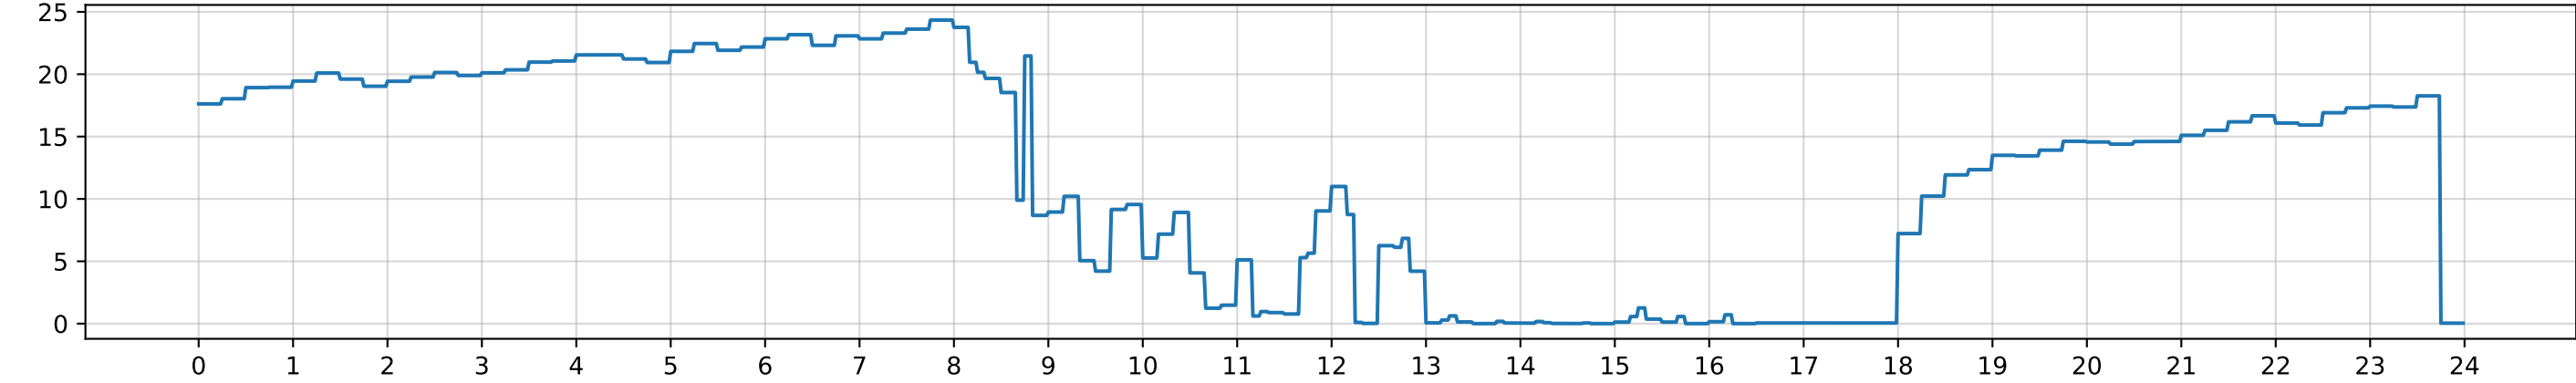


20230608-104817_1_Commercial-450-bed Hospital - active_power_demand_in_kilowatts

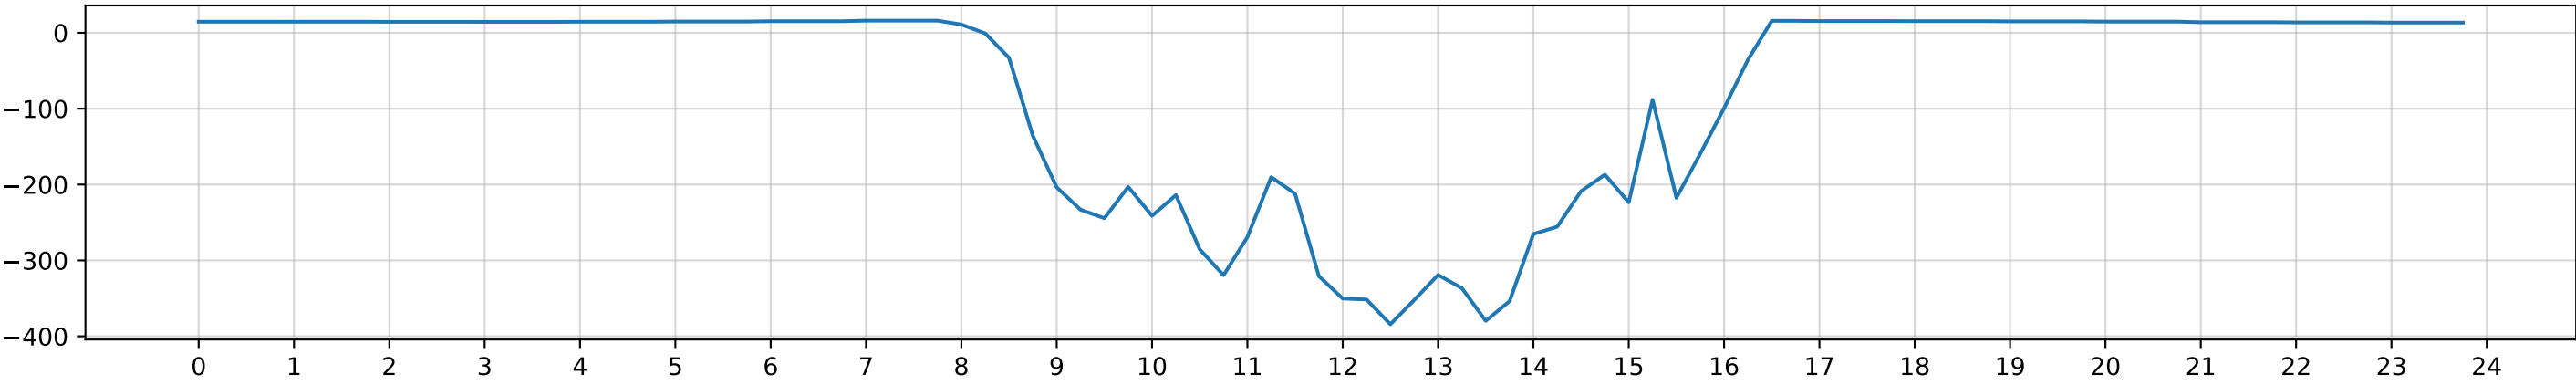


20230608-104817_1_Commercial-450-bed Hospital - active_power_demand_base_in_kilowatts

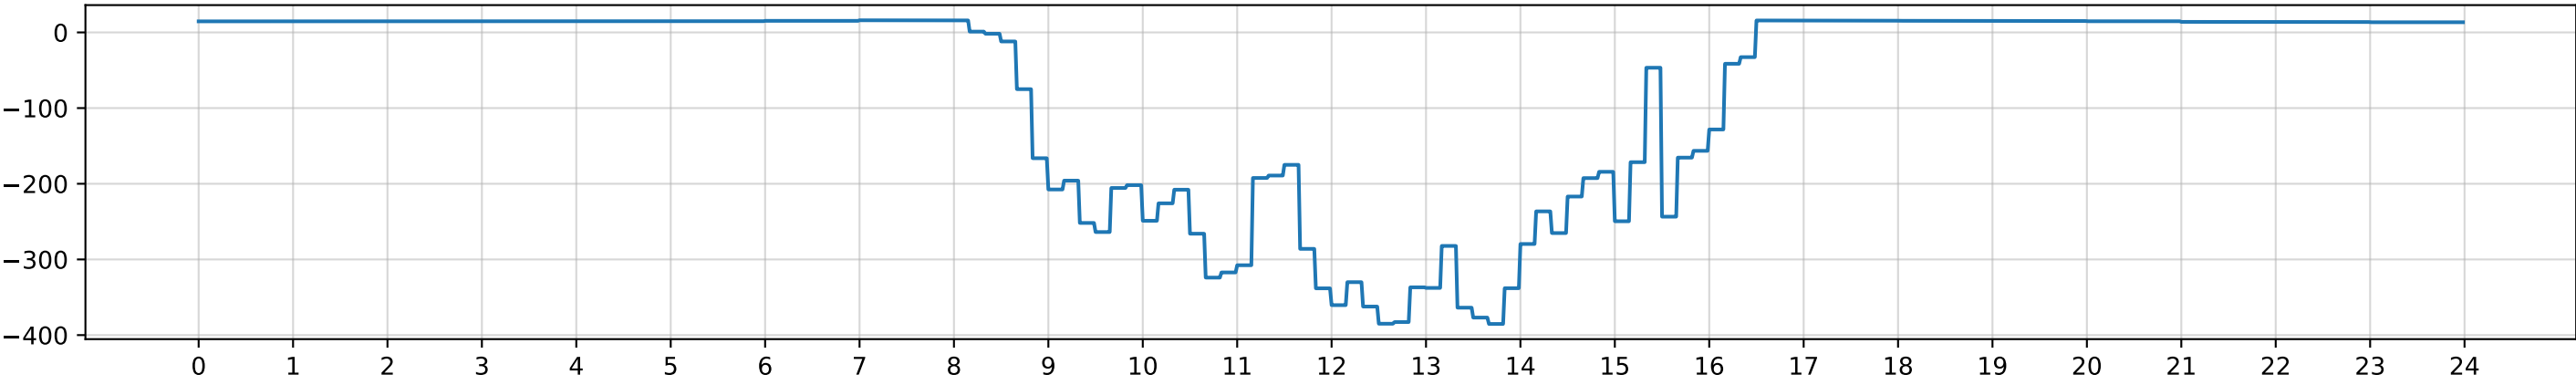


20230608-104817_1_Commercial-450-bed Hospital - imported_active_power_in_kilowatts

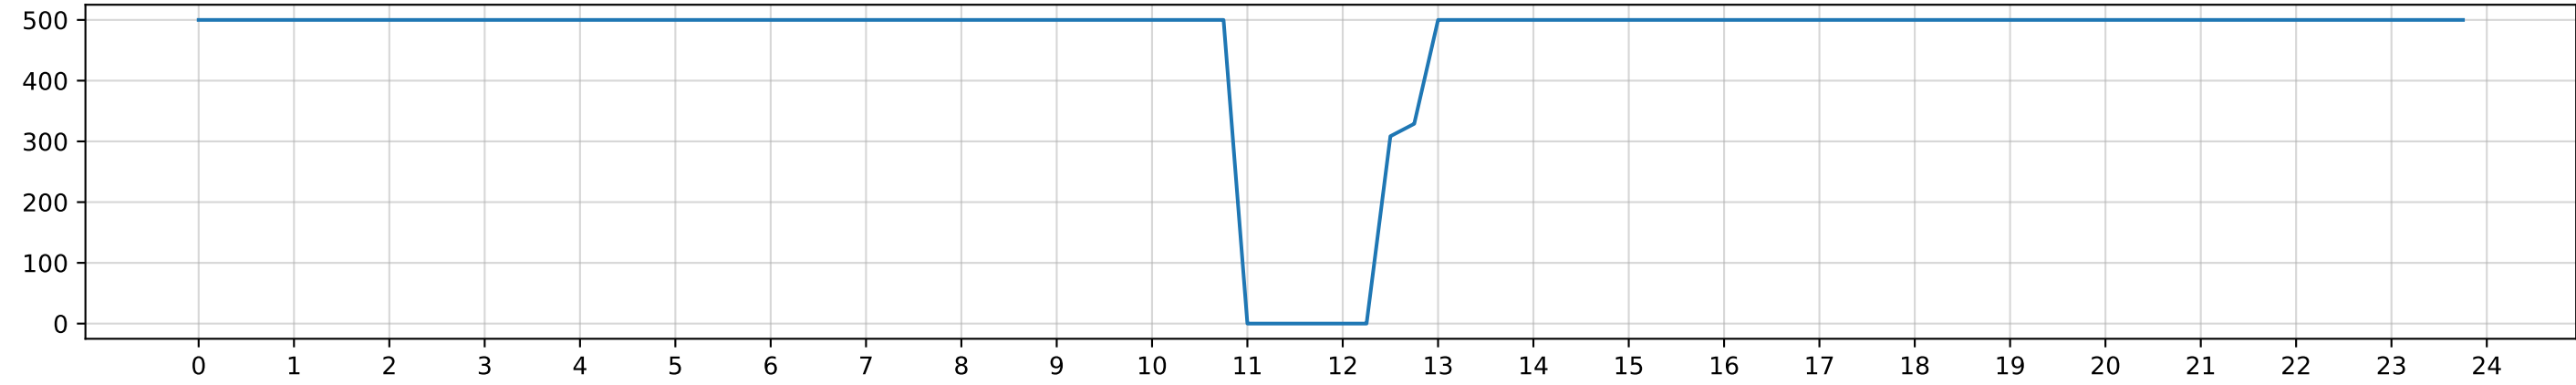


20230608-104817_1_Commercial-450-bed Hospital - exported_active_power_in_kilowatts

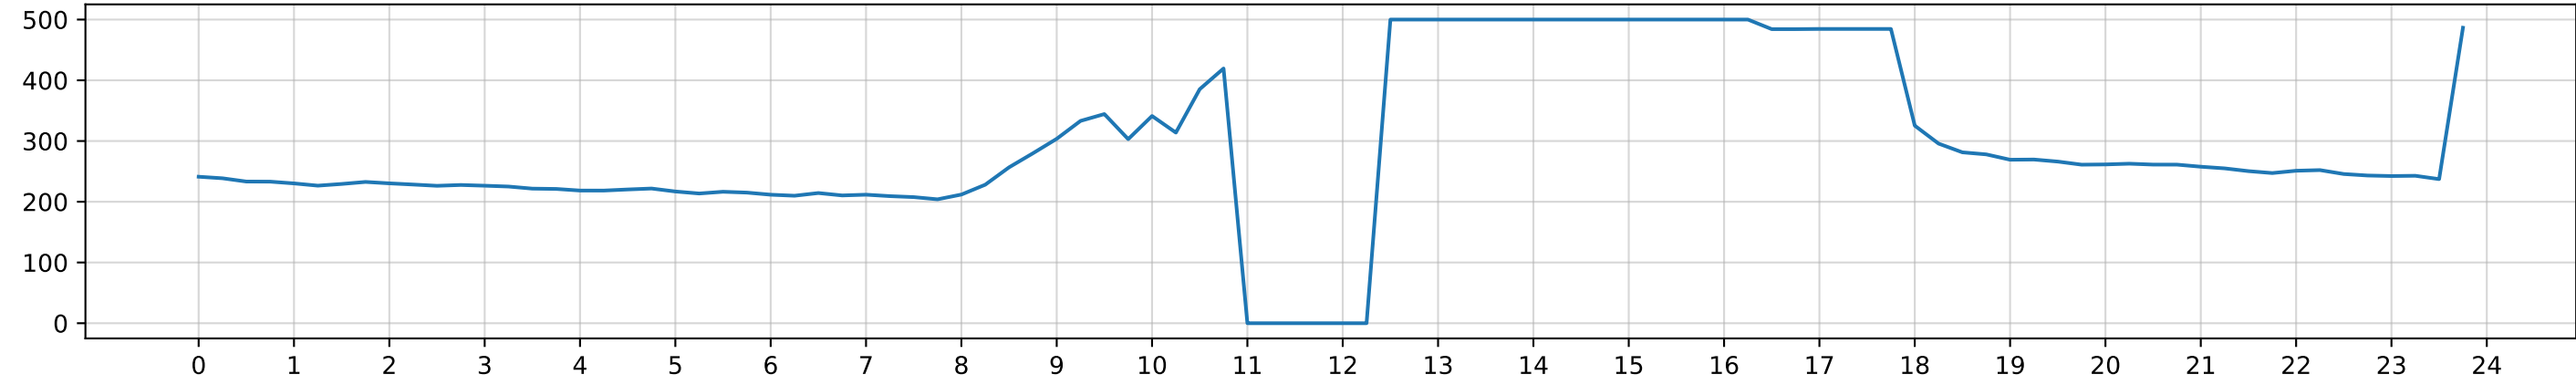


20230608-104817_1_Commercial-450-bed Hospital - building_power_consumption_in_kilowatts

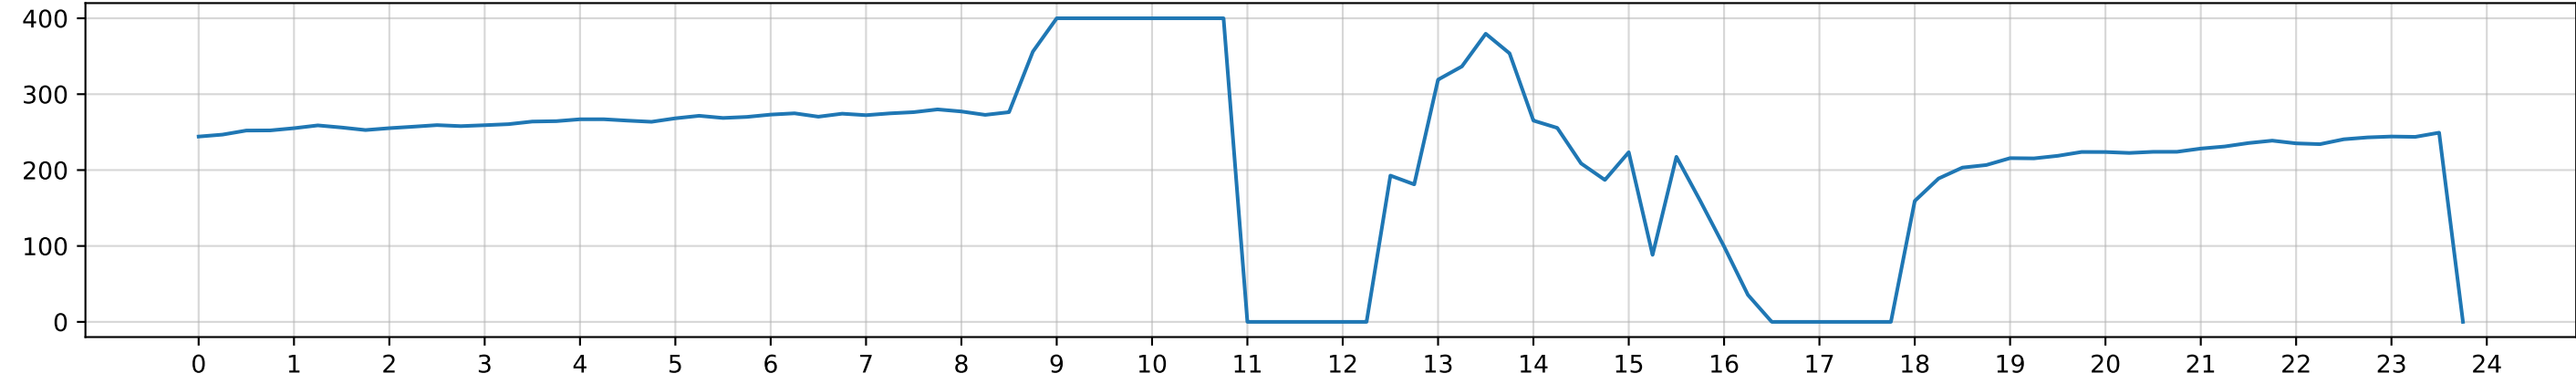


20230608-104817_1_Commercial-450-bed Hospital - ambient_temperature_in_degree_celsius

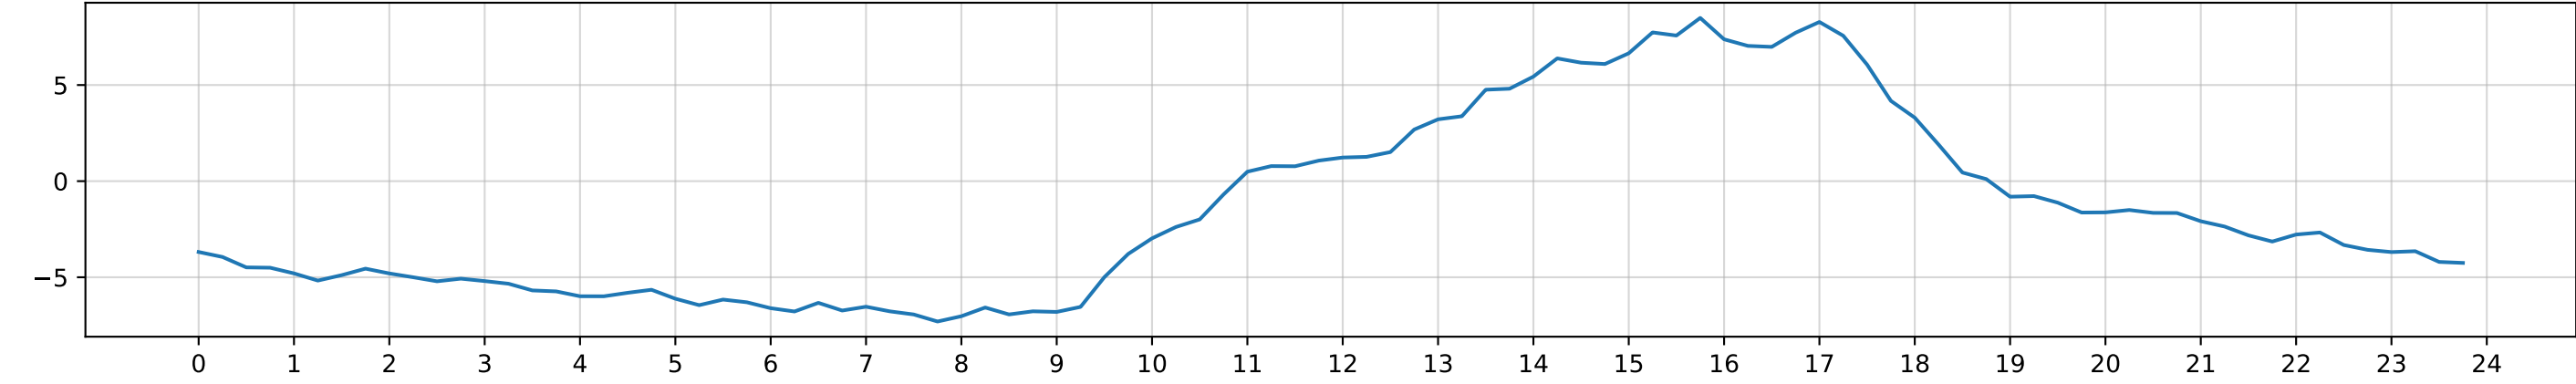


20230608-104817_1_Commercial-450-bed Hospital - building_internal_temperature_in_celsius_degrees

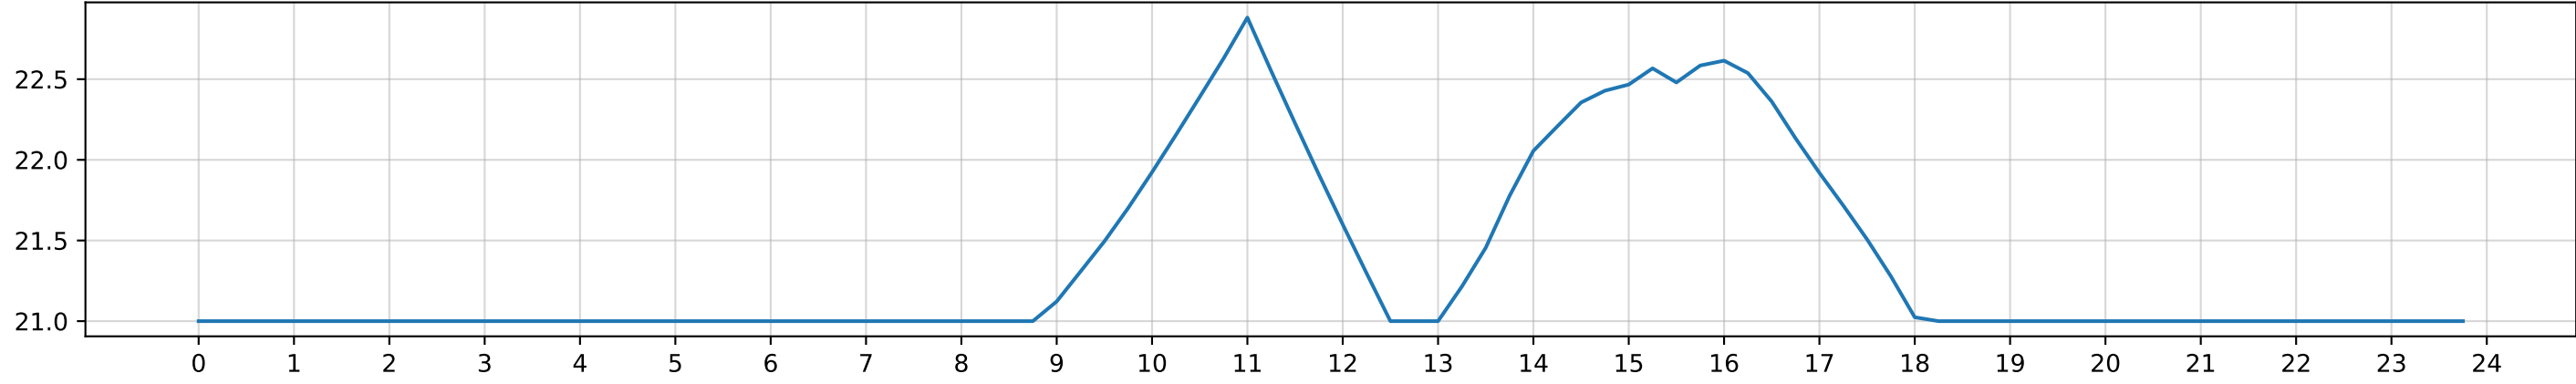

20230608-104817_1_Commercial-450-bed Hospital - hvac_active_power_in_kilowatts

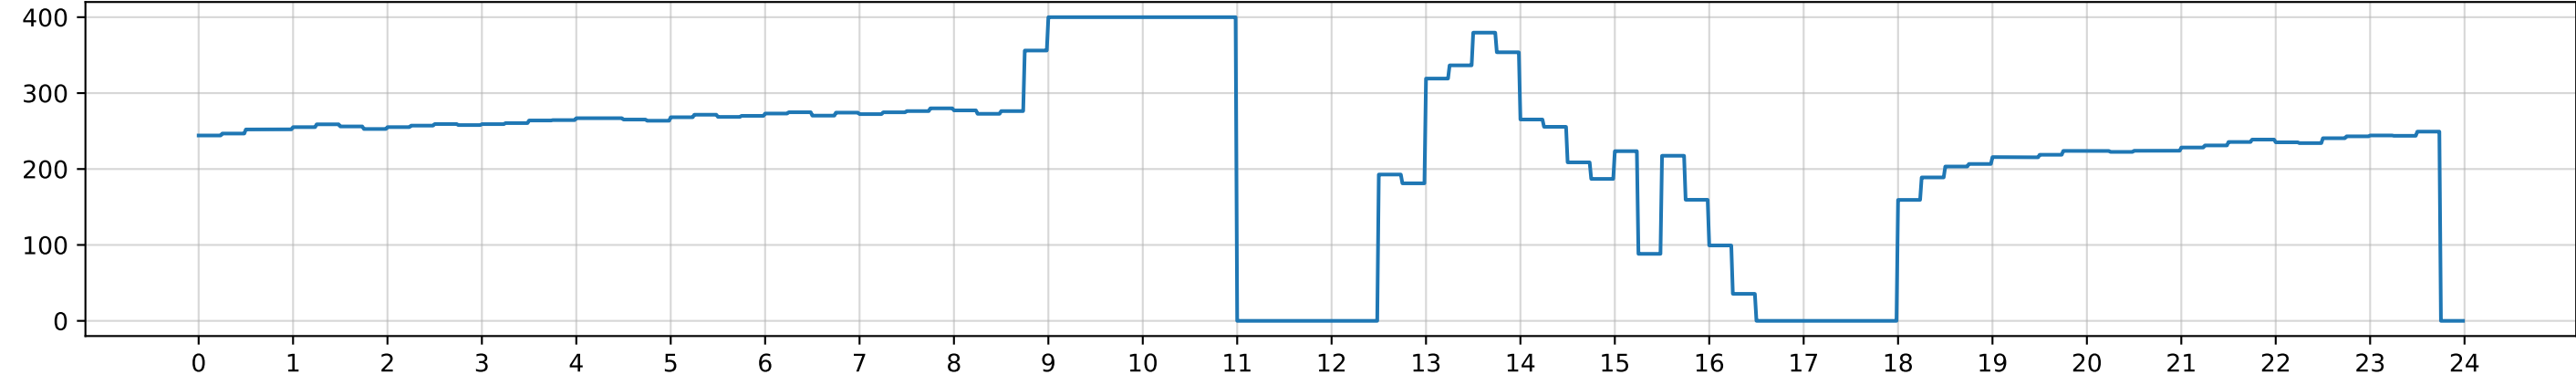

20230608-104817_1_Commercial-450-bed Hospital - storage_asset_accumulated_power_in_kilowatts

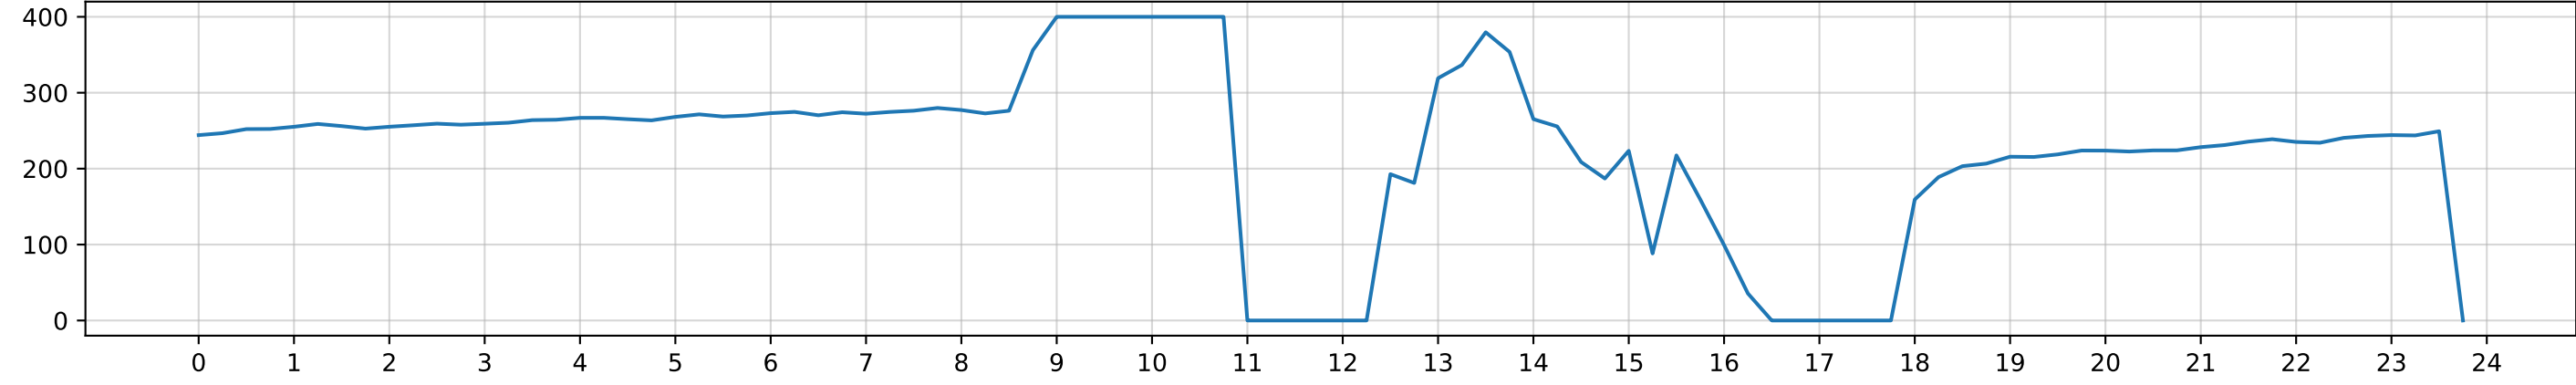

20230608-104817_1_Commercial-450-bed Hospital - storage_asset_charge_or_discharge_power_in_kilowatts

