




Commercial-275-bed Hospital - Market Active Power (January)

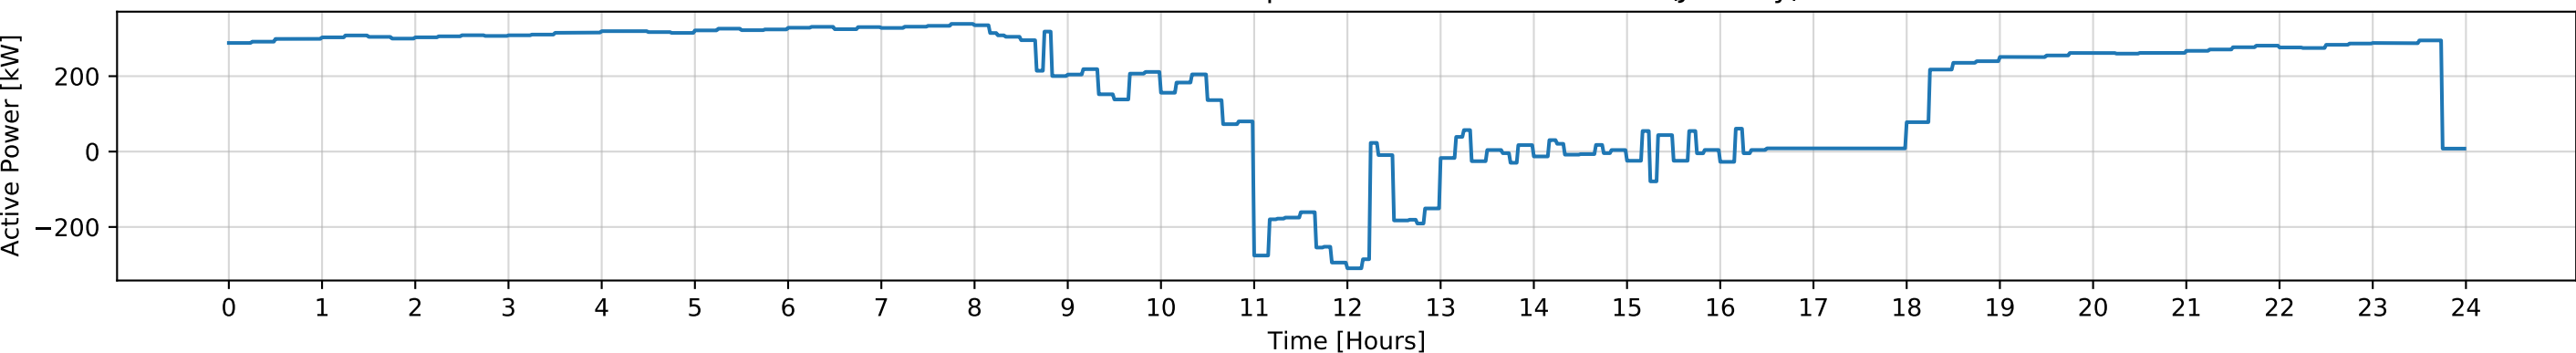


Commercial-275-bed Hospital - Market Reactive Power (January)

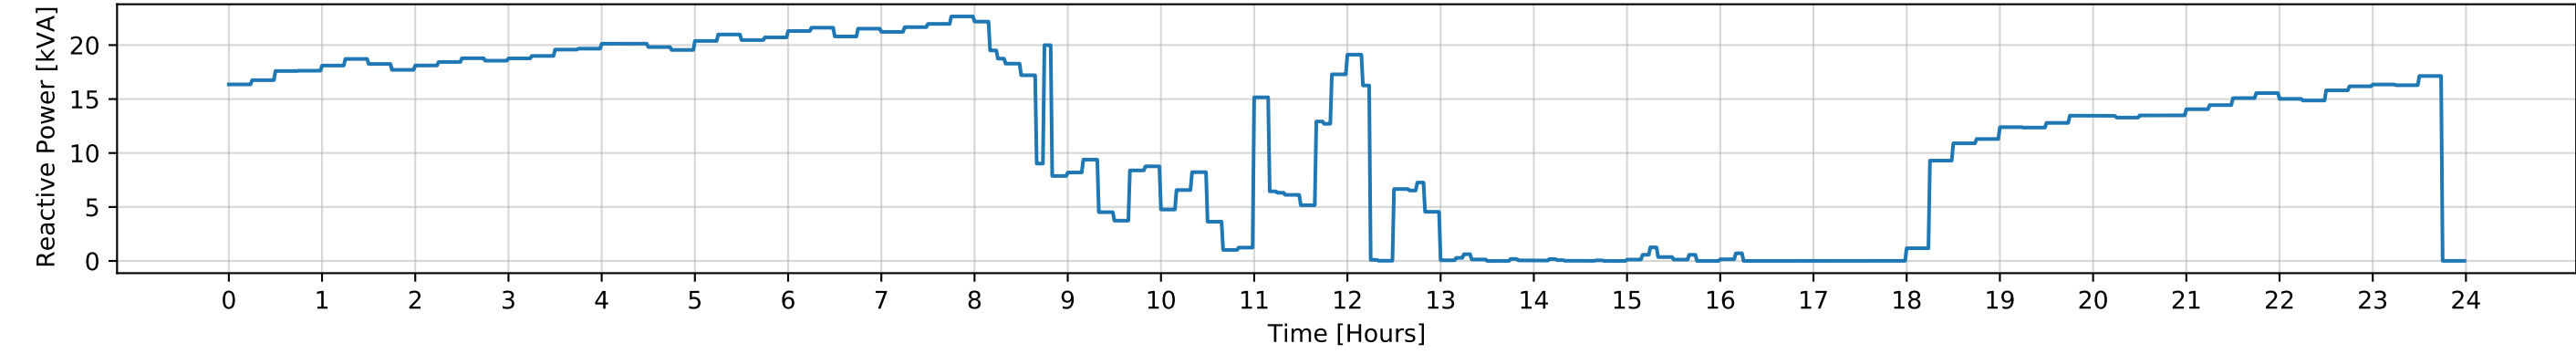


Commercial-275-bed Hospital - Solar PV generation (January)

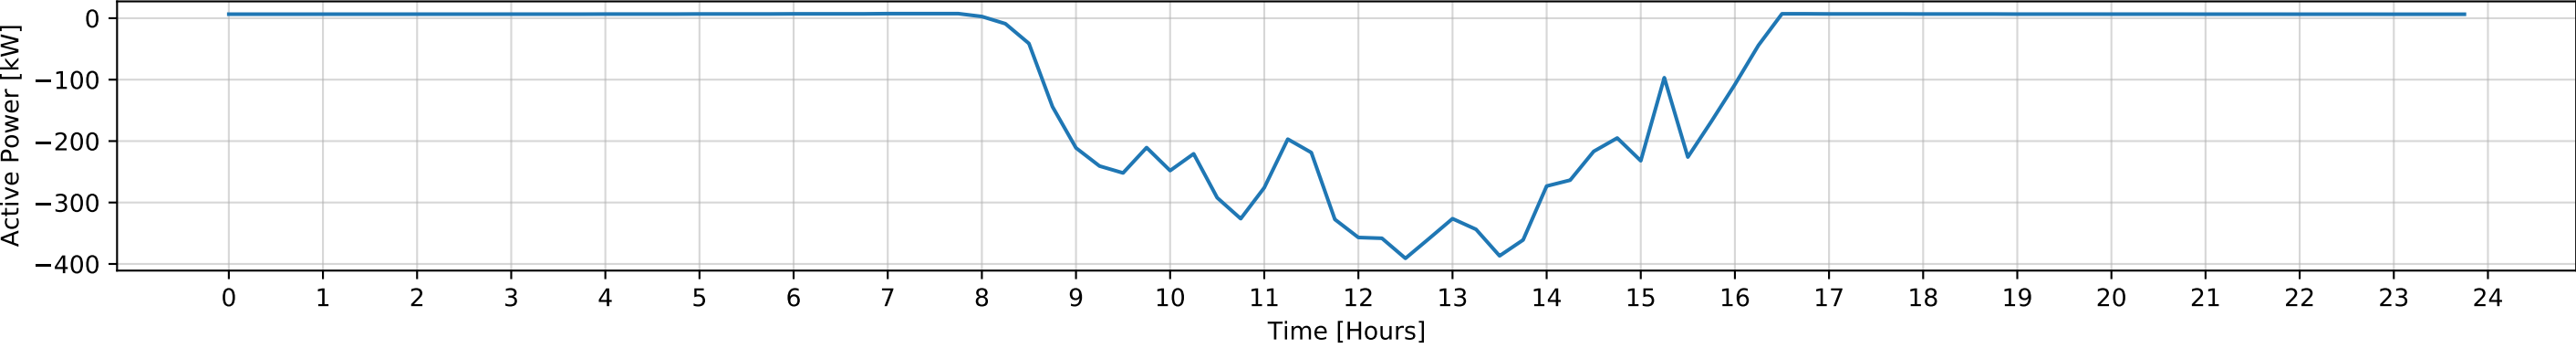


Commercial-275-bed Hospital - Solar PV generation (January)

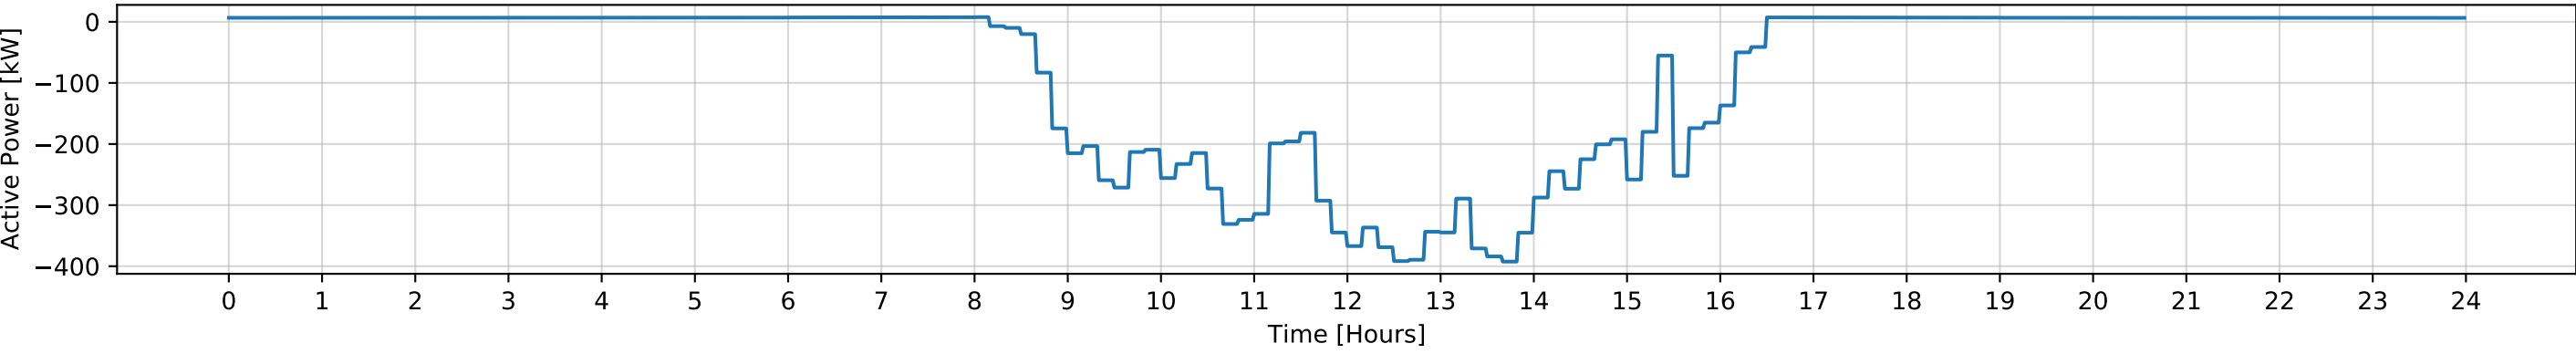


Commercial-275-bed Hospital - Imported Active Power (January)

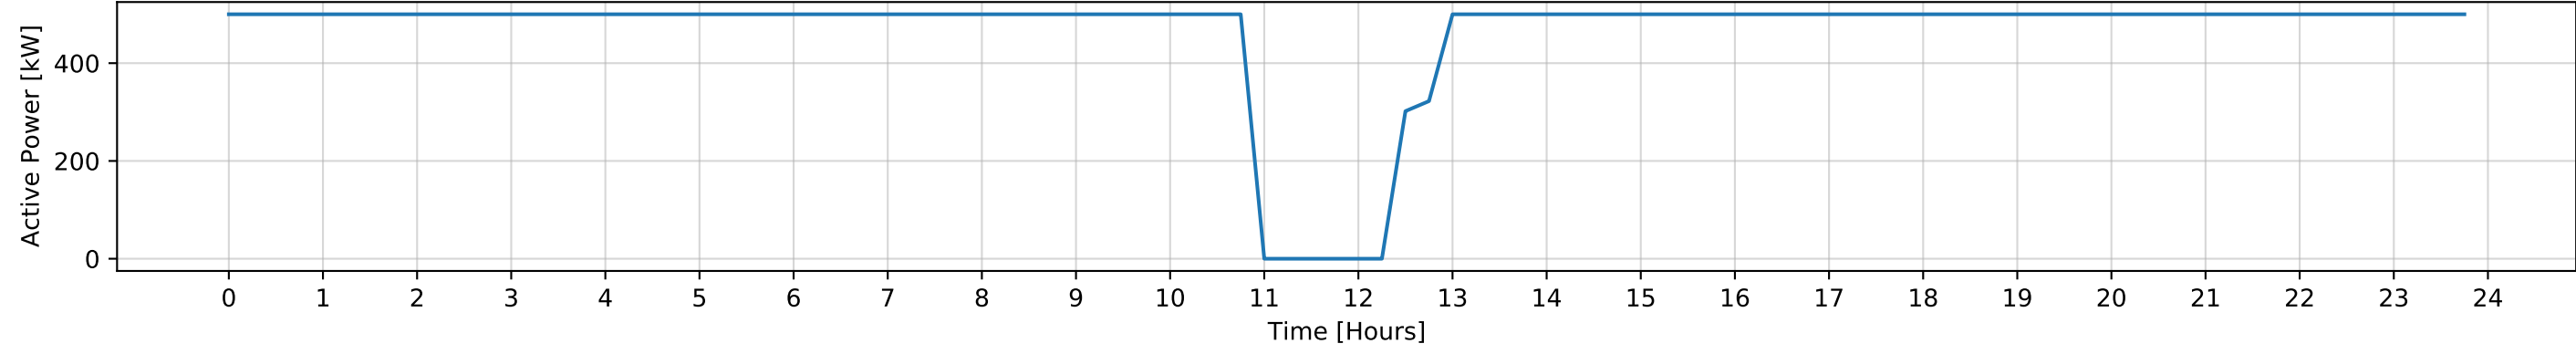


Commercial-275-bed Hospital - Exported Active Power (January)

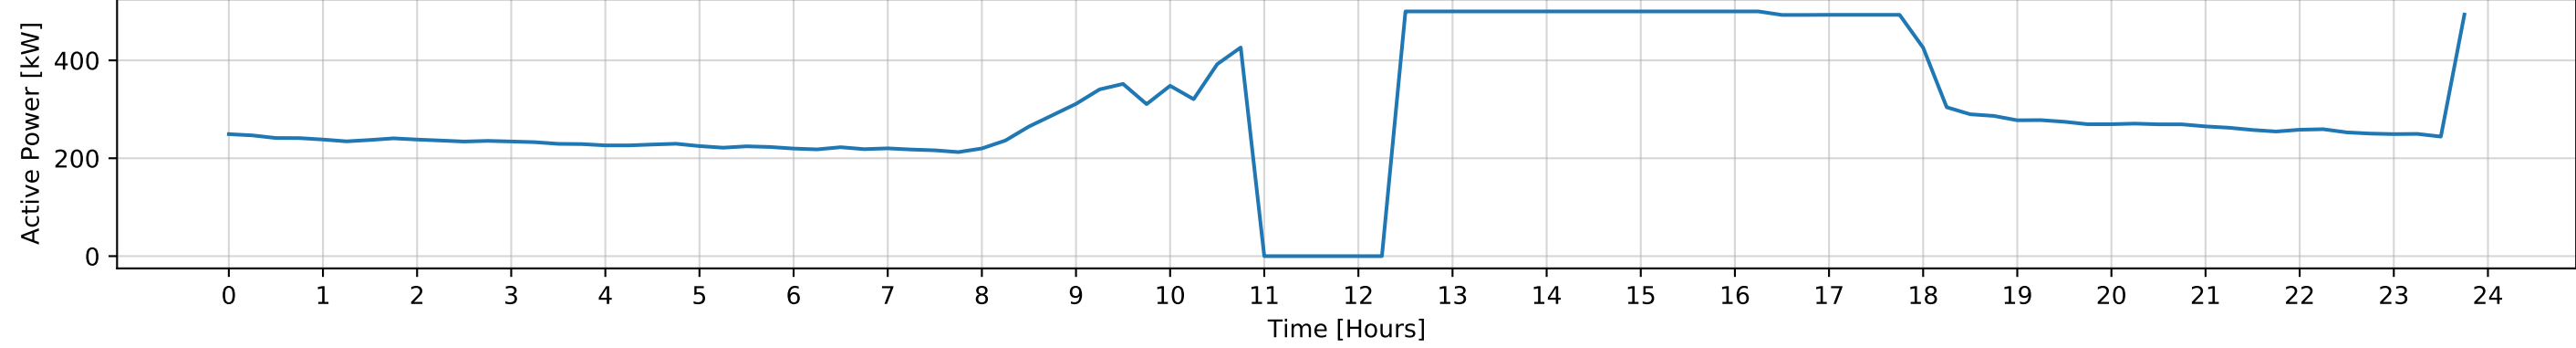


Commercial-275-bed Hospital - Building Electrical Consumption (January)

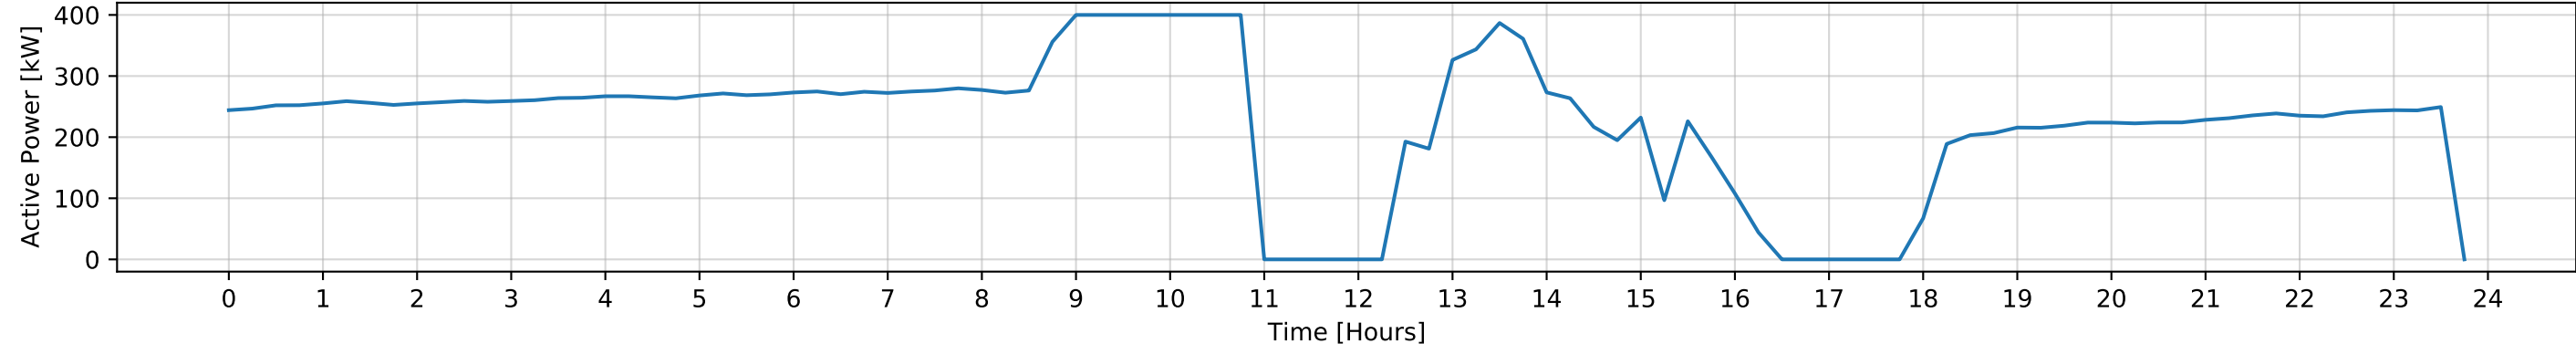


Commercial-275-bed Hospital - Ambient Temperature (January)

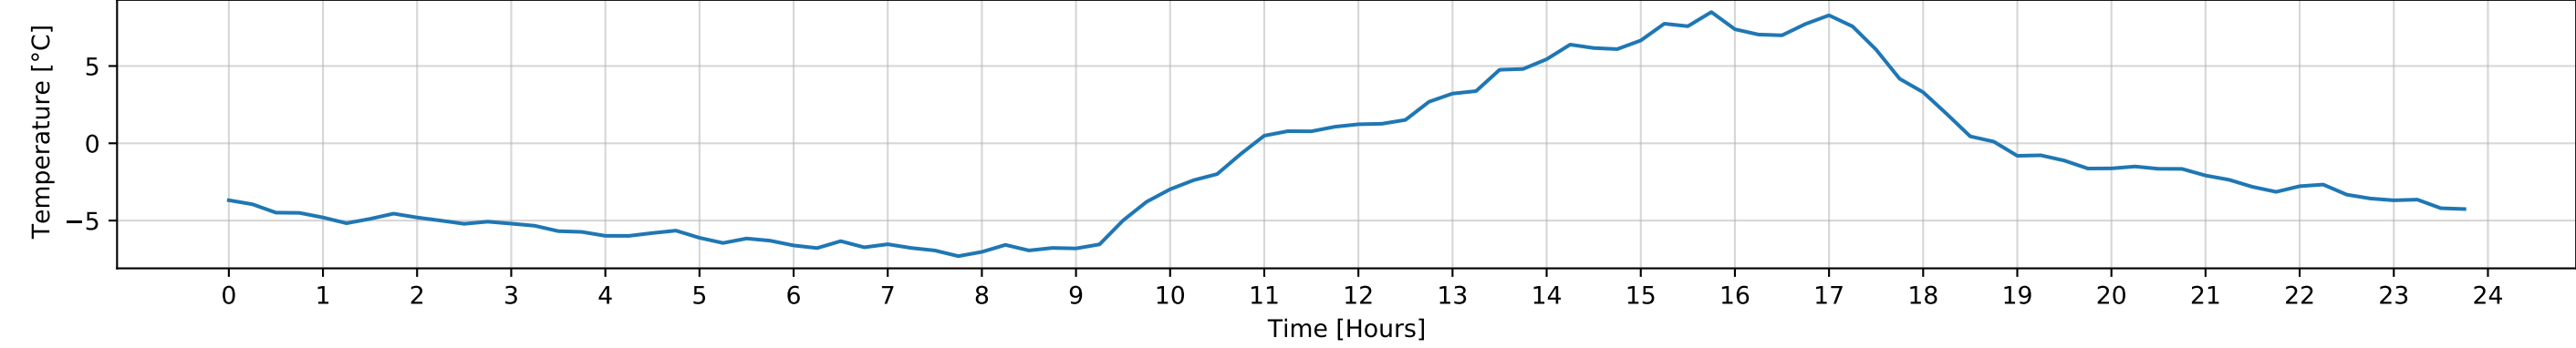


Commercial-275-bed Hospital - Building Internal Temperature (January)

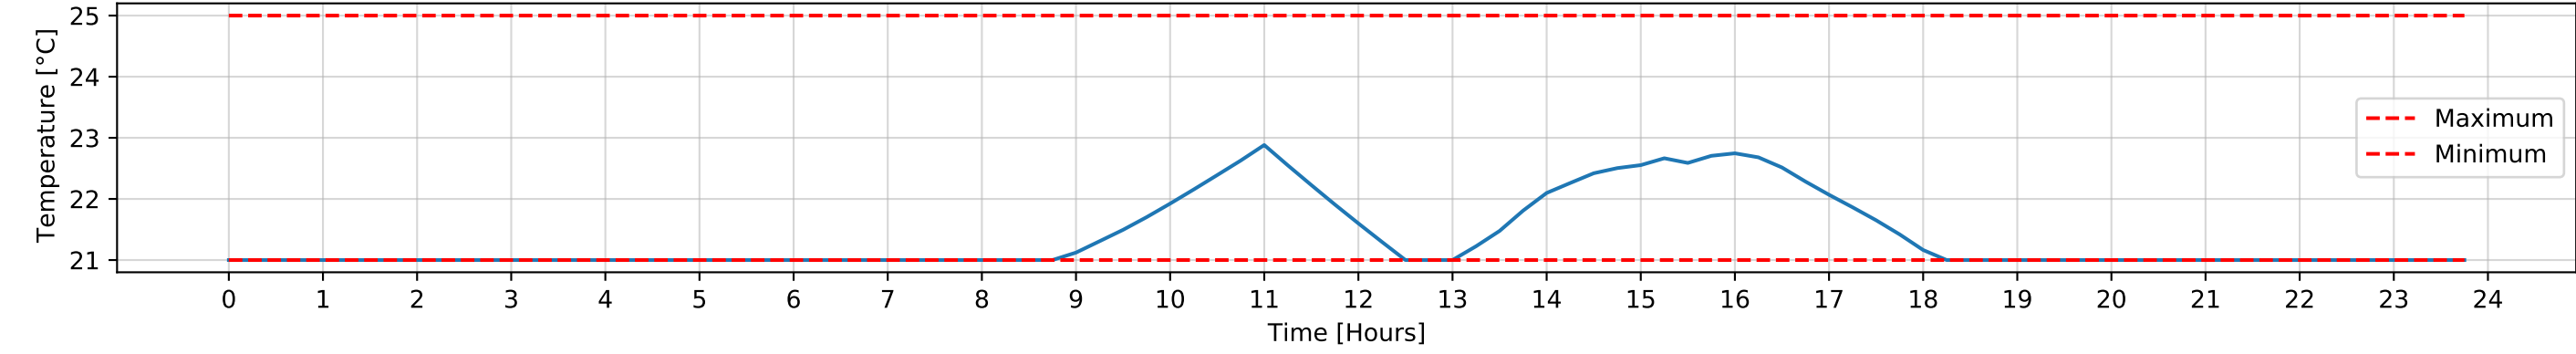


Commercial-275-bed Hospital - HVAC consumption (January)

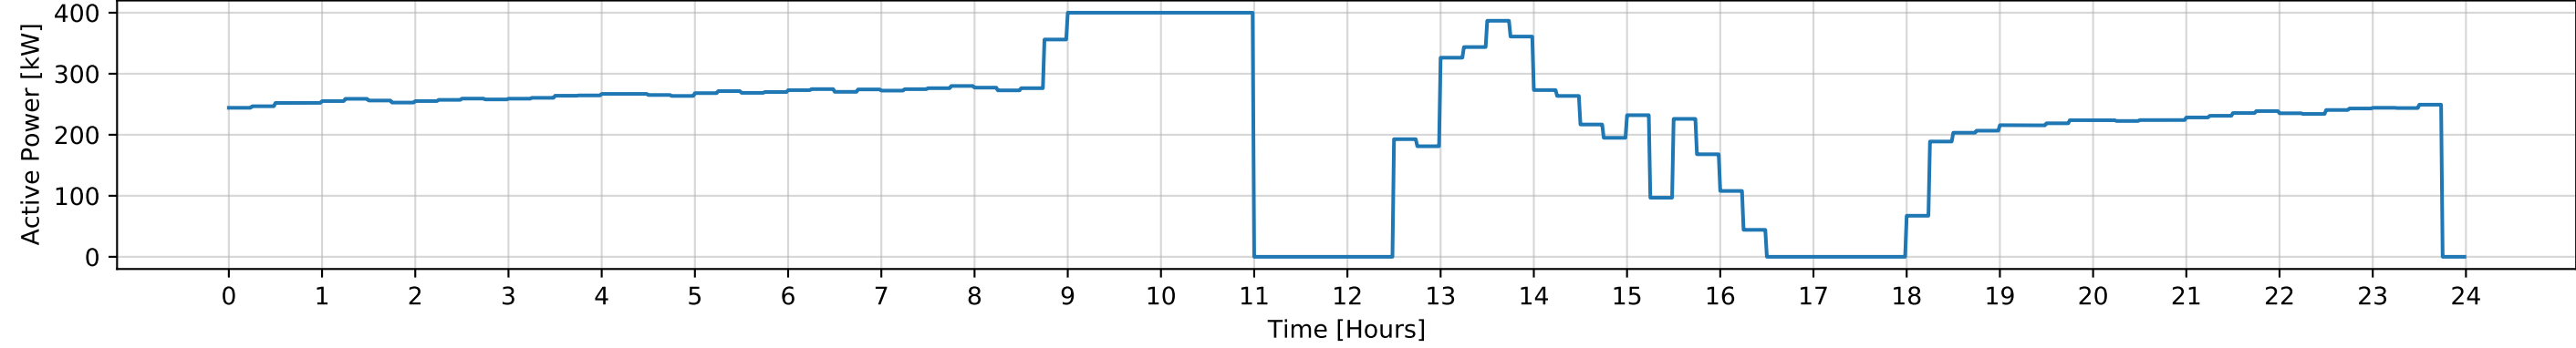

Commercial-275-bed Hospital - Stored Power (January)

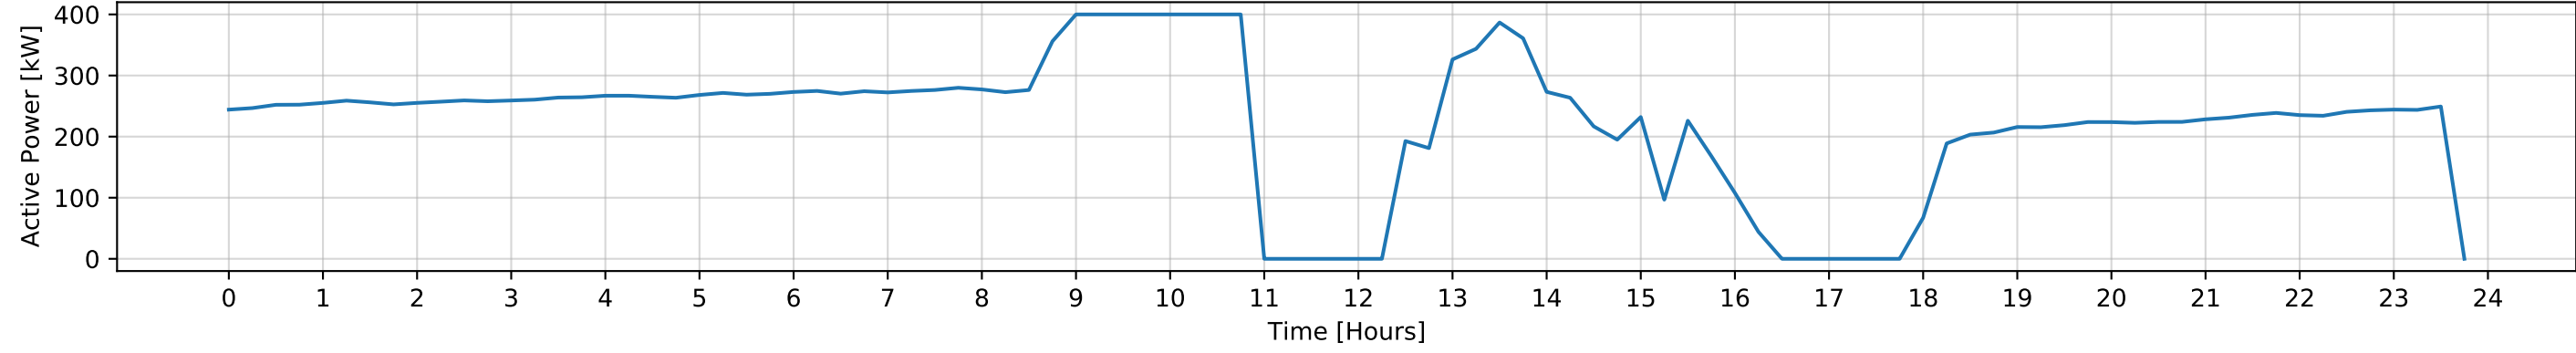

Commercial-275-bed Hospital - Storage Asset System Charged and Discharged Power (January)

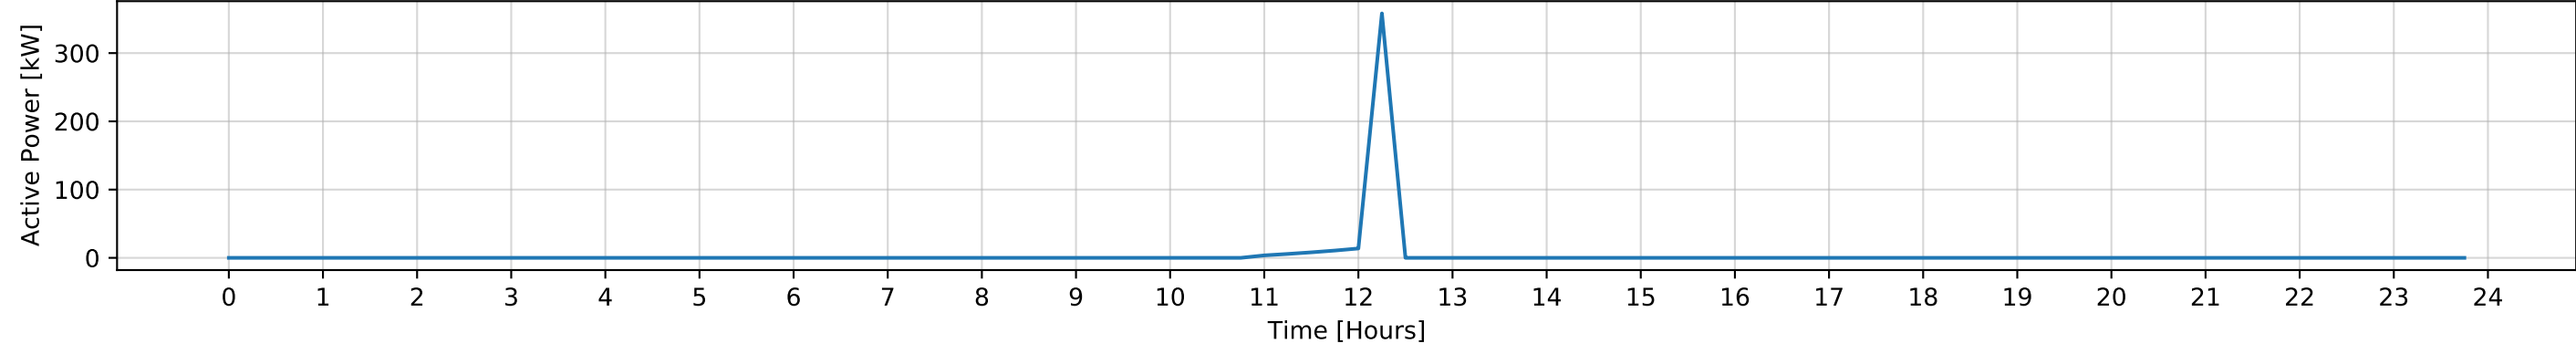

Commercial-275-bed Hospital - Storage Asset Energy Level (January)

