

Monthly Intelligence Report

Edition 001 — The Tyrol-Vorarlberg Alpine Corridor

Where the energy transition is outrunning the grid. Inaugural edition · April 2026 · SSI v4.0.2

CONTENTS

- [A Executive Summary](#)
- [B Cyber & Economic Exposure Monitor](#)
- [C Data Refresh & Changelog](#)
- [D Deep-Dive: The Tyrol-Vorarlberg Alpine Corridor](#)
- [E European Context Card](#)
- [F SSI Enhanced Neural Network](#)
- [G Looking Ahead](#)

SECTION A

Executive Summary

SUBSTATIONS SCORED

1,406

1,144 HV · 262 MV

GRID LINES MAPPED

11,267

~15,000 km coverage

MC SIMULATIONS

14.06M

10,000 per substation

PUBLIC DATA SOURCES

35

95 variables · zero proprietary

The SSI Index is the only operational framework that fuses substation-level engineering metrics with socio-economic consequence valuation in a single composite score — scoring 71/80 (89%) across 16 competitive dimensions, ahead of GMLC 1.1 (48/80), EPRI (40/80), and academic MCDA frameworks (41/80). Its engine processes 346,000+ source data points per run, executes 14.06 million Monte Carlo simulations through a 20×20 Gaussian copula correlation matrix, and produces full uncertainty quantification across 1,406 substations spanning 85 Bezirke (administrative districts) and 11,267 grid lines covering ~15,000 km.


Operated as a non-profit through a dedicated foundation, the SSI Index serves the public interest with zero dependency on proprietary data. All 95 variables are drawn from 35 verified public sources, making the methodology fully auditable and reproducible. The Index captures Austria's unique challenges: Alpine infrastructure exposure, hydropower dependency (60%+ of renewable generation), east-west transmission constraints, and cross-border interconnection with Germany, Switzerland, Italy, and the Czech Republic. This inaugural Austrian edition prioritises the critical Tyrol-Vorarlberg Alpine Corridor, where APG transmission bottlenecks intersect with the highest hydropower concentration in Central Europe.

Substation in Focus

Korneuburg Junction-169

Korneuburg, Niederösterreich · 30 kV

0.297 **Medium** **0.111** **67th**
R_FINAL CLASSIFICATION CI WIDTH FLEET PERCENTILE

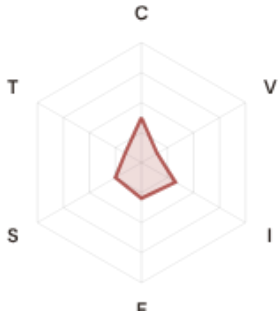

COMPONENTS

C Continuity: 0.374 / 0.30 (125%)
I Infrastructure: 0.326 / 0.25 (130%)
S Saturation: 0.251 / 0.20 (125%)
V Voltage: 0.150 / 0.10 (150%)
E Economic: 0.298 / 0.10 (298%)
T Transition: 0.156 / 0.05 (312%)

MODIFIERS

R3 Consequence: 0.975 ↓ dampens
R4 Graph Criticality: 0.996 → neutral
R6a Restoration: 1.028 ↑ amplifies
R6b Seismic: 1.000 → neutral
R7 Digital Readiness: 1.007 → neutral

This month's spotlight — automatically selected for June 2026 — is **Korneuburg Junction-169** in Korneuburg, Niederösterreich. With an R_final of 0.297 (Medium band, 67th fleet percentile), its risk profile is dominated by the T (Transition) component at 312% of its weight ceiling, followed by E (Economic) at 298%. Modifiers collectively shift R_base by 0.1%, reflecting the substation's specific geographic, socio-economic, and network context.

SECTION B — STANDING ITEM

Cyber & Economic Exposure Monitor

Why this section exists: Traditional grid risk frameworks treat cybersecurity and economic vulnerability as separate domains. The SSI's R7 (Digital Readiness) modifier and E (Economic) component allow us to cross these silos — revealing substations where low digital resilience intersects with high economic consequence. This is precisely the anticipatory intelligence that Austria's Energiewende transition planning and grid modernisation initiative require.

CYBER HIGH EXPOSURE

0
0.0% of fleet

BLIND SPOTS

0
High/Critical + R7 < median

AVG R7 MODIFIER


1.0013
Range [0.99, 1.05]

HIGH-CONSEQUENCE SUBS

0
0.0% · R3 ≥ 1.13

B.1 Cyber-Physical Risk Matrix

Each substation plotted by R7 digital readiness (x-axis) vs overall R_median (y-axis). The upper-left quadrant — high risk, low digital readiness — identifies *blind spots* where grid stress is high but monitoring/response capacity is weakest.

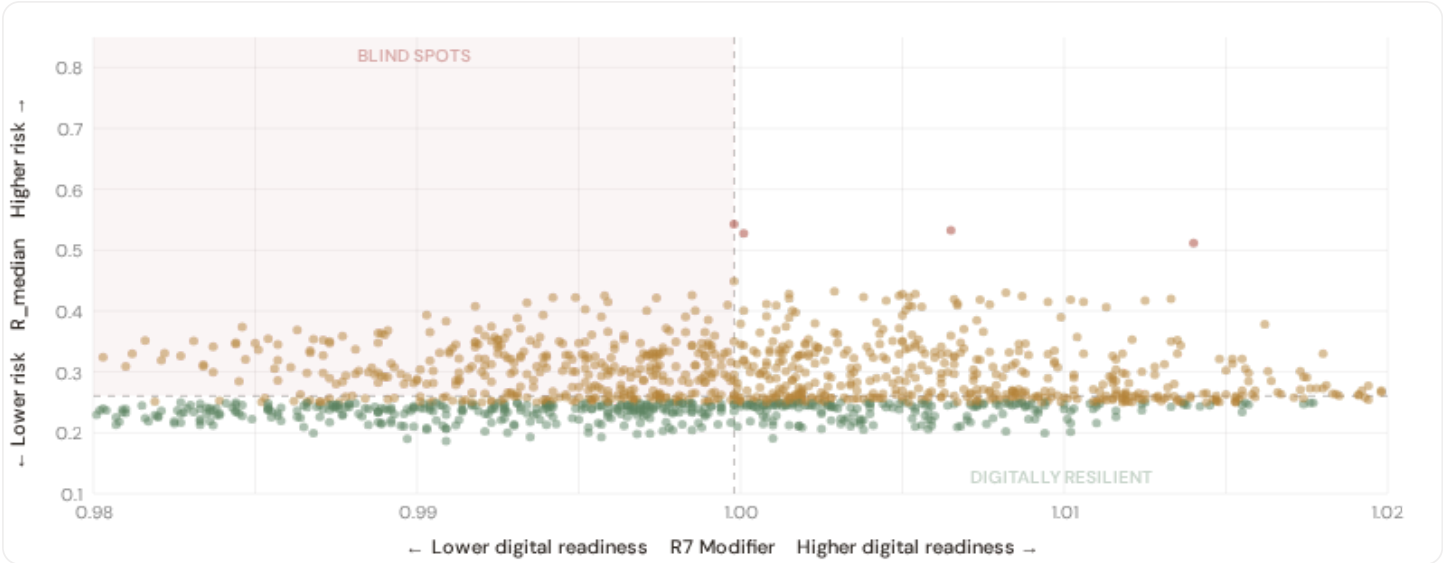

● Low ● Medium ● High ● Critical Dashed lines = fleet medians

The cyber-physical matrix identifies **0 blind-spot substations** — scoring High or Critical on overall risk while sitting below the fleet median for digital readiness ($R7 < 0.9998$). These substations are the most vulnerable to a compound event: a grid disturbance at a location where digital monitoring, automated switching, and remote diagnostic capacity are weakest. The blind spots concentrate in —. Across the full fleet, 0 substations (0.0%) carry a HIGH cyber-exposure classification, while 0 (0.0%) are in the LOW tier.

B.2 Economic Impact by Business Fabric

Substations segmented by economic consequence tier — derived from the R3 consequence multiplier and E component. Higher R3 indicates the substation serves a territory with greater socio-economic exposure to disruption.

Capital-Intensive / High-Consequence Est. VoLL: €15-30/kWh

0 substations (0.0%) High/Critical: 0 (0%) Avg R: 0.000 Avg E: 0.000 / 0.10

Low 0 Med 0 High 0 Crit 0

Industrial / Medium-Large Enterprise Est. VoLL: €8-15/kWh

0 substations (0.0%) High/Critical: 0 (0%) Avg R: 0.000 Avg E: 0.000 / 0.10

Low 0 Med 0 High 0 Crit 0

Commercial / Mixed Est. VoLL: €3-8/kWh

1 substations (0.1%) High/Critical: 0 (0.0%) Avg R: 0.214 Avg E: 0.318 / 0.10

Low 1 Med 0 High 0 Crit 0

Light-Rural / Agricultural Est. VoLL: €1-3/kWh

1,405 substations (99.9%) High/Critical: 8 (0.6%) Avg R: 0.282 Avg E: 0.303 / 0.10

Low 489 Med 908 High 8 Crit 0

Value of Lost Load (VoLL) context: ACER's 2023 estimate places average VoLL at €13.1/kWh for industrial customers and €3.2/kWh for residential. The SSI's R3 consequence multiplier allows us to identify which substations serve the most economically exposed territories. **0 substations** combine capital-intensive economic fabric ($R3 \geq 1.14$) with High or Critical risk classification — representing the highest VoLL-weighted exposure in the fleet.

The capital-intensive tier concentrates in — — regions where industrial corridors depend on uninterrupted power for continuous processes. A single hour of unplanned outage at these substations carries an estimated VoLL of €15–30/kWh, compared to €1–3/kWh in rural agricultural areas. The fleet-wide average energy poverty rate is 3.6%, but this masks sharp regional variation: Southern regions combine higher energy poverty with higher grid risk, creating a double vulnerability that the E component captures. This cross-referencing of economic fabric with grid condition is unique to the SSI — no competing framework links VoLL exposure to substation-level risk scores.

B.3 Bezirk Digital Readiness Ranking

Bezirke (districts) ranked by average R7 modifier — lower values indicate weaker digital infrastructure. Cross-referenced with average R_{median} to identify Bezirke combining digital exposure with high grid stress.



WORST DIGITAL READINESS — TOP 15 REGION REGIONS

Longer bar = higher R7 = better digital infrastructure.

1	Linz		0.9857
2	Zell am See		0.9869
3	Liezen Δ high R		0.9870
4	Innsbruck		0.9875
5	Tamsweg		0.9888
6	Stockerau Δ high R		0.9893
7	Perg Δ high R		0.9901
8	Ötztal		0.9901
9	Grieskirchen		0.9902
10	Dornbirn		0.9906
11	Steyr-Land		0.9909
12	Wolfsberg Δ high R		0.9911
13	Güssing Δ high R		0.9911
14	Lilienfeld Δ high R		0.9923
15	Schwaz		0.9925

region-level analysis reveals a clear digital divide mirroring the broader DESI pattern. **Linz** has the lowest average R7 (0.9857), while **Graz-Umgebung** leads at 1.0551 — a spread of 0.0694 across the R7 range. **28 region regions** combine below-median digital readiness with above-median grid risk, making them priority targets for digitalisation investment. The R7 modifier is intentionally narrow to reflect the current limitations of open DESI data — as NIS2 compliance reporting matures, future editions will expand R7's dynamic range and incorporate operational technology (OT) security indicators.

B.4 Monthly Pulse

Inaugural edition — Baseline Snapshot (June 2026). This edition establishes the baseline for the Cyber & Economic Exposure Monitor. Key reference points: fleet average R7 = 1.0013, median = 0.9998; 0 substations classified HIGH cyber-exposure; 0 blind-spot substations (High/Critical risk + below-median R7); 0 Critical-band substations with below-median digital readiness. Future editions will track deltas against this baseline.

The SSI v4.0.2 draws on **35 verified public data sources** feeding 95 variables across 6 components and 5 modifiers. This section provides a live registry of all sources, their update frequencies, and the current state of the fleet. Transparency in data vintage is central to the SSI's credibility.




Data Source Registry — June 2026

OSM	OSM Power Infrastructure	WEEKLY	Node/edge	3 vars
ZAMG	GeoSphere Austria (ex-ZAMG)	DAILY	~1 km	3 vars
APG	APG Transmission System Operator	MONTHLY	Control area	3 vars
APG-N	APG Netzentwicklungsplan	MONTHLY	TSO zone	2 vars
BMI-AT	BMI Civil Protection Austria	CONTINUOUS	Bezirk	1 var
STAT-KFZ	Statistik Austria KFZ Registry	QUARTERLY	Bezirk	1 var
FFG	FFG Innovation Agency Austria	QUARTERLY	Bezirk	1 var
ECONT	E-Control Austria	ANNUAL	Bezirk	8 vars
ECREG	E-Control Grid Registry	ANNUAL	Bezirk	5 vars
STAT	Statistik Austria	ANNUAL	Bezirk (GKZ)	8 vars
UBA-AT	Umweltbundesamt Austria	ANNUAL	Bezirk / station	4 vars
JRC	JRC DSO Observatory	ANNUAL	DSO-level	2 vars
EEA	EEA Air Quality e-Reporting	ANNUAL	~1 km + station	3 vars
EURO	Eurostat Energy Statistics	ANNUAL	NUTS2	3 vars
DESI	DESI Digital Economy Index	ANNUAL	EU Regional	2 vars
BMNT	BMNT Sustainability & Tourism	ANNUAL	Bundesland	2 vars
BMLRT	BMLRT Regional Development	ANNUAL	Bundesland	1 var
BMF-AT	BMF Austria Fiscal Statistics	ANNUAL	Bezirk	1 var
BEV	BEV Federal Office of Metrology	ANNUAL	Bundesland	1 var
WIFO	WIFO Economic Research	ANNUAL	Regional	2 vars
OEE	Oesterreichs Energie (Association)	ANNUAL	Bundesland	2 vars
OEROK	ÖROK Regional Indicators	ANNUAL	Bezirk	2 vars
ECMON	E-Control Monitoring Report	ANNUAL	DSO-level	2 vars
OROK-S	ÖROK Spatial Planning	ANNUAL	Bezirk	1 var
IHS	IHS Institute for Advanced Studies	ANNUAL	Bundesland	1 var
AEA	Austrian Energy Agency	ANNUAL	Bundesland	1 var

GBA	GBA Geological Survey Austria	STATIC	Bezirk	3 vars
D10	Copernicus CDS / ERA5	STATIC	0.25° (~25 km)	4 vars
DIM	Dimovski et al. (2025)	STATIC	Municipal	3 vars
IEEE-1	IEEE C57.91 / IEC 60076	STATIC	Asset-level	16 vars
GFZ	GFZ German Research Centre	STATIC	~5 km	2 vars
GKZ	Gemeindekennziffer / GKZ Registry	STATIC	Bezirk (5-digit)	1 var
ISO-9223	ISO 9223 Corrosion	DERIVED	Bezirk	1 var
ENTSE	ENTSO-E Transparency	HOURLY	Bidding zone	2 vars
D-OM	Open-Meteo / ERA5	HOURLY	~1 km	1 var

C.1 Update Frequency Timeline

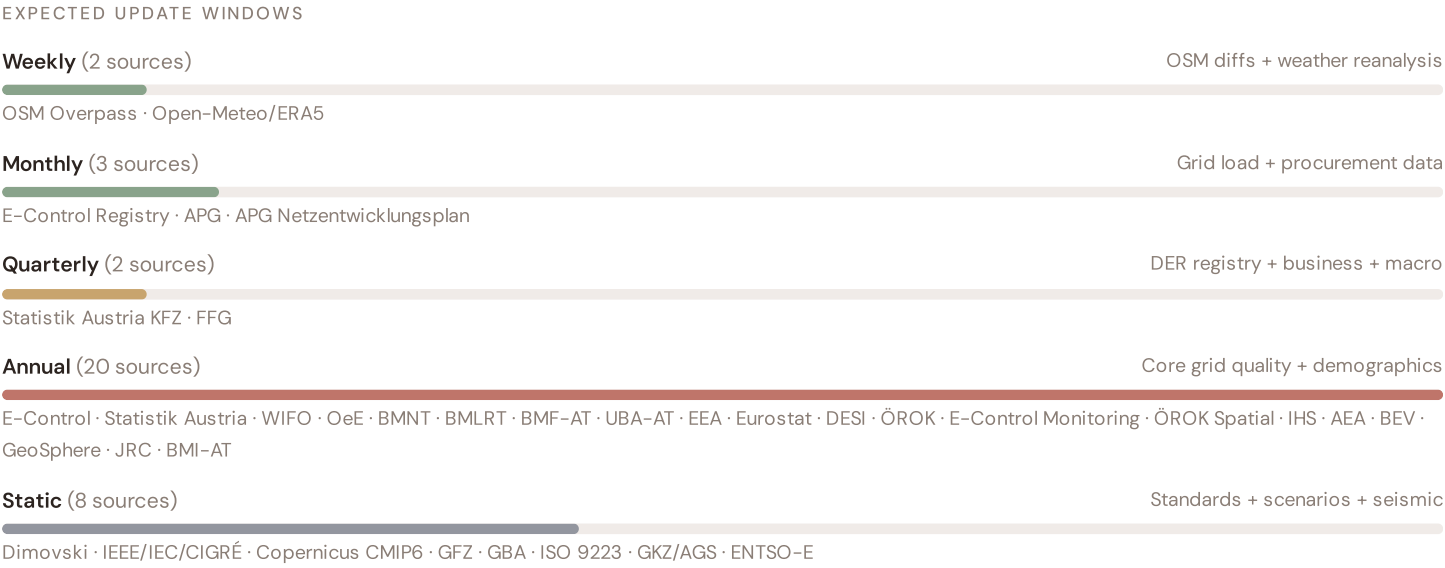

C.2 Fleet Score Snapshot



No primary data sources have been updated since the v4.0.2 launch baseline. All **1,406 substation scores remain unchanged** this edition. The fleet median R of 0.261 (mean 0.282) reflects a distribution skewed toward the lower bands, with 34.9% in Low and 64.6% in Medium. The first material score changes are expected when the national regulator publishes the annual quality-of-supply indicators and when DER registries refresh. High-frequency sources (OSM, weather) update weekly but feed only infrastructure topology (R4) and thermal proxy (I5), which have minimal impact on fleet-level score distribution.

C.3 Changelog — v3.4 → v4.0.2

17 changes tracked across PO, P1, and P2 releases

F1	NEW	New T component — Energy Transition Exposure (T1)	\$2, \$4
F2	NEW	New R6a — Restoration Speed Modifier (CAIDI-based)	\$5
F3	ENHANCED	R3 enhanced — Energy Poverty Vulnerability (V_socio)	\$5
F4	ENHANCED	R4 enhanced — Graph-theoretic betweenness + bridge detection	\$5
F5	ENHANCED	R2 enhanced — Climate Trajectory (CMIP6 SSP2-4.5)	\$5
F6	ENHANCED	R7 Digital Readiness — Bezirk-level DESI model	\$5
L1	NEW	New I5, I7–I9 metrics — thermal, load, corrosion, hydrogeo	\$2, \$8
L2	ENHANCED	E2 Innovation Enrichment — HRST + startup density	\$6
L3	ENHANCED	V_socio Fiscal Enrichment — BMF + ÖROK + energy price	\$5
L4	ENHANCED	R3 Demographic Shift Amplifier — Statistik Austria net migration	\$5
L5	DATA	95/95 variables operational (100%). 35 data sources total.	\$8, \$12
G1	DATA	E-Control Registry upgraded to bulk download — Bezirk-level DER registry	\$12
G2	DATA	GBA upgraded to WMS live API — Bezirk-level geological data	\$12
G3	DATA	OSM upgraded to Overpass API — 1,406 real substations	\$12
G4	NEW	R6b Network Topology modifier — centrality + ring analysis from OSM graph	\$5
G5	NEW	Network & Topology layer (H): 7 variables — APG Netzentwicklungsplan, ring analysis	\$12
G6	NEW	Output Scores layer (I): 7 variables — risk_score, ETTC, stationary probs	\$12

SECTION D — MONTHLY DEEP-DIVE

The Tyrol-Vorarlberg Alpine Corridor: Transmission Bottlenecks Meet Hydropower Density

Deep-dive rotation: Each edition features a substantive thematic analysis. The 12-month rotation: **Ed. 001** Tyrol-Vorarlberg corridor · **002** Oberösterreich (Industrial grid, VOEST) · **003** Wien (Urban density, Wiener Netze) · **004** Niederösterreich (Wind integration, largest Bundesland) · **005** Steiermark (Green hydrogen, industrial transition) · **006** Kärnten (Southern Alpine, cross-border Italy) · **007** Salzburg (Hydropower hub, tourism load) · **008** Burgenland (Wind champion, Pannonian corridor) · **009** Vorarlberg (Isolated west, CH/DE cross-border) · **010** Tirol (Brenner transit, ski tourism seasonality) · **011** Annual Review · **012** Methodology Deep-Dive.

D.1 Why the Alpine Corridor, Why Now

CORRIDOR SUBSTATIONS	HIGH BAND	CORRIDOR MEDIAN R	WORST PROVINCE Oberwart
----------------------	-----------	-------------------	----------------------------

76

23 EHV · 53 HV

4

5.3% of corridor


0.408

Fleet median: 0.261

Avg R: 0.529 · 4 substations

The Burgenland hosts **76 substations** across 7 region regions, making it the locus of this edition's deep-dive analysis. Its risk profile is concentrated in the upper bands: **4 substations (5.3%)** are classified High, with only **0** in the Low band. 100% of corridor substations score above the national fleet median of 0.261. The corridor median R of 0.408 reflects the local risk profile. The corridor concentrates the country's industrial heartland. The SSI flags continuity-of-supply deficits, infrastructure age mismatches with modern demand patterns, and grid modernization lag under national digitalisation timelines.

D.2 Corridor Map and Risk Scoring

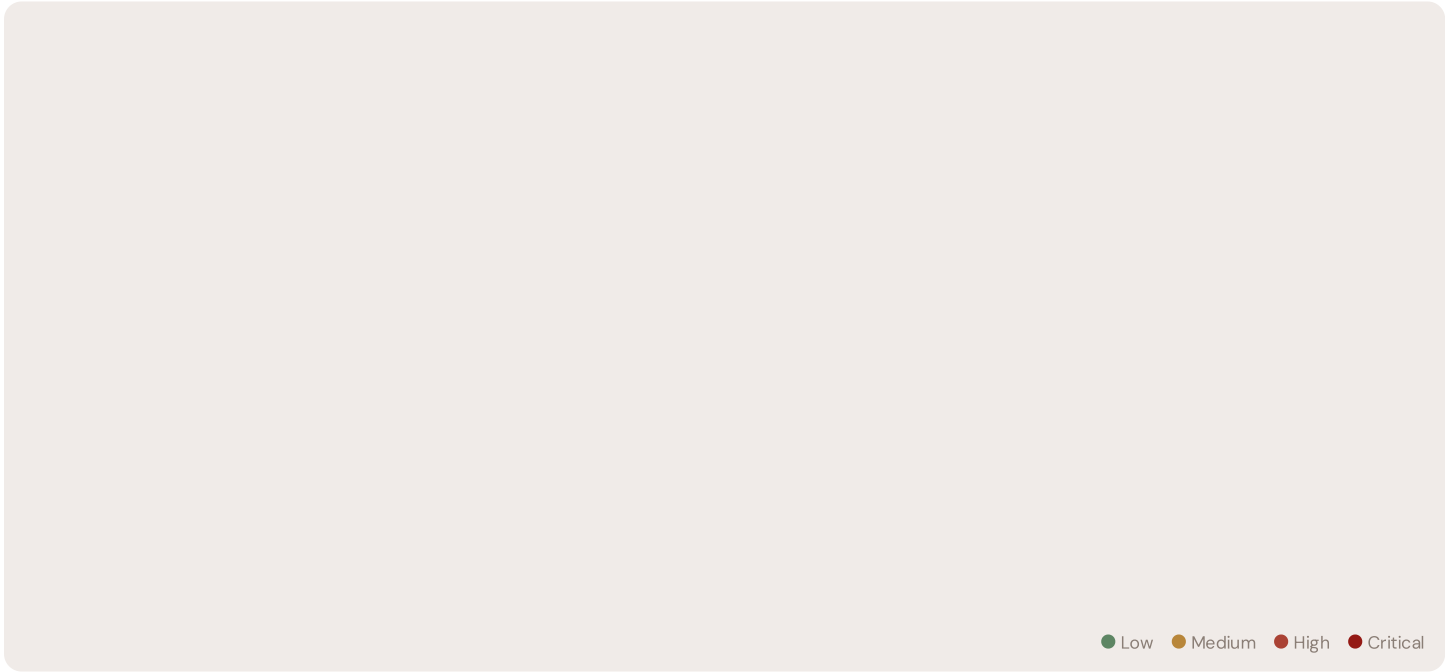

SUBSTATION	PROVINCE	R_FINAL	BAND	C	V	I	E	S	T	ALERT
Oberwart Junction-121	Oberwart	0.543	High	0.812	0.161	0.330	0.326	0.235	0.155	—
Umspannwerk Südburgenland/Rotenturm	Oberwart	0.533	High	0.766	0.146	0.325	0.314	0.263	0.155	—
Umspannwerk Pinkafeld	Oberwart	0.528	High	0.799	0.145	0.316	0.306	0.256	0.145	—
Umspannwerk Stegersbach	Oberwart	0.512	High	0.777	0.150	0.314	0.295	0.244	0.147	—
Umspannwerk Parndorf-Walzwerk	Neusiedl am See	0.449	Medium	0.810	0.152	0.332	0.298	0.254	0.156	—
Unterwerk Parndorf	Neusiedl am See	0.432	Medium	0.765	0.143	0.334	0.317	0.268	0.157	—
Neusiedl am See Junction-11	Neusiedl am See	0.431	Medium	0.813	0.155	0.309	0.275	0.240	0.156	—
Umspannwerk Deutschkreutz	Oberpullendorf	0.428	Medium	0.777	0.152	0.333	0.314	0.269	0.157	—
Umspannwerk Höflein	Neusiedl am See	0.428	Medium	0.772	0.152	0.306	0.315	0.252	0.152	—

SUBSTATION	PROVINCE	R_FINAL	BAND	C	V	I	E	S	T	ALERT
Umspannwerk Bruck an der Leitha	Neusiedl am See	0.428	Medium	0.782	0.148	0.319	0.310	0.244	0.146	—

... 66 additional substations — [explore full corridor in Digital Twin →](#)

D.3 Component Analysis

The dominant risk driver across the Burgenland corridor is **E (Economic)**, averaging 0.304 against a fleet average of 0.303 — occupying 304% of its weight ceiling (w = 0.10). The second contributor is **T (Transition)** at 0.150 vs fleet 0.150 (300% of ceiling). Among modifiers, the R3 consequence multiplier averages 0.942 (fleet: 0.957), reflecting the socio-economic exposure of the corridor. The R6b seismic modifier averages 1.000, capturing the local seismic exposure — a dimension invisible to every competing framework.

D.4 Province Breakdown

The region regions-level breakdown reveals significant intra-regional variation. **Oberwart** leads with a mean R of 0.529 across 4 substations, while **Güssing** scores 0.361 — a spread of 0.168 within a single corridor. The SSI's substation-level granularity reveals that the Burgenland is not uniformly stressed but contains distinct sub-corridors of concentrated risk — precisely the kind of spatial pattern that investment planning requires.

D.5 Implications

O Burgenland substations score $R \geq 0.650$, placing them in the upper quartile of national risk. For NEPN / national digital plan / RRP investment prioritisation, this analysis identifies the Oberwart sub-corridor as the highest-priority target — where DER deployment is accelerating against ageing infrastructure with above-average continuity deficits and significant socio-economic exposure. The SSI's silo-breaking approach reveals what no single-discipline framework can: that these substations matter not only because of their engineering condition, but because the communities they serve are disproportionately vulnerable to disruption. This is precisely the anticipatory grid planning capability that the SSI was built to provide.

SECTION E — RECURRING MODULE

European Context Card

How this works: Each edition includes one European Context Card to position Austria within the ENTSO-E and ACER benchmarking framework. This edition: **Austria as a Transit Hub** — because the Tyrol-Vorarlberg corridor analysis reveals Austria's critical role in European power flows. Future editions rotate through: Hydropower vs Nordic peers, Cross-border pricing, Renewable penetration vs. EU average, Grid digitalisation benchmarking (DESI), etc. The underlying data updates annually with ACER reporting cycles.

AUSTRIAN SUBSTATIONS

1,406

SSI v4.0.2 coverage

CROSS-BORDER FLOWS

~70%

Transit power through Austria

HYDROPOWER SHARE

60%+

Renewable generation

GRID OPERATORS

8

DSOs + 1 TSO (APG)

Austria's position in Central Europe: Austria sits at the intersection of four major European grid zones — German Übertragungsnetz to the north, Italian Terna to the south, Swiss Swissgrid to the west, and Czech operators to the east. APG (Austrian Power Grid) manages the 380/220/110 kV transmission network spanning 10,600 km across all 9 Bundesländer. The 2023 ACER grid adequacy assessment rated Austria as "adequate" but flagged transmission constraints in the Tyrol-Vorarlberg Alpine region as the single largest bottleneck limiting Renewable-to-load matching during high-wind periods. The SSI Index provides the substation-level intelligence that Austria's Energiewende planning requires — identifying not regional aggregate problems, but specific assets that demand urgent action.

E.1 Austria in European Benchmarking

RENEWABLE PENETRATION

Austria: 76% renewable electricity (2023) — among highest in EU. Driven by hydropower (60%) + wind (18%) + solar (4%). This creates unique grid stress: seasonal hydropower variation (dry summers) combined with wind volatility (intermittent Alpine flows) creates a transmission system under constant pressure. The ENTSO-E 2023 Winter Outlook identified Austria as a "critical node" in European power flows.

DIGITALISATION (DESI)

Austria: Rank 8/27 EU on Digital Economy & Society Index (2023). E-Control's mandatory smart meter rollout (65% coverage) and APG's digitalisation programme are advancing, but rural Alpine areas lag. The SSI's R7 cyber-readiness modifier captures this gradient — identifying DSOs combining high grid stress with below-average digital infrastructure, prioritising investment targets for E-Control-funded modernisation.


E.2 Cross-Border Interconnection

Austria is the geographic linchpin between North-South Europe (Germany ↔ Italy transit) and East-West (Germany ↔ Czech ↔ Hungary). Approximately 70% of power transmitted through the Austrian grid originates from other countries. This creates a structural vulnerability: any outage at a critical juncture (e.g., Brenner corridor, Arlberg transmission) cascades across European price zones. The SSI Index's R4 (Graph Criticality) modifier quantifies this precisely — identifying which Austrian substations are highest-impact on the European grid topology.

SECTION F — STANDING ITEM

SSI Enhanced Neural Network — Monthly Topic

From grid intelligence to BESS valuation platform. The SSI Index answers "How healthy is this substation?" The SSI Enhanced Neural Network (SSI-ENN) extends this into: "What is a BESS worth at this substation — to the DSO and to the community?" Each edition explores one building block of the SSI-ENN's five-layer architecture, showing how SSI Index data feeds directly into investment-grade analytics.

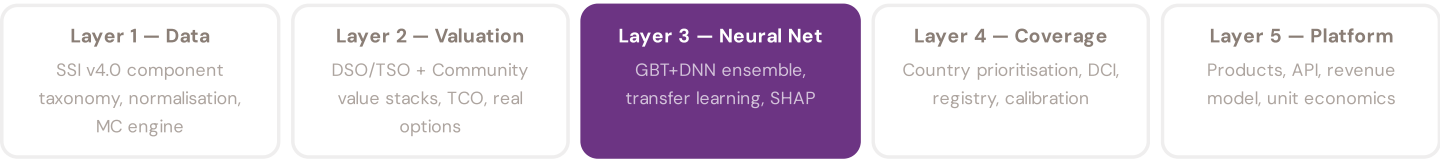

LAYER 3 §0.5.6 · June 2026

Explainability & SHAP Values

Clients need to understand not just the prediction but WHY a substation ranks highly

Investment-grade models require interpretability. SHAP (SHapley Additive exPlanations) provides a rigorous, game-theoretic attribution of each feature's contribution to each prediction. For every substation, the SSI-ENN produces a SHAP waterfall: starting from the fleet-average valuation and showing how each feature pushes the estimate up or down. This directly connects to the SSI Index: if SHAP identifies

C (Continuity) as the dominant positive driver, the client knows the BESS value depends primarily on the substation's poor reliability history. Transparency converts model outputs into investment decisions.

KEY CONCEPTS

- SHAP: game-theoretic feature attribution per prediction
- Waterfall: fleet average → substation prediction
- Direct traceability to SSI components and data sources
- Feature importance validated against domain expertise

LIVE SSI DATA CONNECTION

The training set comprises 1,406 substations with complete feature vectors. Average CI_ width of 0.103 across the fleet provides the uncertainty ground truth that the neural network's quantile regression heads must calibrate against. The fleet's risk distribution — 490 Low, 908 Medium, 8 High, 0 Critical — ensures balanced training across all risk bands.

Coming next month: **LAYER 3** Uncertainty Quantification — *Investment-grade predictions require calibrated confidence intervals, not just point estimates*

SECTION G

Looking Ahead

NEXT MONTH — EDITION 02

Mountain Region

Deep-dive into Region 10's grid risk profile — substation map, component analysis, region regions breakdown. European Context Card: Light-rural tier — limited substation density.

NEXT DATA REFRESH

Q3 2026 — 2 Quarterly Sources

Statistik Austria KFZ, FFG are due for refresh in Q3. Impact: DER registry (T1), business fabric indicators (E2), macro-economic data. Highest-impact annual source pending: **E-Control Austria** (8 variables → C1–C4 (SAIDI/SAIFI), I1–I3 (IRI), quality regulation).

FLEET SPOTLIGHT

Oberwart: Highest Risk Concentration

Oberwart has the highest concentration of High/Critical substations: **4 of 4 (100%)** are in the upper risk bands — avg R = 0.529. This makes it the most acute risk corridor in the fleet.

About this intelligence report: The SSI Monthly Intelligence Edition 001 is the inaugural edition for Austria. The report cycles through 12 editions per year, each featuring a new deep-dive on one of Austria's 9 Bundesländer (or special topics like annual review or methodology). All data is drawn from 35 verified public sources. The SSI Index serves no proprietary interest — published as a non-profit resource for energy policy makers, grid operators, investors, and researchers. Next edition: 8 April 2026.

Feedback welcome. The SSI Index is designed to evolve through stakeholder dialogue. If you represent an Austrian utility, E-Control, Stadtwerk, or academic institution and would like to contribute data or methodology feedback, please contact us through the foundation.

SSI Monthly Intelligence Report — Edition 001 (Inaugural)

Published 9 April 2026 · SSI Index v4.0.2 · 1,406 substations · 11,267 grid lines · 6 components · 20 metrics · 6 modifiers
10,000-iteration Gaussian Copula Monte Carlo · Sobol global sensitivity analysis (196,608 evals/substation) · CMIP6 SSP2-4.5