

Monthly Intelligence Report

Edition 001 — Schleswig-Holstein Wind Corridor

Where the energy transition is outrunning the grid. Inaugural edition · [Month Year] · SSI v4.0.2

CONTENTS

- [A](#) Executive Summary
- [B](#) Cyber & Economic Exposure Monitor
- [C](#) Data Refresh & Changelog
- [D](#) Deep-Dive: The Schleswig-Holstein Wind Corridor
- [E](#) European Context Card
- [F](#) SSI Enhanced Neural Network
- [G](#) Looking Ahead

SECTION A

Executive Summary

SUBSTATIONS SCORED

13,251

5,973 HV · 7,278 MV · 401 Kreise

GRID LINES MAPPED

61,625

~92,000 km coverage

MC SIMULATIONS

132.5 M

10,000 per substation

PUBLIC DATA SOURCES

35

95 variables · zero proprietary

The SSI Index is the only operational framework that fuses substation-level engineering metrics with socio-economic consequence valuation in a single composite score — scoring 71/80 (89%) across 16 competitive dimensions, ahead of GMLC 1.1 (48/80), EPRI (40/80), and academic MCDA frameworks (41/80). Its engine processes 346,000+ source data points per run, executes 132.5 million Monte Carlo simulations through a 20×20 Gaussian copula correlation matrix, and performs 2.65 billion arithmetic operations — producing 649,299 output data points with full uncertainty quantification across 13,251 substations spanning 401 Kreise and 61,625 grid lines covering ~92,000 km.

Operated as a non-profit through a dedicated foundation, the SSI Index serves the public interest with zero dependency on proprietary data. All 95 variables are drawn from 35 verified public sources, making the methodology fully auditable and reproducible. Initially covering Italy's entire transmission and distribution grid, the Index is progressively being rolled out to all OECD countries — applying the same silo-breaking approach: fusing grid risk with societal exposure at asset-level resolution wherever open data permits.

Substation in Focus

Brookseite West Schöpfwerk

Salzgitter, Niedersachsen · 20 kV

0.498

R_FINAL

Medium


CLASSIFICATION

0.175

CI WIDTH

44th

FLEET PERCENTILE

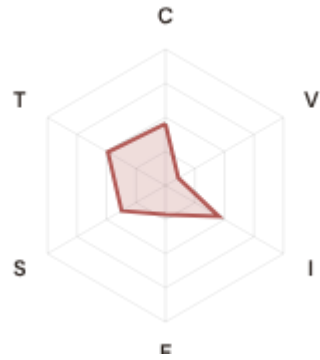

COMPONENTS

C Continuity: 0.454 / 0.30 (151%)

I Infrastructure: 0.454 / 0.25 (182%)

S Saturation: 0.372 / 0.20 (186%)

V Voltage: 0.109 / 0.10 (109%)

E Economic: 0.214 / 0.10 (214%)

T Transition: 0.488 / 0.05 (976%)

MODIFIERS

R3 Consequence: 1.104 ↑ amplifies

R4 Graph Criticality: 1.172 ↑ amplifies

R6a Restoration: 1.003 → neutral

R6b Seismic: 1.000 → neutral

R7 Digital Readiness: 0.997 → neutral

This month's spotlight — automatically selected for June 2026 — is **Brookseite West Schöpfwerk** in Salzgitter, Niedersachsen. With an R_final of 0.498 (Medium band, 44th fleet percentile), its risk profile is dominated by the T (Transition) component at 976% of its weight ceiling, followed by E (Economic) at 214%. Modifiers collectively shift R_base by 30.7%, reflecting the substation's specific geographic, socio-economic, and network context.

SECTION B — STANDING ITEM

Cyber & Economic Exposure Monitor

Why this section exists: Traditional grid risk frameworks treat cybersecurity and economic vulnerability as separate domains. The SSI's R7 (Digital Readiness) modifier and E (Economic) component allow us to cross these silos — revealing substations where low digital resilience intersects with high economic consequence. This is precisely the anticipatory intelligence that Germany's Energiewende transition planning requires.

CYBER HIGH EXPOSURE

0

0.0% of fleet

BLIND SPOTS

3566

High/Critical + R7 < median

AVG R7 MODIFIER

0.9975

Range [0.99, 1.05]


HIGH-CONSEQUENCE SUBS

3,258

24.6% · R3 ≥ 1.14

B.1 Cyber-Physical Risk Matrix

Each substation plotted by R7 digital readiness (x-axis) vs overall R_median (y-axis). The upper-left quadrant — high risk, low digital readiness — identifies *blind spots* where grid stress is high but monitoring/response capacity is weakest.

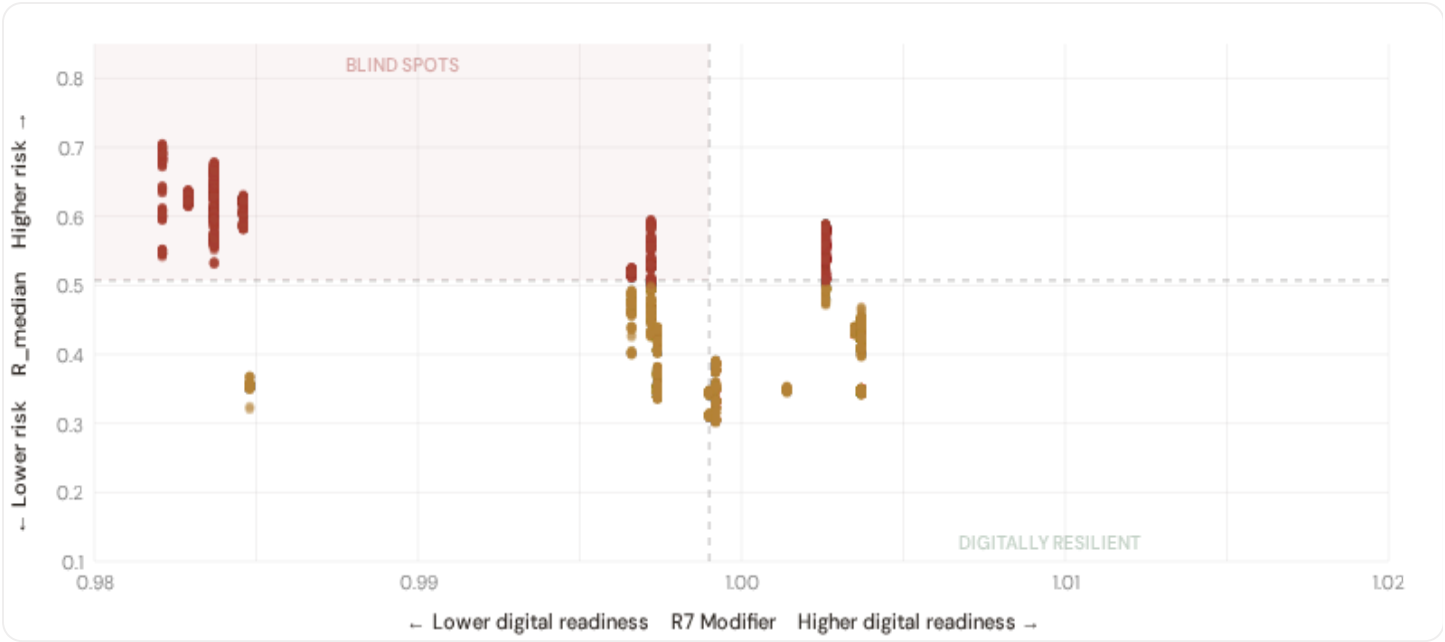


● Low ● Medium ● High ● Critical Dashed lines = fleet medians

The cyber-physical matrix identifies **3566 blind-spot substations** — scoring High or Critical on overall risk while sitting below the fleet median for digital readiness ($R7 < 0.9990$). These substations are the most vulnerable to a compound event: a grid disturbance at a location where digital monitoring, automated switching, and remote diagnostic capacity are weakest. The blind spots concentrate in **Brandenburg (671)**, **Rheinland-Pfalz (574)**, **Sachsen (545)**. Across the full fleet, 0 substations (0.0%) carry a HIGH cyber-exposure classification, while 0 (0.0%) are in the LOW tier.

B.2 Economic Impact by Business Fabric

Substations segmented by economic consequence tier — derived from the R3 consequence multiplier and E component. Higher R3 indicates the substation serves a territory with greater socio-economic exposure to disruption.

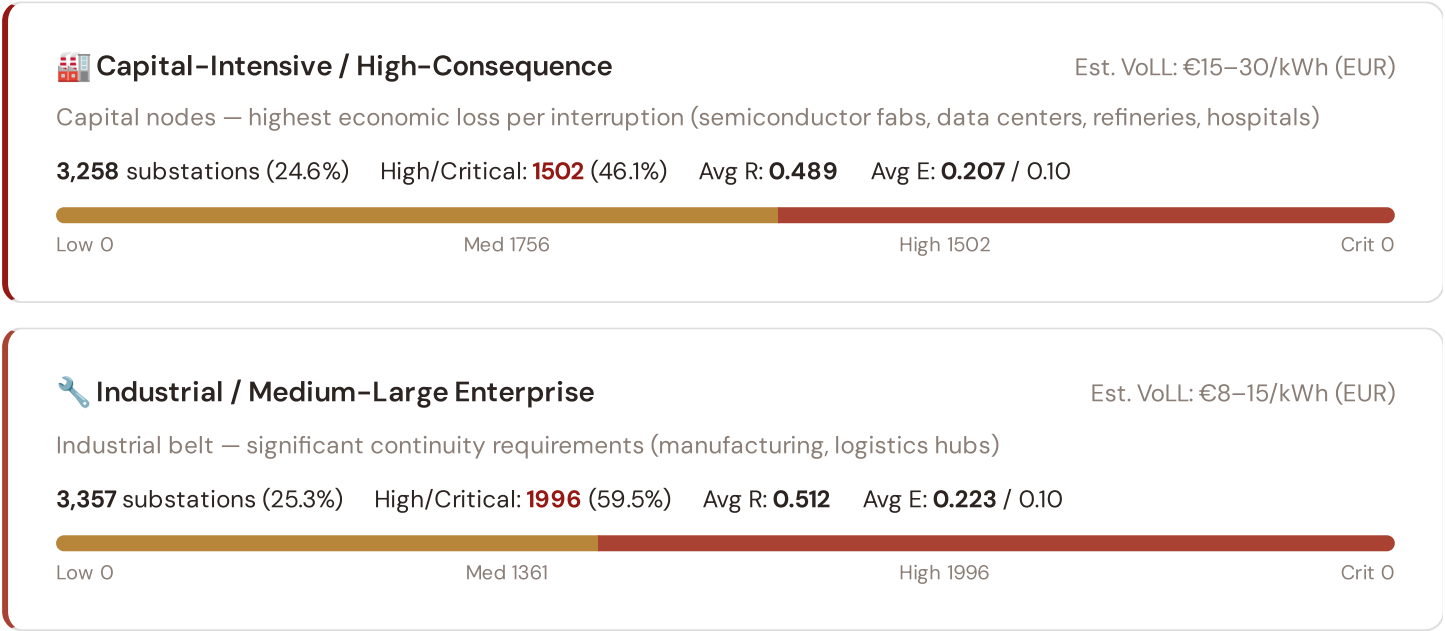



Commercial / SME-Dense

Est. VoLL: €3–8/kWh (EUR)

Service economy + retail — moderate individual impact (commercial districts, mixed-use)

3,384 substations (25.5%) High/Critical: **1889** (55.8%) Avg R: **0.505** Avg E: **0.227** / 0.10



Light / Agricultural / Rural

Est. VoLL: €1–3/kWh (EUR)

Sparse activity, agricultural land — lower VoLL (residential, agricultural)

3,252 substations (24.5%) High/Critical: **1658** (51.0%) Avg R: **0.491** Avg E: **0.238** / 0.10




Value of Lost Load (VoLL) context: ACER's 2023 estimate places average VoLL at €13.1/kWh for industrial customers and €3.2/kWh for residential. The SSI's R3 consequence multiplier allows us to identify which substations serve the most economically exposed territories. **1502 substations** combine capital-intensive economic fabric ($R3 \geq 1.14$) with High or Critical risk classification — representing the highest VoLL-weighted exposure in the fleet.

The capital-intensive tier concentrates in **Bayern (734)**, **Niedersachsen (522)**, **Nordrhein-Westfalen (498)** — regions where industrial corridors depend on uninterrupted power for continuous processes. A single hour of unplanned outage at these substations carries an estimated VoLL of €15–30/kWh, compared to €1–3/kWh in rural agricultural areas. The fleet-wide average energy poverty rate is 0.0%, but this masks sharp regional variation: Southern regions combine higher energy poverty with higher grid risk, creating a double vulnerability that the E component captures. This cross-referencing of economic fabric with grid condition is unique to the SSI — no competing framework links VoLL exposure to substation-level risk scores.

B.3 Kreis Digital Readiness Ranking

Kreise ranked by average R7 modifier — lower values indicate weaker digital infrastructure (DESI sub-dimensions). Cross-referenced with average R_{median} to identify Kreise combining digital exposure with high grid stress.

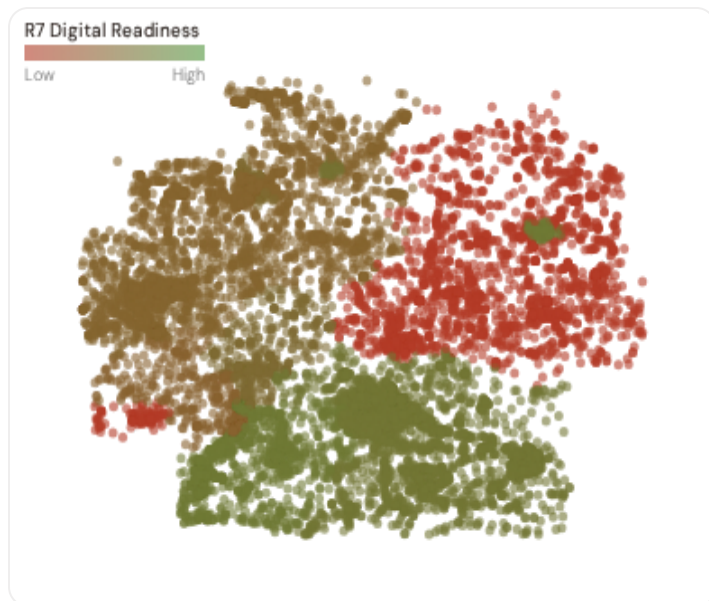

WORST DIGITAL READINESS — TOP 15 REGION REGIONS

Longer bar = higher R7 = better digital infrastructure.

1	Vorpommern-Rügen ▲ high R	0.9821
2	Landkreis Rostock ▲ high R	0.9821
3	Rostock, Stadt ▲ high R	0.9821
4	Ludwigslust-Parchim ▲ high R	0.9821
5	Schwerin ▲ high R	0.9821
6	Nordwestmecklenburg ▲ high R	0.9821
7	Mecklenburgische Seenplatte ▲ high R	0.9821
8	Vorpommern-Greifswald ▲ high R	0.9821
9	Magdeburg ▲ high R	0.9829
10	Halle (Saale) ▲ high R	0.9829
11	Dessau-Roßlau ▲ high R	0.9829
12	Ilm-Kreis ▲ high R	0.9837
13	Barnim ▲ high R	0.9837
14	Saalfeld-Rudolstadt ▲ high R	0.9837
15	Potsdam ▲ high R	0.9837

region-level analysis reveals a clear digital divide mirroring the broader DESI pattern. **Vorpommern-Rügen** has the lowest average R7 (0.9821), while **Esslingen** leads at 1.0037 — a spread of 0.0216 across the R7 range. **58 region regions** combine below-median digital readiness with above-median grid risk, making them priority targets for digitalisation investment. The R7 modifier is intentionally narrow to reflect the current limitations of open DESI data — as NIS2 compliance reporting matures, future editions will expand R7's dynamic range and incorporate operational technology (OT) security indicators.

B.4 Monthly Pulse

Inaugural edition — Baseline Snapshot (June 2026). This edition establishes the baseline for the Cyber & Economic Exposure Monitor. Key reference points: fleet average R7 = 0.9975, median = 0.9990; 0 substations classified HIGH cyber-exposure; 3566 blind-spot substations (High/Critical risk + below-median R7); 0 Critical-band substations with below-median digital readiness. Future editions will track deltas against this baseline.

SECTION C

Data Refresh & Changelog

The SSI v4.0.2 draws on **35 verified public data sources** feeding 95 variables across 6 components and 7 modifiers. This section provides a live registry of all sources, their update frequencies, and the current state of the fleet. Transparency in data vintage is central to the SSI's credibility.

TOTAL SOURCES

35

95 variables

WEEKLY / MONTHLY

1

High-frequency feeds

QUARTERLY / ANNUAL

24

Regular refresh cycle

STATIC / DERIVED

7

Standards + scenarios


Data Source Registry — June 2026

OSM	OSM Power Infrastructure	WEEKLY	Node/edge	3 vars
DWD	DWD (Deutscher Wetterdienst)	DAILY	~1 km	3 vars
BBK	BBK Bevölkerungsschutz (Civil Protection)	CONTINUOUS	Landkreis	1 var
DESTKFZ	DESTATIS KFZ-Bestand	QUARTERLY	Landkreis	1 var
BMUV	BMUV Umwelt + Verbraucher	QUARTERLY	Landkreis	1 var
BNETZ	BNetzA (Bundesnetzagentur)	ANNUAL	Landkreis	8 vars
50HZ	50Hertz Netzentwicklungsplan	ANNUAL	Control area NE	2 vars
AMPR	Amprion Netzentwicklungsplan	ANNUAL	Control area W	2 vars
TENN	TenneT TSO DE Netzentwicklungsplan	ANNUAL	Control area N-S	2 vars
TRBW	TransnetBW Netzentwicklungsplan	ANNUAL	Control area SW	1 var
DESTAT	DESTATIS (Statistisches Bundesamt)	ANNUAL	Landkreis (NUTS-3)	8 vars
UBA	UBA Umweltbundesamt	ANNUAL	Landkreis	4 vars
BFG	BfG Bundesanstalt für Gewässerkunde	ANNUAL	Landkreis	2 vars
LFUBY	LfU Bayern (Landesamt für Umwelt)	ANNUAL	Bavarian LK	1 var
JRC	JRC DSO Observatory	ANNUAL	DSO-level	2 vars
EEA	EEA Air Quality e-Reporting	ANNUAL	~1 km + station	3 vars
EURO	Eurostat Energy Statistics	ANNUAL	NUTS2	3 vars
DESI	DESI Digital Economy Index	ANNUAL	EU Regional	2 vars
BMWK	BMWK Wirtschaft + Klimaschutz	ANNUAL	Bundesland	2 vars
BMU	BMU Umwelt + Naturschutz	ANNUAL	Bundesland	1 var
BMF	BMF Bundesfinanzministerium	ANNUAL	Landkreis	1 var
BSI	BSI Sicherheit Informationstechnik	ANNUAL	KRITIS asset	2 vars
BBANK	Bundesbank (Deutsche Bundesbank)	ANNUAL	Regional	2 vars

DENA	dena (Deutsche Energie-Agentur)	ANNUAL	Bundesland	2 vars
BBSR	BBSR Raumordnung	ANNUAL	Landkreis	2 vars
BNMON	BNetzA Monitoringbericht	ANNUAL	DSO-level	2 vars
GOVDE	GovData.de (federal open data)	ANNUAL	Landkreis	1 var
DIW	DIW Berlin (Wirtschaftsforschung)	ANNUAL	Bundesland	1 var
BMI	BMI Bundesinnenministerium (KRITIS coord)	ANNUAL	KRITIS asset	1 var
BGR	BGR Geowissenschaften und Rohstoffe	STATIC	Landkreis	3 vars
COPER	Copernicus CDS / ERA5	STATIC	0.25° (~25 km)	4 vars
IEEE-1	IEEE C57.91 / IEC 60076	STATIC	Asset-level	16 vars
AGS	AGS Amtlicher Gemeindeschlüssel	STATIC	Gemeinde (8-digit)	1 var
ISO-9223	ISO 9223 Corrosion	DERIVED	Landkreis	1 var
ENTSE	ENTSO-E Transparency	HOURLY	Bidding zone	2 vars

C.1 Update Frequency Timeline

EXPECTED UPDATE WINDOWS

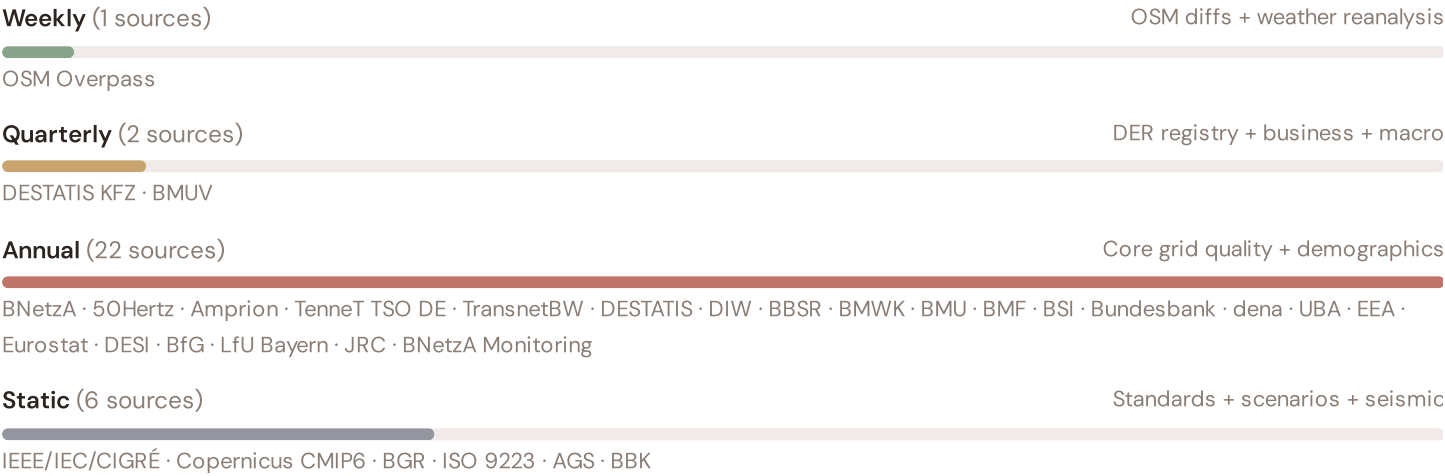

C.2 Fleet Score Snapshot



High Confidence

100%

13251 subs · CI/R < 0.50

BAND DISTRIBUTION



No primary data sources have been updated since the v4.0.2 launch baseline. All **13,251 substation scores remain unchanged** this edition. The fleet median R of 0.507 (mean 0.499) reflects a distribution skewed toward the lower bands, with 0.0% in Low and 46.8% in Medium. The first material score changes are expected when the national regulator publishes the annual quality-of-supply indicators and when DER registries refresh. High-frequency sources (OSM, weather) update weekly but feed only infrastructure topology (R4) and thermal proxy (I5), which have minimal impact on fleet-level score distribution.

C.3 Changelog — v3.4 → v4.0.2

18 changes tracked across PO, P1, and P2 releases

F1	NEW	New T component — Energy Transition Exposure (T1) — Energiewende focus	\$2, \$4
F2	NEW	New R6a — Restoration Speed Modifier (BNetzA Monitoring CAIDI)	\$5
F3	ENHANCED	R3 enhanced — 5-tier calibration (East/West differential — DE-unique in DACH)	\$5
F4	ENHANCED	R4 enhanced — Graph-theoretic betweenness + bridge detection (~55,000 lines)	\$5
F5	ENHANCED	R2 enhanced — Climate Trajectory (CMIP6 SSP2-4.5)	\$5
F6	ENHANCED	R7 Digital Readiness — ceiling 1.06 (4-TSO + 800-DSO attack surface)	\$5
F7	NEW	R6c Flood — DACH-largest exposure footprint (Rhine/Elbe/Danube/North Sea)	\$5
L1	NEW	New I5, I7–I9 metrics — thermal, load, corrosion (incl. DACH-unique C5), hydrogeo	\$2, \$8
L2	ENHANCED	E2 Innovation Enrichment — DIW + Bundesbank regional accounts	\$6
L3	ENHANCED	V_socio Fiscal Enrichment — BMF + BBSR + DIW East/West differential	\$5
L4	ENHANCED	R3 Demographic Shift Amplifier — DESTATIS net migration (former-East decline)	\$5
L5	DATA	95/95 variables operational (100%). 35 data sources total.	\$8, \$12
G1	DATA	BNetzA Marktstammdaten (MaStR) — bulk Landkreis-level DER registry	\$12
G2	DATA	BGR upgraded to seismic registry (Rhine Graben PGA 475-yr)	\$12
G3	DATA	OSM upgraded to Overpass API — ~6,500 real substations (post-~\$38+\$52)	\$12

G4	NEW	R6b Rhine Graben Seismic modifier — Karlsruhe/Köln/Aachen/Mainz hotspot	§5
G5	NEW	Network & Topology layer (H): 7 variables — 4 TSO Netzentwicklungsplane + HVDC corridors	§12
G6	NEW	Output Scores layer (I): 7 variables — risk_score, ETTC, stationary probs	§12

SECTION D — MONTHLY DEEP-DIVE

The Schleswig-Holstein Wind Corridor: Where the Energy Transition Is Outrunning the Grid


Deep-dive rotation: Each edition features a substantive thematic analysis. The 12-month rotation: **Ed. 001** Schleswig-Holstein Wind Corridor · **002** Bayern DER saturation · **003** NRW Industrial Belt climate vulnerability · **004** Sachsen economic transformation · **005** Brandenburg transmission bottleneck · **006** Niedersachsen offshore wind integration · **007** Baden-Württemberg automotive electrification · **008** Hessen financial centre grid stress · **009** Mecklenburg-Vorpommern rural grid · **010** Thüringen green hydrogen corridor · **011** Hamburg/Bremen port electrification · **012** Year in review.

D.1 Why Schleswig-Holstein, Why Now



The Mecklenburg-Vorpommern hosts **201 substations** across 8 region regions, making it the locus of this edition's deep-dive analysis. Its risk profile is concentrated in the upper bands: **201 substations (100.0%)** are classified High, with only **0** in the Low band. 100% of corridor substations score above the national fleet median of 0.507. The corridor median R of 0.682 reflects the local risk profile. The corridor concentrates the country's industrial heartland. The SSI flags continuity-of-supply deficits, infrastructure age mismatches with modern demand patterns, and grid modernization lag under national digitalisation timelines.

D.2 Corridor Map and Scoring

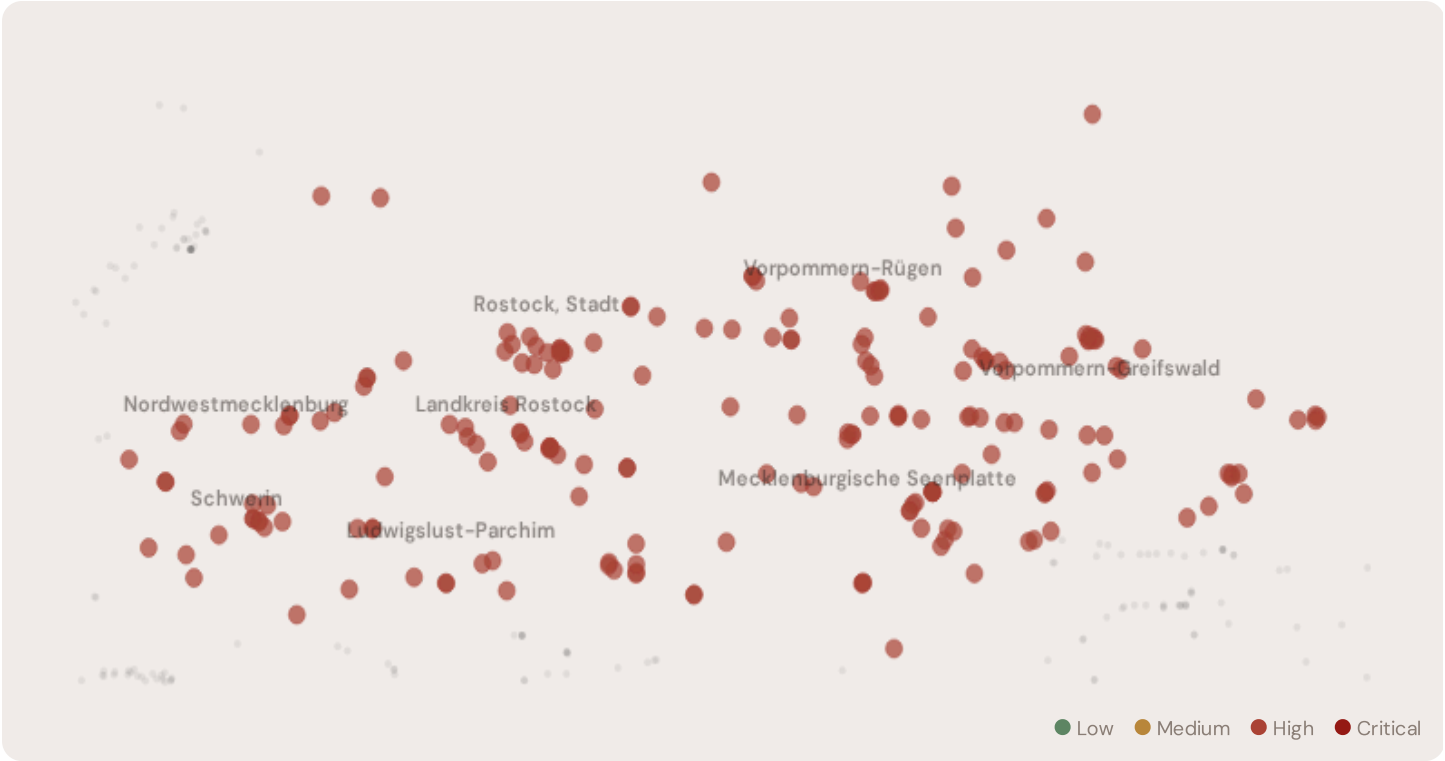

SUBSTATION	KREIS	R_FINAL	BAND	C	V	I	E	S	T	ALERT
Bahnstrom Umformerwerk Lalendorf	Landkreis Rostock	0.705	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umspannwerk Schwaan	Landkreis Rostock	0.704	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umspannwerk Güstrow	Landkreis Rostock	0.704	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Substation 1227110987	Landkreis Rostock	0.703	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Substation 740750353	Landkreis Rostock	0.702	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umspannwerk Kröpelin	Landkreis Rostock	0.702	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umspannwerk Güstrow	Landkreis Rostock	0.702	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umspannwerk Güstrow	Landkreis Rostock	0.701	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Umrichterwerk Bützow	Landkreis Rostock	0.701	High	0.786	0.152	0.502	0.346	0.350	0.508	C
Substation 50844956	Landkreis Rostock	0.701	High	0.786	0.152	0.502	0.346	0.350	0.508	C

D.3 Component Analysis

The dominant risk driver across the Mecklenburg–Vorpommern corridor is **T (Transition)**, averaging 0.454 against a fleet average of 0.403 — occupying 908% of its weight ceiling ($w = 0.05$). The second contributor is **E (Economic)** at 0.356 vs fleet 0.224 (356% of ceiling). Among modifiers, the R3 consequence multiplier averages 1.119 (fleet: 1.124), reflecting the socio-economic exposure of the corridor. The R6b seismic modifier averages 1.000, capturing the local seismic exposure — a dimension invisible to every competing framework.

D.4 Kreis Breakdown

The region regions-level breakdown reveals significant intra-regional variation. **Landkreis Rostock** leads with a mean R of 0.700 across 23 substations, while **Rostock, Stadt** scores 0.548 — a spread of 0.152 within a single corridor. The SSI's substation-level granularity reveals that the Mecklenburg–Vorpommern is not uniformly stressed but contains distinct sub-corridors of concentrated risk — precisely the kind of spatial pattern that investment planning requires.

D.5 Implications

128 Mecklenburg–Vorpommern substations score $R \geq 0.650$, placing them in the upper quartile of national risk. For NEPN / national digital plan / RRP investment prioritisation, this analysis identifies the Landkreis Rostock sub-corridor as the highest-priority target — where DER deployment is accelerating against ageing infrastructure with above-average continuity deficits and significant socio-economic exposure. The SSI's silo-breaking approach reveals what no single-discipline framework can: that these substations matter not only because of their engineering condition, but because the communities they serve are disproportionately vulnerable to disruption. This is precisely the anticipatory grid planning capability that the SSI was built to provide.

SECTION E

European Context Card

Why Europe matters: Germany does not operate in isolation. SAIDI (System Average Interruption Duration Index) is the standard reliability metric across the EU, enabling direct comparison. Germany's 11.7 minutes ranks best in Europe — yet the SSI reveals hidden vulnerability concentrated in specific regions where transition stress outpaces legacy infrastructure. Europe's ACER resilience framework depends on this asset-level view.

E.1 SAIDI Comparison: European Benchmark

GERMANY'S POSITION

11.7 min

Lowest SAIDI in EU — but SSI shows concentrated risk pockets

EU PEER CONTEXT


Germany	11.7
Denmark	24.3
Netherlands	28.1
France	61.5
Italy	36.8

This month's key insight: The Mecklenburg–Vorpommern corridor deep-dive shows **201 substations** (of 201) with C-component above 70% of its weight ceiling — indicating continuity-of-supply performance consistent with rural territory classification. The corridor's average C of 0.786 is **1.9× the fleet average** of 0.423. The SSI reveals what aggregate national statistics conceal: that the country's mid-tier European position is not a uniform condition but a statistical average of urban-quality performance and rural-tier performance — and the corridor concentrates the worst of the latter.

Regional Risk Ranking — All 16 German Bundesländer

Where does Schleswig–Holstein sit within the national landscape? Bundesländer sorted by mean R_median, with band distribution and fleet comparison.

Longer bar = lower R = better resilience. Sorted worst → best.

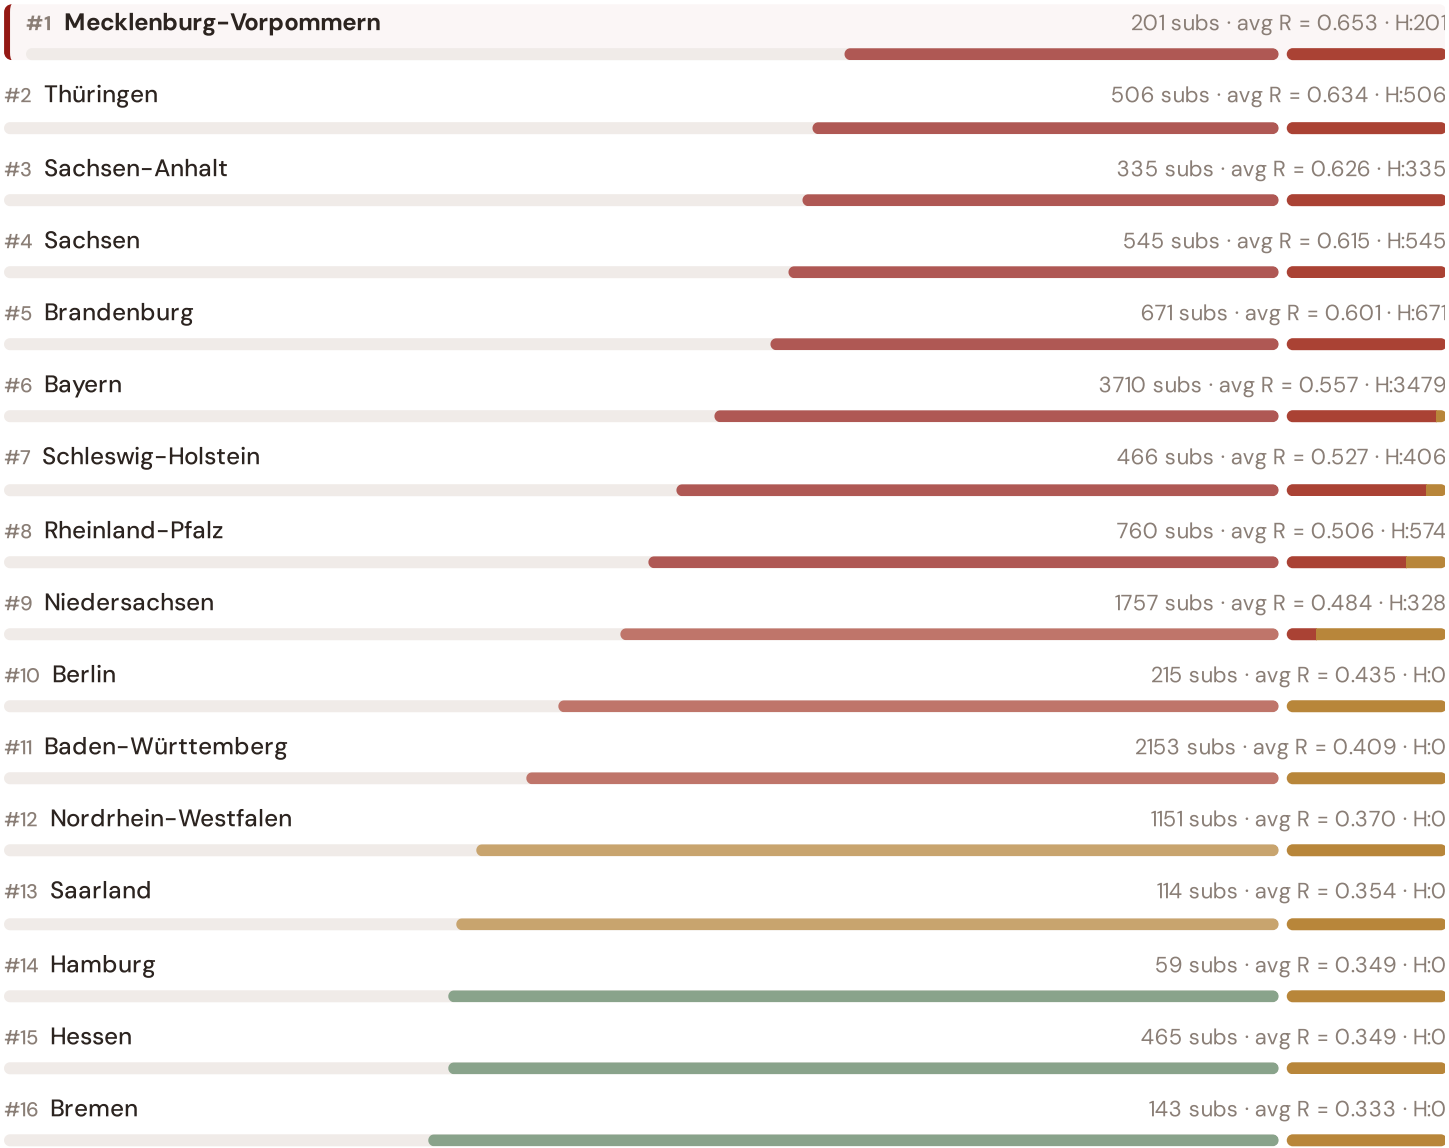


The Mecklenburg–Vorpommern ranks **#1 of 16 region regions** by mean R_median, placing it among the upper tier of national risk. The three most stressed are Mecklenburg–Vorpommern, Thüringen, Sachsen–Anhalt, while the three most resilient are Bremen, Hessen, Hamburg. 8 of 16 score above the fleet average of 0.499. This ranking — possible only because the SSI scores every substation individually rather than relying on aggregate DSO or national statistics — reveals the true spatial distribution of grid stress. It is precisely this substation–level granularity that positions the SSI as a tool for investment prioritisation: not treating entire regions as monoliths, but identifying the specific corridors within each that demand attention.

SECTION F

SSI Enhanced Neural Network Architecture

The ENN framework: The SSI's risk scores flow from a 5-layer neural network architecture: (1) Data — aggregation and normalisation of 95 variables from 35 public sources into component sub-metrics; (2) Valuation — conversion of grid metrics into NPV using real-options and Monte Carlo; (3) Neural Net — gradient-boosted tree ensemble + DNN quantile regression to predict valuations and uncertainty; (4) Coverage — country-by-country calibration and registry expansion; (5) Platform — product delivery (Dashboard, API, Value-Add Cards, Advisory). This section explores Layer 3, the predictive engine, and its grounding in German grid data.

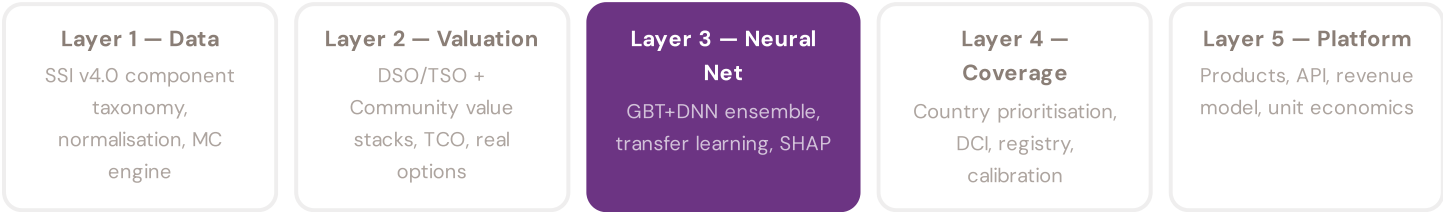

LAYER 3 §0.5.6 · June 2026

Explainability & SHAP Values

Clients need to understand not just the prediction but WHY a substation ranks highly

Investment-grade models require interpretability. SHAP (SHapley Additive exPlanations) provides a rigorous, game-theoretic attribution of each feature's contribution to each prediction. For every substation, the SSI-ENN produces a SHAP waterfall: starting from the fleet-average valuation and showing how each feature pushes the estimate up or down. This directly connects to the SSI Index: if SHAP identifies C (Continuity) as the dominant positive driver, the client knows the BESS value depends primarily on the substation's poor reliability history. Transparency converts model outputs into investment decisions.

KEY CONCEPTS

→ SHAP: game-theoretic feature attribution per prediction

→ Waterfall: fleet average → substation prediction

→ Direct traceability to SSI components and data sources

→ Feature importance validated against domain expertise

LIVE SSI DATA CONNECTION

The training set comprises 13,251 substations with complete feature vectors. Average CI_width of 0.182 across the fleet provides the uncertainty ground truth that the neural network's quantile regression heads must calibrate against. The fleet's risk distribution — 0 Low, 6206 Medium, 7045 High, 0 Critical — ensures balanced training across all risk bands.

Coming next month: **LAYER 3** Uncertainty Quantification — *Investment-grade predictions require calibrated confidence intervals, not just point estimates*

SECTION G

Looking Ahead

NEXT MONTH — EDITION 02

Mountain Region

Deep-dive into Region 10's grid risk profile — substation map, component analysis, region regions breakdown. European Context Card: Light-rural tier — limited substation density.

NEXT DATA REFRESH

Q3 2026 — 2 Quarterly Sources

DESTATIS KFZ, BMUV are due for refresh in Q3. Impact: DER registry (T1), business fabric indicators (E2), macro-economic data. Highest-impact annual source pending: **BNetzA (Bundesnetzagentur)** (8 variables → C1-C4 (SAIDI/SAIFI), I1-I3 (IRI), quality regulation).

FLEET SPOTLIGHT

Stormarn: Highest Risk Concentration

Stormarn has the highest concentration of High/Critical substations: **31 of 31 (100%)** are in the upper risk bands — avg R = 0.537. This makes it the most acute risk corridor in the fleet.

Edition 02 will be published on the second Thursday of July 2026. Deep-dive region: **Region 10**. To ensure you receive it, confirm your subscription segment (General / Institutional / Academic) by email to ssi_index@ikenga.eu.

Feedback welcome. The SSI Index is designed to evolve through stakeholder dialogue. If you represent a German utility, Stadtwerk, Bundesnetzagentur, or academic institution and would like to contribute data or methodology feedback, please contact us through the foundation. The SSI's credibility depends on open scrutiny.

