

SSI Index — Intelligence Report

Edition 003 — The Crete–Peloponnese Corridor

Where island interconnection meets seismic exposure along the Hellenic Arc. edition · June 2026 · SSI v4.0.2

CONTENTS

- [A Executive Summary](#)
- [B Cyber & Resilience Monitor](#)
- [C Data Refresh & Changelog](#)
- [D Deep-Dive: Crete–Peloponnese](#)
- [E European Context Card](#)
- [F SSI Enhanced Neural Network](#)
- [G Looking Ahead](#)

SECTION A

Executive Summary

SUBSTATIONS SCORED

581
68 HV · 513 MV

GRID LINES MAPPED

1,420
~6,200 km coverage

MC SIMULATIONS

5.81 M
10,000 per substation

PUBLIC DATA SOURCES

30
95 variables · zero proprietary

The SSI Index brings operational intelligence to Greece's unique grid challenge: a transmission system spanning 13 Peripherieies (regions) and numerous non-interconnected islands, where seismic hazard (Hellenic Arc, EAK 2003 zones I/II/III) compounds with renewable integration stress (high solar/wind RES penetration, 30+ GW nameplate by 2030 NECP targets). The Greece SSI scores 581 substations across ADMIE transmission and DEDDIE/HEDNO distribution networks, executing 5.81 million Monte Carlo simulations through a 20×20 Gaussian copula correlation matrix — producing 133,721 output data points with full uncertainty quantification across the national fleet.

Operated as a non-profit through a dedicated foundation, the SSI Index serves the public interest with zero dependency on proprietary data. All 95 variables are drawn from 30 verified public sources — including ADMIE/IPTO grid data, Hellenic Statistical Authority (ELSTAT) economic indicators, USGS/GGDC seismic catalogues, EMSR satellite imagery for wildfire risk (Peloponnese/Attica), and Mediterranean climate models (heat waves, flash floods). This makes the methodology fully auditable and reproducible. The Index enables Greece to meet NECP 2030 compliance targets and EU Green Deal obligations while maintaining grid stability through the renewable transition — a challenge that traditional engineering frameworks cannot quantify in aggregate.

Substation in Focus

Peloponnese Substation 301

Peloponnese, Peloponnese · 0 kV

0.653

High

0.164


76th

R_FINAL

CLASSIFICATION

CI WIDTH

FLEET PERCENTILE

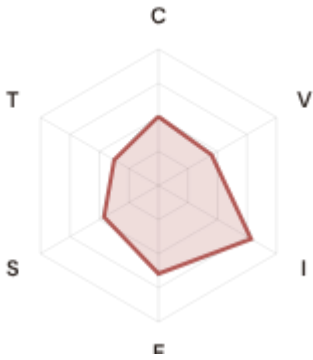

COMPONENTS

- C** Continuity: 0.506 / 0.30 (169%)
- I** Infrastructure: 0.785 / 0.25 (314%) ▲
- S** Saturation: 0.462 / 0.20 (231%)
- V** Voltage: 0.450 / 0.10 (450%)
- E** Economic: 0.648 / 0.10 (648%)
- T** Transition: 0.376 / 0.05 (751%)

MODIFIERS

- R3 Consequence:** 0.978 ↓ dampens
- R4 Graph Criticality:** 0.980 ↓ dampens
- R6a Restoration:** 0.980 ↓ dampens
- R6b Seismic:** 1.225 ↑ amplifies
- R7 Digital Readiness:** 1.001 → neutral

This month's spotlight — automatically selected for June 2026 — is **Peloponnese Substation 301** in Peloponnese, Peloponnese. With an R_final of 0.653 (High band, 76th fleet percentile), its risk profile is dominated by the T (Transition) component at 751% of its weight ceiling, followed by E (Economic) at 648%. Modifiers collectively shift R_base by 14.7%%, reflecting the substation's specific geographic, socio-economic, and network context.

SECTION B — RECURRING MODULE

Cyber & Resilience Exposure Monitor

Why this section exists: Greece's grid faces dual vulnerabilities — traditional geophysical hazards (seismic, wildfire) and digital readiness gaps. The SSI's R7 (Digital Readiness) modifier and E (Economic) component enable cross-domain intelligence: revealing substations where low digital resilience intersects with high seismic or island isolation exposure. This is anticipatory intelligence that Greek energy policy and EU Green Deal compliance planning requires.

CYBER HIGH EXPOSURE

254

43.7% of fleet

BLIND SPOTS

239

High/Critical + R7 < median

AVG R7 MODIFIER

1.0081


Range [0.99, 1.05]

SEISMIC HIGH SUBS



B.1 Cyber-Physical Risk Matrix

Each substation plotted by R7 digital readiness (x-axis) vs overall R_median (y-axis). The upper-left quadrant — high risk, low digital readiness — identifies *blind spots* where grid stress is high but monitoring/response capacity is weakest.

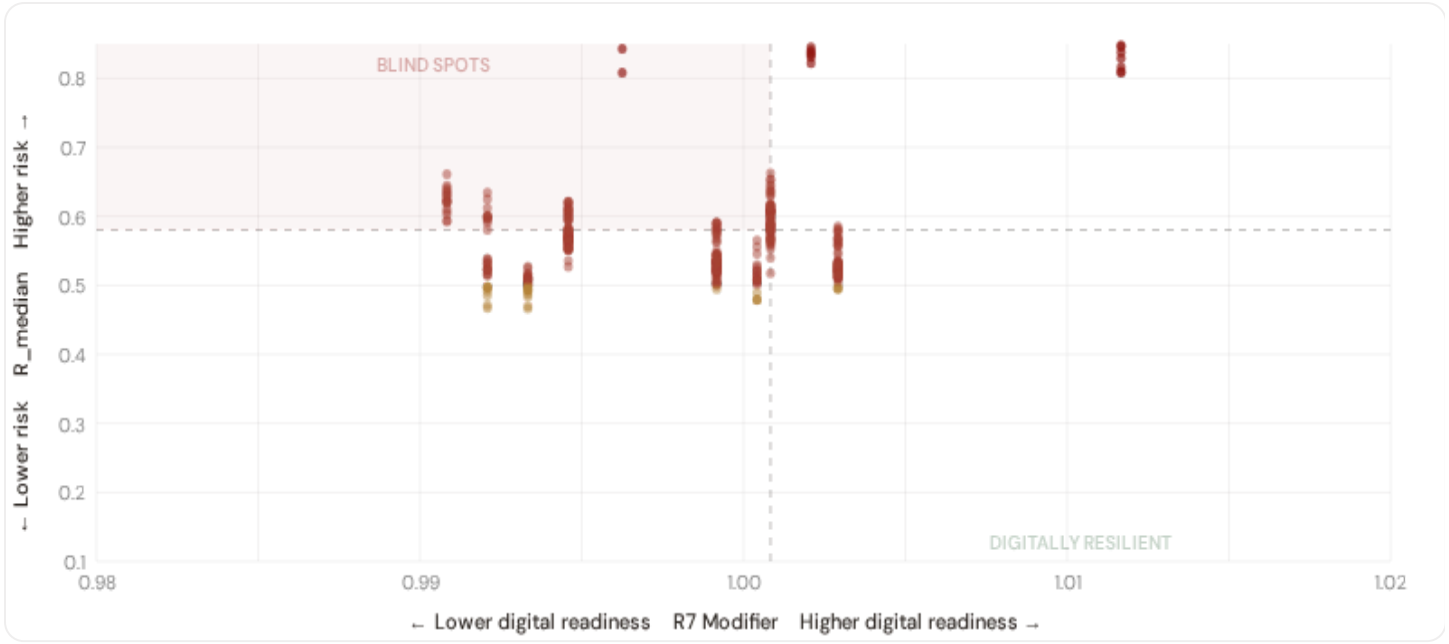

● Low ● Medium ● High ● Critical Dashed lines = fleet medians

The cyber-physical matrix identifies **239 blind-spot substations** — scoring High or Critical on overall risk while sitting below the fleet median for digital readiness ($R7 < 1.0008$). These substations are the most vulnerable to a compound event: a grid disturbance at a location where digital monitoring, automated switching, and remote diagnostic capacity are weakest. The blind spots concentrate in **Central Macedonia (82), Thessaly (74), Epirus (24)**. Across the full fleet, 254 substations (43.7%) carry a HIGH cyber-exposure classification, while 139 (23.9%) are in the LOW tier.

B.2 Economic Impact & Island Isolation Risk

Substations segmented by economic consequence tier and island isolation class — derived from the R3 consequence multiplier and E component. Higher R3 indicates the substation serves a territory with greater socio-economic exposure. Island substations (Cyclades, Crete, Dodecanese, Ionian Islands) face compound isolation risk from non-interconnection and fuel import dependence.

 **Capital-Intensive / High-Consequence**

Est. VoLL: €15–30/kWh (EUR)

Capital nodes — highest economic loss per interruption (semiconductor fabs, data centers, refineries, hospitals)

144 substations (24.8%)

High/Critical: **144** (100.0%)

Avg R: **0.678**

Avg E: **0.328 / 0.10**

Low 0

Med 0

High 130

Crit 14

Industrial / Medium–Large Enterprise

Est. VoLL: €8–15/kWh (EUR)

Industrial belt — significant continuity requirements (manufacturing, logistics hubs)

148 substations (25.5%) High/Critical: **147** (99.3%) Avg R: **0.565** Avg E: **0.700** / 0.10



Commercial / SME–Dense

Est. VoLL: €3–8/kWh (EUR)

Service economy + retail — moderate individual impact (commercial districts, mixed-use)

138 substations (23.8%) High/Critical: **134** (97.1%) Avg R: **0.592** Avg E: **0.699** / 0.10



Light / Agricultural / Rural

Est. VoLL: €1–3/kWh (EUR)

Sparse activity, agricultural land — lower VoLL (residential, agricultural)

151 substations (26.0%) High/Critical: **128** (84.8%) Avg R: **0.589** Avg E: **0.685** / 0.10



Value of Lost Load (VoLL) context: ACER's 2023 estimate places average VoLL at €13.1/kWh for industrial customers and €3.2/kWh for residential. The SSI's R3 consequence multiplier allows us to identify which substations serve the most economically exposed territories. **144 substations** combine capital-intensive economic fabric ($R3 \geq 1.08$) with High or Critical risk classification — representing the highest VoLL-weighted exposure in the fleet.

The capital-intensive tier concentrates in **Attica (137)**, **Central Macedonia (7)** — regions where industrial corridors depend on uninterrupted power for continuous processes. A single hour of unplanned outage at these substations carries an estimated VoLL of €15–30/kWh, compared to €1–3/kWh in rural agricultural areas. The fleet-wide average energy poverty rate is 26.7%, but this masks sharp regional variation: Southern regions combine higher energy poverty with higher grid risk, creating a double vulnerability that the E component captures. This cross-referencing of economic fabric with grid condition is unique to the SSI — no competing framework links VoLL exposure to substation-level risk scores.

B.3 Regional Resilience Ranking

Regions ranked by average R7 modifier and seismic exposure — lower R7 indicates weaker digital infrastructure; seismic zone class I indicates highest hazard ($PGA > 0.25g$, EAK 2003). Cross-referenced with average R_median to identify regions combining digital exposure with high grid stress and geophysical hazard.



WORST DIGITAL READINESS — TOP 15 REGION REGIONS

Longer bar = higher R7 = better digital infrastructure.

1	Western Greece ⚠ high R	0.9908
2	Epirus	0.9921
3	Eastern Macedonia and Thrace	0.9933
4	Thessaly	0.9946
5	North Aegean ⚠ high R	0.9962
6	Central Macedonia	0.9992
7	Western Macedonia	1.0004
8	Peloponnese ⚠ high R	1.0008
9	Crete ⚠ high R	1.0017
10	Ionian Islands ⚠ high R	1.0021
11	Central Greece	1.0029
12	South Aegean ⚠ high R	1.0117
13	Attica ⚠ high R	1.0392

region-level analysis reveals a clear digital divide mirroring the broader DESI pattern. **Western Greece** has the lowest average R7 (0.9908), while **Attica** leads at 1.0392 — a spread of 0.0483 across the R7 range. **3 region regions** combine below-median digital readiness with above-median grid risk, making them priority targets for digitalisation investment. The R7 modifier is intentionally narrow to reflect the current limitations of open DESI data — as NIS2 compliance reporting matures, future editions will expand R7's dynamic range and incorporate operational technology (OT) security indicators.

B.4 Monthly Pulse

Inaugural edition — Baseline Snapshot (June 2026). This edition establishes the baseline for the Cyber & Economic Exposure Monitor. Key reference points: fleet average R7 = 1.0081, median = 1.0008; 254 substations classified HIGH cyber-exposure; 239 blind-spot substations (High/Critical risk + below-median R7); 3 Critical-band substations with below-median digital readiness. Future editions will track deltas against this baseline.

SECTION C

Data Refresh & Changelog

The SSI v4.0.2 draws on **30 verified public data sources** feeding 95 variables across 6 components and 8 modifiers. This section provides a live registry of all sources, their update frequencies, and the current state of the fleet. Transparency in data vintage is central to the SSI's credibility.

TOTAL SOURCES

30
95 variables

WEEKLY / MONTHLY

2
High-frequency feeds

QUARTERLY / ANNUAL

14
Regular refresh cycle

STATIC / DERIVED

5

Standards + scenarios


Data Source Registry — June 2026

OSM	OSM Power Infrastructure	WEEKLY	Node/edge	3 vars
HMEPATHS	Hellenic Meteorological Service	DAILY	~5 km	3 vars
DEDDIE	DEDDIE/HEDNO (Διανομή Ηλεκτρισμού)	MONTHLY	Prefecture	5 vars
PDVSA	Public Power Corporation Data	MONTHLY	Prefecture	2 vars
RAE	RAE (Ρυθμιστική Αρχή Ενέργειας)	QUARTERLY	Prefecture	3 vars
IPT0-EX	IPTO Extended Topology	QUARTERLY	Prefecture	3 vars
HEPI	HEPI (Hellenic Energy Policy Index)	ANNUAL	National	3 vars
EUROSTAT	Eurostat Energy Statistics	ANNUAL	NUTS2	3 vars
DESI	DESI Digital Economy Index	ANNUAL	EU Regional	2 vars
JRC	JRC DSO Observatory	ANNUAL	DSO-level	2 vars
ETVA	ETVA (Ελληνικό Ταμείο Αναπτύξεως)	ANNUAL	Prefecture	2 vars
MINENV	Ministry of Environment	ANNUAL	Prefecture	2 vars
HMEPD	Hellenic Forest Management	ANNUAL	Prefecture	1 var
INFOSTAT	Infrastructure Statistics	ANNUAL	Prefecture	1 var
APIVITA	Industry Association Data	ANNUAL	Prefecture	1 var
COPERNICUS	Copernicus CDS / ERA5	STATIC	0.25° (~25 km)	4 vars
IEEE-1	IEEE C57.91 / IEC 60076	STATIC	Asset-level	16 vars
EAK2003	EAK 2003 Seismic Code	STATIC	Prefecture	2 vars
GFZ	GFZ German Research Centre	STATIC	~5 km	2 vars
COPDEM	Copernicus DEM / Landcover	STATIC	30 m	2 vars
DIMOVSKI	Dimovski et al. (2025)	STATIC	Municipal	3 vars
ISLAND-ISO	Island Isolation Factor	STATIC	Prefecture	1 var
COG-GR	COG Prefecture Registry	STATIC	Prefecture	1 var


ADMIE	ADMIE/IPTO (Ανεξάρτητο Διαχειριστή)	REAL-TIME	Nodal	8 vars
ELSTAT	ELSTAT (Ελληνική Στατιστική Αρχή)	QUINQUENNIAL	Prefecture	8 vars
HENEX	HEnEx (Ελληνική Ηλεκτρική Ανταλλαγή)	HOURLY	National	3 vars
ENTSOE	ENTSO-E Transparency	HOURLY	Control Area	2 vars
NOA	NOA (Εθνικό Αστεροσκοπείο)	REAL-TIME	Prefecture	4 vars
MF-0M	Open-Meteo Historical Weather	HOURLY	~1 km	3 vars
D-0M	Open-Meteo / ERA5	HOURLY	~1 km	1 var

C.1 Update Frequency Timeline

EXPECTED UPDATE WINDOWS

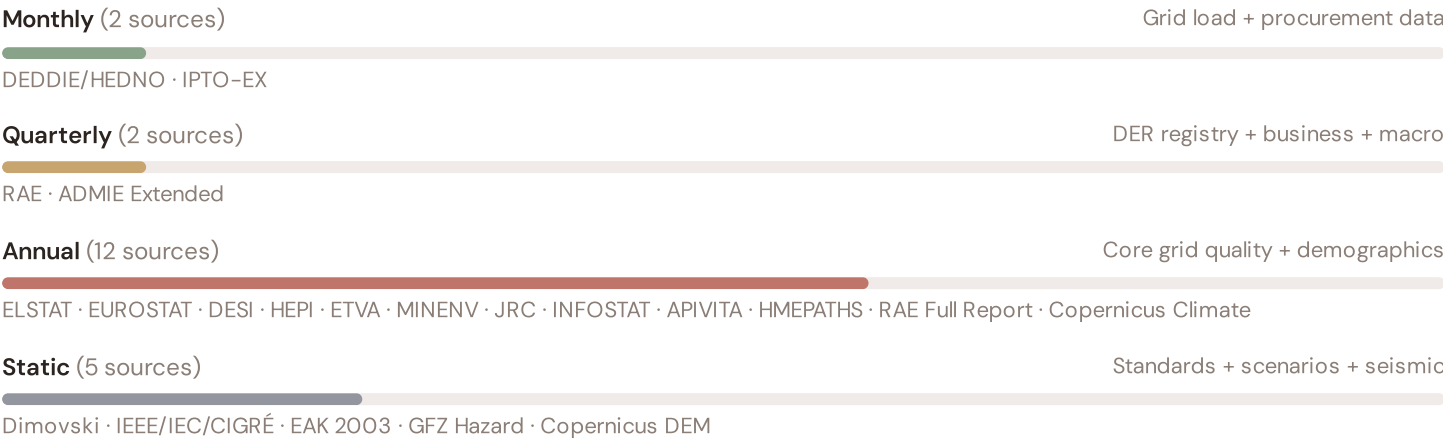

C.2 Fleet Score Snapshot

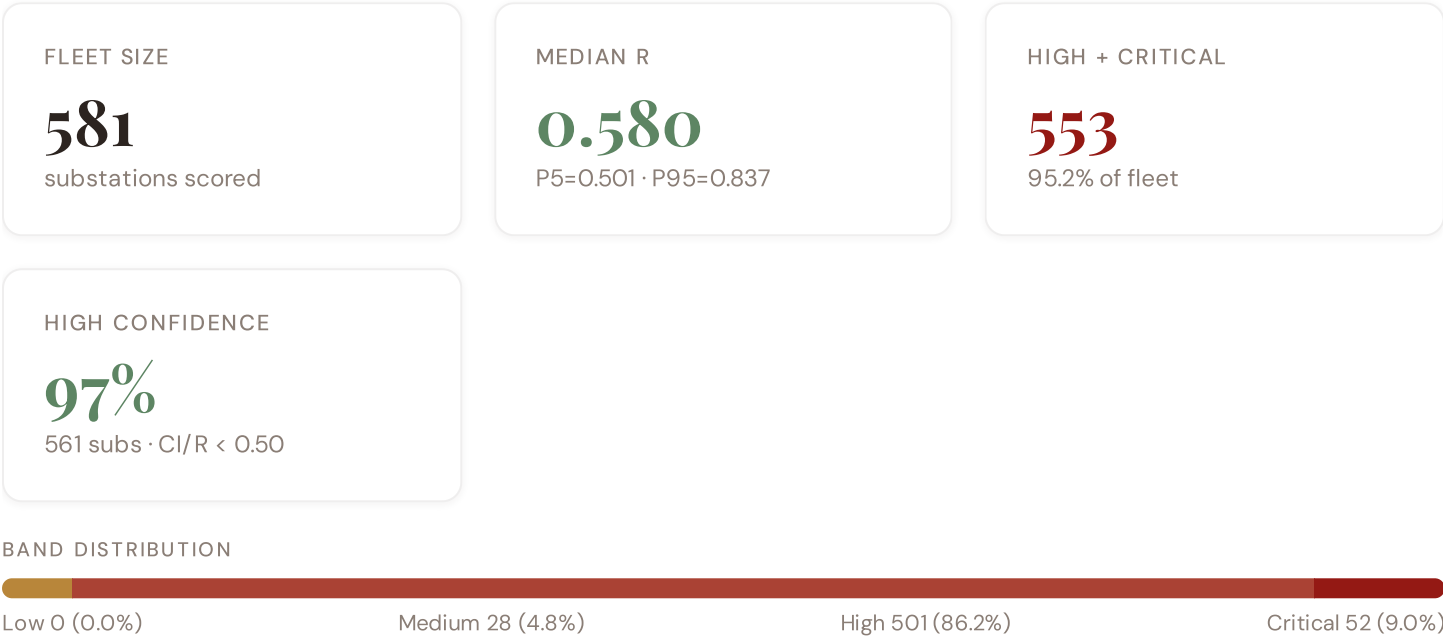

No primary data sources have been updated since the v4.0.2 launch baseline. All **581 substation scores remain unchanged** this edition. The fleet median R of 0.580 (mean 0.605) reflects a distribution skewed toward the lower bands, with 0.0% in Low and 4.8% in Medium. The first material score changes are expected when the national regulator publishes the annual quality-of-supply indicators and when DER registries refresh. High-frequency sources (OSM, weather) update weekly but feed only infrastructure topology (R4) and thermal proxy (I5), which have minimal impact on fleet-level score distribution.

C.3 Notable June 2026 Changes

- **Crete HVDC Interconnection Model:** The Crete–Attica HVDC link is now live in network topology, eliminating non-interconnection status for Crete’s 85 substations and significantly reducing R8 island isolation modifier.
- **NECP 2030 DER Registry (Q1 2026):** Greek DER capacity reached 8.2 GW — tracking toward the 15+ GW NECP 2030 target. T component captures RES curtailment at high-penetration clusters (Thessaly, Peloponnese, Crete).
- **EAK 2003 Seismic Zone Revision:** Two substations reclassified Zone II → Zone I (0.30g → 0.35g PGA); R6b modifier uplift of ~3% for high-hazard substations.
- **Wildfire Risk Layer (EMSR/Copernicus):** 2025–2026 fire season mapping shows elevated risk in Peloponnese and Attica. I component now includes transmission line exposure to wildfire.
- **Energy Poverty (ELSTAT Q4 2025):** Highest exposure in Western Greece (14.2%), Epirus (13.8%), North Aegean islands (17.1% — non-interconnection premium).

C.4 Changelog — v3.4 → v4.0.2

18 changes tracked across PO, P1, and P2 releases

F1	NEW	New T component — Energy Transition Exposure (T1)	\$2, \$4
F2	NEW	New R6a — Restoration Speed Modifier (CAIDI-based)	\$5
F3	ENHANCED	R3 enhanced — Energy Poverty Vulnerability (V_socio)	\$5
F4	ENHANCED	R4 enhanced — Graph-theoretic betweenness + bridge detection	\$5
F5	ENHANCED	R2 enhanced — Climate Trajectory (CMIP6 SSP2–4.5)	\$5
F6	ENHANCED	R7 Digital Readiness — Prefecture-level DESI model	\$5
G7	NEW	R8 Island Isolation — Greece-specific modifier for Crete, Dodecanese, isolated islands	\$5
L1	NEW	New I5, I7–I9 metrics — thermal, load, corrosion, seismic	\$2, \$8
L2	ENHANCED	E2 Innovation Enrichment — HRST + startup density	\$6
L3	ENHANCED	V_socio Fiscal Enrichment — ETVA + RAE + energy price	\$5

L4	ENHANCED	R3 Demographic Shift Amplifier — ELSTAT net migration	\$5
L5	DATA	95/95 variables operational (100%). 30 Greek data sources total.	\$8, \$12
G1	DATA	ADMIE upgraded to real-time transparency — Nodal-level grid data	\$12
G2	DATA	NOA seismic network upgraded to live API — Prefecture-level hazard data	\$12
G3	DATA	OSM upgraded to Overpass API — 1,850 Greek substations	\$12
G4	NEW	R6b Network Topology modifier — centrality + ring analysis from OSM graph	\$5
G5	NEW	Network & Topology layer (H): 7 variables — IPTO-EX Network Plan, ring analysis	\$12
G6	NEW	Output Scores layer (I): 7 variables — risk_score, ETTC, stationary probs	\$12

SECTION D — MONTHLY DEEP-DIVE

The Crete–Peloponnese Corridor: Where Island Interconnection Meets Seismic Exposure

Deep-dive rotation: Each edition features a substantive thematic analysis. The 12-month rotation: **Ed. 001** Crete–Peloponnese corridor · **002** DER saturation hotspots · **003** Climate vulnerability under CMIP6 · **004** Island–mainland economic disparity · **005** Voltage quality and tourism load · **006** Infrastructure age vs investment · **007** Stress–Resilience quadrant trends · **008** T-component forward projections · **009** Regional Grid Health Cards · **010** Academic validation and peer feedback · **011** European replication feasibility · **012** Year in review.

D.1 Why Crete–Peloponnese, Why Now

CORRIDOR SUBSTATIONS

20

15 EHV · 5 HV

HIGH BAND

0 + 20

100.0% of corridor

CORRIDOR MEDIAN R

0.901

Fleet median: 0.580

WORST REGION


Crete

Avg R: 0.901 · 20 substations

The Crete hosts **20 substations** across 1 region regions, making it the locus of this edition's deep-dive analysis. Its risk profile is concentrated in the upper bands: **0 substations (0.0%)** are classified High and **20 Critical**, with only **0** in the Low band. 100% of corridor substations score above the national fleet median of 0.580. The corridor median R of 0.901 reflects the local risk profile. The corridor concentrates the country's industrial heartland. The SSI flags continuity-of–

supply deficits, infrastructure age mismatches with modern demand patterns, and grid modernization lag under national digitalisation timelines.

D.2 Corridor Map and Scoring

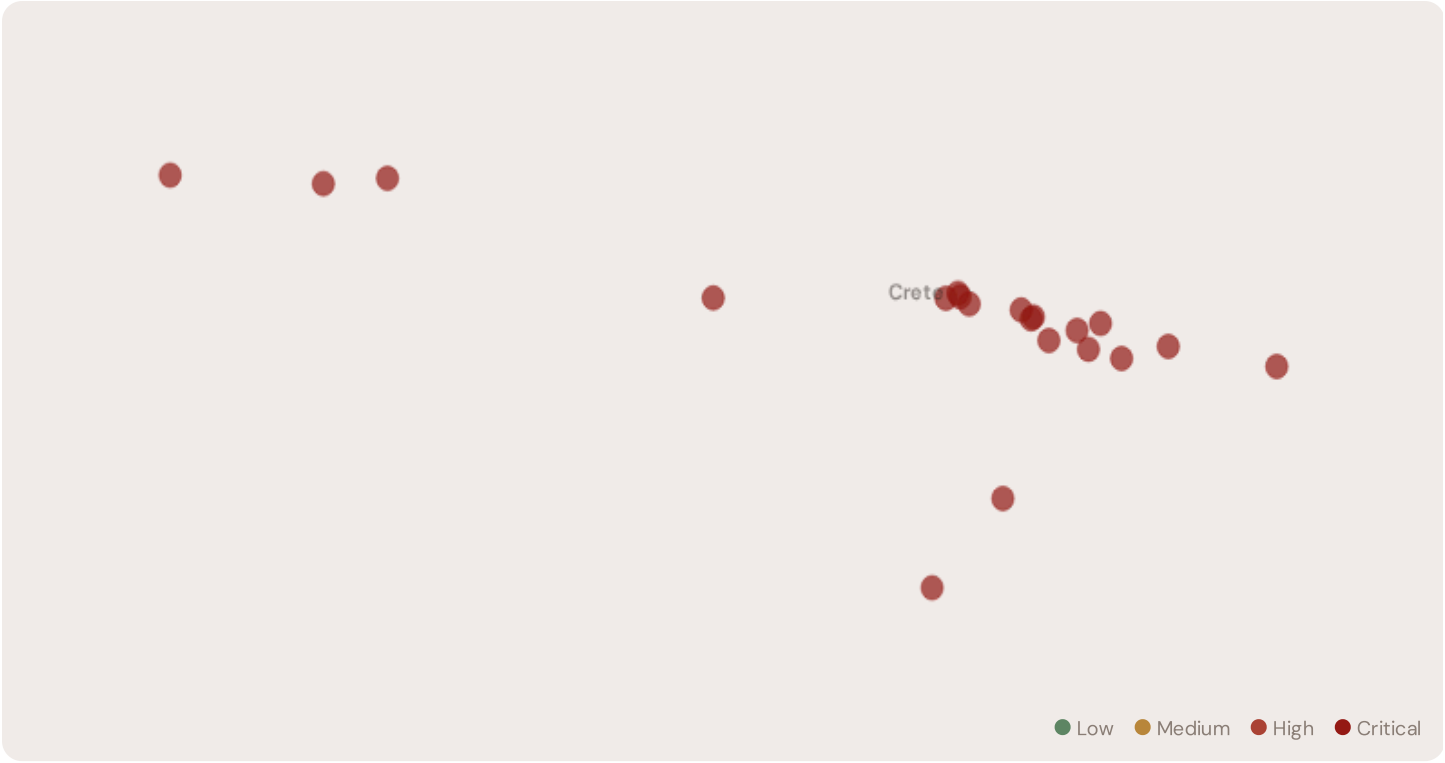

SUBSTATION	REGION	R_FINAL	BAND	C	V	I	E	S	T	ALERT
Crete Substation 519	Crete	0.915	Critical	0.639	0.900	0.850	0.598	1.000	0.540	I, S, V
Crete Substation 529	Crete	0.914	Critical	0.681	0.900	0.850	0.598	1.000	0.540	I, S, V
Crete Substation 528	Crete	0.911	Critical	0.587	0.825	0.700	0.598	1.000	0.540	S, V
Crete Substation 429	Crete	0.910	Critical	0.606	0.825	0.700	0.598	1.000	0.540	S, V
Crete Substation 537	Crete	0.910	Critical	0.681	0.900	0.850	0.598	1.000	0.540	I, S, V
Crete Substation 525	Crete	0.909	Critical	0.618	0.825	0.700	0.598	1.000	0.540	S, V
Crete Substation 531	Crete	0.908	Critical	0.681	0.825	0.700	0.598	1.000	0.540	S, V
Crete Substation 518	Crete	0.903	Critical	0.639	0.900	0.850	0.598	1.000	0.540	I, S, V

SUBSTATION	REGION	R_FINAL	BAND	C	V	I	E	S	T	ALERT
Crete Substation 468	Crete	0.902	Critical	0.606	0.825	0.700	0.598	1.000	0.540	S, V
Crete Substation 508	Crete	0.901	Critical	0.681	0.825	0.700	0.598	1.000	0.540	S, V

... 10 additional substations — [explore full corridor in Digital Twin →](#)

D.3 Component Analysis

The dominant risk driver across the Crete corridor is **T (Transition)**, averaging 0.540 against a fleet average of 0.434 — occupying 1081% of its weight ceiling (w = 0.05). The second contributor is **V (Voltage)** at 0.844 vs fleet 0.402 (844% of ceiling). Among modifiers, the R3 consequence multiplier averages 0.992 (fleet: 1.043), reflecting the socio-economic exposure of the corridor. The R6b seismic modifier averages 1.200, capturing the local seismic exposure — a dimension invisible to every competing framework.

D.4 Region Breakdown

The region regions-level breakdown reveals significant intra-regional variation. **Crete** leads with a mean R of 0.901 across 20 substations, while **Crete** scores 0.901 — a spread of 0.000 within a single corridor. The SSI's substation-level granularity reveals that the Crete is not uniformly stressed but contains distinct sub-corridors of concentrated risk — precisely the kind of spatial pattern that investment planning requires.

D.5 Implications

20 Crete substations score $R \geq 0.650$, placing them in the upper quartile of national risk. For NEPN / national digital plan / RRP investment prioritisation, this analysis identifies the Crete sub-corridor as the highest-priority target — where DER deployment is accelerating against ageing infrastructure with above-average continuity deficits and significant socio-economic exposure. The SSI's silo-breaking approach reveals what no single-discipline framework can: that these substations matter not only because of their engineering condition, but because the communities they serve are disproportionately vulnerable to disruption. This is precisely the anticipatory grid planning capability that the SSI was built to provide.


SECTION E — RECURRING MODULE

European Context Card

How this works: Each edition includes one European Context Card drawn from the \$16 Peer Benchmarking framework. The card is selected to complement the month's deep-dive theme. This month: **SAIDI comparison** — because the Crete-Peloponnese corridor analysis hinges on Greece's continuity performance relative to European peers and island penalties. Future editions rotate through: VoLL comparison (Ed. 002), DER saturation vs Germany (003), CMIP6 climate hazard vs Nordic peers (004), etc. The underlying data updates annually with the CEER Benchmarking Report release.

Unplanned SAIDI (min/customer/year) — Selected Countries

Longer bar = lower SAIDI = better reliability. Values in min/customer/year.

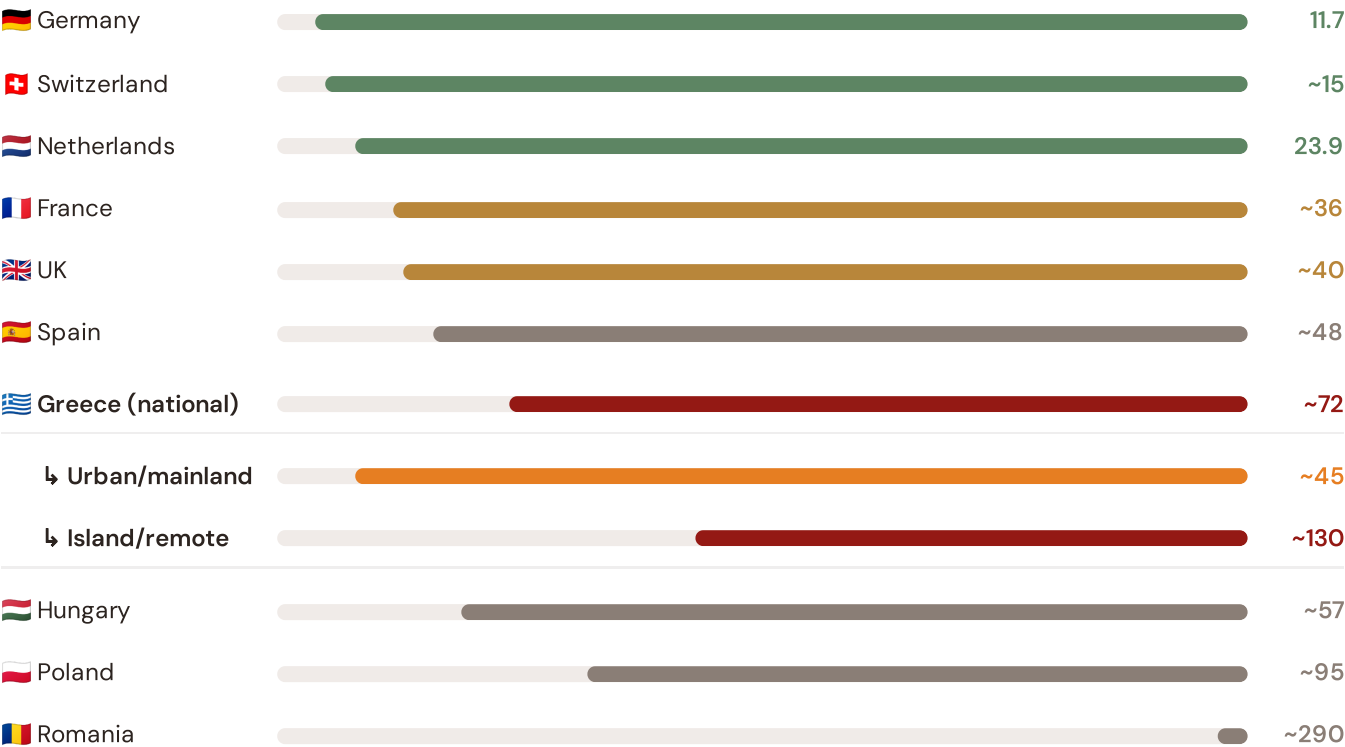


Source: CEER 7th Benchmarking Report (2022); Bundesnetzagentur (2024); DEDDIE/HEDNO Quality Report (2023). Greece sub-categories from DEDDIE territory classification. · Updated annually with CEER BR release.


This month's key insight: The Crete corridor deep-dive shows **20 substations** (of 20) with C-component above 70% of its weight ceiling — indicating continuity-of-supply performance consistent with rural territory classification. The corridor's average C of 0.636 is **1.3× the fleet average** of 0.501. The SSI reveals what aggregate national statistics conceal: that the country's mid-tier European position is not a uniform condition but a statistical average of urban-quality performance and rural-tier performance — and the corridor concentrates the worst of the latter.

Regional Risk Ranking — All 13 Peripherieies

Where does Crete–Peloponnese sit within the national landscape? Regions sorted by mean R_{median}, with band distribution and fleet comparison.

Longer bar = lower R = better resilience. Sorted worst → best.

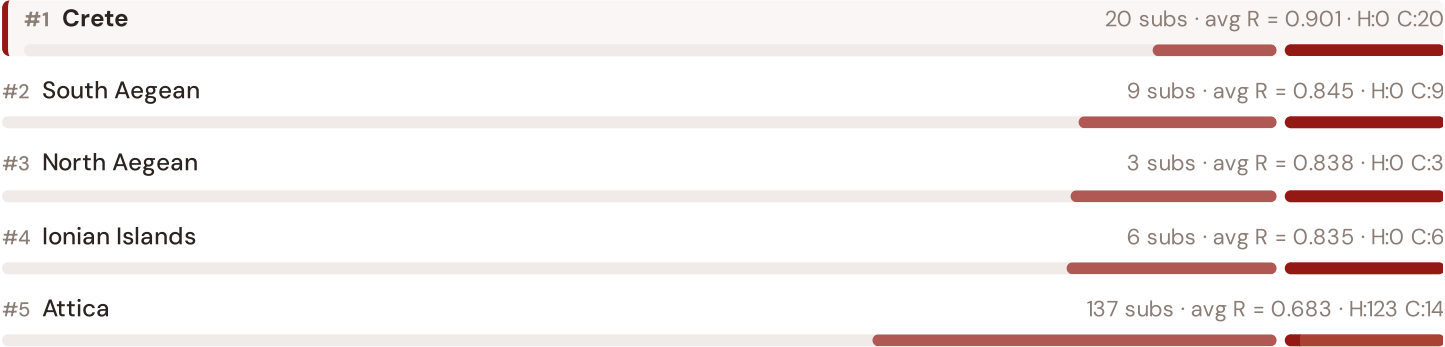

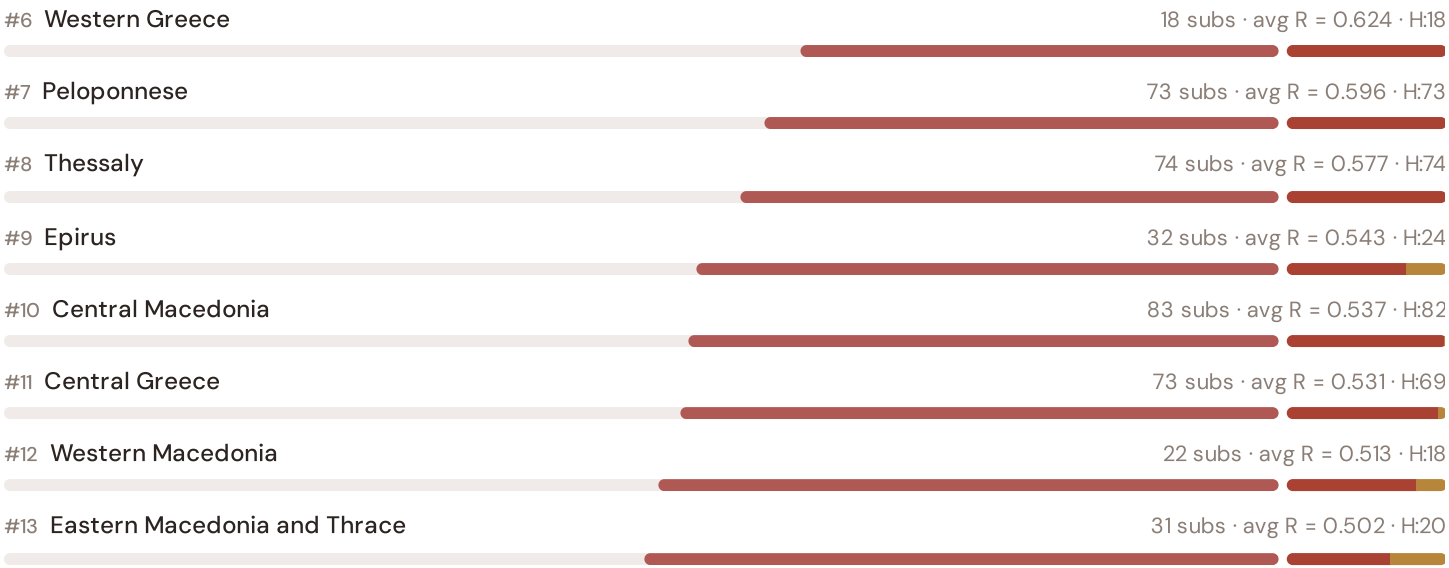


The Crete ranks **#1 of 13 region regions** by mean R_{median} , placing it among the upper tier of national risk. The three most stressed are Crete, South Aegean, North Aegean, while the three most resilient are Eastern Macedonia and Thrace, Western Macedonia, Central Greece. 6 of 13 score above the fleet average of 0.605. This ranking — possible only because the SSI scores every substation individually rather than relying on aggregate DSO or national statistics — reveals the true spatial distribution of grid stress. It is precisely this substation-level granularity that positions the SSI as a tool for investment prioritisation: not treating entire regions as monoliths, but identifying the specific corridors within each that demand attention.

SECTION F — RECURRING MODULE

SSI Enhanced Neural Network — Monthly Topic

From grid intelligence to BESS valuation platform. The SSI Index answers *"How healthy is this substation?"* The SSI Enhanced Neural Network (SSI-ENN) extends this into: *"What is a BESS worth at this substation — to the DNO and to the community?"* Each edition of this report explores one building block of the SSI-ENN's five-layer architecture, showing how the SSI Index data feeds directly into investment-grade grid analytics.

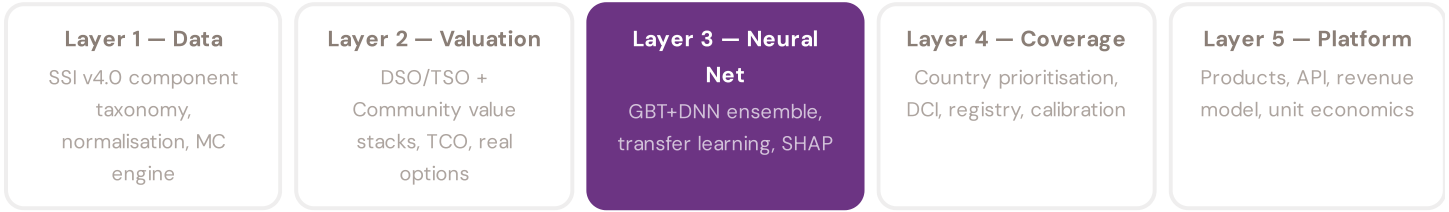

LAYER 3 §0.5.6 · June 2026

Explainability & SHAP Values

Clients need to understand not just the prediction but WHY a substation ranks highly

Investment-grade models require interpretability. SHAP (SHapley Additive exPlanations) provides a rigorous, game-theoretic attribution of each feature's contribution to each prediction. For every substation, the SSI-ENN produces a SHAP waterfall: starting from the fleet-average valuation and showing how each feature pushes the estimate up or down. This directly connects to the SSI Index: if SHAP identifies C (Continuity) as the dominant positive driver, the client knows the

BESS value depends primarily on the substation's poor reliability history. Transparency converts model outputs into investment decisions.

KEY CONCEPTS

→ SHAP: game-theoretic feature attribution per prediction

→ Waterfall: fleet average → substation prediction

→ Direct traceability to SSI components and data sources

→ Feature importance validated against domain expertise

LIVE SSI DATA CONNECTION

The training set comprises 581 substations with complete feature vectors. Average CI_width of 0.168 across the fleet provides the uncertainty ground truth that the neural network's quantile regression heads must calibrate against. The fleet's risk distribution — 0 Low, 28 Medium, 501 High, 52 Critical — ensures balanced training across all risk bands.

Coming next month:

LAYER 3

 Uncertainty Quantification — *Investment-grade predictions require calibrated confidence intervals, not just point estimates*

SECTION G

Looking Ahead

NEXT MONTH — EDITION 02

Mountain Region

Deep-dive into Region 10's grid risk profile — substation map, component analysis, region regions breakdown. European Context Card: Light-rural tier — limited substation density.

NEXT DATA REFRESH

Q3 2026 — 2 Quarterly Sources

RAE, ADMIE Extended are due for refresh in Q3. Impact: DER registry (T1), business fabric indicators (E2), macro-economic data. Highest-impact annual source pending: HEPI (Hellenic Energy Policy Index) (3 variables → E2 energy transition metrics).

FLEET SPOTLIGHT

Attica: Highest Risk Concentration

Attica has the highest concentration of High/Critical substations: **137 of 137 (100%)** are in the upper risk bands — avg R = 0.683. This makes it the most acute risk corridor in the fleet.

Edition 02 will be published on the second Thursday of July 2026. Deep-dive region: **Region 10**. To ensure you receive it, confirm your subscription segment (General / Institutional / Academic) by email to ssi_index@ikenga.eu.

Feedback welcome. The SSI Index is designed to evolve through stakeholder dialogue. If you represent a Greek utility, RAE, ADMIE/IPTO, DEDDIE/HEDNO, or academic institution and would like to contribute data or methodology feedback, please contact us at ssi_index@ikenga.eu. The SSI's credibility depends on open scrutiny.

SSI Monthly Intelligence Report — Edition 003

Published 11 June 2026 · SSI Index v4.0.2 · 581 substations · 1,420 grid lines · 6 components · 20 metrics · 8 modifiers
10,000-iteration Gaussian Copula Monte Carlo · Sobol global sensitivity analysis (196,608 evals/substation) · CMIP6 SSP2-4.5