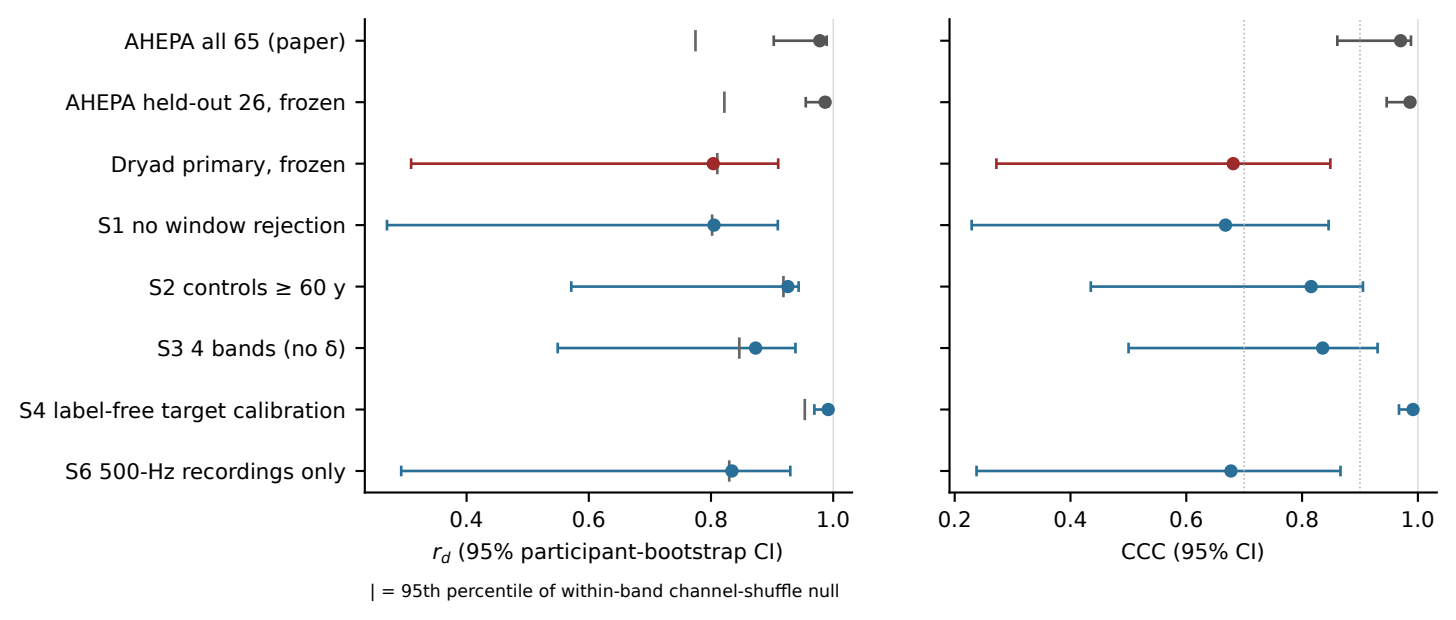
AHEPA all 65 (paper)
AHEPA held-out 26, frozen
Dryad primary, frozen
S1 no window rejection
S2 controls ≥ 60 y
S3 4 bands (no δ)
S4 label-free target calibration
S6 500-Hz recordings only
0.4
0.6
0.8
1.0
r_d (95% participant-bootstrap CI)
| = 95th percentile of within-band channel-shuffle null
0.2
0.4
0.6
0.8
1.0
CCC (95% CI)