# JF1 Cycle Test Result

LG Energy Solution

# JF1 Cycle Test Result

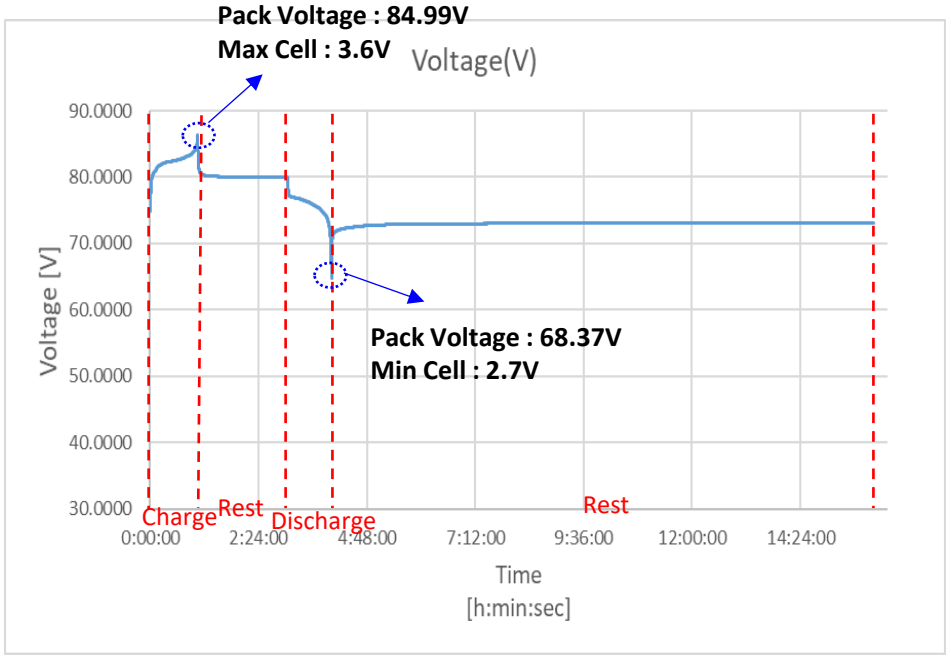
## ❑ 1CP Charge / Discharge Test @ 25°C

**<Test Procedure>**

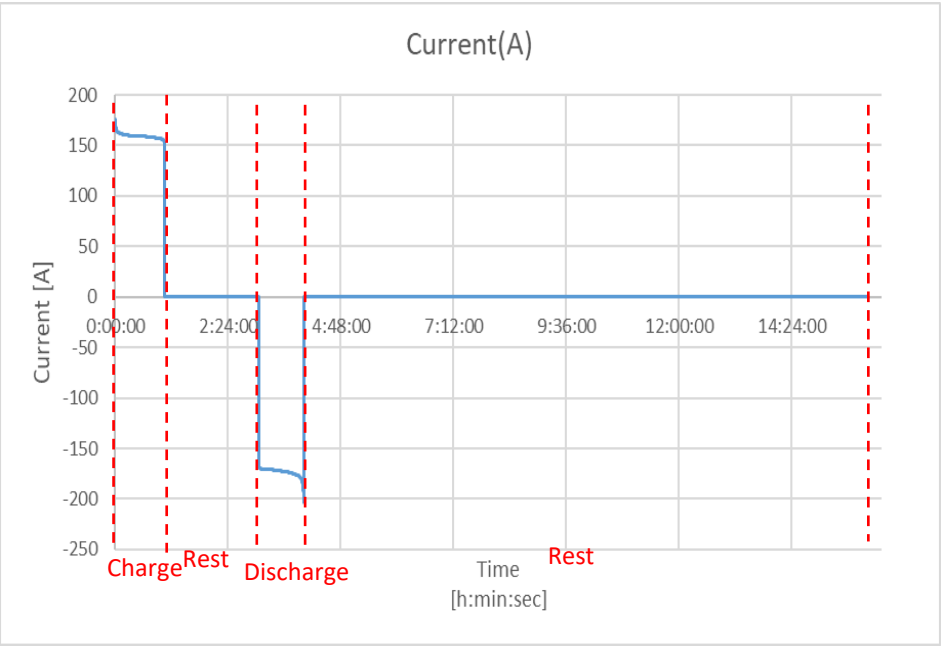
| Order | Procedure | Duration | Average Power | Test contents | Notes |
|---|---|---|---|---|---|
| **1** | Charge | 01:02:11 | 13.122kW (1CP) | 1CP Charge (DC) till the Maximum Cell Voltage reaches 3.6V | |
| **2** | Rest | 02:00:00 | - | Rest for 2hours | |
| **3** | Discharge | 00:57:04 | -13.122kW (1CP) | 1CP Discharge (DC) till the Minimum Cell Voltage reaches 2.7V | |
| 4 | Rest and End | 12:00:00 | - | Rest for 12hours | |

**<Test Result>**

### ❑ Voltage



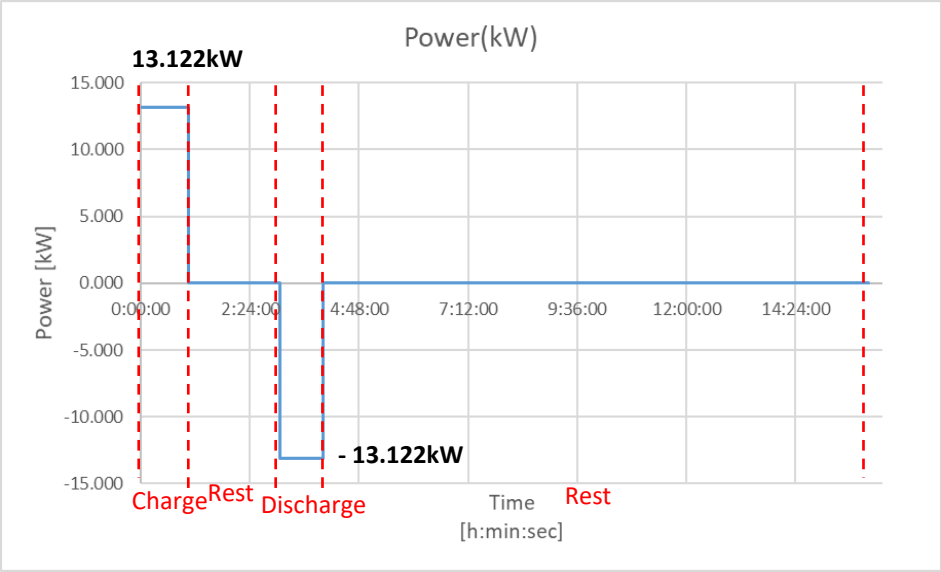

### ❑ Current



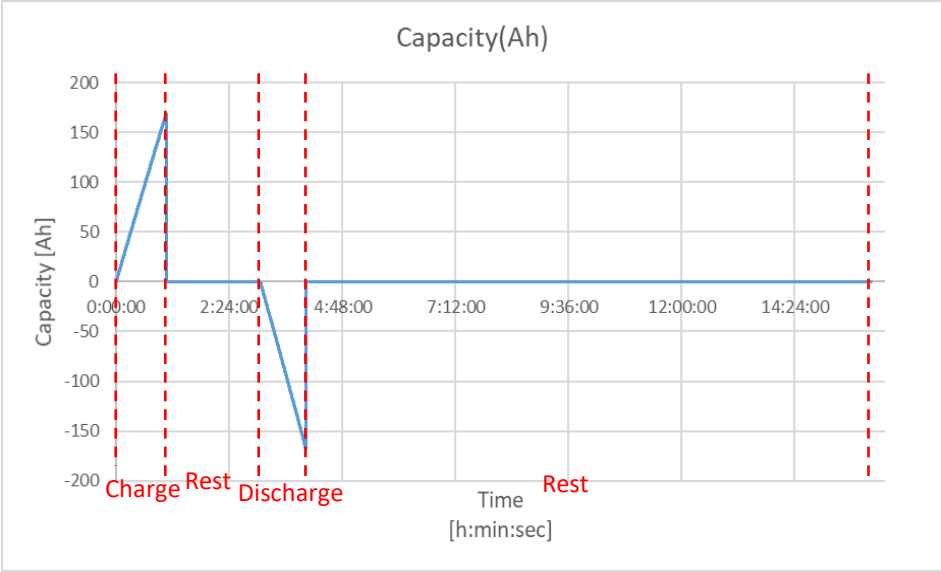

Confidential © 2026 LG Energy Solution, Ltd. All rights reserved.

# JF1 Cycle Test Result

## ❑ Power




## ❑ Capacity



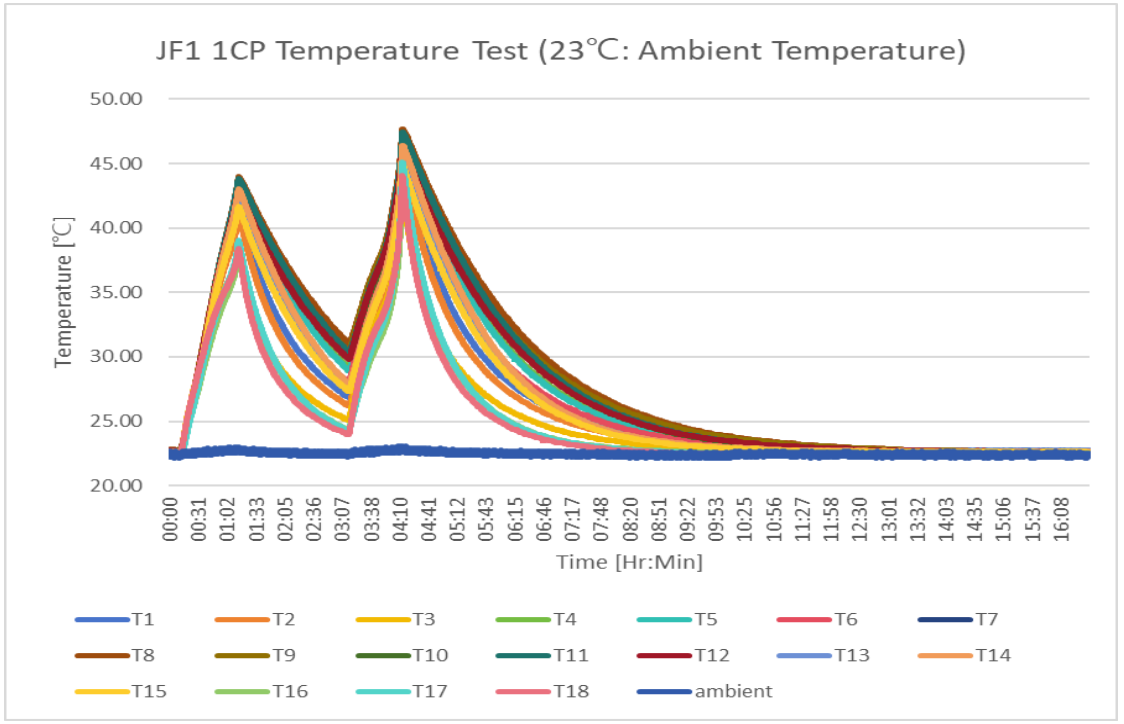

| Test Result | |
|---|---|
| Charged Energy | 13.603kWh |
| Discharged Energy | 12.376kWh |

| Test Result | |
|---|---|
| Charged Capacity | 165.25Ah |
| Discharged Capacity | 163.66Ah |

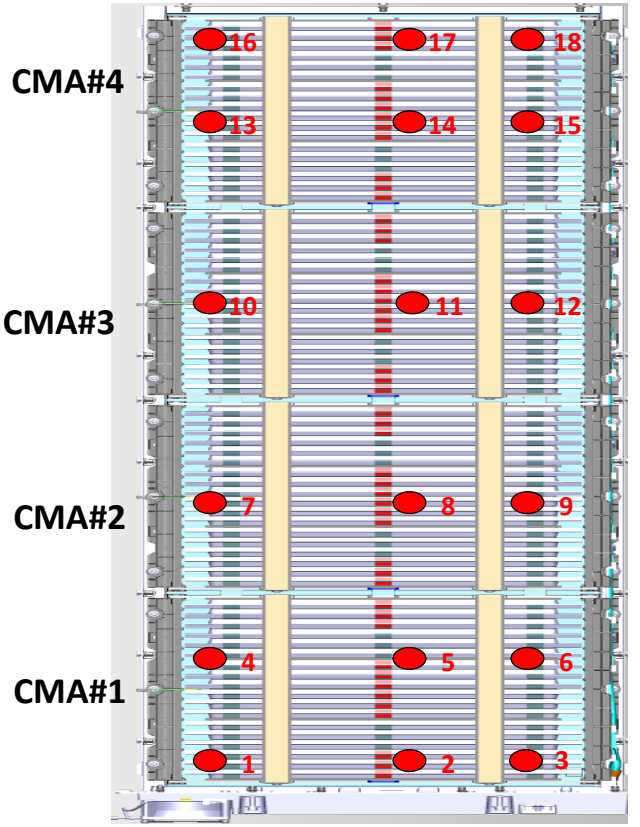
Confidential © 2026 LG Energy Solution, Ltd. All rights reserved.

# JF1 Cycle Test Result

❑ **Temperature**




❑ **TC Map**




| | T1 | T2 | T3 | T4 | T5 | T6 | T7 | T8 | T9 | T10 | T11 | T12 | T13 | T14 | T15 | T16 | T17 | T18 | Dev (Max-Min) |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Max | 44.80 | 44.95 | 42.55 | 46.35 | 47.05 | 45.65 | 46.65 | 47.60 | 46.75 | 46.35 | 47.35 | 46.40 | 45.00 | 45.90 | 44.55 | 41.95 | 43.45 | 42.95 | 5.65℃ |
| Avg | 28.71 | 28.32 | 27.51 | 29.69 | 29.63 | 29.11 | 30.25 | 30.50 | 30.19 | 29.92 | 30.16 | 29.91 | 28.94 | 29.13 | 28.73 | 27.06 | 27.13 | 26.98 | 3.52℃ |

Confidential © 2026 LG Energy Solution, Ltd. All rights reserved.