


# IPKE Procedural Knowledge Graph Schema

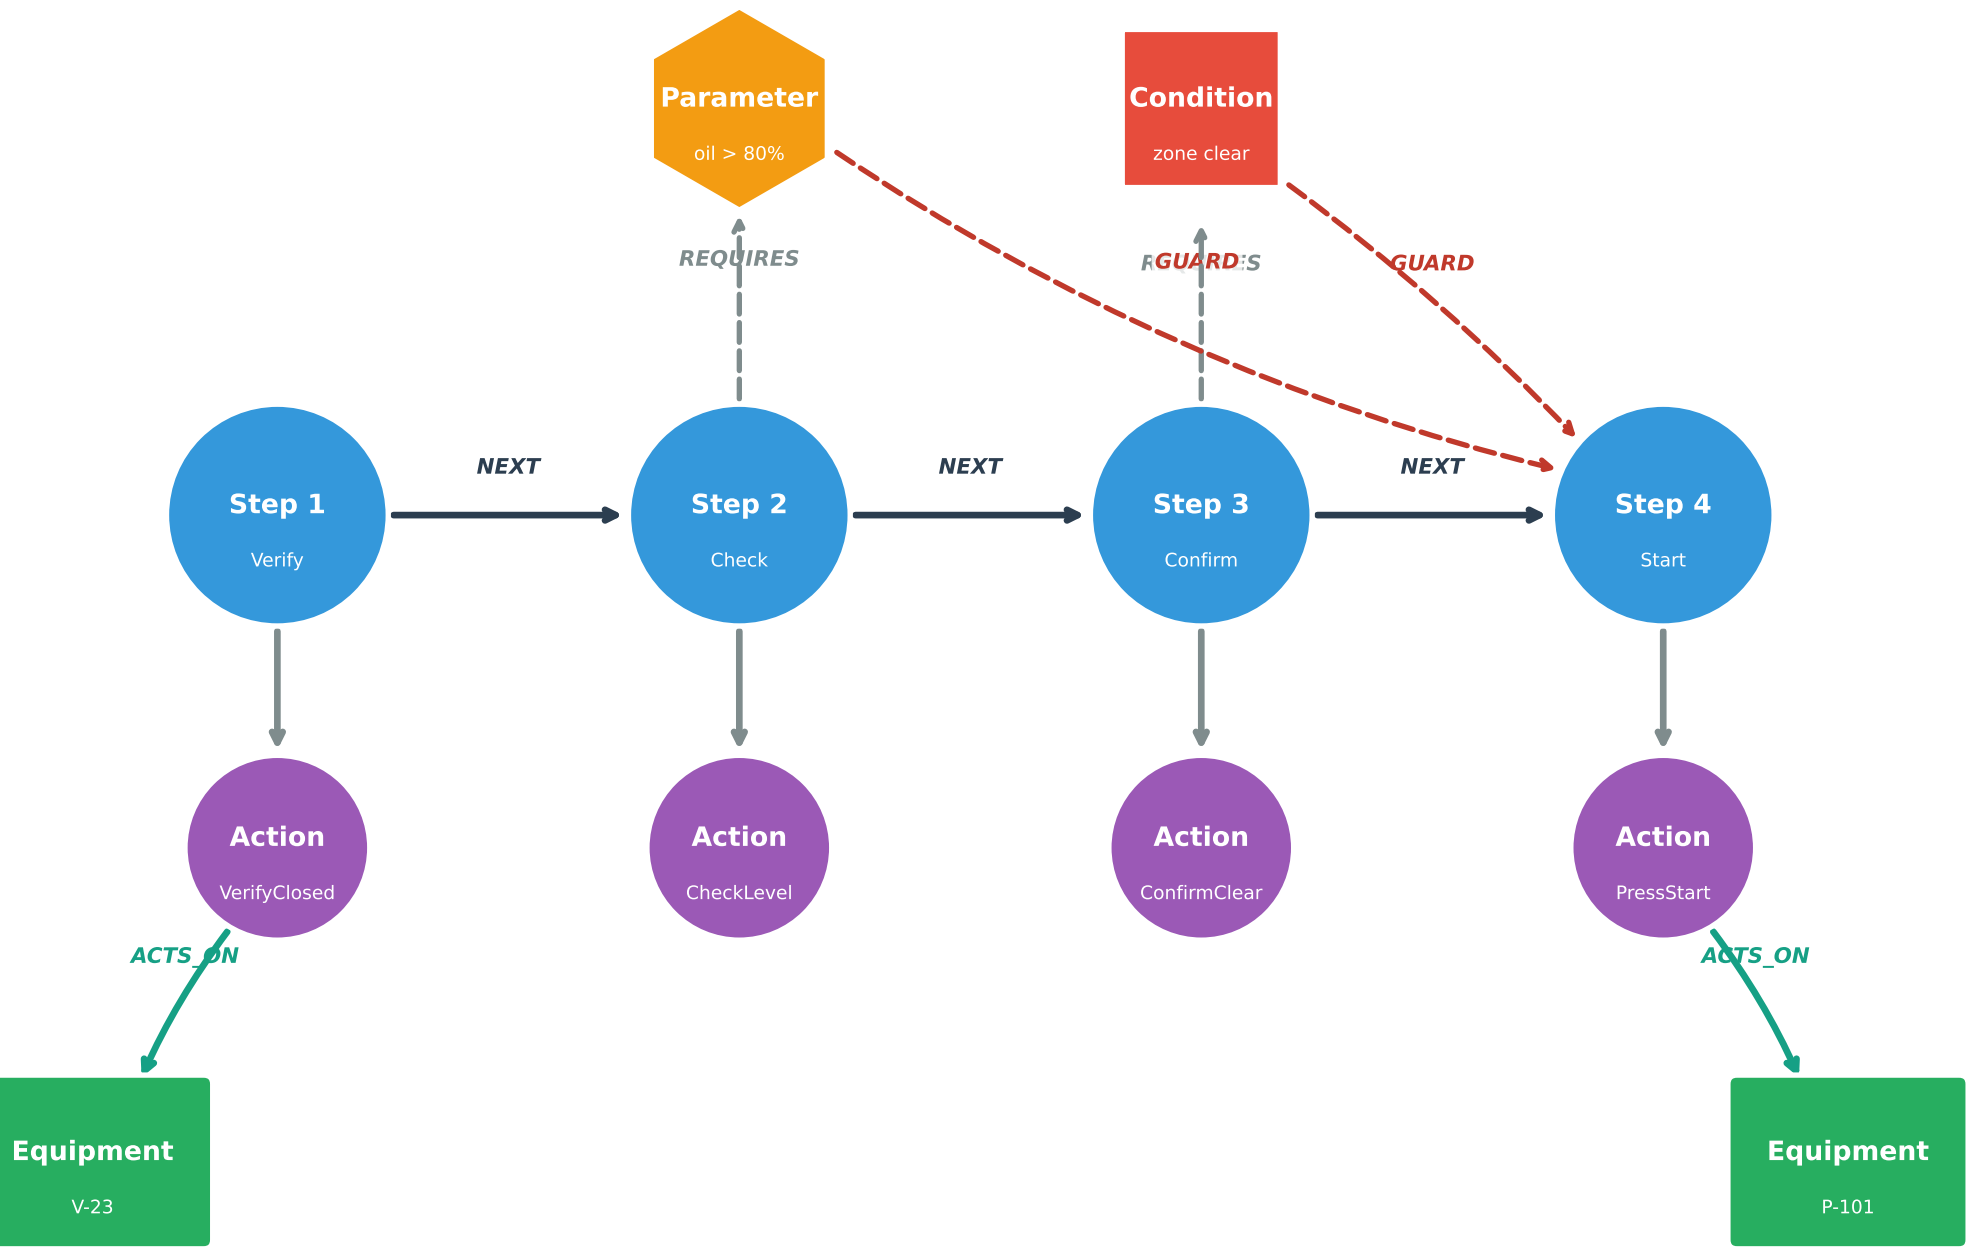

"Before starting pump P-101: (1) Verify valve V-23 is closed; (2) Check oil level > 80%; (3) Confirm no personnel in hazard zone; (4) Press Start."