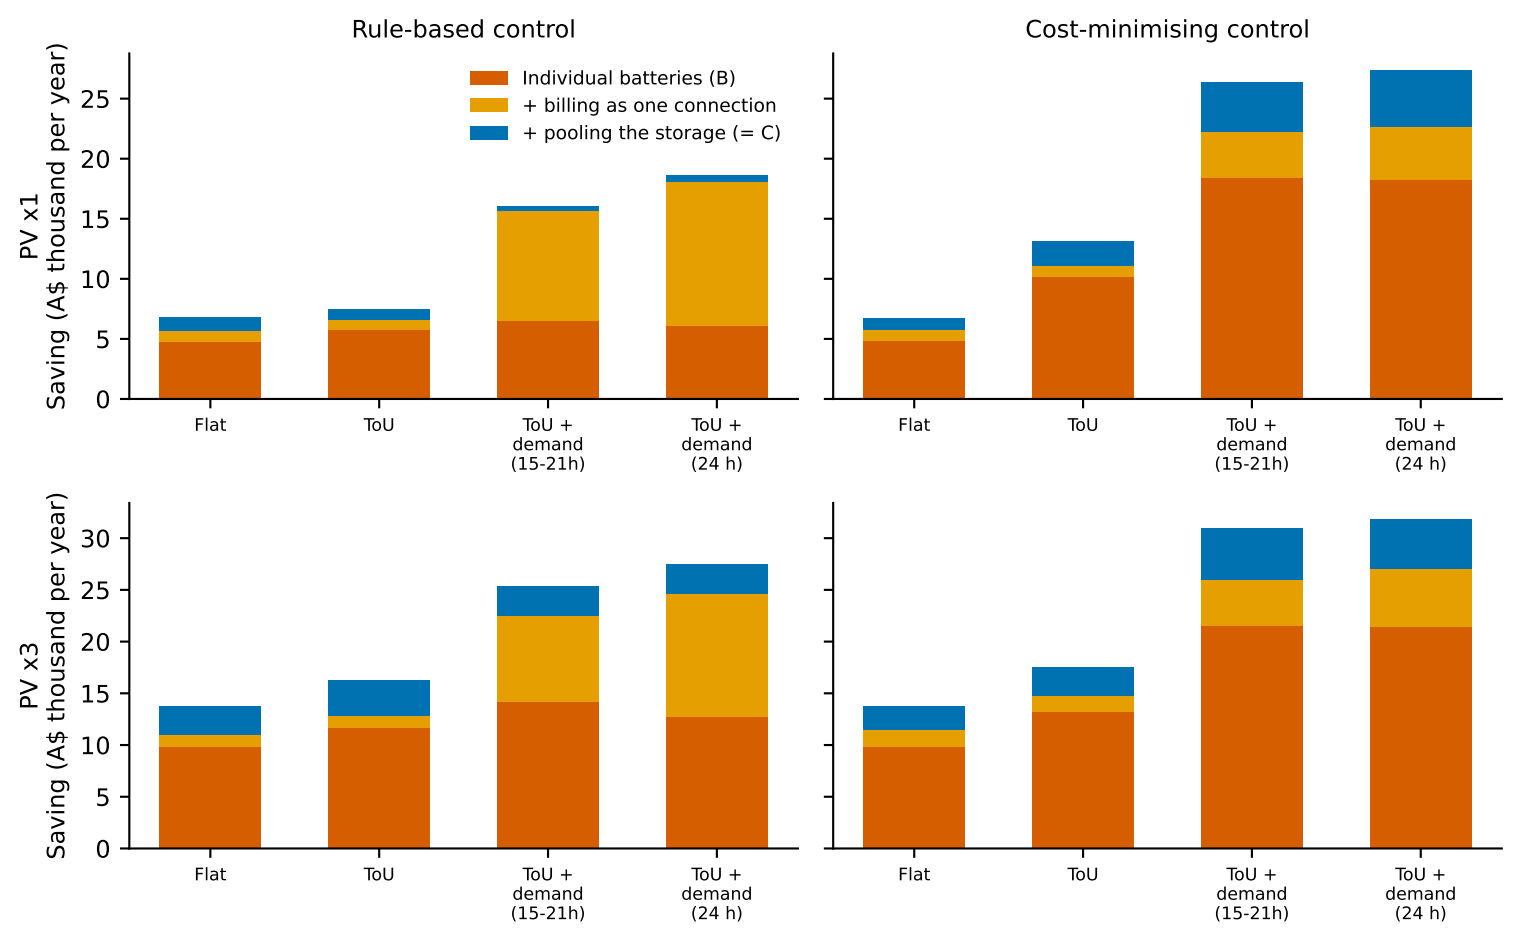
Rule-based control
Cost-minimising control
Individual batteries (B)
+ billing as one connection
+ pooling the storage (= C)
PV x1
PV x3
Saving (A$ thousand per year)
0
5
10
15
20
25
30
Flat
ToU
ToU + demand (15-21h)
ToU + demand (24 h)