


























Structural Engineer

DOB Consultant

Owner

FIRE ALARM SYMBOLS					
	FIRE COMMAND STATION		MOTORIZED DAMPER		ELEVATOR RECALL
	PURGE KEY SWITCH		FIRE SMOKE DAMPER		MANUAL FIRE ALARM PULL STATION
	FIRE SERVICE ACCESS ELEVATOR ANNUCIATOR		FIRE PUMP RUNNING RELAY		LOCKABLE FUSED DISCONNECT SWITCH (RISER/FLOOR PLAN) WP DENOTES WEATHER PROOF
	AREA SMOKE DETECTOR: "XX" DENOTES THE FOLLOWING: "EL" DENOTES ELEVATOR LOBBY DETECTOR "TOS" DENOTES TOP OF SHAFTS/SHaft DETECTOR "TOD" DENOTES TOP OF DETECTOR SHAFT DETECTOR "C" DENOTES COMBINATION SMOKE/CARBON MONOXIDE		FIRE PUMP FAILURE		LOCKABLE UNFUSED DISCONNECT SWITCH (RISER/FLOOR PLAN) WP DENOTES WEATHER PROOF
			ADDRESSABLE MONITORING MODULE WP DENOTES WEATHER PROOF		MOTOR CONTROLLER
	HEAT DETECTOR		ADDRESSABLE CONTROL MODULE		DEDICATED RADIO CONSOLE
	DEDICATED RADIO CONSOLE		MAGNETIC DOOR HOLDER		DIGITAL ALARM COMMUNICATION TRANSMITTER
	TAMPER SWITCH		REMOTE ANNUCIATOR		DRY-PIPE VALVES, HIGH AIR PRESSURE SWITCH (FURNISHED BY OTHERS)
	DATA GATHERING PANEL		FIRE PUMP PHASE REVERSAL		DRY-PIPE VALVES, LOW AIR PRESSURE SWITCH (FURNISHED BY OTHERS)
	WALL MOUNTED SPEAKER ONLY DEVICE (80" AFF)		ADDRESSABLE DUAL MODULE		PRESSURE SWITCH
	EMERGENCY GENERATOR FAIL WP DENOTES WEATHER PROOF		WATER FLOW SWITCH		MULTI-PULSE CUTOFF PANEL
	EMERGENCY GENERATOR RUNNING RELAY WP DENOTES WEATHER PROOF		AUTOMATIC TRANSFER SWITCH(ATS)(FLOOR PLAN)		TEMPERATURE MONITORING HEAT DETECTOR FOR THE FIRE SERVICE ACCESS ELEVATOR (FSAE)
	EMERGENCY GENERATOR (RISER)		EMERGENCY GENERATOR (FLOOR PLAN)		AUTOMATIC TRANSFER SWITCH(ATS)(RISER)
	ALTERNATIVE ELEVATOR RECALL		COMBINED SMOKE/HEAT DETECTOR "EL" ELEVATOR LOBBY		
	FIRE SHUTTER		FIRE DOOR		


AUXILIARY RADIO COMMUNICATION SYSTEM
(ARCS) FILED UNDER SEPARATE APPLICATION
2025-TMARCS-008176-PLAN

FIRE ALARM DRAWING LIST	
NO.	DESCRIPTION
FA-001.00	FIRE ALARM - LEAD SHEET - BUILDING A
FA-002.00	FIRE ALARM - FS&E DETAIL - BUILDING A
FA-100.00	FIRE ALARM - SUB CELLAR FLOOR PLAN - BUILDING A
FA-101.00	FIRE ALARM - CELLAR FLOOR PLAN - BUILDING A
FA-102.00	FIRE ALARM - 1ST FLOOR PLAN - BUILDING A
FA-103.00	FIRE ALARM - 3RD TO 6TH FLOOR PLANS - BUILDING A
FA-104.00	FIRE ALARM - 9TH TO 11TH FLOOR PLANS - BUILDING A
FA-105.00	FIRE ALARM - 12TH TO 27TH FLOOR PLANS - BUILDING A
FA-106.00	FIRE ALARM - 28TH - 30TH FLOOR PLAN - BUILDING A
FA-107.00	FIRE ALARM - ROOF PLAN - BUILDING A
FA-108.00	FIRE ALARM - EMB & STAIR BULKHEAD PLAN - BUILDING A
FA-300.00	FIRE ALARM - RISER DIAGRAM - BUILDING A

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

FA-001.00

ARCHITECTURAL	STRUCTURAL	MECHANICAL	ELECTRICAL	PLUMBING

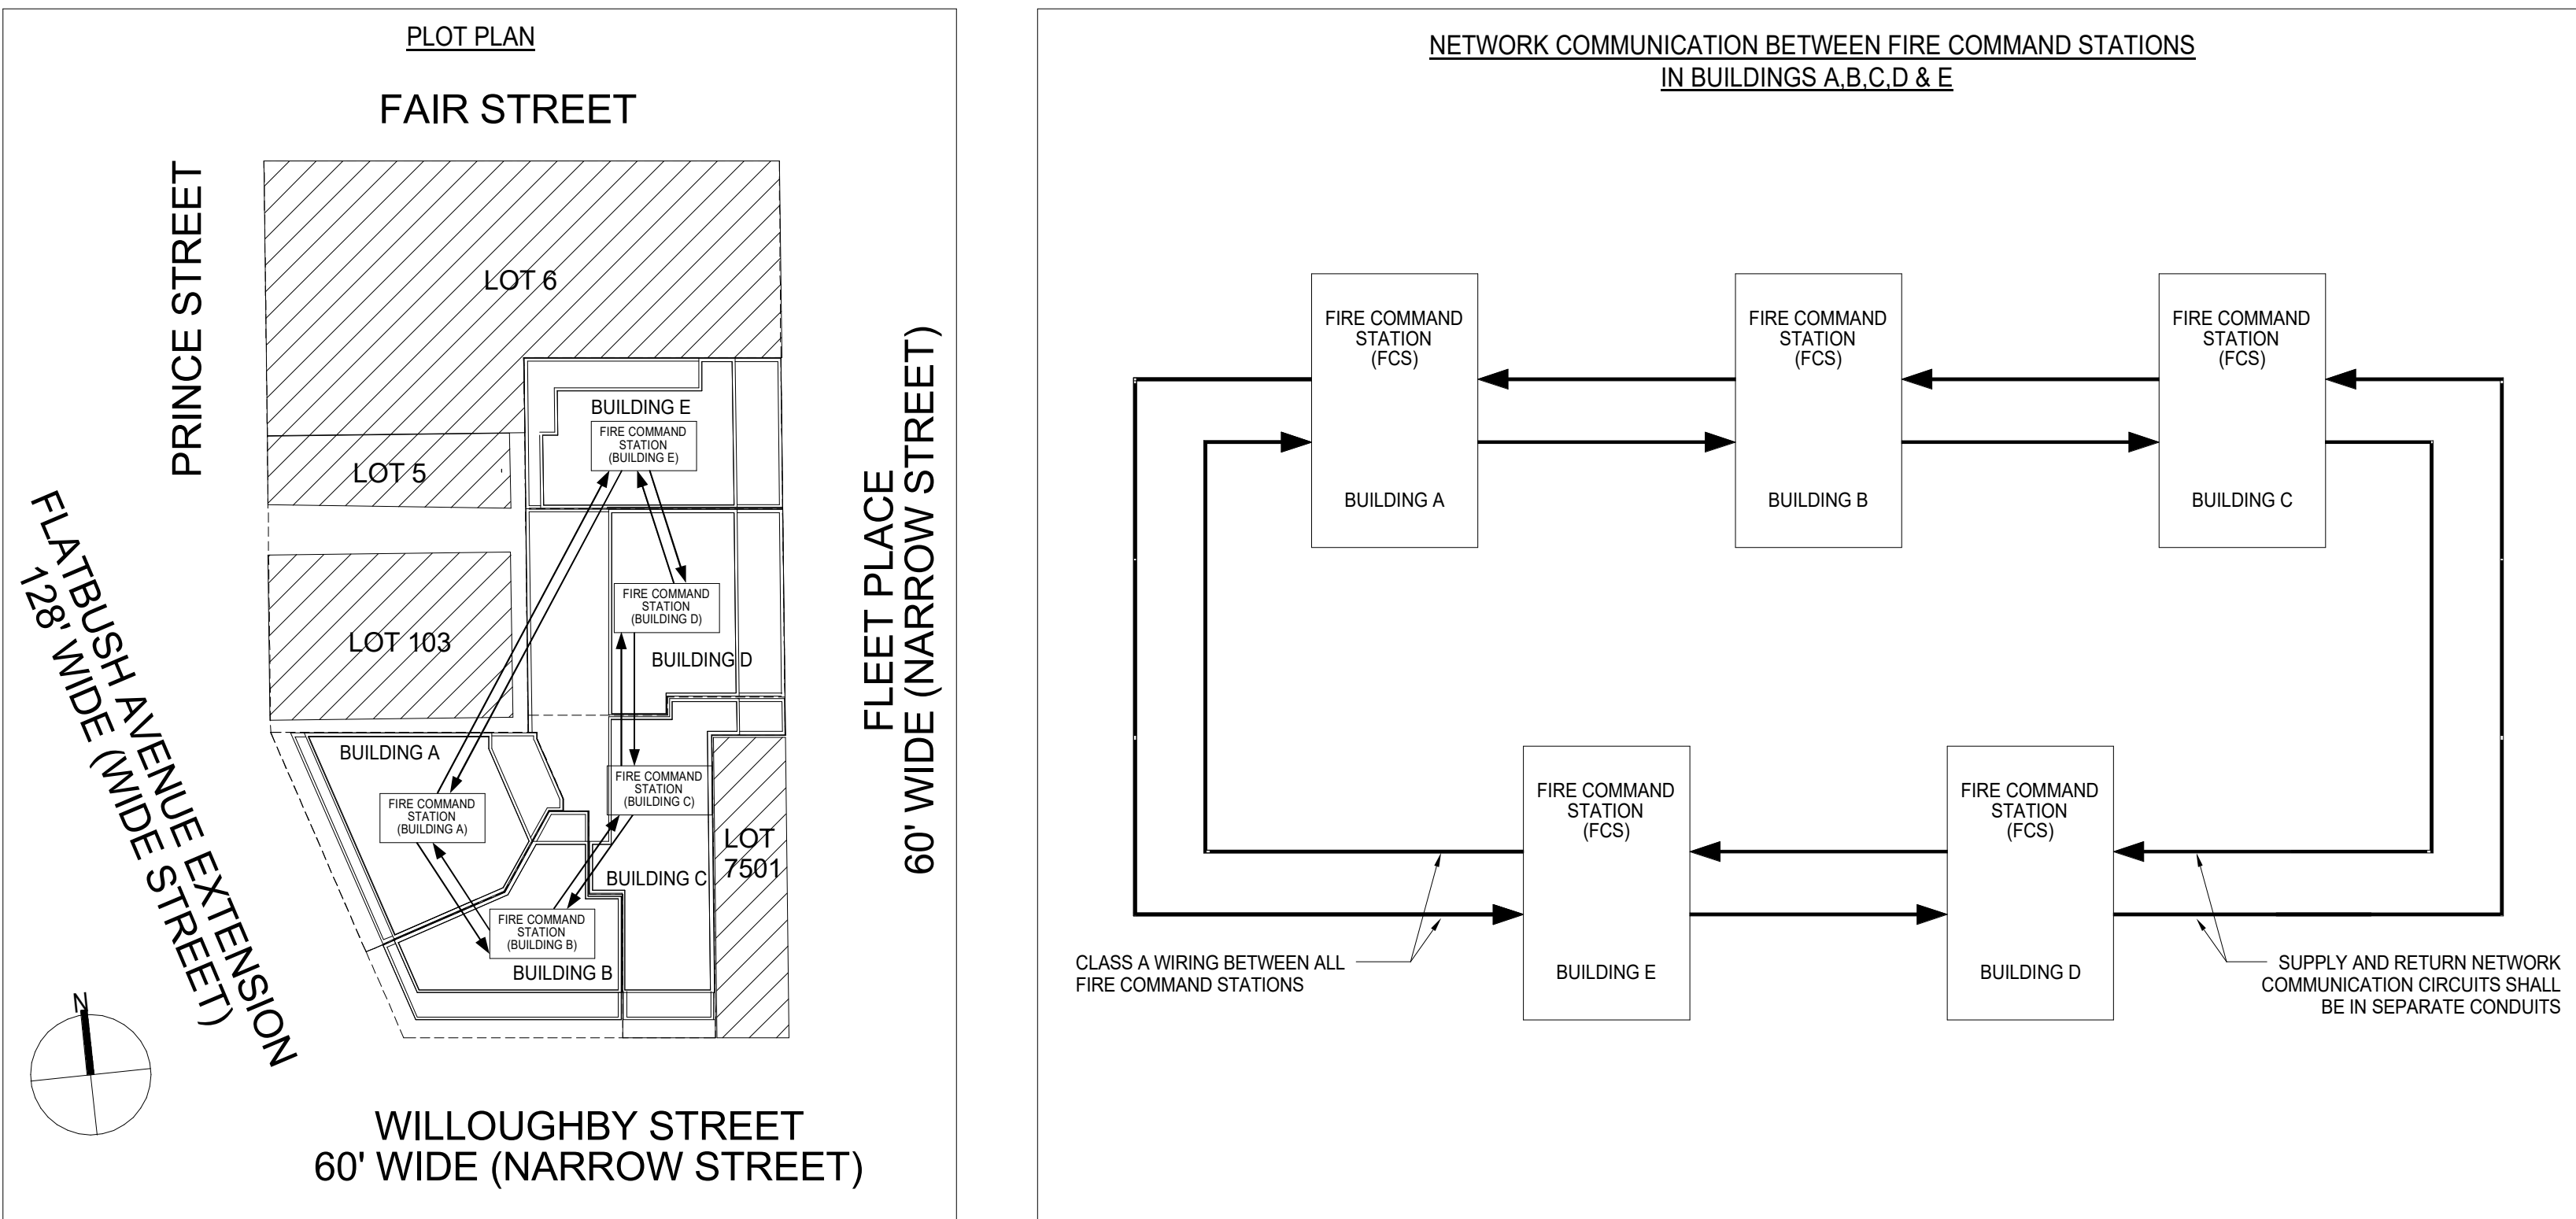

A

B

C

D

E

F

G

H

I

J

K

L

M

N

O

P

Q

R

FIRE SERVICE ACCESS ELEVATOR PANEL

ELEVATOR LOBBY TEMPERATURE ELEVATOR LOBBY SMOKE DETECTOR

(FLOORS)	NORMAL <100°F	MONITORING >100° &<135°F	UNSAFE >135°F	ALARM
EMR	G	Y	R	R
ROOF	G	Y	R	R
30TH FL	G	Y	R	R
29TH FL	G	Y	R	R
28TH FL	G	Y	R	R
27TH FL	G	Y	R	R
26TH FL	G	Y	R	R
25TH FL	G	Y	R	R
24TH FL	G	Y	R	R
23RD FL	G	Y	R	R
22ND FL	G	Y	R	R
21ST FL	G	Y	R	R
20TH FL	G	Y	R	R
19TH FL	G	Y	R	R
18TH FL	G	Y	R	R
17TH FL	G	Y	R	R
16TH FL	G	Y	R	R
15TH FL	G	Y	R	R
14TH FL	G	Y	R	R
13TH FL	G	Y	R	R
12TH FL	G	Y	R	R
11TH FL	G	Y	R	R
10TH FL	G	Y	R	R
9TH FL	G	Y	R	R
8TH FL	G	Y	R	R
7TH FL	G	Y	R	R
6TH FL	G	Y	R	R
5TH FL	G	Y	R	R
4TH FL	G	Y	R	R
3RD FL	G	Y	R	R
1ST FL	G	Y	R	R
CELALR FL	G	Y	R	R
SUBCELLAR FL	G	Y	R	R

AUTO OPEN

HOISTWAY VENTS

ON AUTO OFF

HOISTWAY LIGHTS

(SEE NOTE #1.B)

LAMP TEST

G FIRE SERVICE ACCESS ELEVATOR POWER ON

Y FIRE SERVICE ACCESS ELEVATOR SYSTEM TROUBLE

Y FAULT - ELEVATOR NORMAL POWER

Y FAULT - ELEVATOR EMERGENCY POWER

Y FAULT - HOISTWAY VENT POWER

- NOTES:
- PANEL SHALL BE UL 864 LISTED.
 - PANEL SHOWN SHALL INDICATED ALL FLOORS SERVED BY FSAE.
 - PANEL SHALL BE PROVIDED FOR EACH FSAE AND FOR OCCUPANT EVACUATION ELEVATORS.
 - ACTIVATION OF SWITCH TO "ON" OR "AUTO" POSITION SHALL GENERATE SUPERVISORY SIGNAL.
 - G = GREEN LED; Y = YELLOW LED; R = RED LED

FIRE SERVICE ACCESS ELEVATOR NOTES:

- DESIGN CRITERIA
 - ALL LED'S AND SWITCHES SHALL BE ARRANGED TO GRAPHICALLY REPRESENT THE SPATIAL RELATIONSHIP BETWEEN FLOORS AND ASSOCIATED SYSTEM COMPONENTS. EACH INDIVIDUAL FLOOR SHALL BE LABELED WITH THE CORRESPONDING FLOOR NUMBER. WHERE MARKETING FLOOR DESIGNATIONS ARE USED IN ACCORDANCE WITH FDNY OTMB BULLETIN #11/2011, ONLY THE MARKETING FLOOR DESIGNATION SHALL BE DISPLAYED ON THIS PANEL.
 - SMOKE MONITORING HEAT DETECTOR
 - ACTIVATION OF AN ELEVATOR MACHINE ROOM, ELEVATOR LOBBY OR ELEVATOR LANDING SMOKE DETECTOR SHALL SEND AN ALARM SIGNAL TO THE FIRE COMMAND CENTER AND SHALL LIGHT A RED LED INDICATING THE ASSOCIATED FLOOR/ELEVATOR BANK AND INDICATING THE DEVICE TYPE THAT ACTIVATED. ACTIVATION OF ANY RED LED SHALL BE LATCHING AND SHALL ONLY CLEAR UPON RESET INITIATED FROM THE FIRE ALARM CONTROL PANEL.
 - WHERE HOISTWAY SMOKE DETECTION IS REQUIRED BY THE NYC CONSTRUCTION CODES, THE STATUS OF THE HOISTWAY SMOKE DETECTOR SHALL BE DISPLAYED ON THIS PANEL.
 - WHERE CROSSZONING OF MULTIPLE SMOKE DETECTORS IS USED, THE ACTIVATION OF THE SECOND SMOKE DETECTOR IN THAT CORRESPONDING AREA SHALL LIGHT THE RED LED.
 - WHERE ALARM VERIFICATION FOR A SINGLE SMOKE DETECTOR IS USED, THE ACTIVATION OF THE DETECTOR IN VERIFIED ALARM MODE SHALL LIGHT THE RED LED.
 - TEMPERATURE MONITORING
 - THREE SEPARATE LED'S FOR EACH MACHINE ROOM AND FOR EACH FLOOR/ELEVATOR BANK UTILIZED FOR FIRE SERVICE ACCESS ELEVATORS SHALL BE PROVIDED TO INDICATE ASSOCIATED TEMPERATURES IN THE ELEVATOR LOBBY OR ELEVATOR LANDING SERVED BY THE FSAE. THESE LED'S SHALL BE PROVIDED UNDER THE HEADINGS NORMAL <100 °F (FOR GREEN), MONITORING 100 °F< > 135 °F (FOR YELLOW), AND UNSAFE >135 °F (FOR RED).
 - ACTIVATION OF AN ELEVATOR LOBBY OR ELEVATOR LANDING HEAT DETECTOR AT 100°F SHALL SEND A SUPERVISORY SIGNAL TO THE FIRE COMMAND CENTER AND SHALL LIGHT THE ASSOCIATED YELLOW LED.
 - ACTIVATION OF AN ELEVATOR LOBBY OR ELEVATOR LANDING HEAT DETECTOR AT 135°F SHALL SEND AN ALARM SIGNAL TO THE FIRE COMMAND CENTER AND SHALL LIGHT THE ASSOCIATED RED LED. ACTIVATION OF ANY RED LED SHALL BE LATCHING AND SHALL ONLY CLEAR UPON RESET INITIATED FROM THE FIRE ALARM CONTROL PANEL.
 - THE ASSOCIATED GREEN LED SHALL BE LIT AT ALL OTHER TIMES WHEN NO HEAT CONDITION AT OR ABOVE 100 °F HAS BEEN DETECTOR IN THE CORRESPONDING ELEVATOR LOBBY OR ELEVATOR LANDING.
 - NORMAL AND EMERGENCY POWER MONITORING
 - INDIVIDUAL YELLOW OR AMBER LED'S FOR FAULT CONDITION MONITORING SHALL BE PROVIDED FOR THE FOLLOWING:
 - ELEVATOR NORMAL POWER FAULT-UPON LOSS OF NORMAL POWER SOURCE SUPPLYING THE ELEVATORS, THE ASSOCIATED YELLOW OR AMBER LED SHALL ACTIVATE AND REMAIN LIT UNTIL SUCH POWER SOURCE IS RESTORED.
 - ELEVATOR EMERGENCY POWER FAULT - UPON LOSS OF THE EMERGENCY POWER SOURCE THAT SERVES SUPPLY TO THE FIRE SERVICE ACCESS ELEVATOR(S), THE ASSOCIATED YELLOW OR AMBER LED SHALL ACTIVATE AND REMAIN LIT UNTIL SUCH POWER SOURCE IS RESTORED.
 - ELEVATOR HOISTWAY VENTILATION POWER FAULT-WHERE ELEVATOR HOISTWAY VENTILATION IS PROVIDED, EITHER THROUGH PASSIVE OR ACTIVE/MECHANICAL MEANS, LOSS OF POWER TO THE ASSOCIATED EQUIPMENT SHALL ACTIVATE THE YELLOW OR AMBER LED AND THE LED SHALL REMAIN LIT UNTIL SUCH POWER SOURCE IS RESTORED.
 - FIRE SERVICE ACCESS ELEVATOR (FSAE) HOISTWAY LIGHTING CONTROLS
 - A TWO-POSITION ON-AUTO SHALL BE PROVIDED FOR FSAE HOISTWAY LIGHTING CONTROLS.
 - ONE SWITCH FOR EACH HOISTWAY CONTAINING FIRE SERVICE ACCESS ELEVATORS SHALL BE PROVIDED.
 - EACH SWITCH'S LABEL DESCRIPTOR SHALL INCLUDE A REFERENCE TO THE FSAE ELEVATOR CAR DESIGNATION (E.G. PE-1).
 - ACTIVATION OF THE SWITCH TO EITHER THE ON OR OFF POSITION SHALL GENERATE A SUPERVISORY SIGNAL REPORTED TO THE BUILDING'S FIRE ALARM SYSTEM.
 - WHERE A MACHINE ROOM - LESS (MRL) ELEVATOR IS PROVIDED, SMOKE AND HEAT MONITORING FROM THE ELEVATOR HOISTWAY SHALL BE DISPLAYED ON THIS PANEL IN THE SAME MANNER AS REQUIREMENTS APPLICABLE TO A TRADITIONAL ELEVATOR MACHINE ROOM.
 - EACH FIRE SERVICE ACCESS ELEVATOR ANNUNCIATOR SHALL INCLUDE A GREEN LED INDICATING POWER ON, A YELLOW OR AMBER LED INDICATING SYSTEM TROUBLE, AND A LAMP TEST FEATURE.
 - THE FIRE SERVICE ACCESS ELEVATOR ANNUNCIATOR SHALL BE INSTALLED IN SUCH A WAY THAT THE CONTROL SWITCHES ARE PROTECTED AGAINST TAMPERING BY UNAUTHORIZED INDIVIDUALS.
 - WHERE A BUILDING IS PROVIDED WITH BOTH FIRE SERVICE ACCESS ELEVATOR(S), AND OCCUPANT EVACUATION ELEVATOR(S) UNDER NYCBC SECTION 3008, A SINGLE GRAPHIC ANNUNCIATOR MAY BE PROVIDED TO INDICATE ALL REQUIRED SIGNALS.
 - ELEVATOR LOCATION WITHIN THE HOISTWAY, DIRECTION OF TRAVEL, POSITION OF LANDING DOORS, AND OCCUPIED/UNOCCUPIED STATUS OF EACH SUCH ELEVATOR CAR MAY BE INDICATED ON THIS PANEL OR MAY BE REPRESENTED ON A SEPARATE PANEL(S) PROVIDED THE SEPARATE PANEL IS ALSO LOCATED AT THE FIRE COMMAND CENTER IN ACCORDANCE WITH NYCBC SECTION 911.1.
 - WHERE APPROVED BY THE FIRE DEPARTMENT, DESIGNS MAY UTILIZE TOUCH SCREEN OR SIMILAR GRAPHIC ANNUNCIATOR TECHNOLOGIES IN LIEU OF A PHYSICAL CABINET CONTAINING LED'S SWITCHES.

NOTES:
FSAE PANEL DETAIL FOR GRAPHICAL REPRESENTATIONS ONLY. CONTRACTOR TO PROVIDE PANEL LAYOUT FOR FINAL APPROVAL.

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS





FIRE ALARM - FSAE
DETAIL - BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	12" = 1'-0"

FA-002.00

SHEET OF
DOB BSCAN STICKER

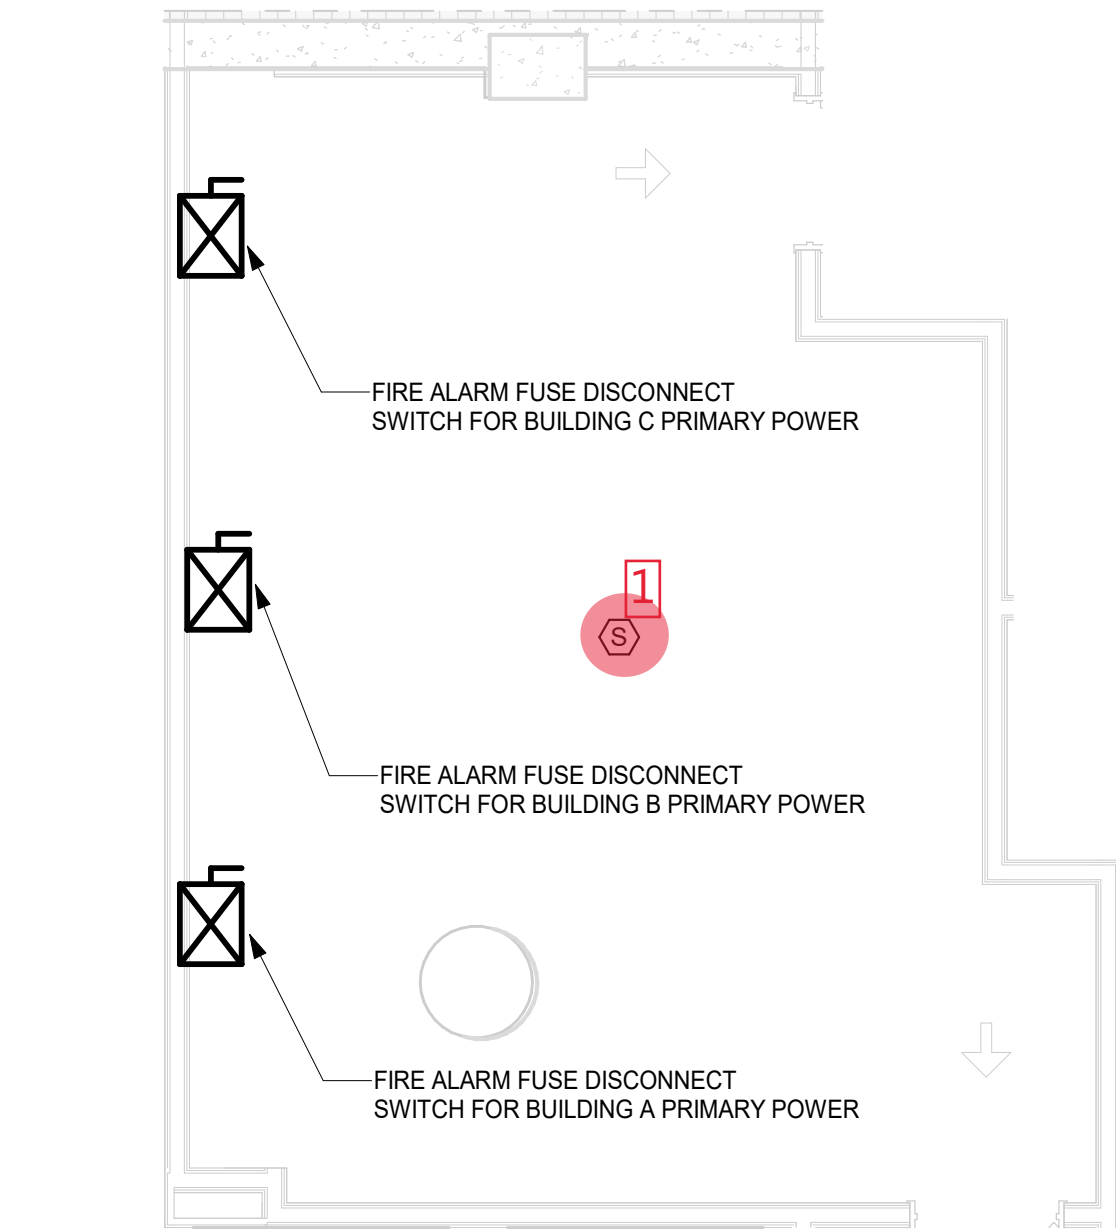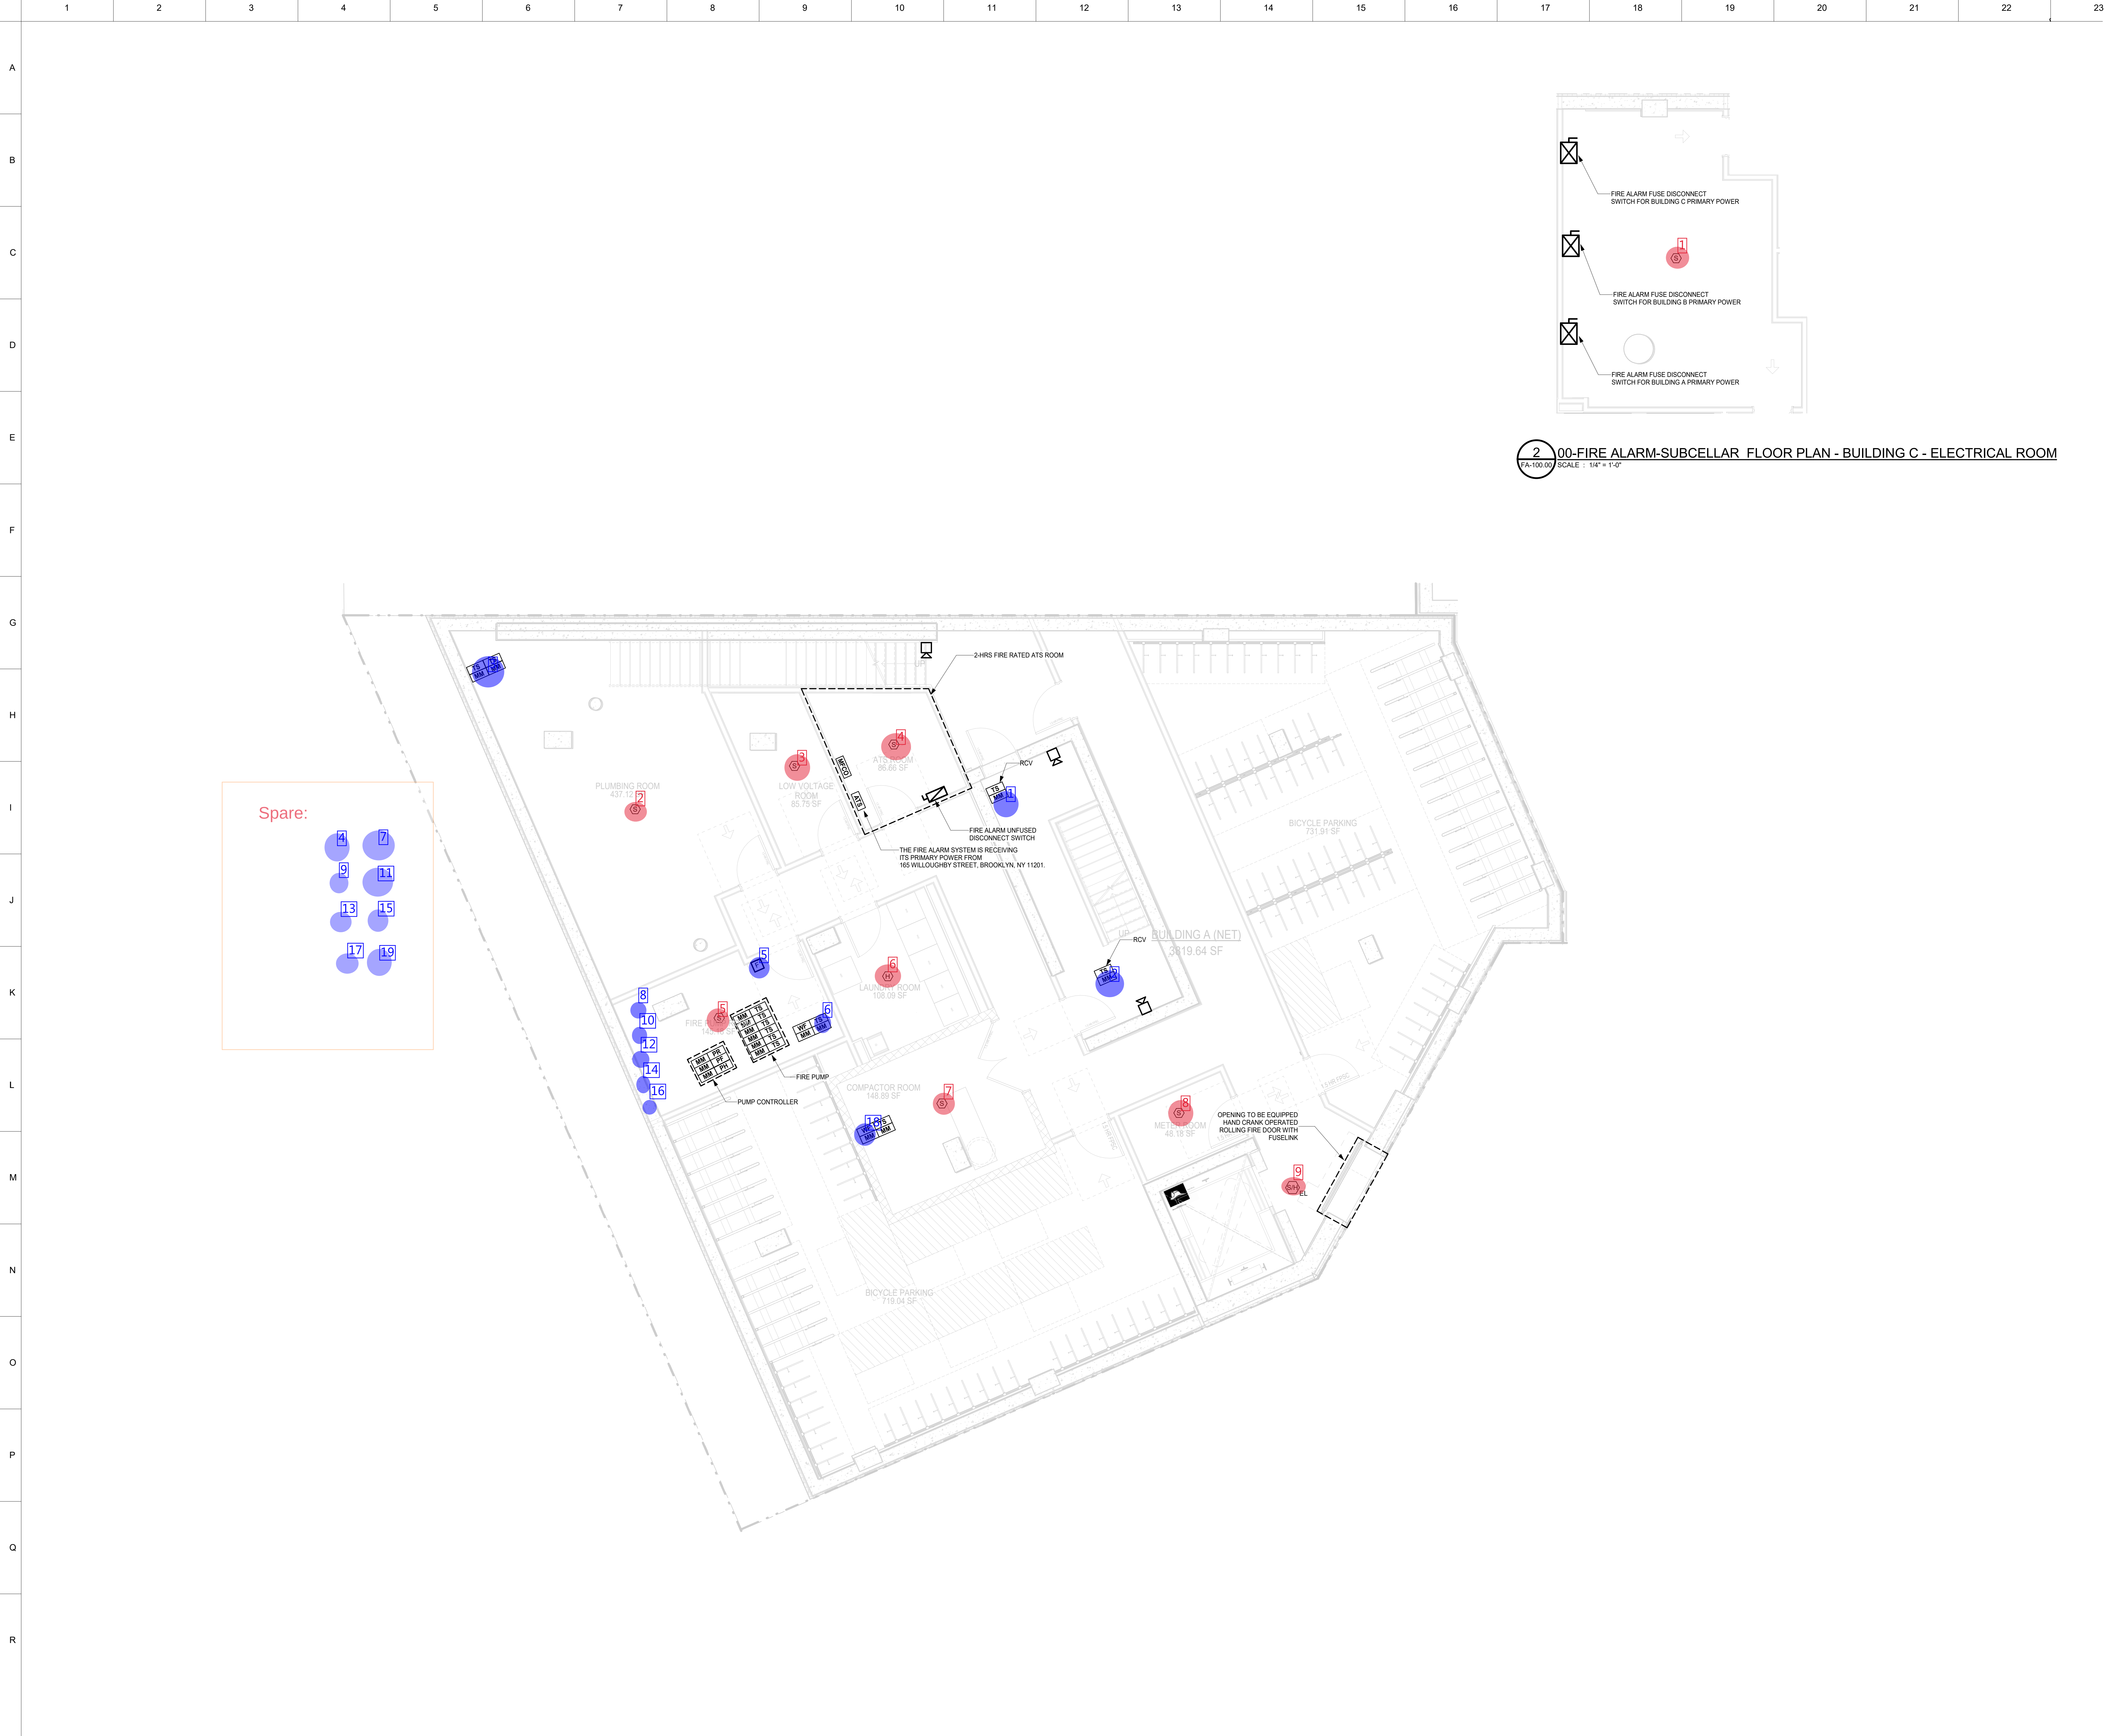

200-FIRE ALARM-SUBCELLAR FLOOR PLAN - BUILDING C - ELECTRICAL ROOM
FA-100.00 SCALE : 1/4" = 1'-0"

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorised use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for best fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS




**FIRE ALARM -
SUBCELLAR FLOOR PLAN -
BUILDING A**

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-100.00

SHEET OF
DOB BSCAN STICKER

PLUMBING
ELECTRICAL
MECHANICAL
STRUCTURAL
ARCHITECTURAL

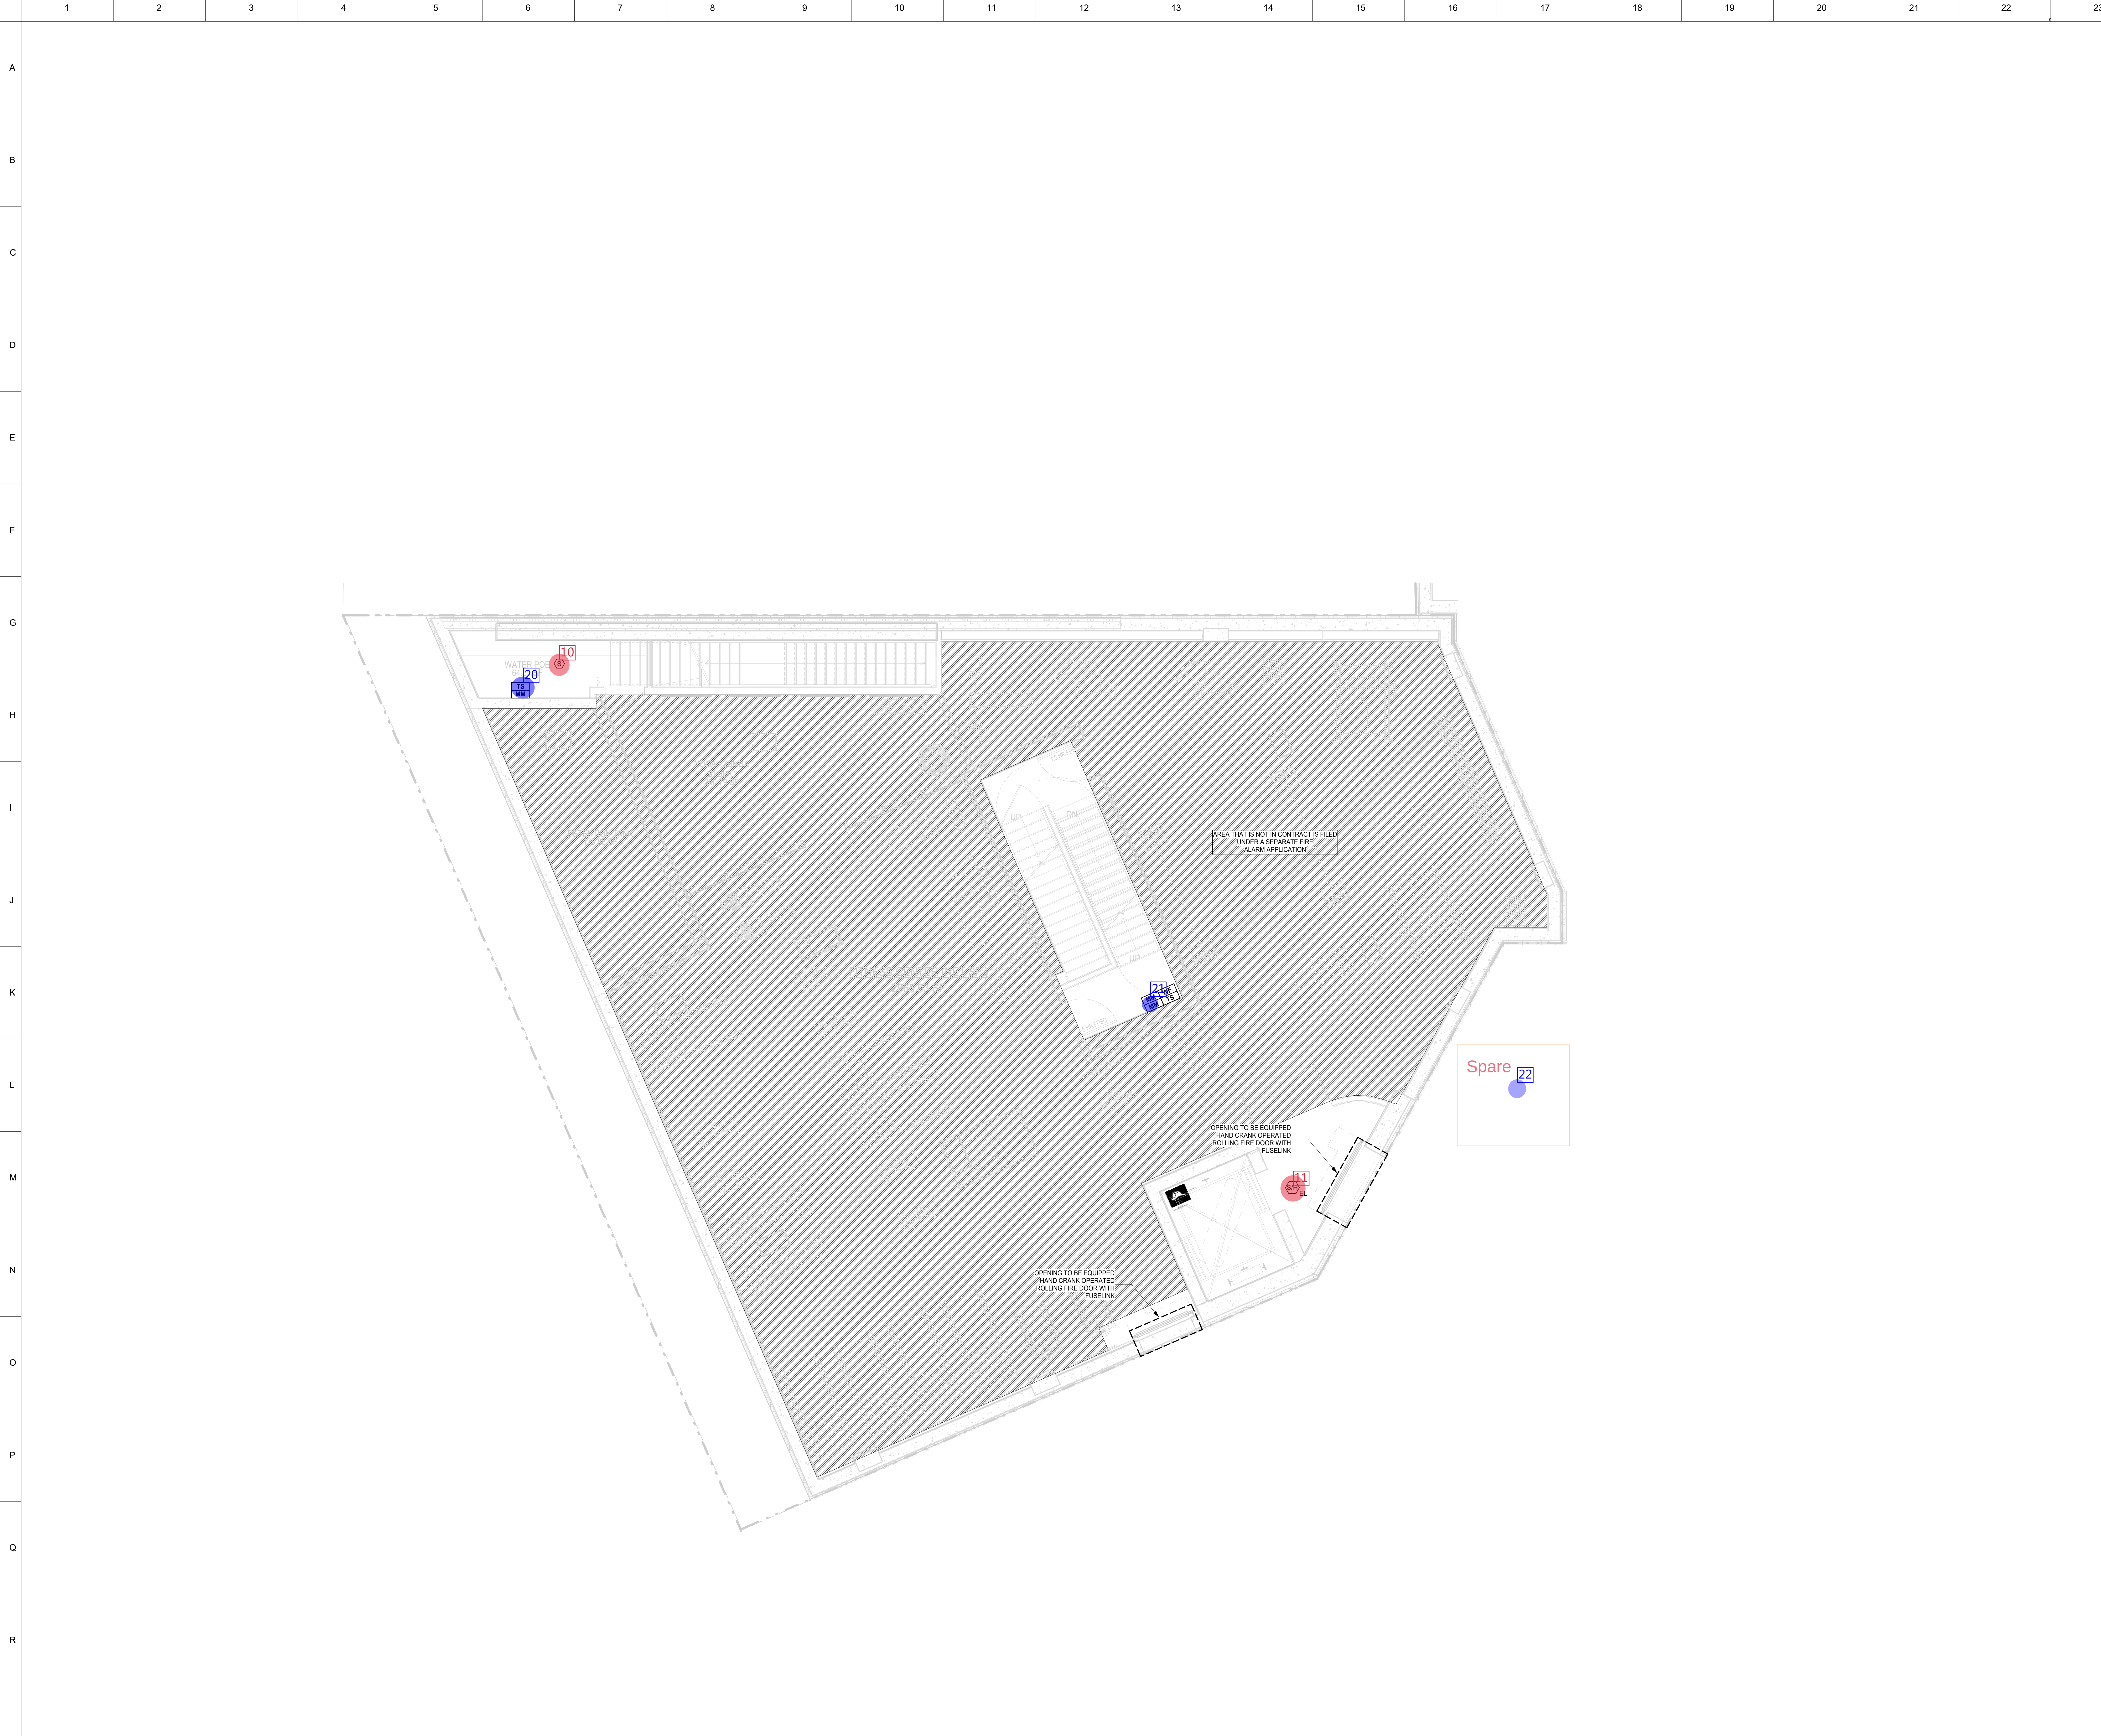

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for best fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



FIRE ALARM - CELLAR
FLOOR PLAN - BUILDING
A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-101.00

SHEET OF
DOB BSCAN STICKER

PLUMBING

ELECTRICAL


MECHANICAL

STRUCTURAL

ARCHITECTURAL

Structural Engineer

Mechanical Engineer

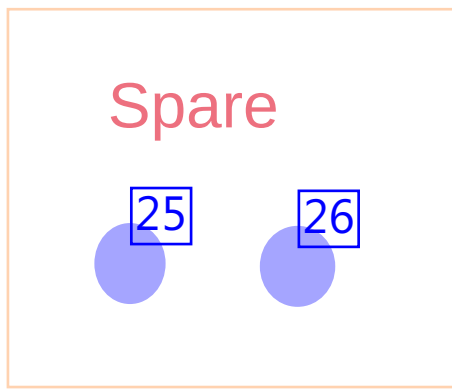DOB Consultant**Owner**

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



FIRE ALARM - 1ST FLOOR
PLAN - BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-102.00

SHEET OF
DOB BSCAN STICKER


PLUMBING

ELECTRICAL

MECHANICAL

STRUCTURAL

ARCHITECTURAL

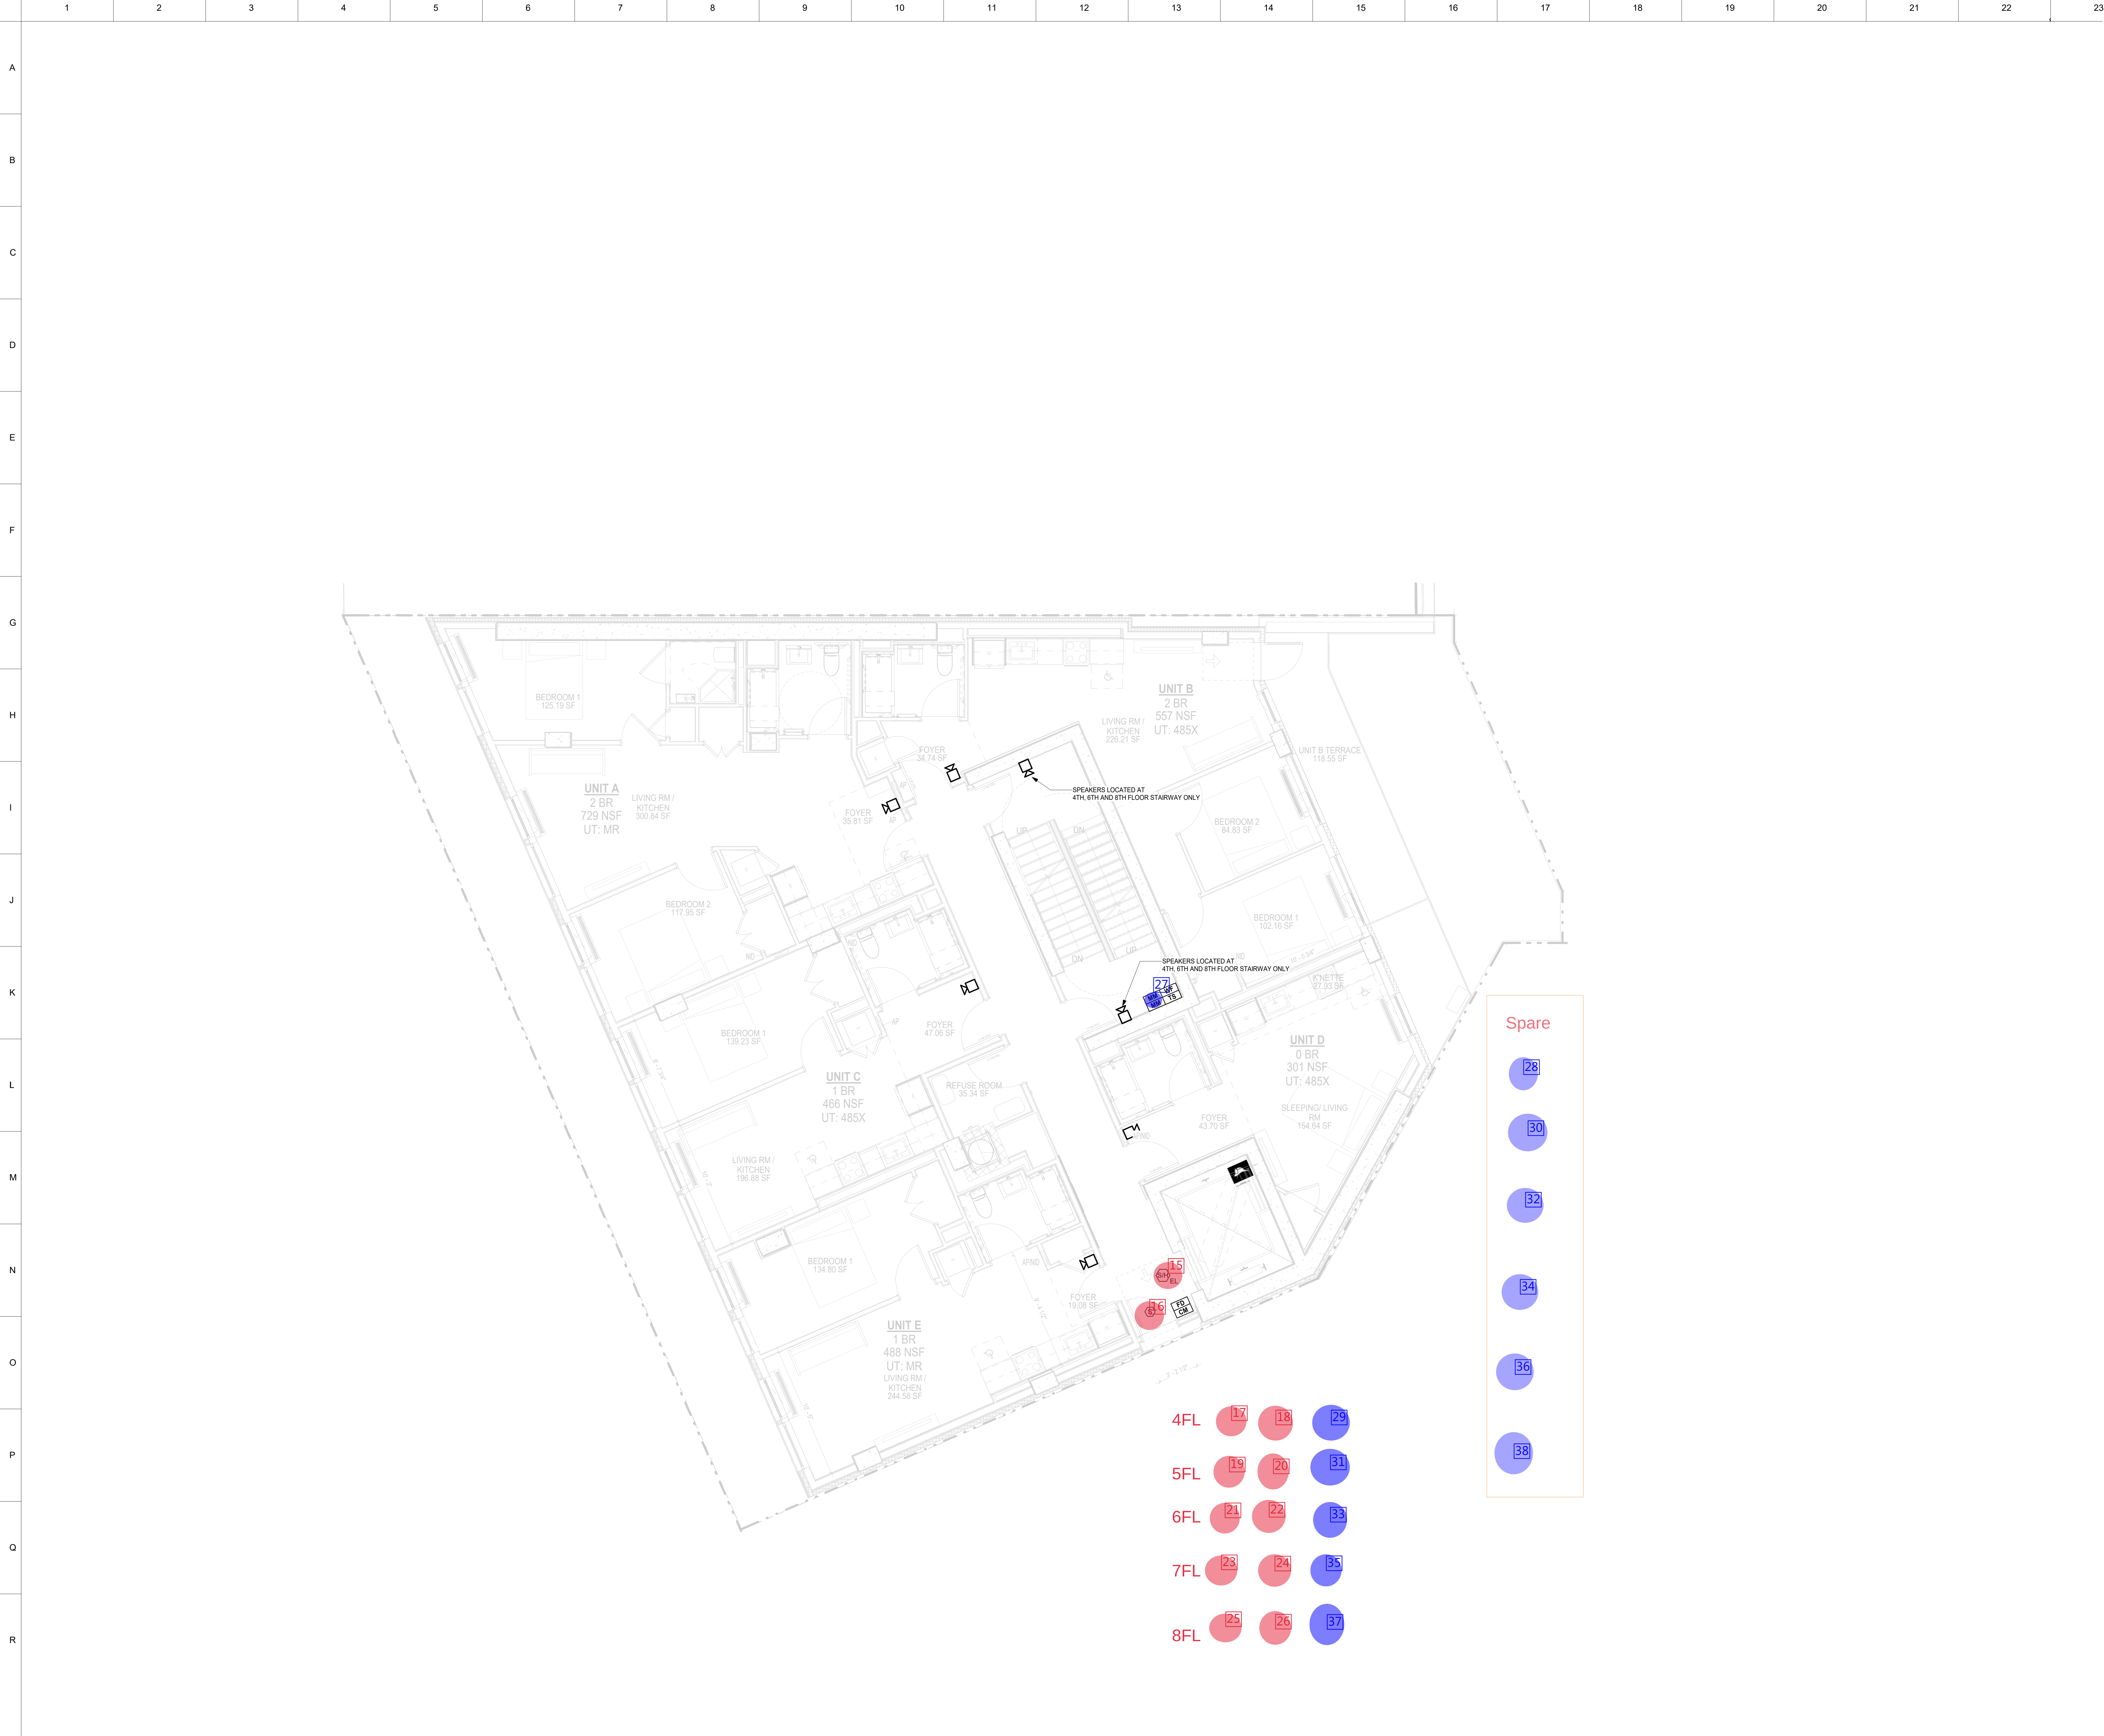

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS




FIRE ALARM - 3RD TO
8TH FLOOR PLANS -
BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-103.00
SHEET OF
DOB BSCAN STICKER

PLUMBING
ELECTRICAL
MECHANICAL
STRUCTURAL
ARCHITECTURAL

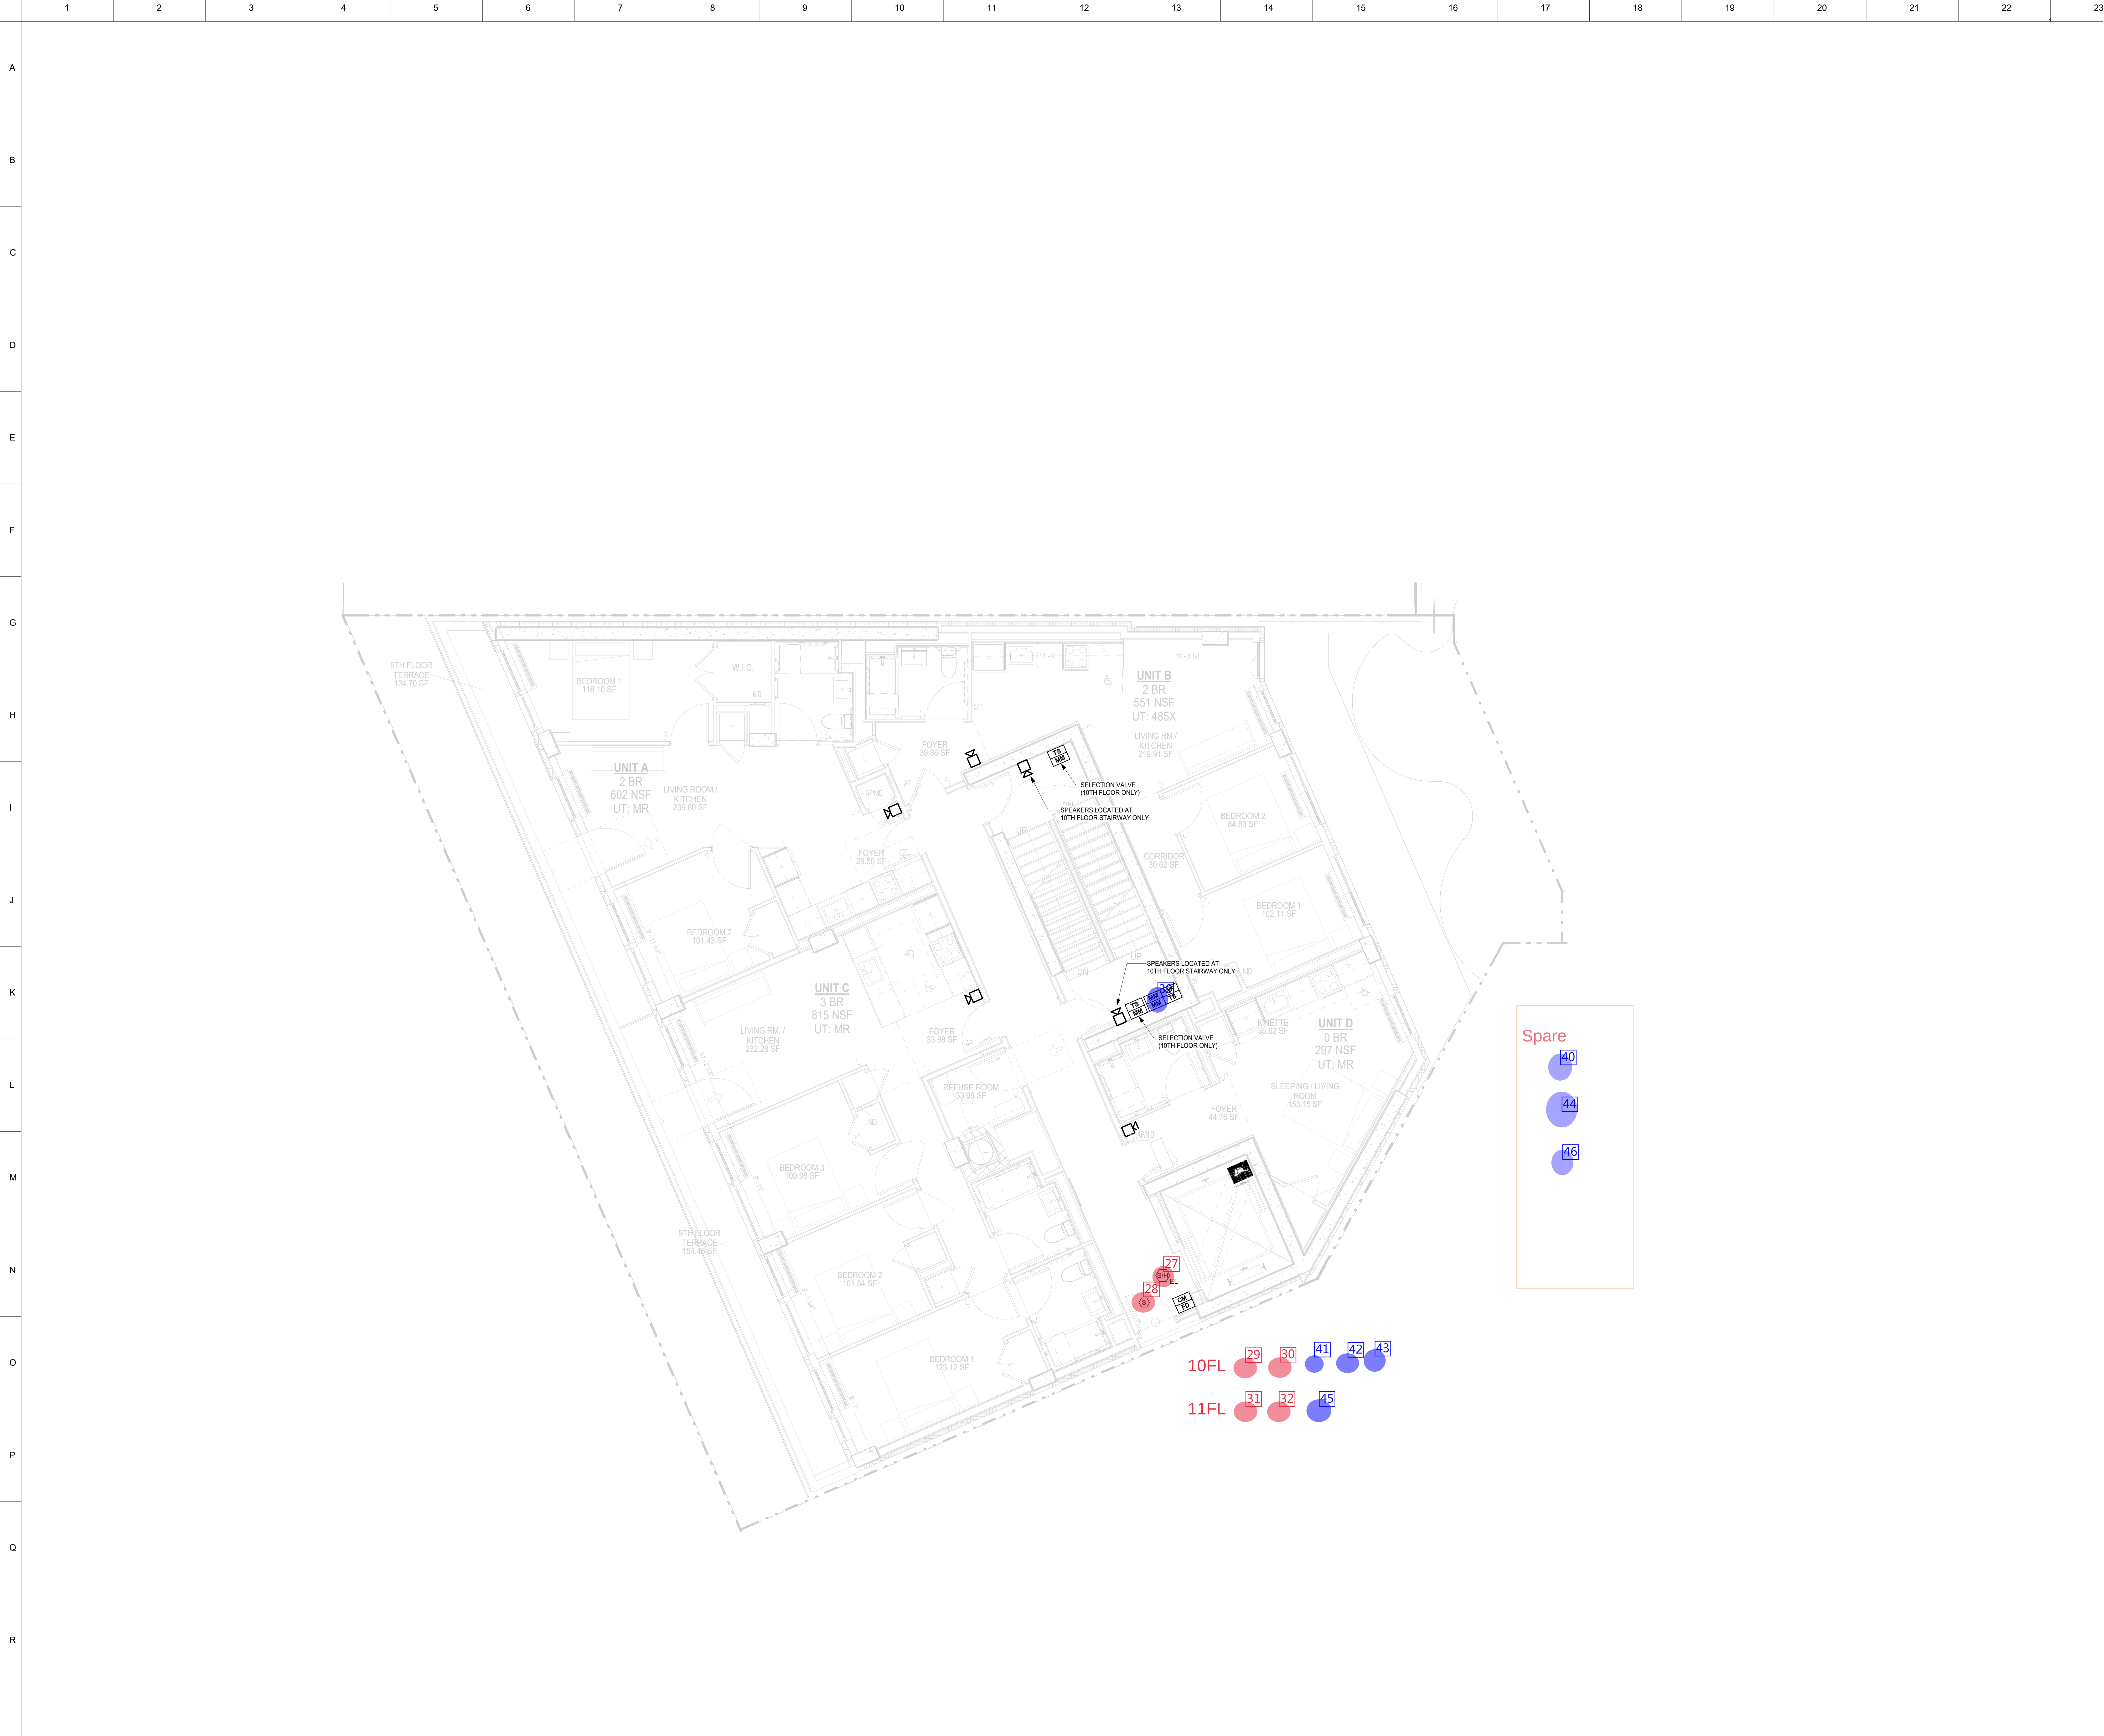

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



FIRE ALARM - 9TH TO
11TH FLOOR PLANS -
BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-104.00

SHEET OF
DOB BSCAN STICKER


PLUMBING

ELECTRICAL

MECHANICAL

STRUCTURAL

ARCHITECTURAL

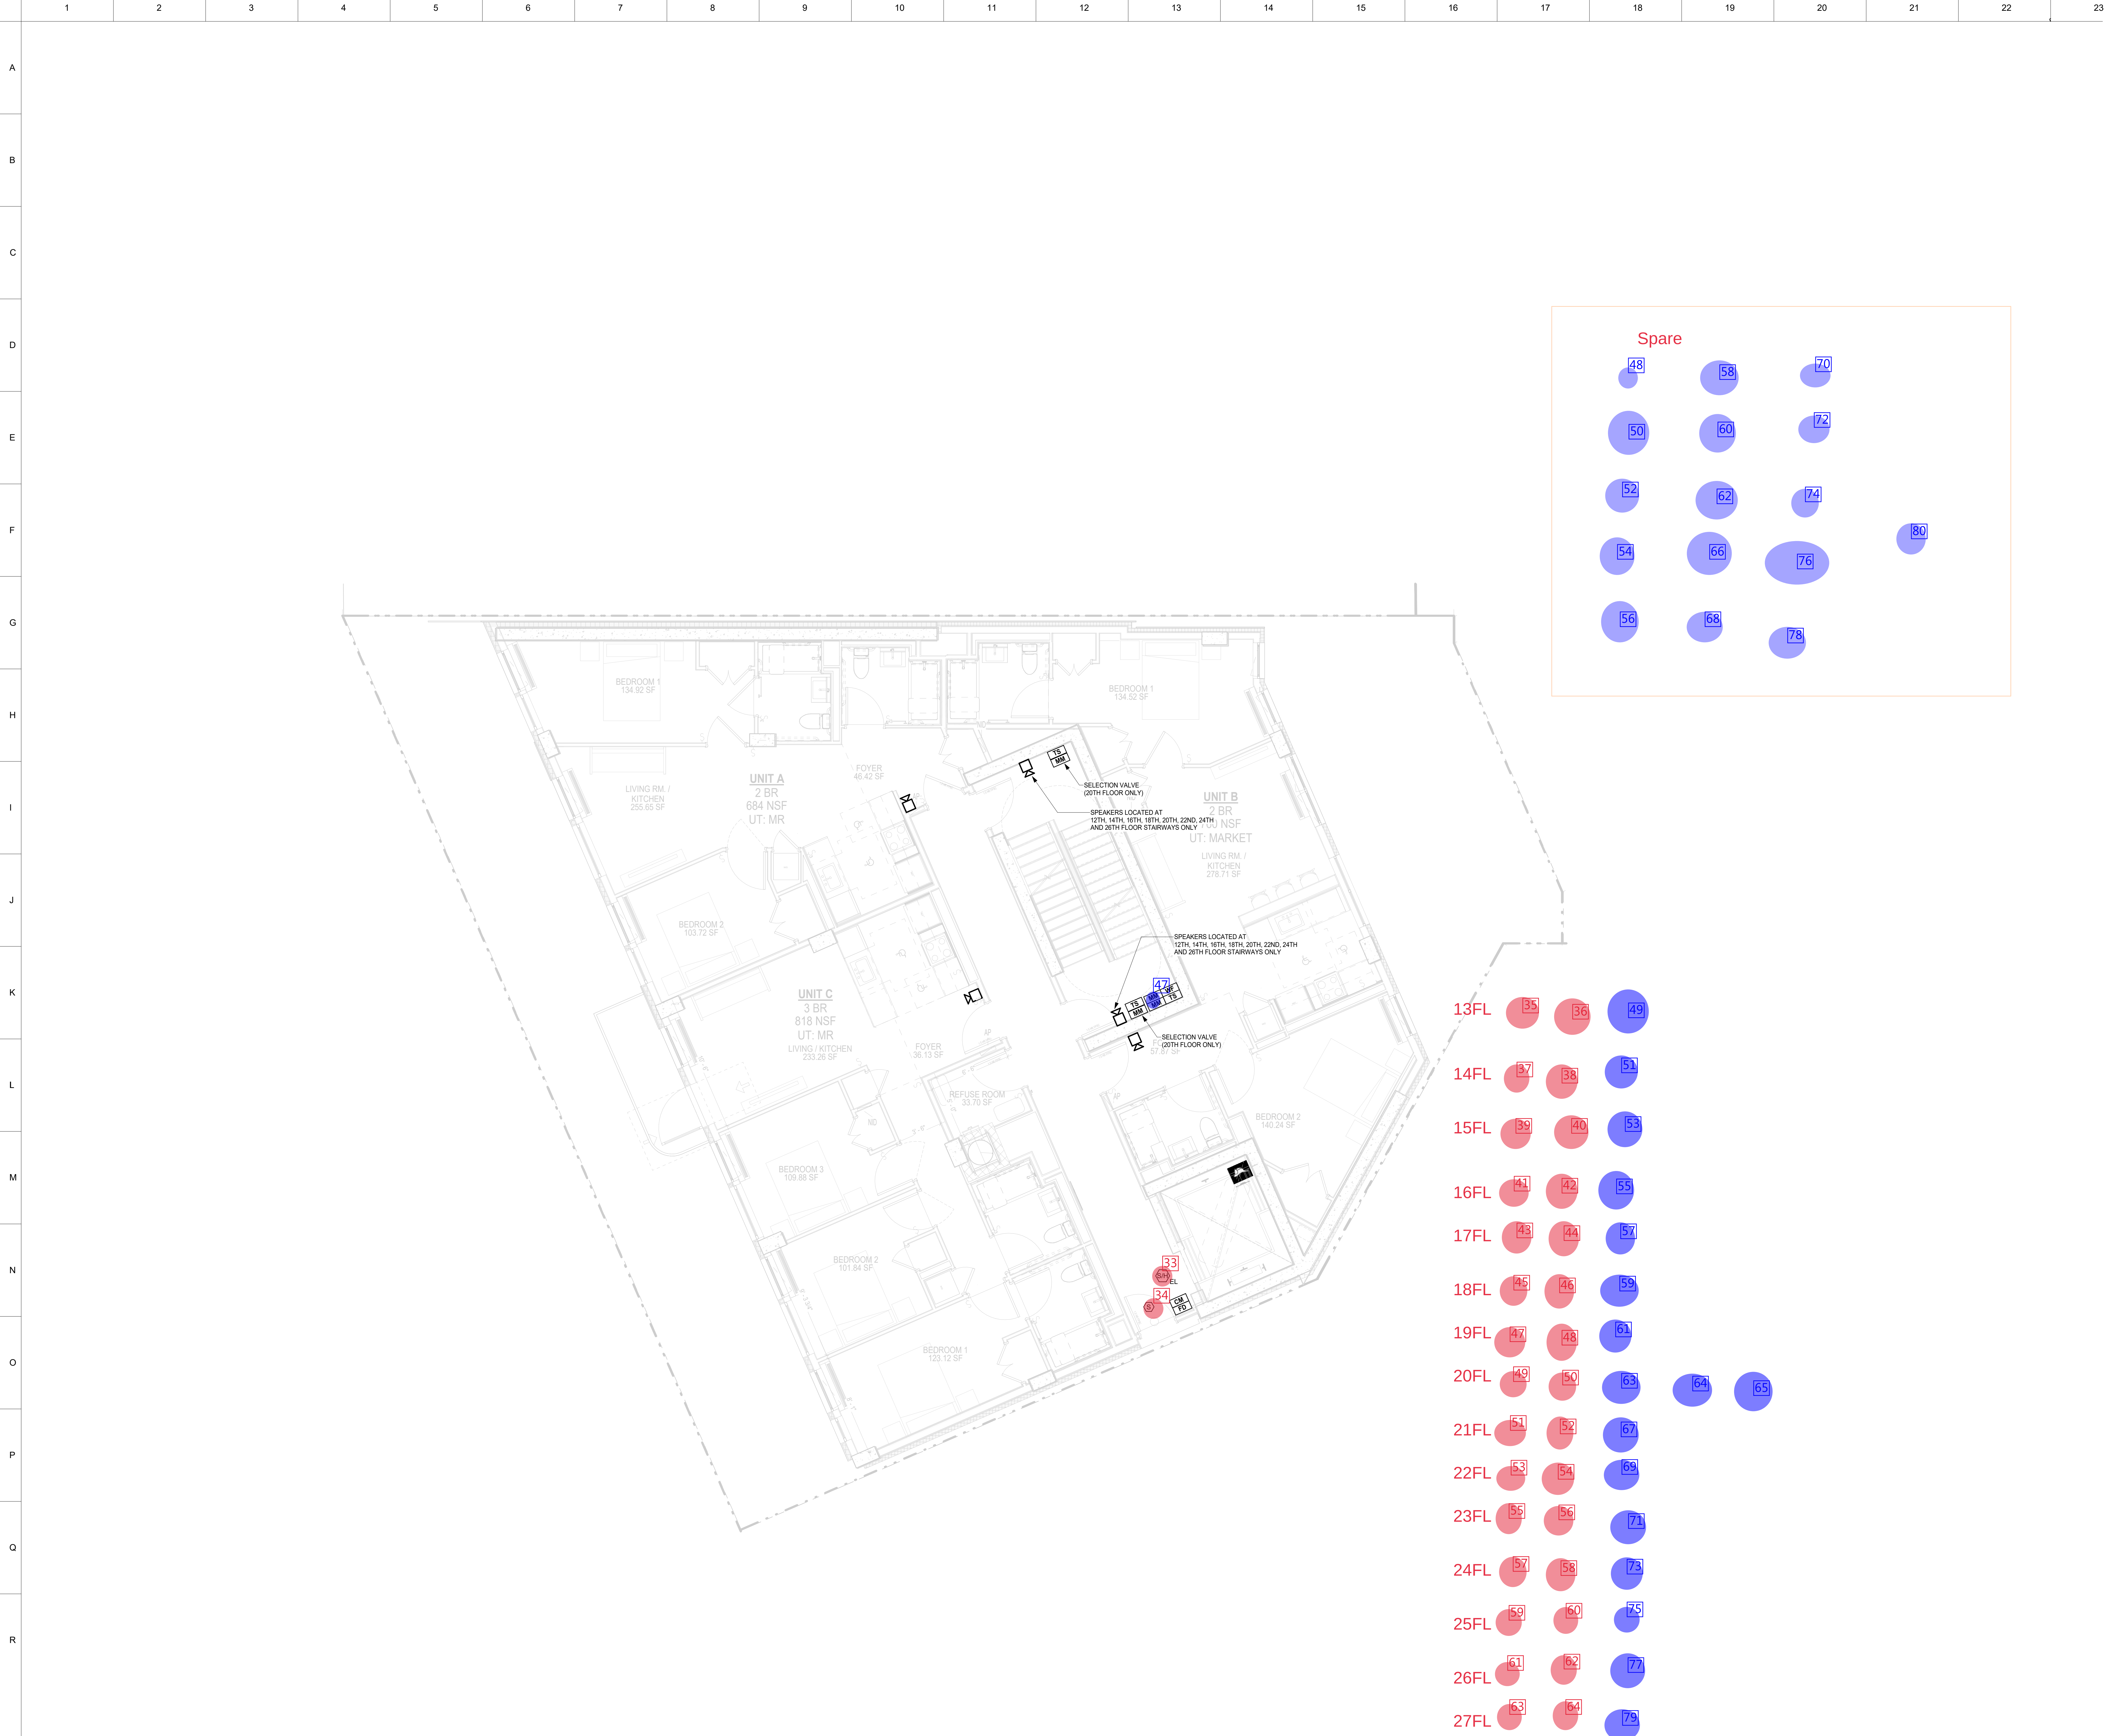

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for best fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS




FIRE ALARM - 12TH TO
27TH FLOOR PLANS -
BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-105.00

SHEET OF
DOB BSCAN STICKER

PLUMBING
ELECTRICAL
MECHANICAL
STRUCTURAL
ARCHITECTURAL

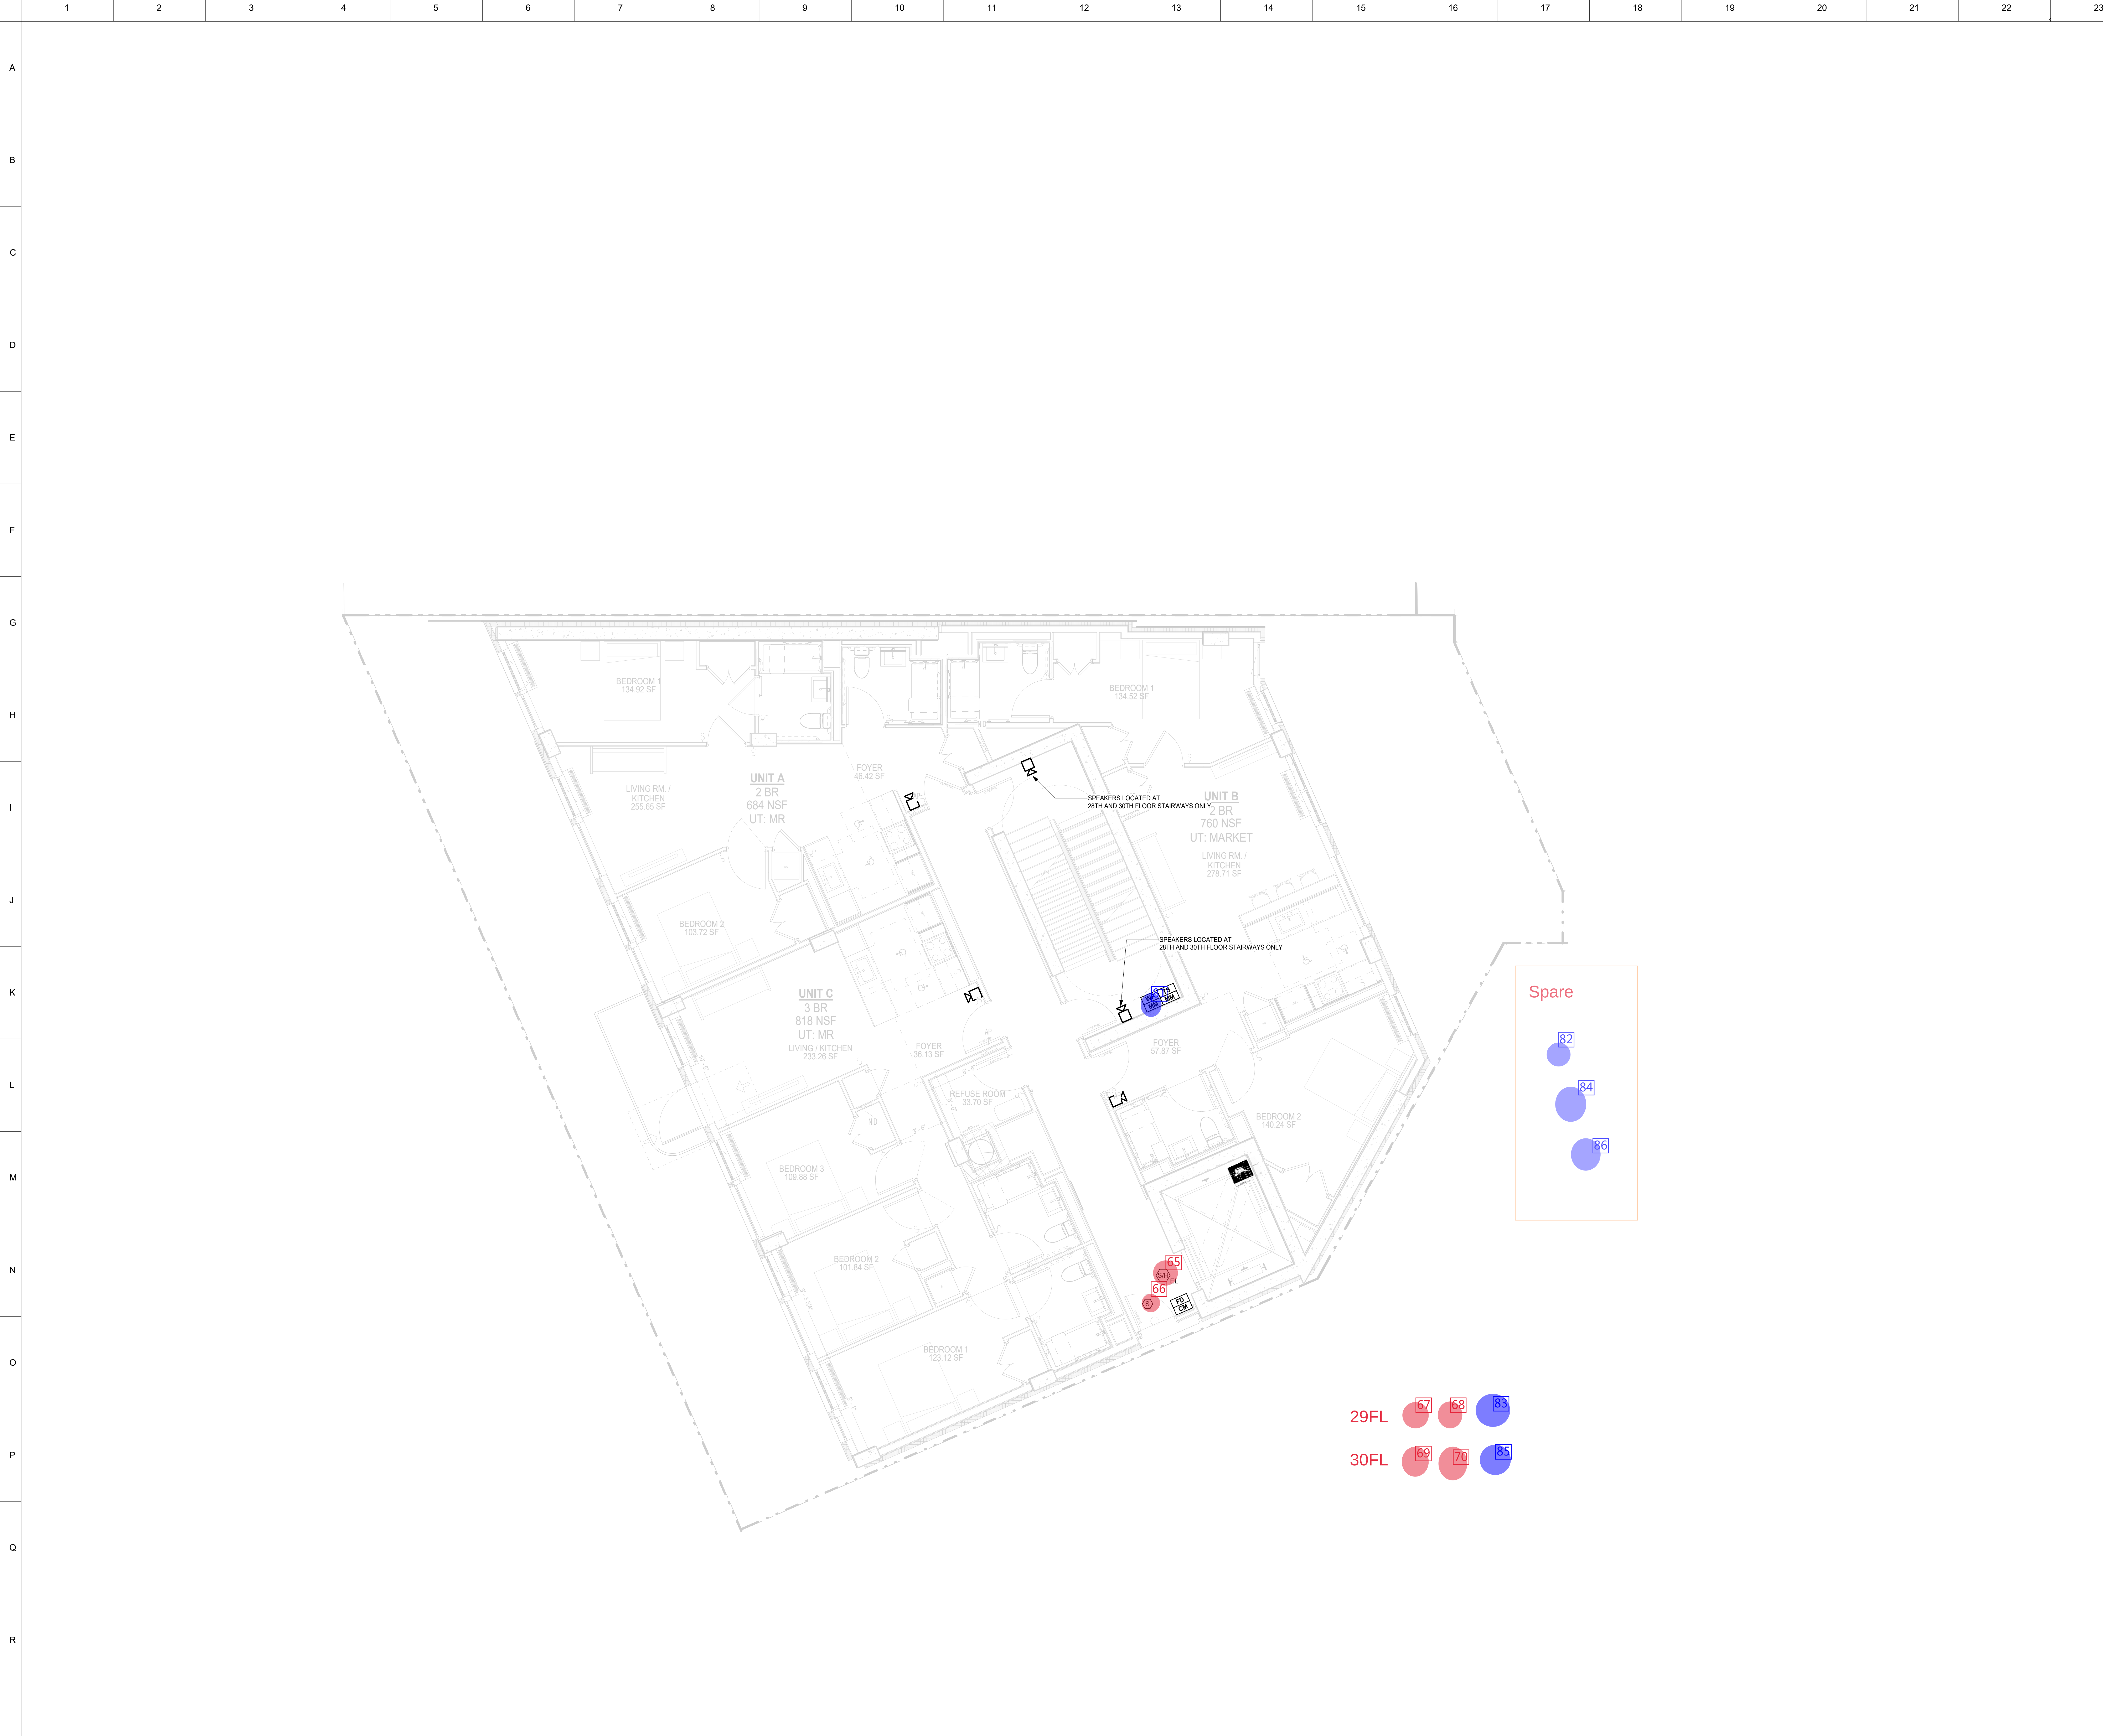

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



FIRE ALARM - 28TH -
30TH FLOOR PLAN -
BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-106.00

SHEET OF
DOB BSCAN STICKER


PLUMBING

ELECTRICAL

MECHANICAL

STRUCTURAL

ARCHITECTURAL

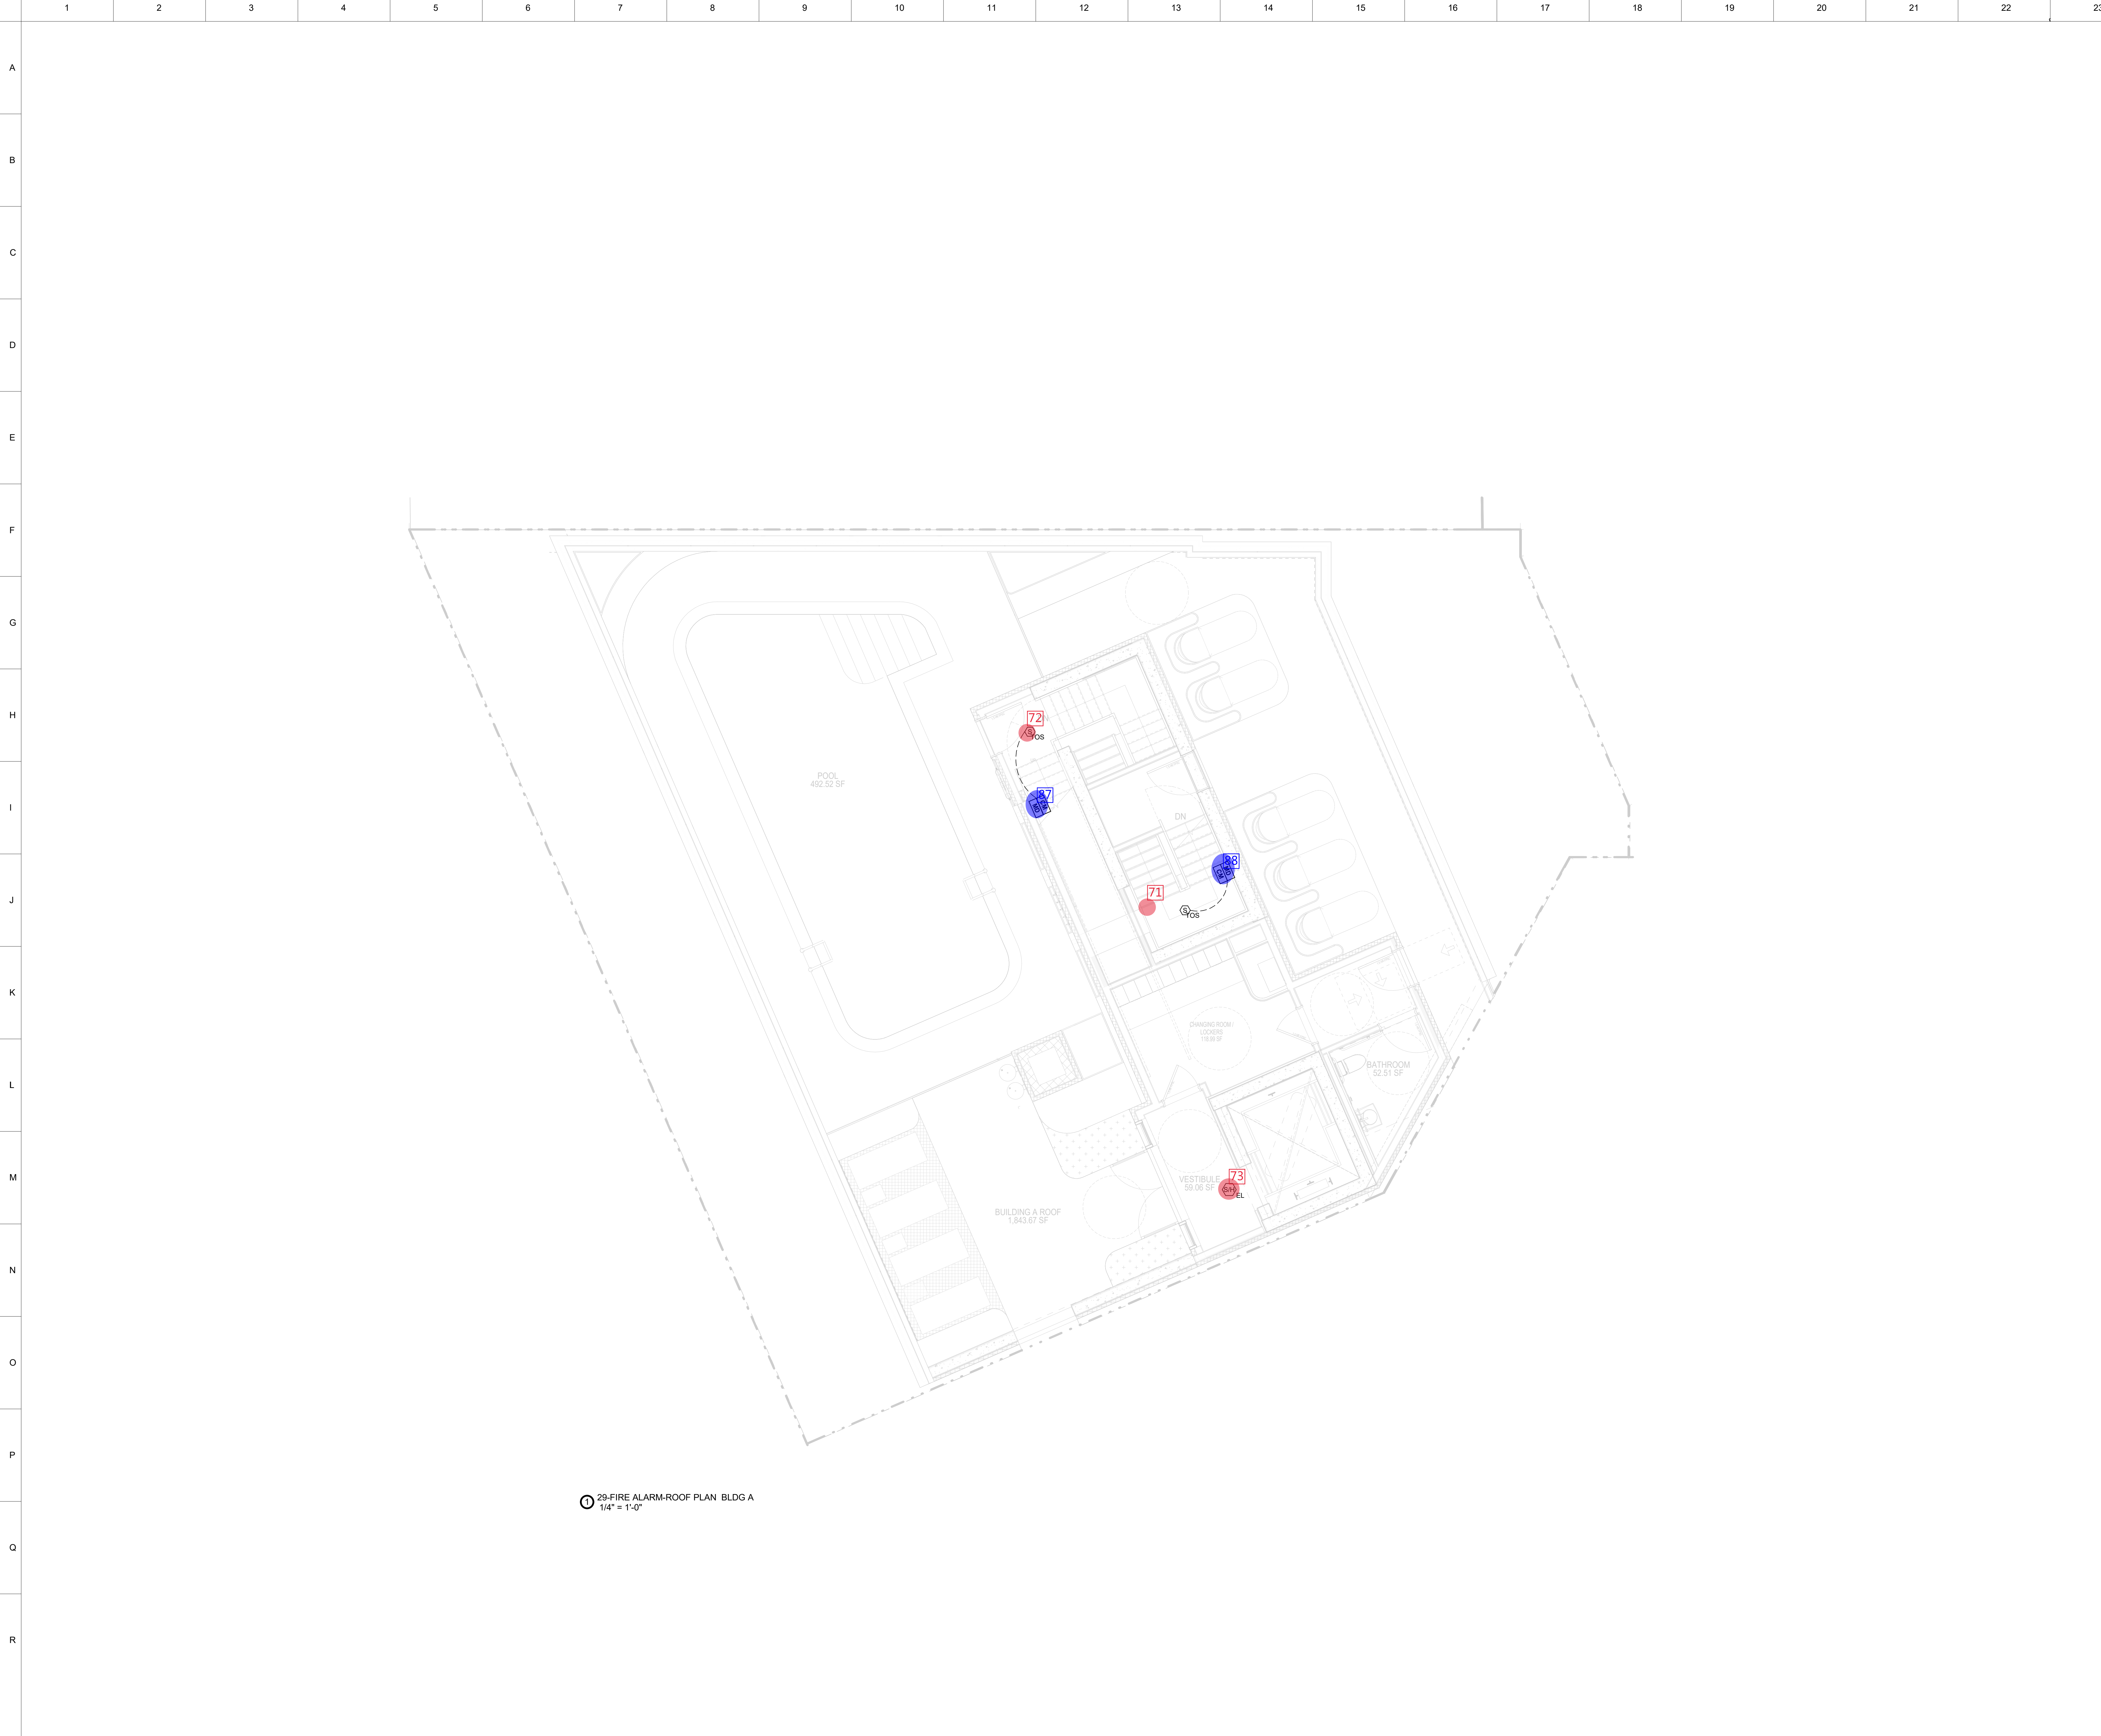

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.



J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.569.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



FIRE ALARM - ROOF
PLAN - BUILDING A

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	1/4" = 1'-0"

FA-107.00

SHEET OF
DOB BSCAN STICKER

Owner

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for field fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a contract between sealed drawings and electronic files the sealed drawings will govern.

FA-108.00

SHEET OF

DOB BSCAN STICKER

③ 33-FIRE ALARM - EMR PLAN BLDG A
1/4" = 1'-0"

283 Flatbush Ave
Extension, Brooklyn,
NY-11201.

jfa

J FRANKL ARCHITECTS
16 Court Street, 36th Floor
Brooklyn, NY 11241
718.669.2200

Structural Engineer

Mechanical Engineer

DOB Consultant

Owner

REVISION TABLE		
NUMBER	DATE	DESCRIPTION
	2024-12-20	80%CD / ISSUED FOR PRICING
	2025-04-11	ISSUED FOR 100% CD
	2025-05-22	ISSUED FOR FDNY

CAD files, sealed drawings and specifications are instruments of service whose ownership belongs to Joseph Frankl, RA. Unauthorized use, changes or publication are prohibited unless expressly approved by Joseph Frankl, RA. Infringements will be prosecuted. Contractor shall verify all field conditions and dimensions and be responsible for best fit and quantity of work. No allowances shall be made on behalf of the contractor for any error or neglect on his part. In a conflict between sealed drawings and electronic files, the sealed drawings will govern.

PROGRESS



**FIRE ALARM - RISER
DIAGRAM - BUILDING A**

DOB JOB #	
BIN #	
DATE	MM-DD-YYYY
DRAWN BY	Author
SCALE	12" = 1'-0"

FA-300.00

SHEET OF
DOB BSCAN STICKER

PLUMBING

ELECTRICAL

MECHANICAL

STRUCTURAL

ARCHITECTURAL

