
VACCUM INTERRUPTER (GV 001)

PATENT REGN NO.: 207951, DATE: 19TH January 2007

Vacuum interrupter is the most efficient device used for arc quenching used in circuit breakers. They efficiently break the circuit in spite of high potential difference and high current due to absence of conducting medium in the vacuum. The GV001 series is designed to withstand and operate at 36KV potential and peak current of 25 kA.

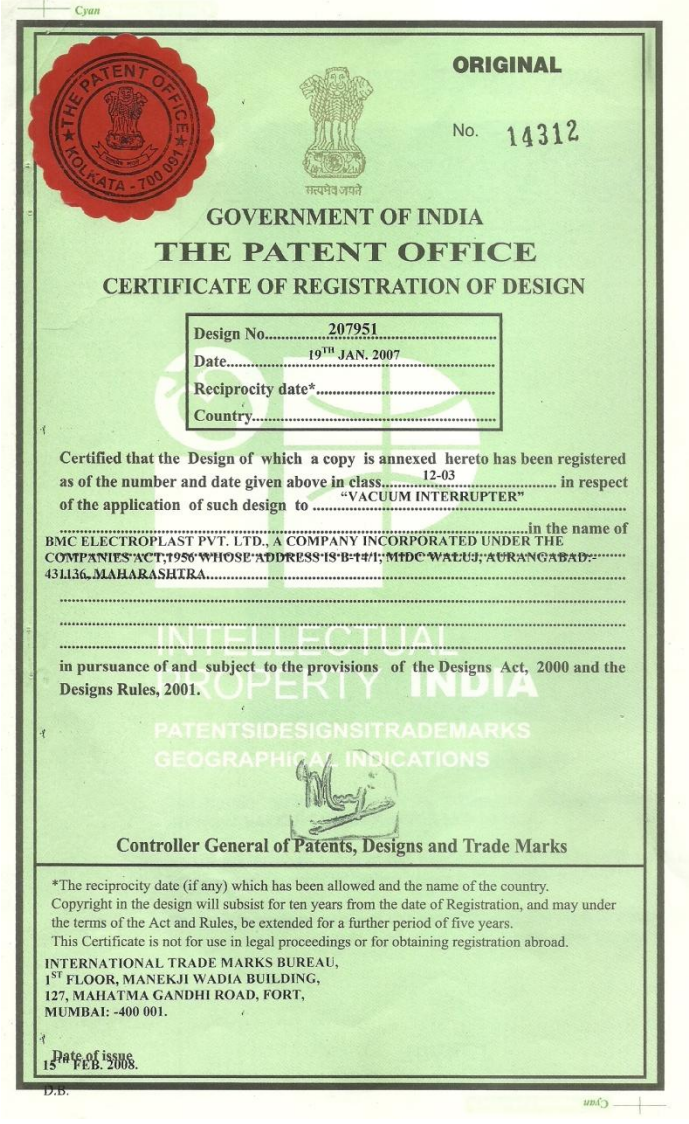

ORIGINAL

No. 14312

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 207951

Date 19TH JAN. 2007

Reciprocity date*

Country

Certified that the Design of which a copy is annexed hereto has been registered as of the number and date given above in class 12-03 in respect of the application of such design to "VACUUM INTERRUPTER"

in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT,1956 WHOSE ADDRESS IS B-14/1, MIDC WALUJ, AURANGABAD-431136, MAHARASHTRA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.

Copyright in the design will subsist for ten years from the date of Registration, and may under the terms of the Act and Rules, be extended for a further period of five years.

This Certificate is not for use in legal proceedings or for obtaining registration abroad.

INTERNATIONAL TRADE MARKS BUREAU,
1ST FLOOR, MANEKJI WADIA BUILDING,
127, MAHATMA GANDHI ROAD, FORT,
MUMBAI: -400 001.

Date of issue
15TH FEB. 2008.


D.B.



VACCUM INTERRUPTER (GV 004)

PATENT REGN NO.: 207953, DATE: 19TH January 2007

Vacuum interrupter is the most efficient device used for arc quenching used in circuit breakers. They efficiently break the circuit in spite of high potential difference and high current due to absence of conducting medium in the vacuum. The GV004 series is designed to withstand and a potential of 36KV operating at 2500A and peak current of 25 kA.

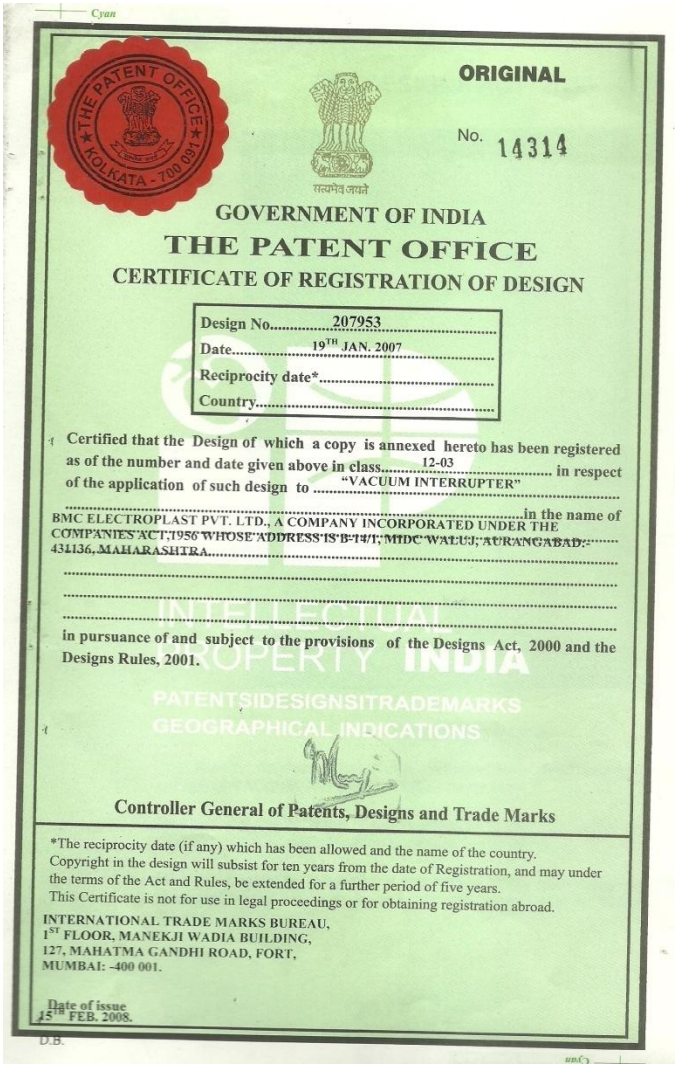

ORIGINAL

No. 14314

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 207953

Date 19TH JAN. 2007

Reciprocity date*

Country

Certified that the Design of which a copy is annexed hereto has been registered as of the number and date given above in class 12-03 in respect of the application of such design to "VACUUM INTERRUPTER"

in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT,1956 WHOSE ADDRESS IS B-14/1, MIDC WALUJ, AURANGABAD-431136, MAHARASHTRA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may under the terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad.

INTERNATIONAL TRADE MARKS BUREAU,
1ST FLOOR, MANEKJI WADIA BUILDING,
127, MAHATMA GANDHI ROAD, FORT,
MUMBAI: -400 001.


Date of issue
15TH FEB. 2008.



VACCUM INTERRUPTER (GV 006)

PATENT REGN NO.: 207952, DATE: 19TH January 2007

Vacuum interrupter is the most efficient device used for arc quenching used in circuit breakers. They efficiently break the circuit in spite of high potential difference and high current due to absence of conducting medium in the vacuum. The GV006 series is designed to withstand and operate at 36KV potential and peak current of 25 kA.

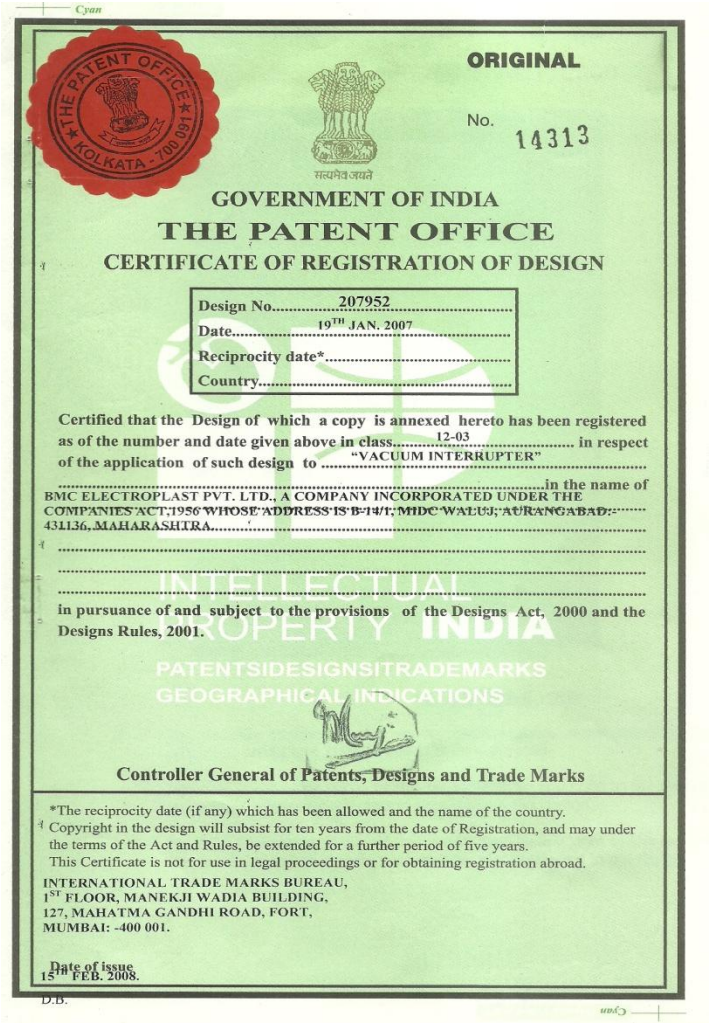

ORIGINAL

No. 14313

सत्यमेव जयते

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 207952

Date 19TH JAN. 2007

Reciprocity date*

Country

Certified that the Design of which a copy is annexed hereto has been registered as of the number and date given above in class 12-03 in respect of the application of such design to "VACUUM INTERRUPTER"

in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT,1956 WHOSE ADDRESS IS B-14/1, MIDC WALUJ, AURANGABAD:- 431136, MAHARASHTRA.

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.

Copyright in the design will subsist for ten years from the date of Registration, and may under the terms of the Act and Rules, be extended for a further period of five years.

This Certificate is not for use in legal proceedings or for obtaining registration abroad.

INTERNATIONAL TRADE MARKS BUREAU,
1ST FLOOR, MANEKJI WADIA BUILDING,
127, MAHATMA GANDHI ROAD, FORT,
MUMBAI: -400 001.

Date of issue
15TH FEB. 2008.

D.B.



TRANSFORMER

(OUTDOOR DRY TYPE CEP CT)

PATENT REGN NO.: 208540, DATE: 21ST February 2007

The specialty & novelty of the product lies in the concept of casting the dry type current transformer in a Cycloeliphatic polymer or CEP polymer structure. This increases the insulation of the transformer between terminals and reduces leakage losses. Also the CEP casted transformer is safe from any sort of damage to core during handling.



ORIGINAL

No. 14578

सत्यमेव जयते

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 208540

Date 21ST FEB. 2007

Reciprocity date*

Country

Certified that the Design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-02 "TRANSFORMER" in respect of the application of such design to in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS B-44/1, MIDC WALUJ, AURANGABAD 431136, MAHARASHTRA, INDIA.

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may under the terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad.
INTERNATIONAL TRADE MARKS BUREAU,
1ST FLOOR, MANEKJI WADIA BUILDING,
127, MAHATMA GANDHI ROAD, FORT,
MUMBAI: -400 001.

Dated this 4th MARCH 2008

D.P.




VACCUM CONTACTOR

(COMBINE HOUSING TYPE)

PATENT REGN NO.: 223930, DATE: 22nd July, 2009

The specialty & novelty of the product lies in the process of casting three individual vacuum interrupter into one structure. This reduces assembly time making assembly faster & compact. Combining the vacuum interrupters of 3 poles in one housing makes handling easier & epoxy casted poles provides good insulation between poles.

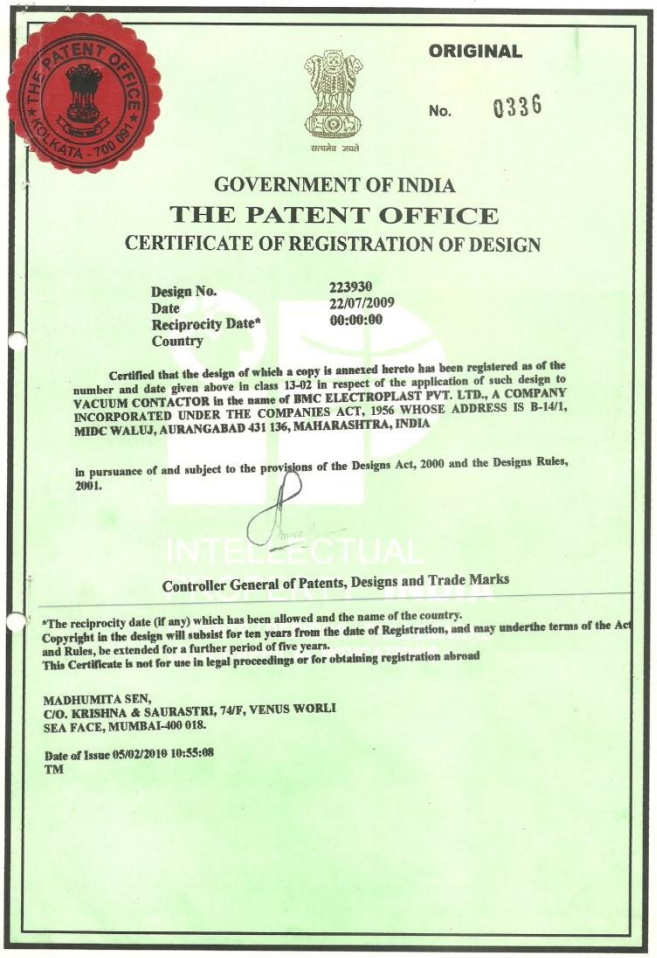

ORIGINAL

No. 0336

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No.	223930
Date	22/07/2009
Reciprocity Date*	00:00:00
Country	

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-02 in respect of the application of such design to VACUUM CONTACTOR in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS B-14/1, MIDC WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
C/O. KRISHNA & SAURASTRI, 74/F, VENUS WORLI
SEA FACE, MUMBAI-400 018.

Date of Issue 05/02/2010 10:55:08
TM





DRIVE FOR VACCUM CIRCUIT BREAKER

(FOR 12KV DRIVE LINKAGE)

PATENT REGN NO.: 245303, DATE: 14th May 2012

The specialty & novelty of the product lies in the design of the mechanism which is used to operate 3 poles of vacuum circuit breaker simultaneously with the aid of a single mechanism. This mechanism operates the pole instantly without minimum delay. The contact loading spring operates with a force to operate the breaker at 12KV. The rotating type mechanism provides sufficient space for easy assembly & workmanships.



ORIGINAL

No. 20809

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245303
Date 14/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to DRIVER FOR VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI
SEA FACE MUMBAI 400 018

Date of Issue 11/01/2013 13:38:10



DRIVE FOR VACCUM CIRCUIT BREAKER

(FOR 36 KV DRIVE LINKAGE)

PATENT REGN NO.: 245304, DATE: 14th May 2012

The specialty & novelty of the product lies in the design of the mechanism which is used to operate 3 poles of vacuum circuit breaker simultaneously with the aid of a single mechanism. This mechanism operates the pole instantly without minimum delay. The contact loading spring operates with a force to operate the breaker at 36KV. The rotating type mechanism provides sufficient space for easy assembly & workmanship.



ORIGINAL

No. 21491

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245304
Date 14/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to DRIVER FOR VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI
SEA FACE MUMBAI 400018

Date of Issue 21/02/2013 17:06:14



POLE ASSEMBLY FOR VACCUM CIRCUIT BREAKER

(FOR 36KV OD VCB)

PATENT REGN NO.: 245305, DATE: 14th May 2012

The specialty & novelty of the product lies in the concept of assembling the Vacuum interrupter in such a way that it can be mechanically operated a drive insulator by the drive linkage. The Vacuum interrupter is placed between 2 aluminum plates which are connected to bus bar. So opening or closing the Vacuum interrupter the line between the bus bars can be connected or disconnected and that too via an insulated medium (drive insulator) connecting it to the mechanism



ORIGINAL

No. 20849

GOVERNMENT OF INDIA
THE PATENT OFFICE
CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245305
Date 14/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to POLE ASSEMBLY FOR VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI
SEA FACE MUMBAI 400 018

Date of Issue 16/01/2013 12:35:50



EMBEDDED POLE FOR VACUUM CONTACTOR

(7.2 KV EPCOS TYPE)

PATENT REGN NO.: 245306, DATE: 14th May 2012

The specialty & novelty of the product lies in the design of integration of the vacuum interrupter in the casted pole. The 7.2kv vacuum interrupter is placed in casting machine & casted in epoxy. Epoxy provides good insulation, less chances of damage to VI during transportation and easy & stable assembly in the contactor. This types of poles can be used for 3 pole, 2 pole or 1 pole Vacuum contactor.



ORIGINAL

No. 23588

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245306
Date 14/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to EMBEDDED POLE FOR VACUUM CONTACTOR in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI SEA
FACE MUMBAI 400 018

Date of Issue 31/05/2013 14:48:12




VACCUM CIRCUIT BREAKER

(MECHANISHM FOR 12KV, 25KA VCB)

PATENT REGN NO.: 245307, DATE: 14th May 2012

The specialty & novelty of the product lies in the design of the mechanism that is used to operate the 3 poles of vacuum interrupters simultaneously manually or electrically to connect or disconnect a 12KV, 25KA line. This mechanism drives a drive linkage that operates the 3 phases simultaneously. Spring operated Mechanisms are operated by manual lever or electrical coil & motors to close and trip the machine as per requirement.

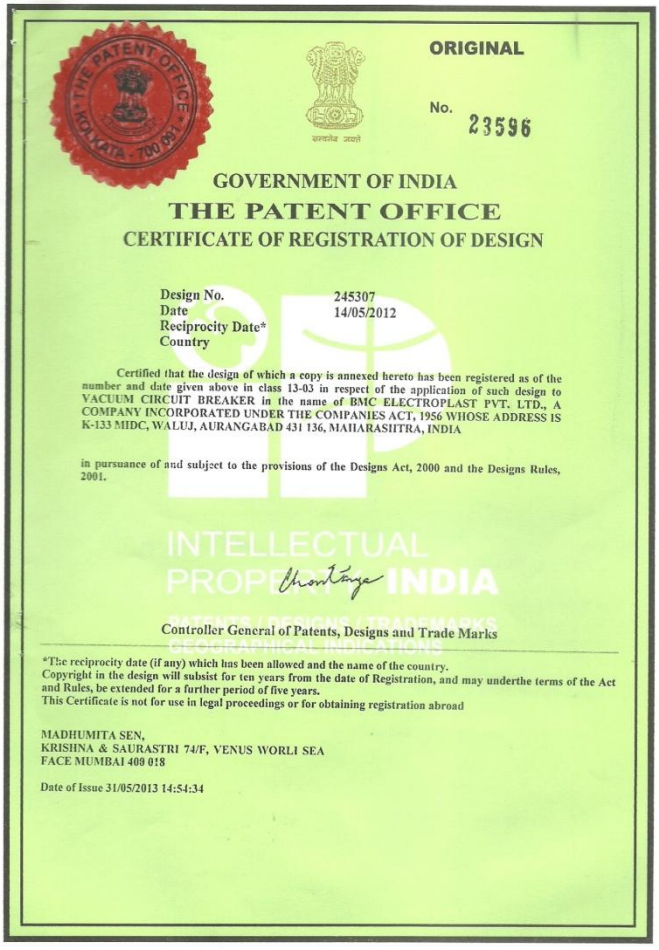

ORIGINAL

No. 23596

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245307
Date 14/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA


in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI SEA
FACE MUMBAI 400 018

Date of Issue 31/05/2013 14:54:34

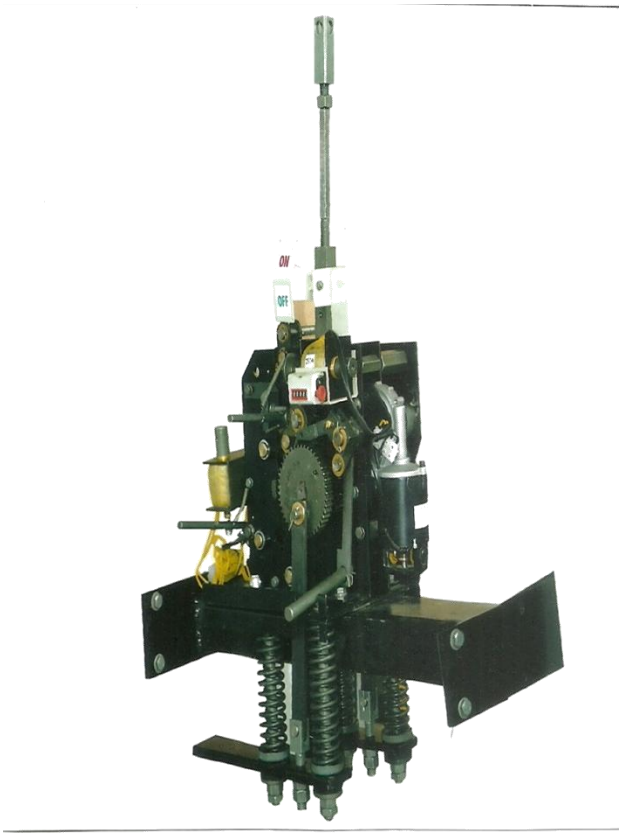

VACCUM CIRCUIT BREAKER

(MECHANISHM FOR 36KV, 25KA VCB)

PATENT REGN NO.: 245349, DATE: 15th May 2012

The specialty & novelty of the product lies in the design of the mechanism that is used to operate the 3 poles of vacuum interrupters simultaneously manually or electrically to connect or disconnect a 36KV, 25KA line. This mechanism drives a drive linkage that operates the 3 phases simultaneously. Spring operated Mechanisms are operated by manual lever or electrical coil & motors to close and trip the machine as per requirement. The springs to charge the mechanism are mounted separately to provide force to operate the drive linkage.



ORIGINAL

No. 23174

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245349
Date 15/05/2012
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA. INDIA


in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI SEA FACE MUMBAI 400 018

Date of Issue 16/05/2013 14:53:31

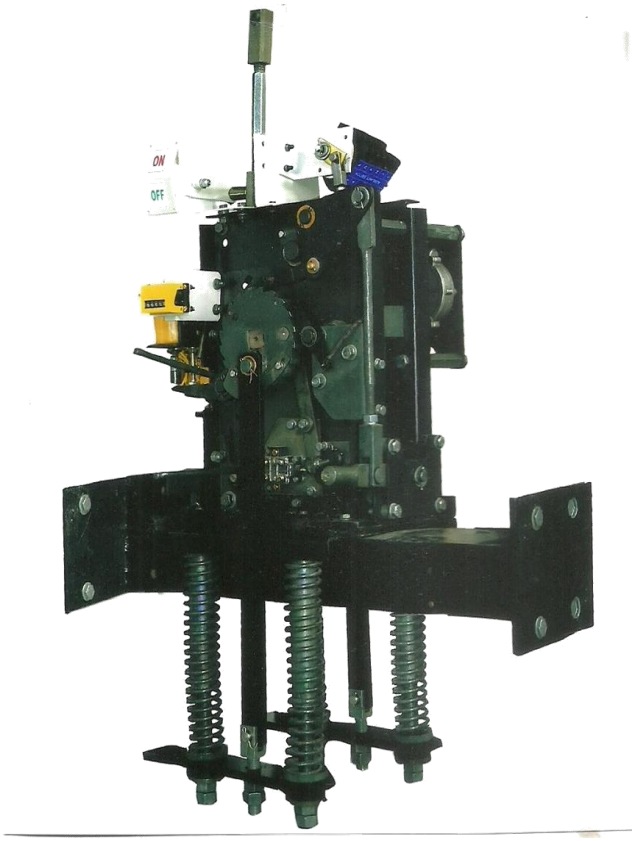


VACCUM CONTACTOR POLE

(HYBRID TYPE VC)

PATENT REGN NO.: 245350, DATE: 15th May 2012

The specialty & novelty of the product lies in the design of integration of the vacuum interrupter in the casted pole. The vacuum interrupter is placed in casting machine & casted in epoxy. Epoxy provides good insulation, less chances of damage to VI during transportation and easy & stable assembly in the contactor. The casted pole is assembled in vacuum contactor making a hybrid model of casted poles with assembled mechanism.

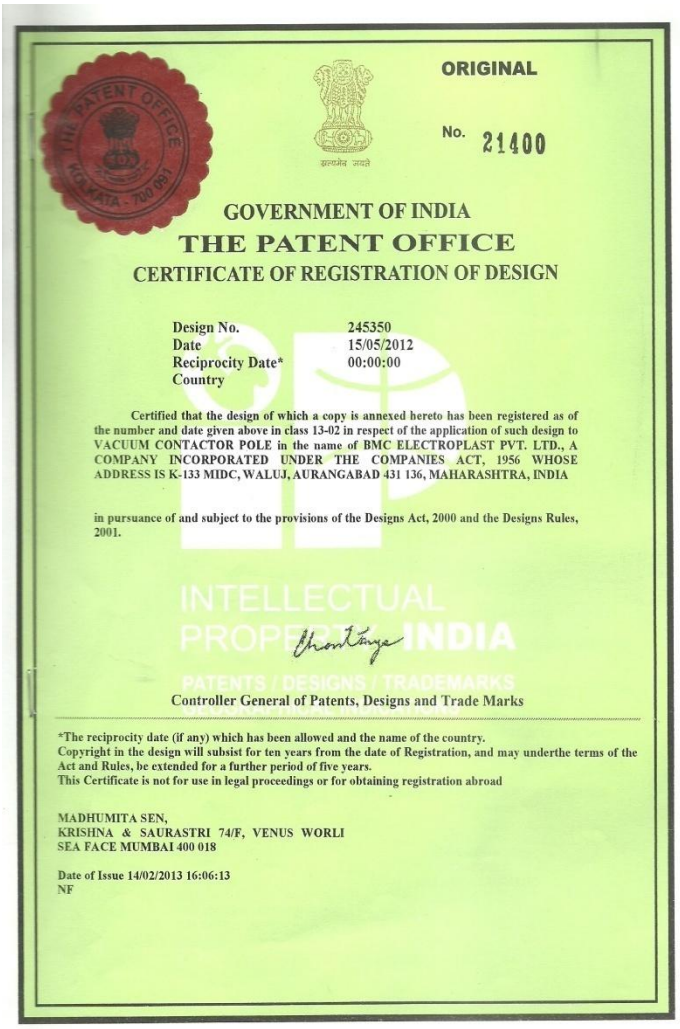

ORIGINAL

No. 21400

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No.	245350
Date	15/05/2012
Reciprocity Date*	00:00:00
Country	

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-02 in respect of the application of such design to VACUUM CONTACTOR POLE in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431 136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.


Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI
SEA FACE MUMBAI 400 018

Date of Issue 14/02/2013 16:06:13
NF



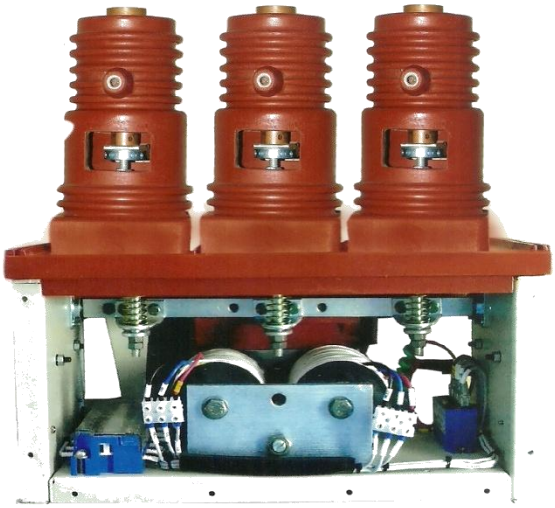


VACCUM CIRCUIT BREAKER

(MECHANISHM FOR 12KV, 40KA VCB)

PATENT REGN NO.: 245351, DATE: 15th May 2012

The specialty & novelty of the product lies in the design of the mechanism that is used to operate the 3 poles of vacuum interrupters simultaneously manually or electrically to connect or disconnect a 36KV, 25KA line. This mechanism drives a drive linkage that operates the 3 phases simultaneously. Spring operated Mechanisms are operated by manual lever or electrical coil & motors to close and trip the machine as per requirement. The springs to charge the mechanism are mounted separately to provide force to operate the drive linkage.

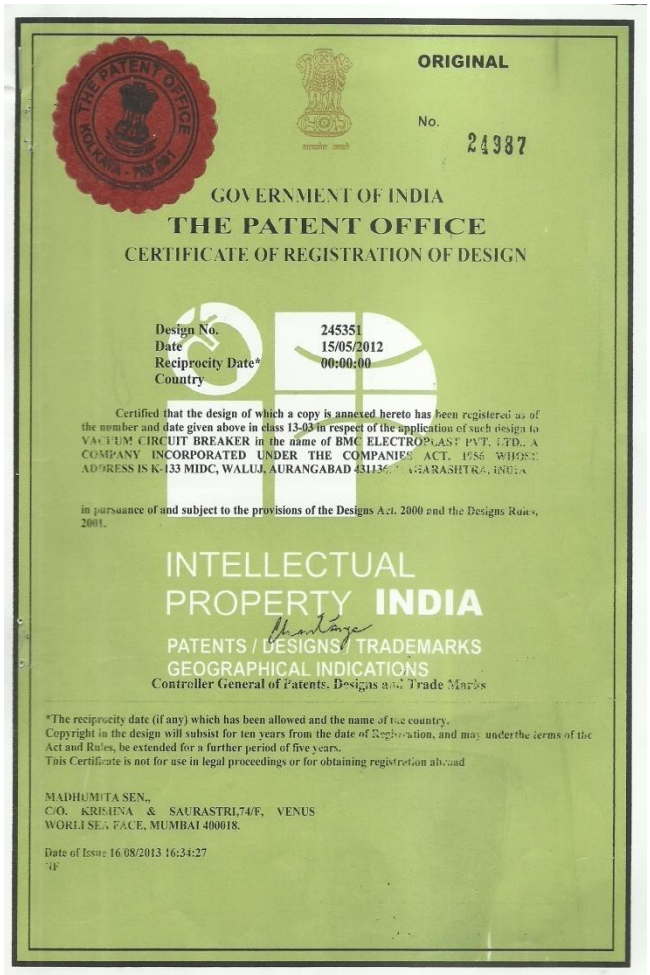

ORIGINAL

No. 24987

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No.	245351
Date	15/05/2012
Reciprocity Date*	00:00:00
Country	

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to VACUUM CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

INTELLECTUAL PROPERTY **INDIA**


PATENTS / DESIGNS / TRADEMARKS
GEOGRAPHICAL INDICATIONS


Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may, under the terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN.,
C/O. KRISHNA & SAURASTRI,74/F, VENUS
WORLI SEA FACE, MUMBAI 400018.

Date of Issue 16/08/2013 16:34:27
*IF

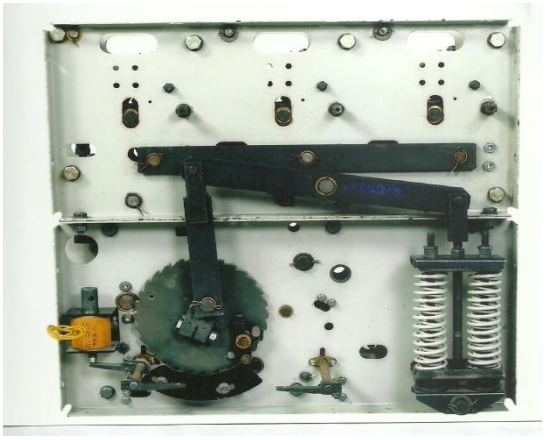

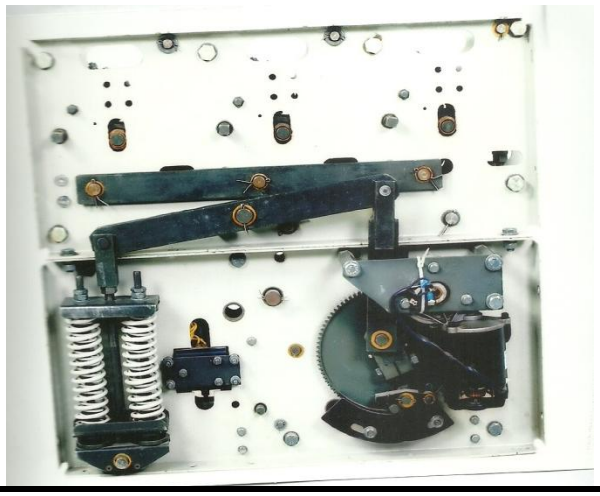

WALL THROUGH BUSHING FOR CSS

PATENT REGN NO.: 245352, DATE: 15th May 2012

The specialty & novelty of the product lies there in its design. The copper conductor is connected by brazing and then it is thoroughly insulated by casting it in epoxy resin by the technique of aerated pressure gellation. The insulation of the epoxy material is high. Also the insulation of the bare conductor to bare conductor is increased by the creep age provided in the design. This helps the wall through bushing sustain a voltage of 36 KV between its terminal without failure.



ORIGINAL

No. 20832

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 245352
Date 15/05/2012
Reciprocity Date* 00:00:00
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-02 in respect of the application of such design to WALL THROUGH BUSHING in the name of BMC ELECTROPLAST PVT. LTD., A COMPANY INCORPORATED UNDER THE COMPANIES ACT, 1956 WHOSE ADDRESS IS K-133 MIDC, WALUJ, AURANGABAD 431136, MAHARASHTRA, INDIA

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

INTELLECTUAL PROPERTY INDIA
PATENTS / DESIGNS / TRADEMARKS

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MADHUMITA SEN,
KRISHNA & SAURASTRI 74/F, VENUS WORLI
SEA FACE MUMBAI 400 018

Date of Issue 16/01/2013 10:56:28
NF




DRIVE FOR CIRCUIT BREAKER

(MECHANISM FOR 12KV, 25KA VCB, POMMIER)

PATENT REGN NO.: 260391, DATE: 17th February 2014

The specialty & novelty of the product lies in the design of the mechanism that it is used to operate the 3 poles vacuum interrupters in the 3 phases simultaneously make of brake a 12KV, 25 KA power line. This mechanism is fit in a assembly in a panel that is used for switching purpose of a 12 KV medium voltage line. Spring operated Mechanisms are operated by manual lever or electrical coil & motors to close and trip the machine as per requirement. The spring is mounted on side of the mechanism to make the arrangement more compact & agile.

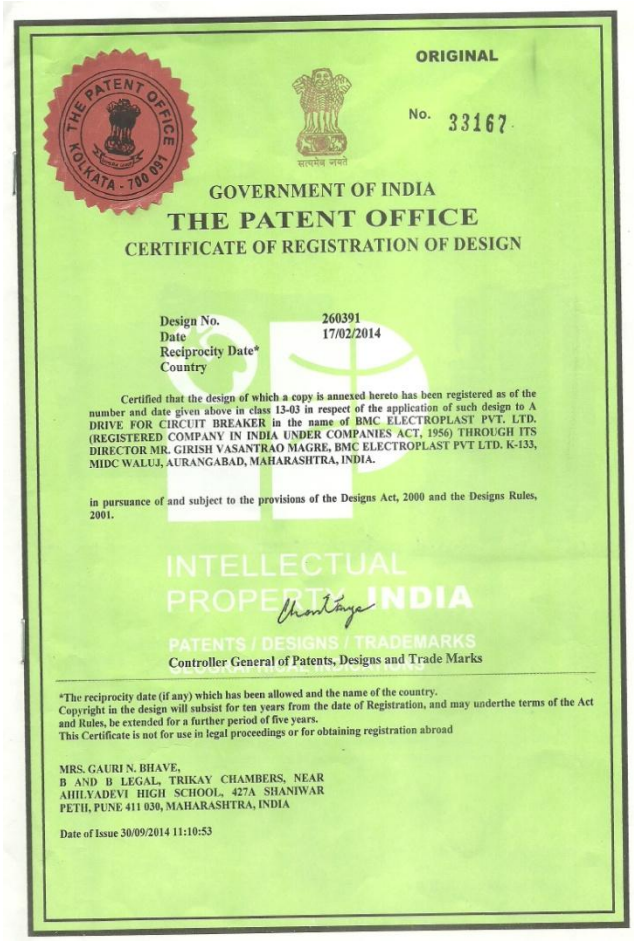

ORIGINAL

No. 33167

GOVERNMENT OF INDIA

THE PATENT OFFICE

CERTIFICATE OF REGISTRATION OF DESIGN

Design No. 260391
Date 17/02/2014
Reciprocity Date*
Country

Certified that the design of which a copy is annexed hereto has been registered as of the number and date given above in class 13-03 in respect of the application of such design to A DRIVE FOR CIRCUIT BREAKER in the name of BMC ELECTROPLAST PVT. LTD. (REGISTERED COMPANY IN INDIA UNDER COMPANIES ACT, 1956) THROUGH ITS DIRECTOR MR. GIRISH VASANTRAO MAGRE, BMC ELECTROPLAST PVT LTD. K-133, MIDC WALUJ, AURANGABAD, MAHARASHTRA, INDIA.

in pursuance of and subject to the provisions of the Designs Act, 2000 and the Designs Rules, 2001.

INTELLECTUAL PROPERTY INDIA


PATENTS / DESIGNS / TRADEMARKS

Controller General of Patents, Designs and Trade Marks

*The reciprocity date (if any) which has been allowed and the name of the country.
Copyright in the design will subsist for ten years from the date of Registration, and may underthe terms of the Act and Rules, be extended for a further period of five years.
This Certificate is not for use in legal proceedings or for obtaining registration abroad

MRS. GAURI N. BHAVE,
B AND B LEGAL, TRIKAY CHAMBERS, NEAR AHILYADEVI HIGH SCHOOL, 427A SHANIWAR PETH, PUNE 411 030, MAHARASHTRA, INDIA

Date of Issue 30/09/2014 11:10:53

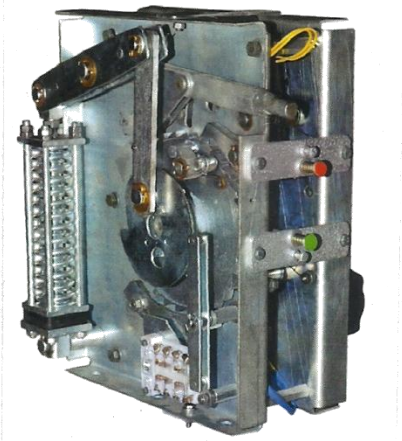



TRADEMARK REGN NO.: 1520743

प्ररूप ओ - 2
FORM O-2

सत्यमेव जयते

बौध्दिक सम्पदा, भारत
Intellectual Property, India

भारत सरकार
GOVERNMENT OF INDIA
व्यापार चिन्ह रजिस्ट्री
TRADE MARKS REGISTRY

क्रमांक
No. 855230

व्यापार चिन्ह अधिनियम, 1999
Trade Marks Act, 1999

व्यापार चिन्ह के रजिस्ट्रीकरण का प्रमाणपत्र, धारा 23 (2) नियम 62 (I)

Certificate of Registration of Trade Mark, Section 23 (2), Rule 62 (1)

व्यापार चिन्ह संख्या / Trade Mark No. 1520743 दिनांक/ Date 15/01/2007 ज.संख्या/ J.No. 1426

यह प्रमाणित किया जाता है कि जिस प्रकार चिन्ह की समाकृति इसके साथ संलग्न है, वह .....

के बारे में दिनांक ..... नाम से रजिस्ट्रीकृत हो चुका है।

Certified that the Trade Mark / a representation is annexed hereto, has been registered in the name(s) of

BMC ELECTROPLAST PRIVATE LIMITED, A COMPANY INCORPORATED UNDER THE COMPANIES ACT,1956, B-14/1, MIDC, WALUJ, AURANGABAD - 431 136., MANUFACTURERS AND MERCHANTS., (Body Incorporate)

In Class 9 Under No. 1520743 as of the Date 15 January 2007 in respect of

apparatus and instruments for conducting, switching, transforming, accumulating, regulating or conducting electricity; vacuum interrupters and parts thereof included in class 9.

व्यापार चिन्ह रजिस्ट्री TRADE MARKS REGISTRY MUMBAI सत्यमेव जयते

GV

मेरे निदेश पर आज दि ..... के ..... मास के ..... वे दिन को इस पर मुद्रा लगायी गई।

Sealed at my direction, this 29th day of March, 2010

व्यापार चिन्ह रजिस्ट्री
Trade Marks Registry Mumbai

व्यापार चिन्ह रजिस्ट्रार
Registrar of Trade Marks

रजिस्ट्रीकरण आवेदन की तारीख से १० वर्ष के लिए है और तदुपरान्त वह १० वर्ष की कालावधि के लिए और प्रत्येक १० वर्ष की कालावधि के अवसान पर भी नवीनीकृत किया जा सकेगा।
Registration is for 10 years from the date of application and may then be renewed for a period of 10 years and also at the expiration of each period of 10 years.

यह प्रमाणपत्र विधि कार्यवाहियों मे प्रयोग के लिये या विदेश में रजिस्ट्रीकरण अभिप्राप्त करने के लिये नही है।
This certificate is not for use in Legal proceedings or for obtaining Registration abroad.

टिप्पणी - इस व्यापार चिन्ह के स्वामित्व में कोई परिवर्तन होने पर, या कारेबार के मुख्य स्थान के पते में या भारत में तामील के लिये पते में परिवर्तन होने पर परिवर्तन के लिये आवेदन तुरन्त किया जाना चाहिये।

Note : Upon any change of ownership of this Trade Mark, or change in address, of the principal place of business or address for service in India a request should **AT ONCE** be made to register the change.

CNT. No.: