


1. ALL OPEN END DUCT WORK MUST BE COVER WITH PLASTIC TO PREVENT DUST ENTERING IN THE SYSTEM AFTER RELOCATION OR MODIFYING THE DUCT WORK.
2. ALL GRILLE AND FLEX DUCT NEED TO BE STORE IN A SECURE PLACE ON SITE - SUBJECTE TO REVIEW AND APPROVAL FROM PROJECT MANAGER/ENGINEER/CONSULTANT FOR REUSE.
3. ALL TEMP. SENSOR SHOULD BE ROLLED UP AND SECURE WITH A TAPE ON VAV ONLY DISMANTAL OR RELOCATED

[illegible]

MECHANICAL SERVICES

DRAWING NUMBER	ISSUE
----------------	-------

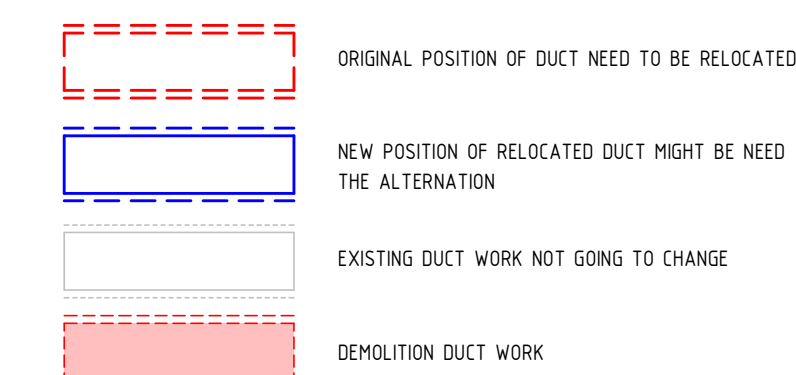