

LEVEL 4

LEVEL 1

GROUND

LEVEL B1

LEVEL B2


LEVEL B3

LEVEL B4

LEVEL B5


LEGEND

- HWH Flow
- HWH Return
- CHW Circuit A Flow
- CHW Circuit A Return
- CHW Circuit B Flow
- CHW Circuit B Return

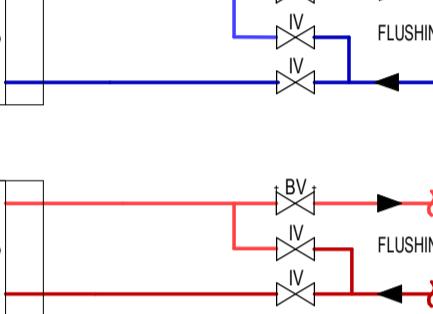

TYPICAL INSTALLATION FOR AHU / FCU

Indicates Pipe Size(mm) and Material
Indicates Design FlowCapacity (L/s)
Indicates FlowCapacity Including SWTC Spec (L/s)

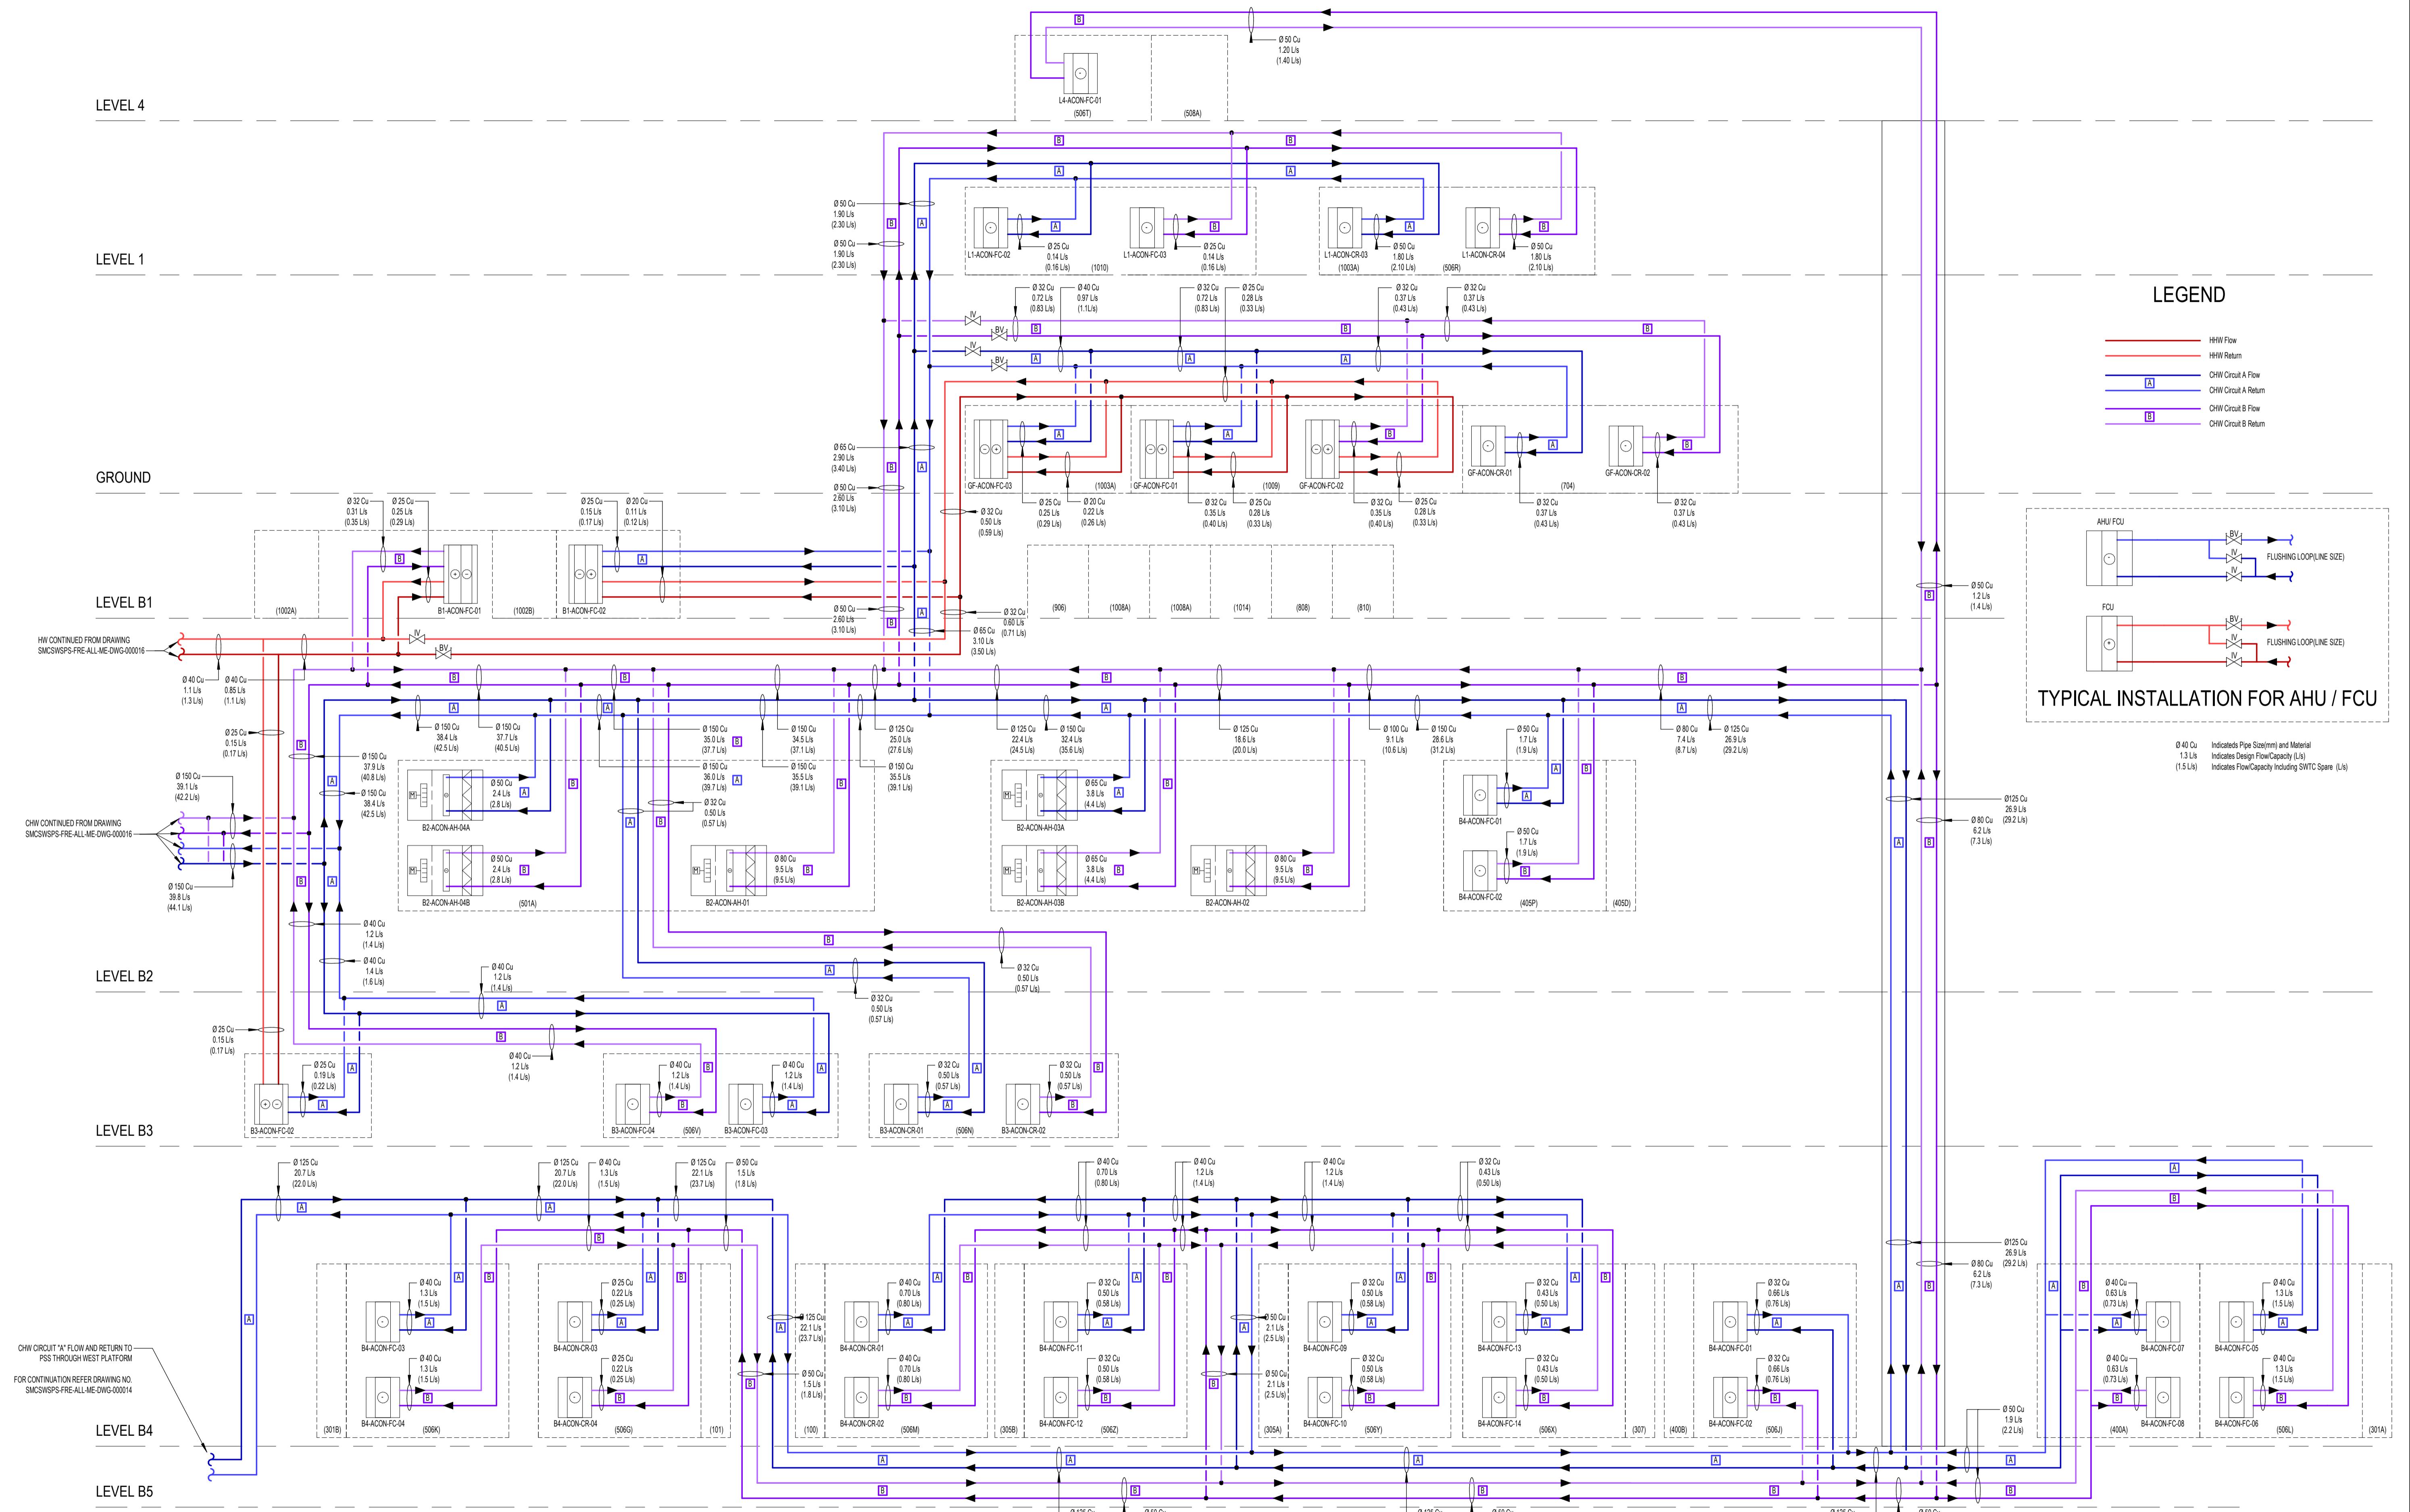

REV	DATE	ISSUER	APPD	DESCRIPTION	Consultants	MAIN CONTRACTOR:	CLIENT:	PROJECT:	DRAWN:	APPROVED:	TITLE:
									OES		Mechanical Services
									DESIGNED:	APPROVED RCC SERVICES MANAGER:	CHW AND HHW SCHEMATIC
									CHECK:	APPROVED RCC HEAD OF DESIGN:	
									N.T.S.	SCALE AT A0:	PROJECT No:
										DRAWING No:	REVISION
B	14.07.2020	DES		ISSUED FOR APPROVAL							B
A	12 JUNE 2020			ISSUED FOR PRICING							