



Regulated Design Record			
Project Address:			
Project Title:			
Consent No:			Body Corporate Reg No:
Drawing Title:			Drawing No:
Rev	Date	Description	DP Full Name
			Reg No

GENERAL NOTE:


- ALL KITCHEN EXHAUST DUCTS ARE TO BE INSTALLED AT 0.05% GRADE RAISE TO THE RISER.
- ALL KITCHEN EXHAUST DUCTWORK TO BE MADE OF GALVANISED STEEL OF MIN 1.2mm THICKNESS.
- ALL SUPPLY-AIR SIDE CANVASES WERE INSULATED TO PREVENT SWEAT.
- FOR THE THERMOSTAT SET OUTS AND HEIGHTS ON THE WALLS, REFER TO ARCHITECTURAL WALL ELEVATIONS.
- FOR GRILLE SET OUT, REFER TO ARCHITECTURAL REFLECTED CEILING PLAN (RCP).

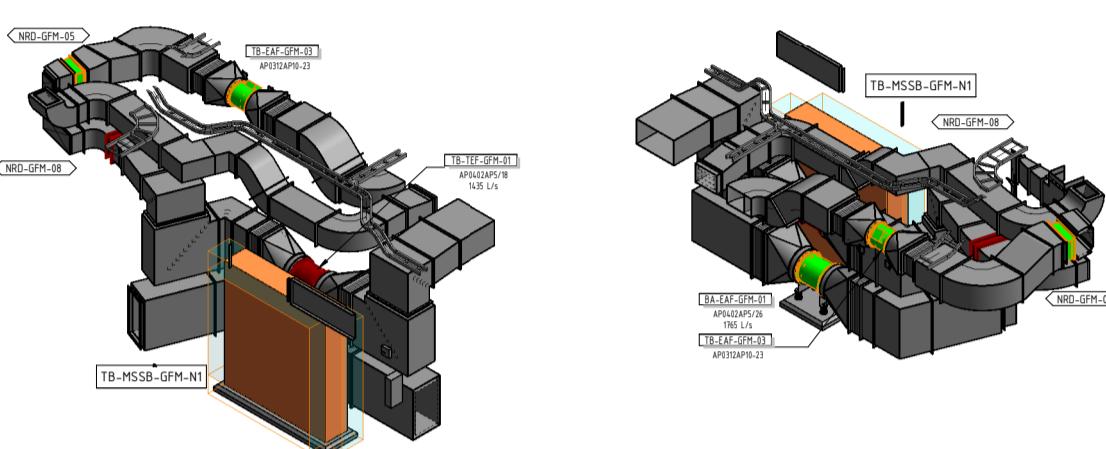

1 SW ISO VIEW-01
NTS

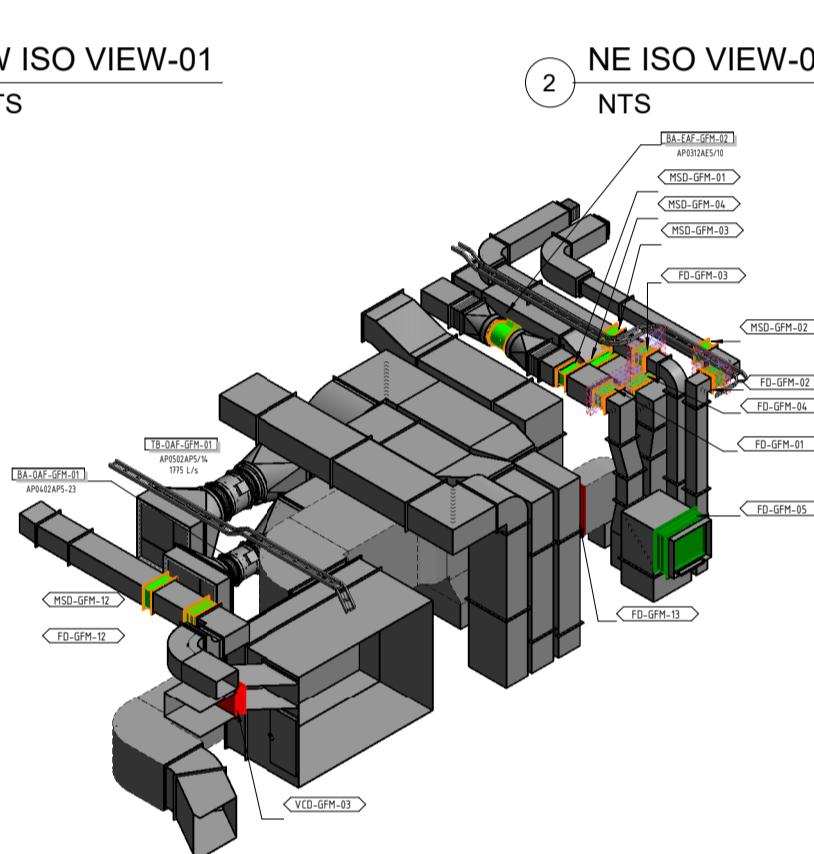


2 NE ISO VIEW-02
NTS

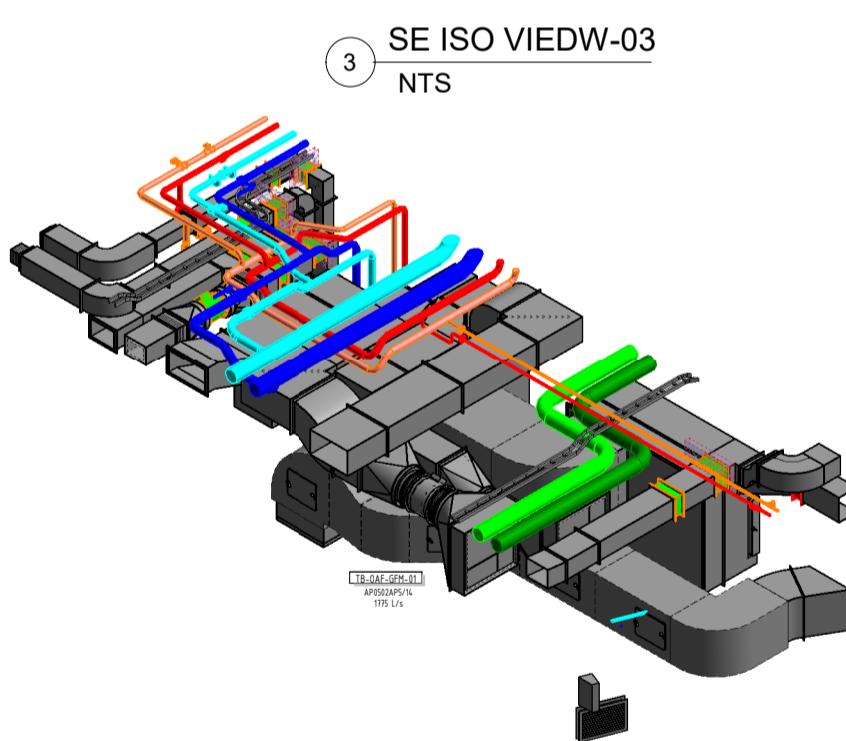

3 SE ISO VIEDW-03
NTS

4 SW ISO VIEW-04
NTS

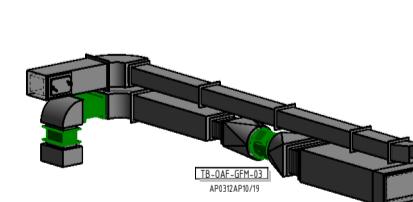

5 ISO VIEW 05
NTS



Rev Date By Revision Notes
INTERNAL CHECKED BY: CLIENT CHECKED BY: DATE: