

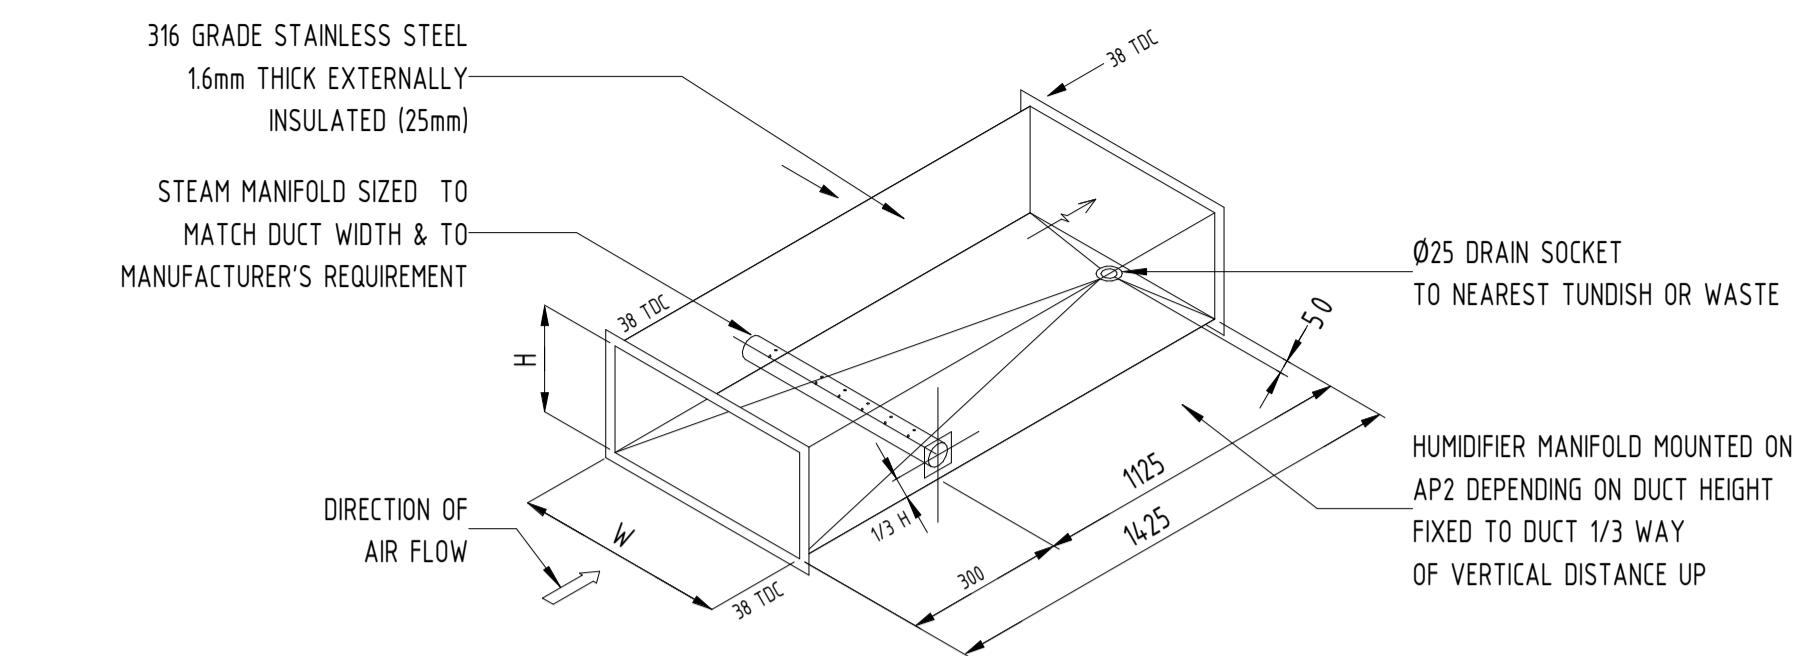
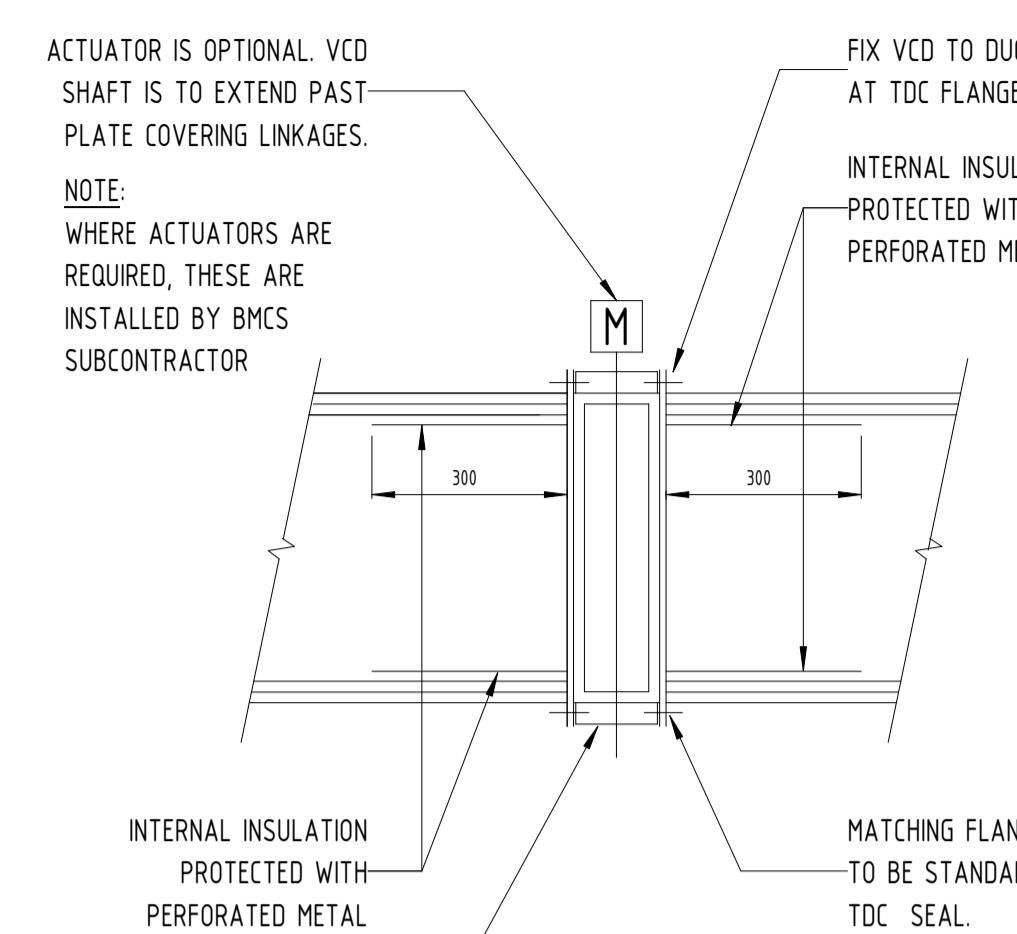




0 10 20 30 40 50 60 70 80 90 100 200 300 400 500 600 700 800

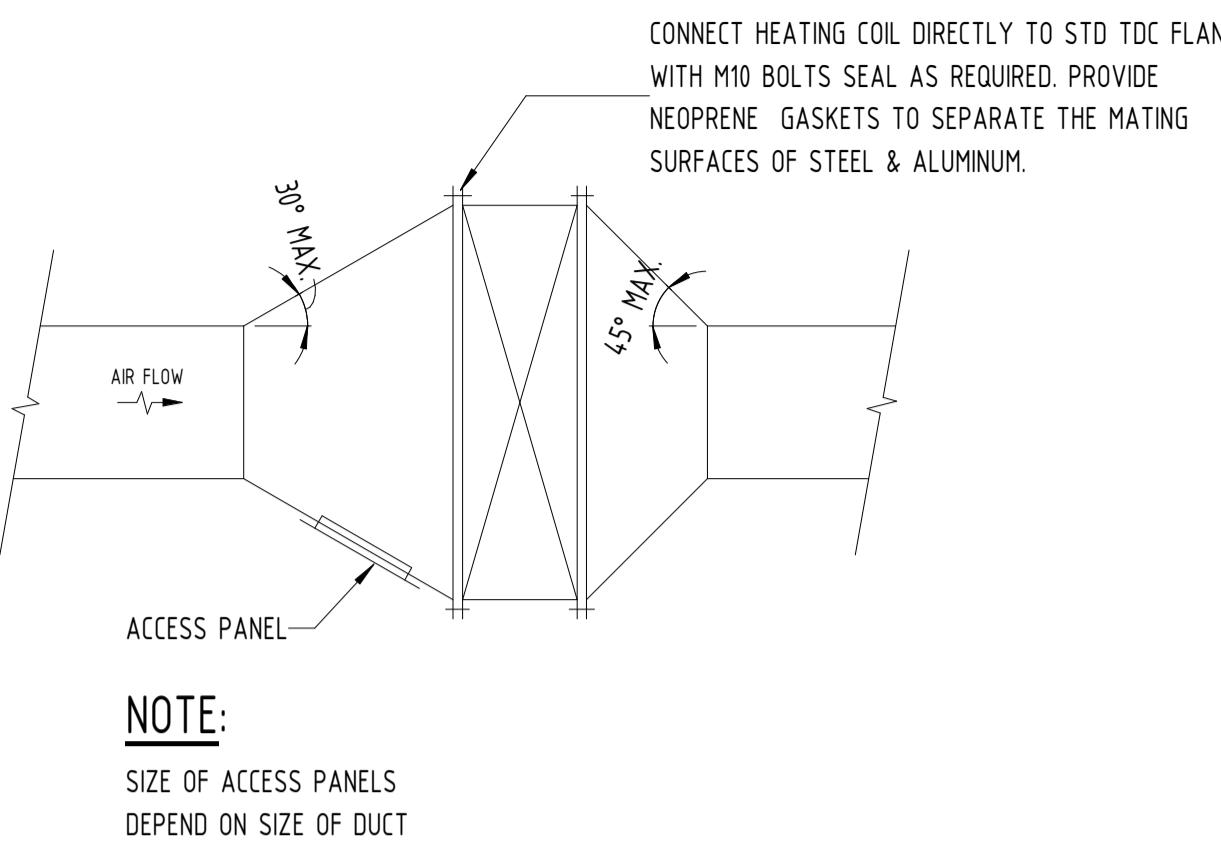

DUCT STEAM & HEATING COIL INSTALLATION

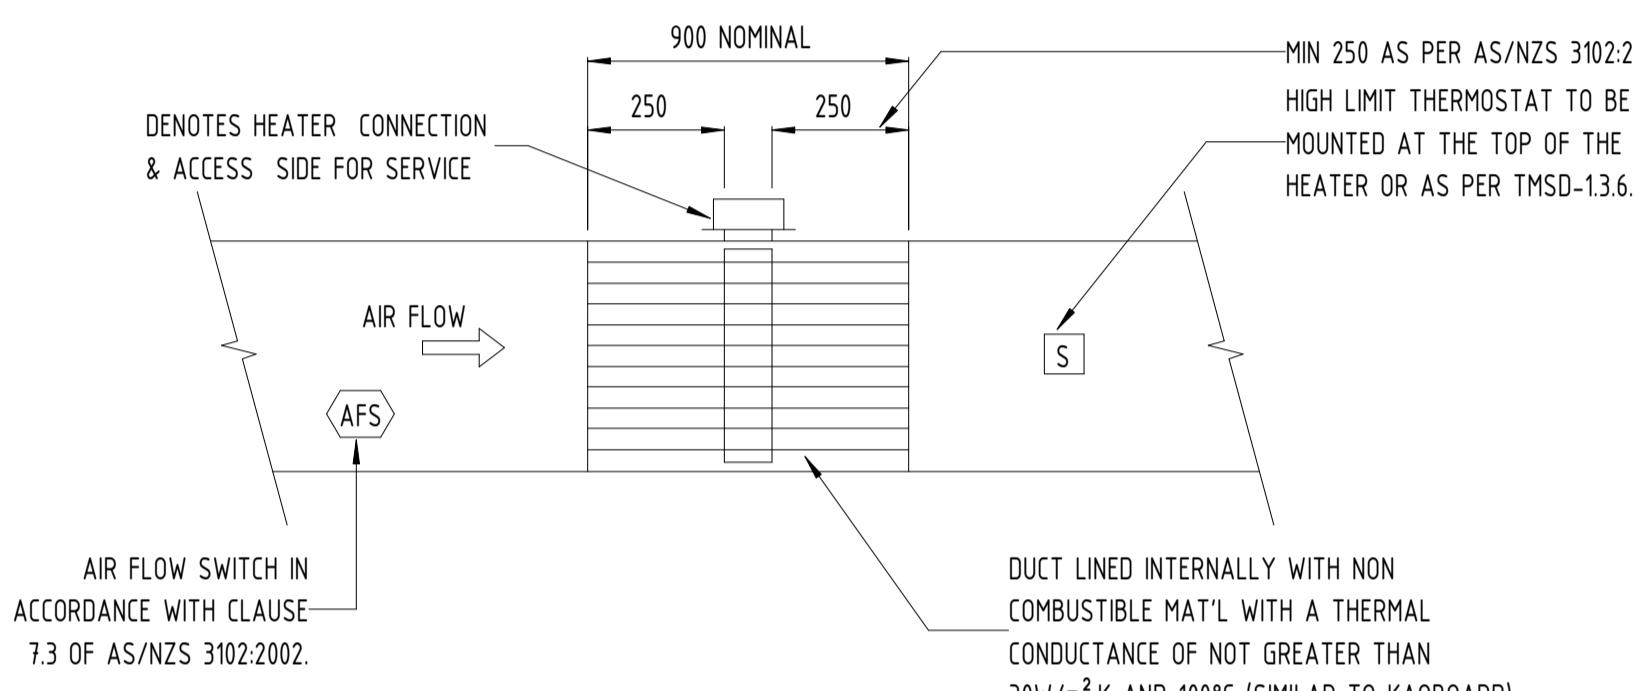


ELECTRIC DUCT HEATER INSTALLATION

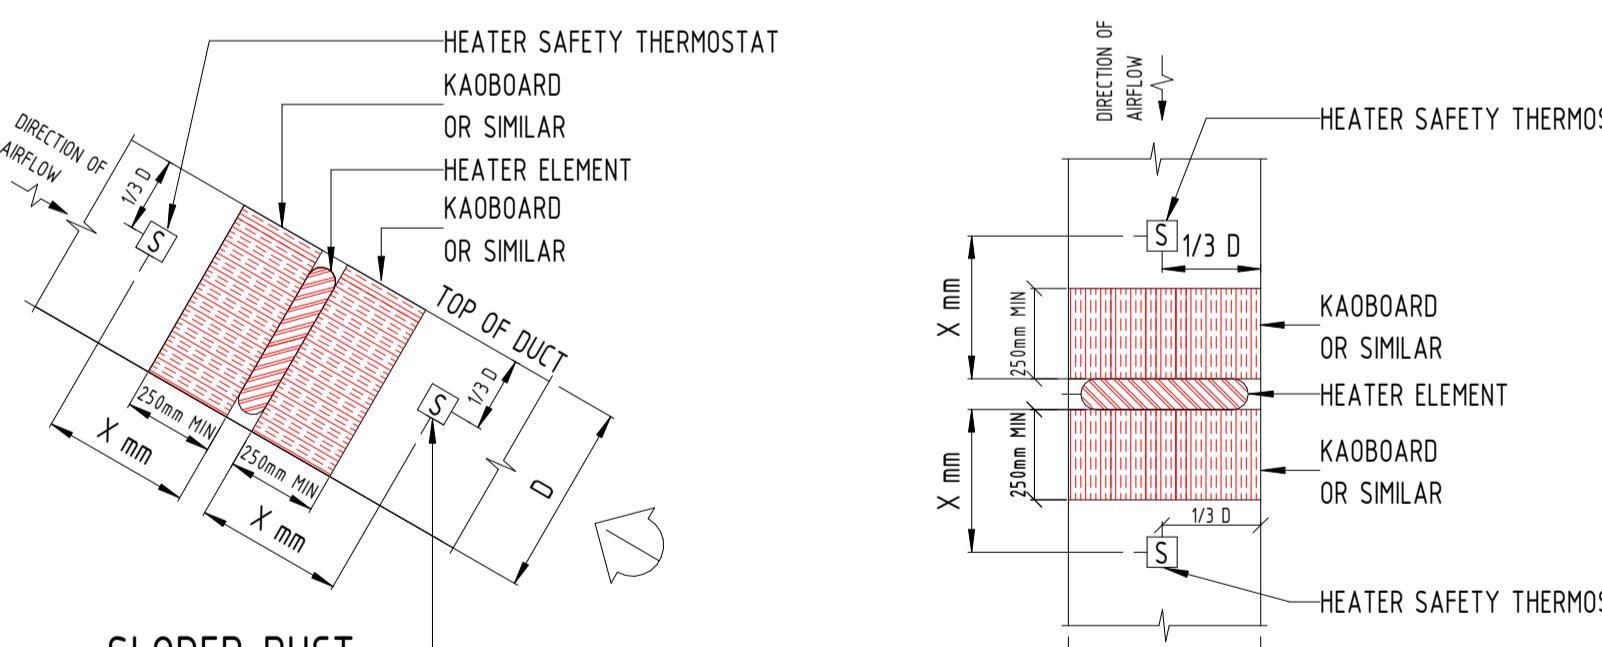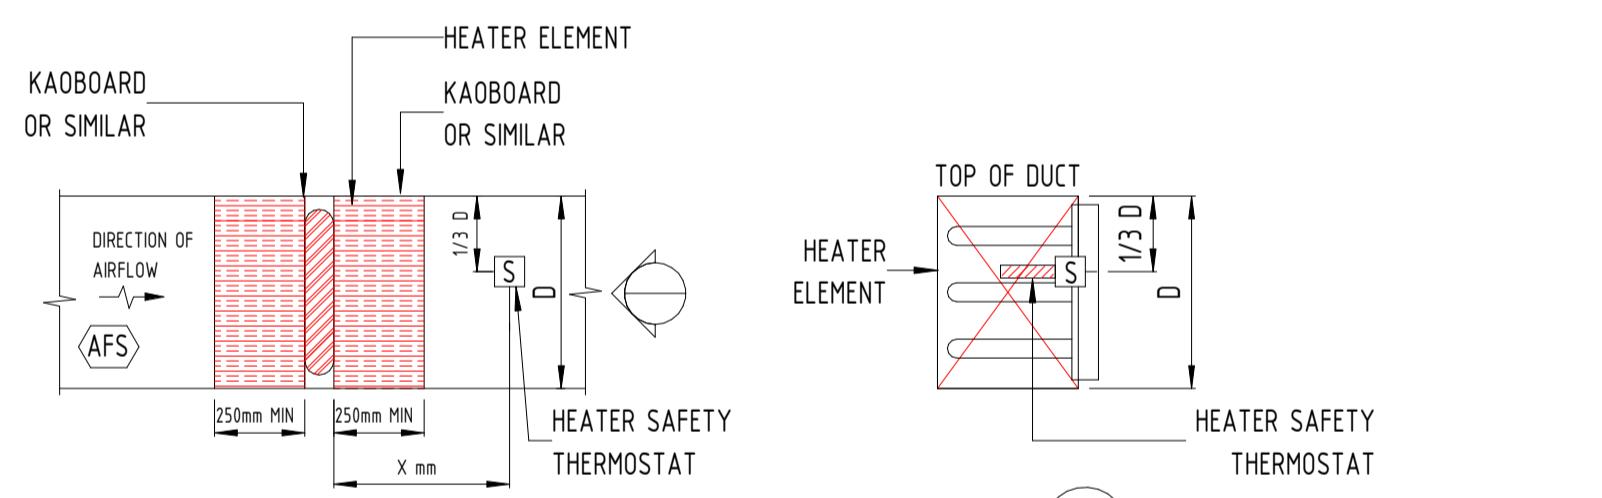


SLOPED DUCT

HEATER SAFETY THERMOSTAT (THERMAL CUTOUT CAN ALSO BE LOCATED WITHIN THE DUCT HEATING CASING IN ACCORDANCE WITH CLAUSE 7.3 OF AS/NZS 3102:2002)

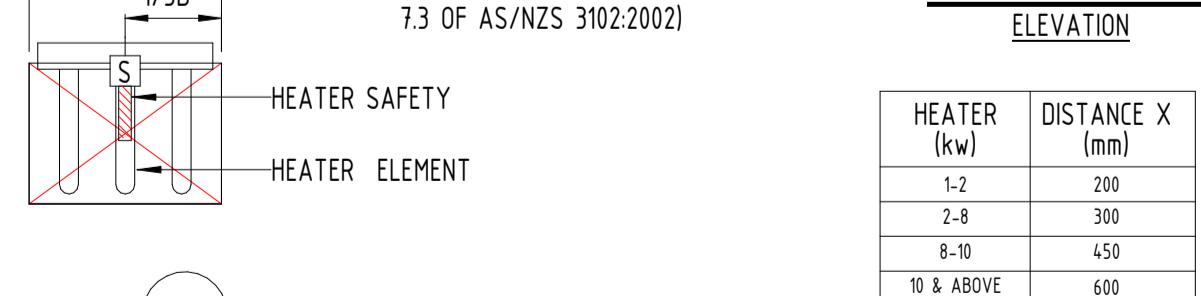


DUCT MOUNTED ELECTRIC HEATER SAFETY SWITCH LOCATIONS

VOLUME CONTROL DAMPER INSTALLATION

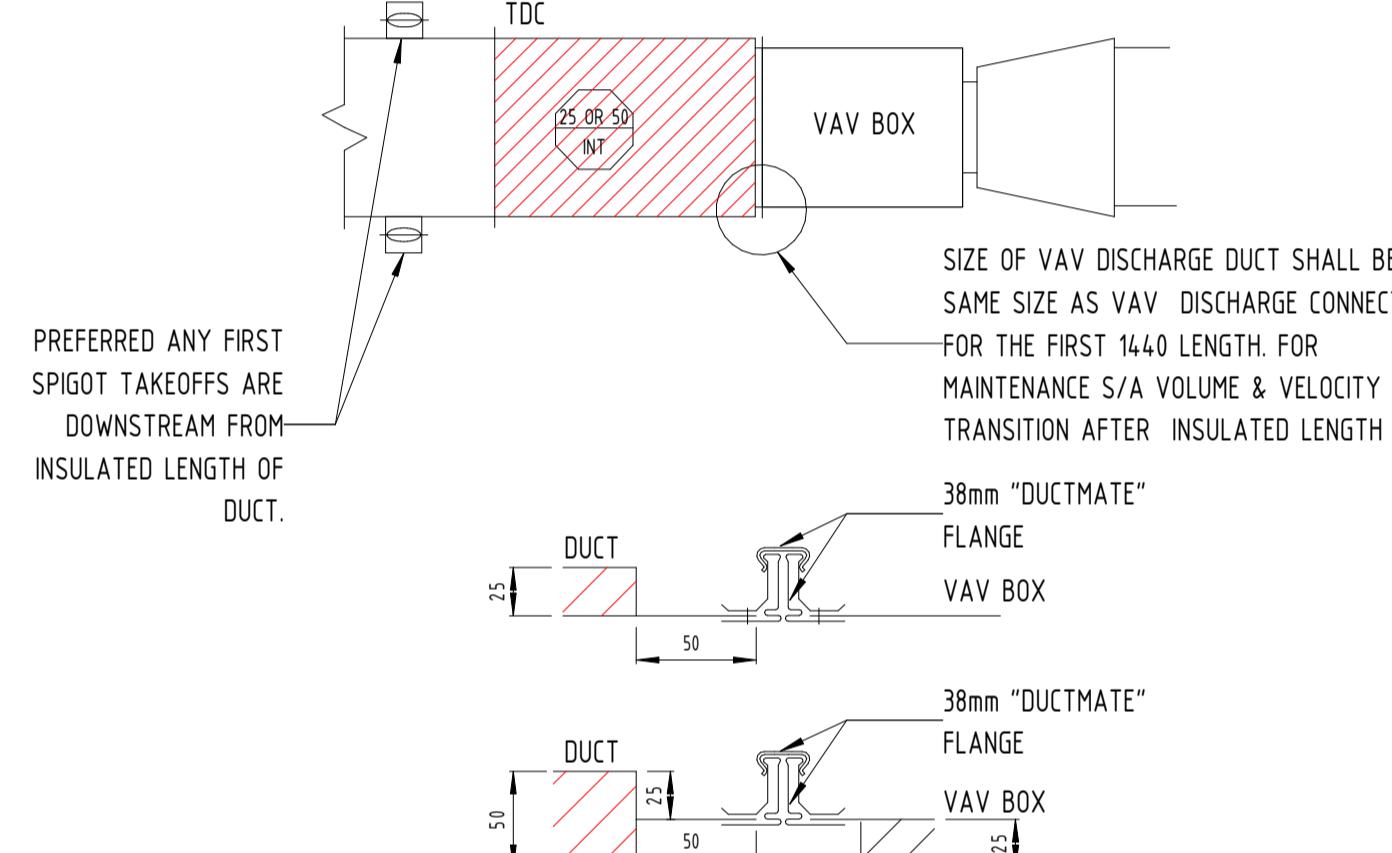


VAV BOX INSTALLATION DETAIL

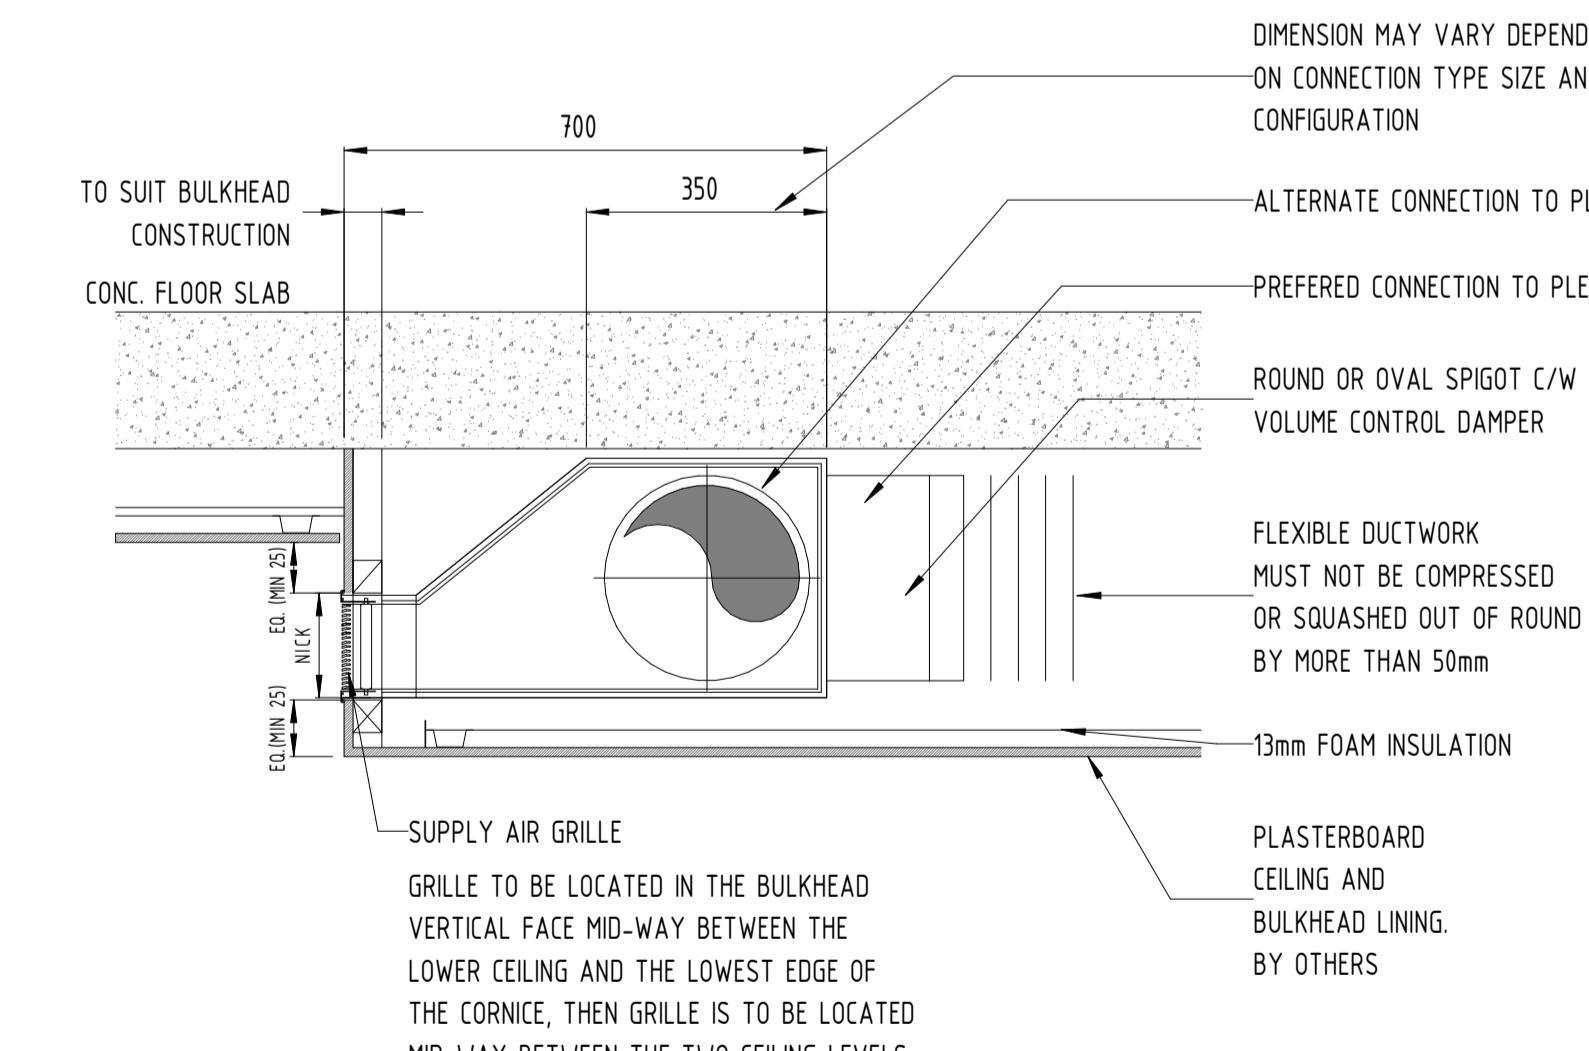

GRILLE & S/A PLENUM (13mm FOAM INSULATION) DETAIL

NOTE:
BULKHEAD FRAMING IS TO BE CONSTRUCTED TO ENABLE GRILLE TO BE LOCATED IN THE DESIRED LOCATION IN THE DESIRED POSITION, BOTH VERTICALLY AND HORIZONTALLY

DIRECTION OF HUMIDIFIER STEAM DISCHARGE

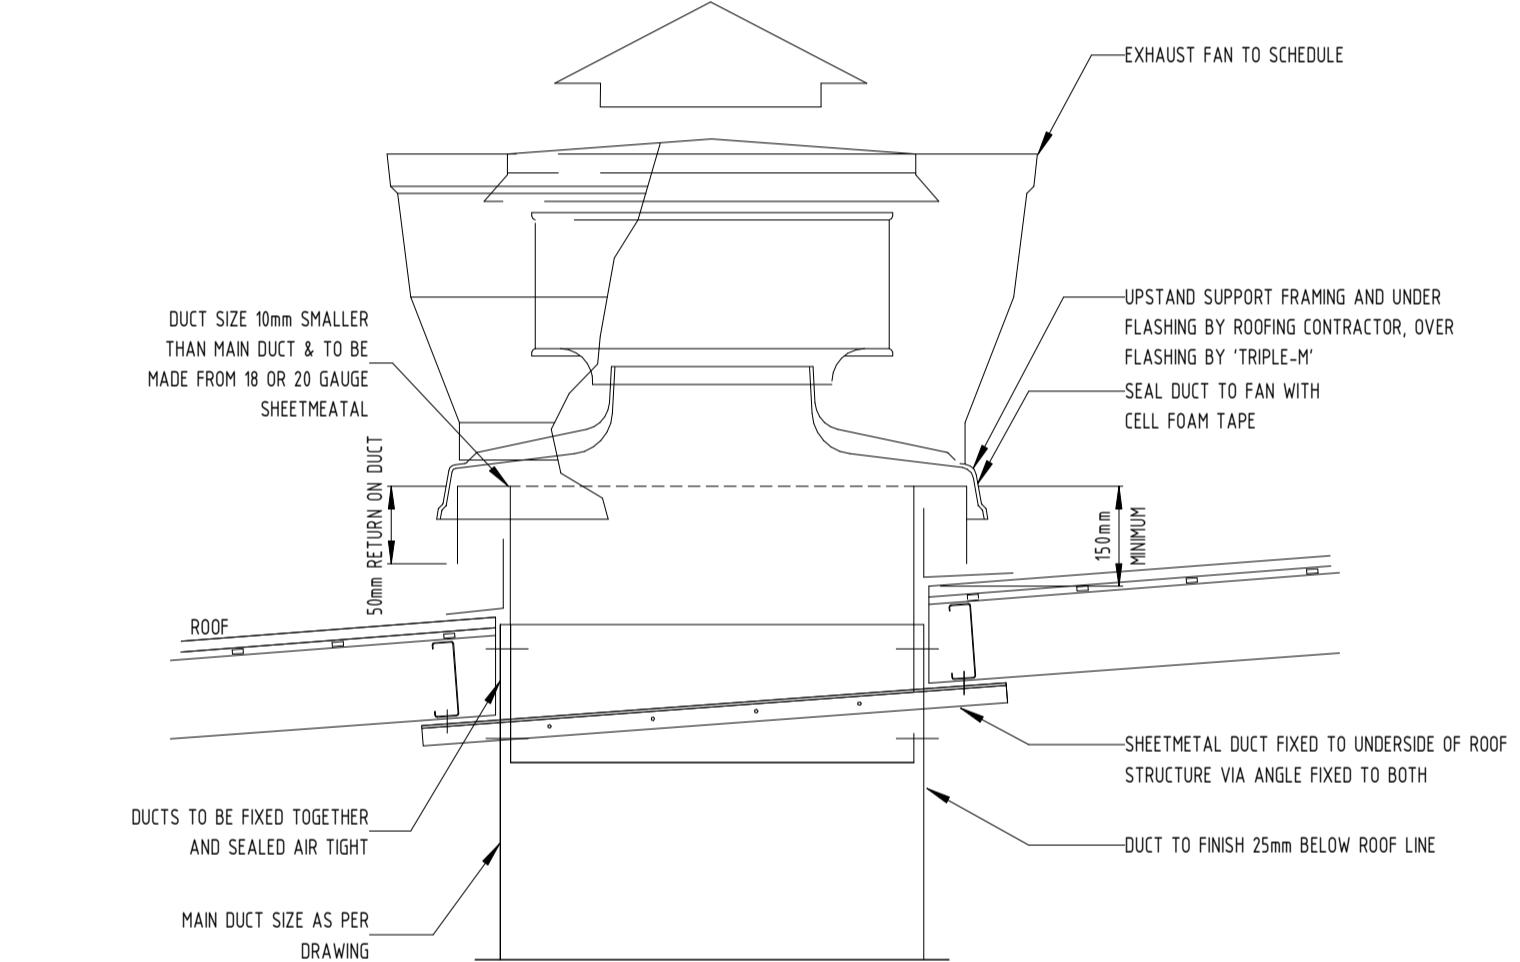

ISSUED	REV	DESCRIPTION	DATE DRAWN
CAD FILE NAME:			

ARCHITECT

CLIENT

BUILDER

PROJECT	OES SAMPLE
---------	------------

MECHANICAL SERVICES


TITLE	MECHANICAL SERVICES
DETAIL SHEET 03	

APP.PM DATE DSGN CHECK DATE

DRAWN DATE DRG CHECK DATE

PROJECT NUMBER NTS SCALE@A1
DRAWING NUMBER ISSUE

MES-XXXX-00-004

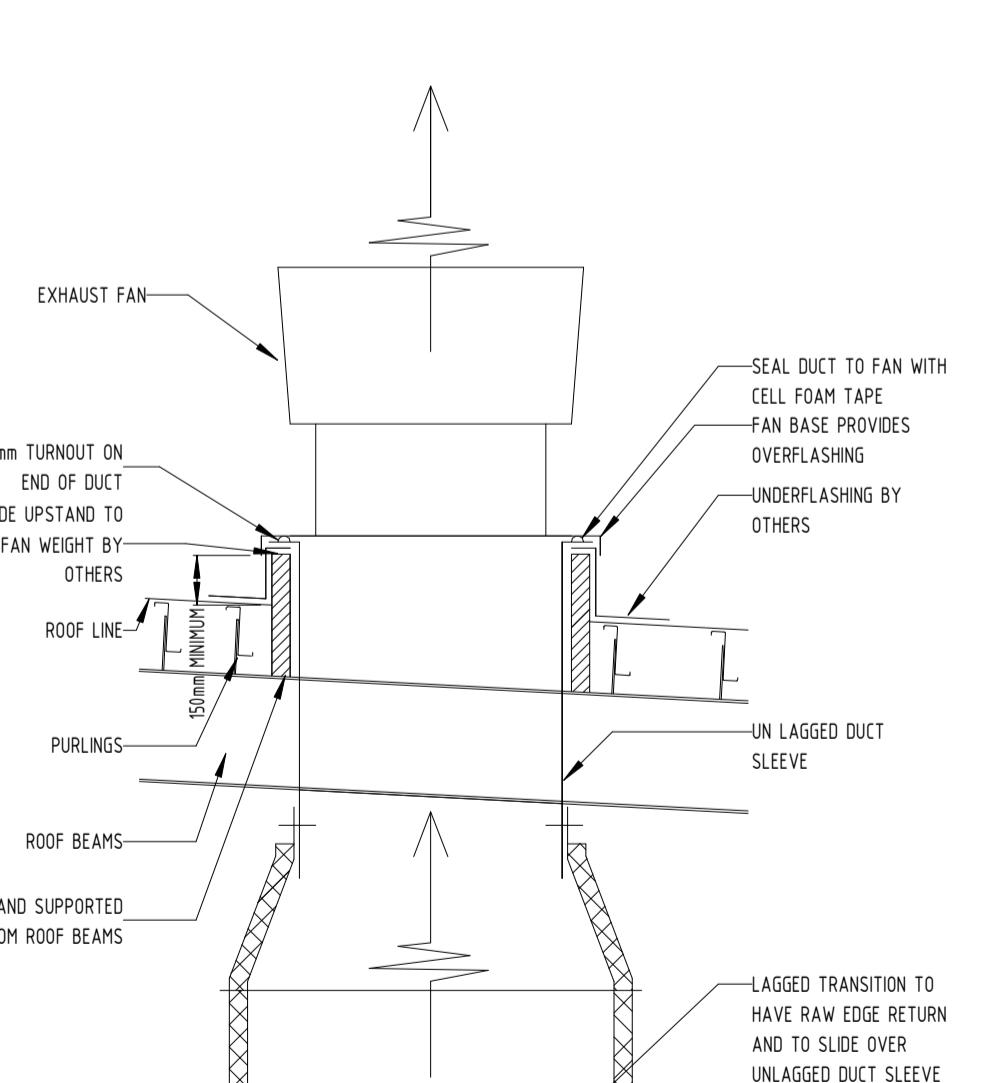

DETAIL OF ROOF MOUNTED FAN

80 kg AND OVER

