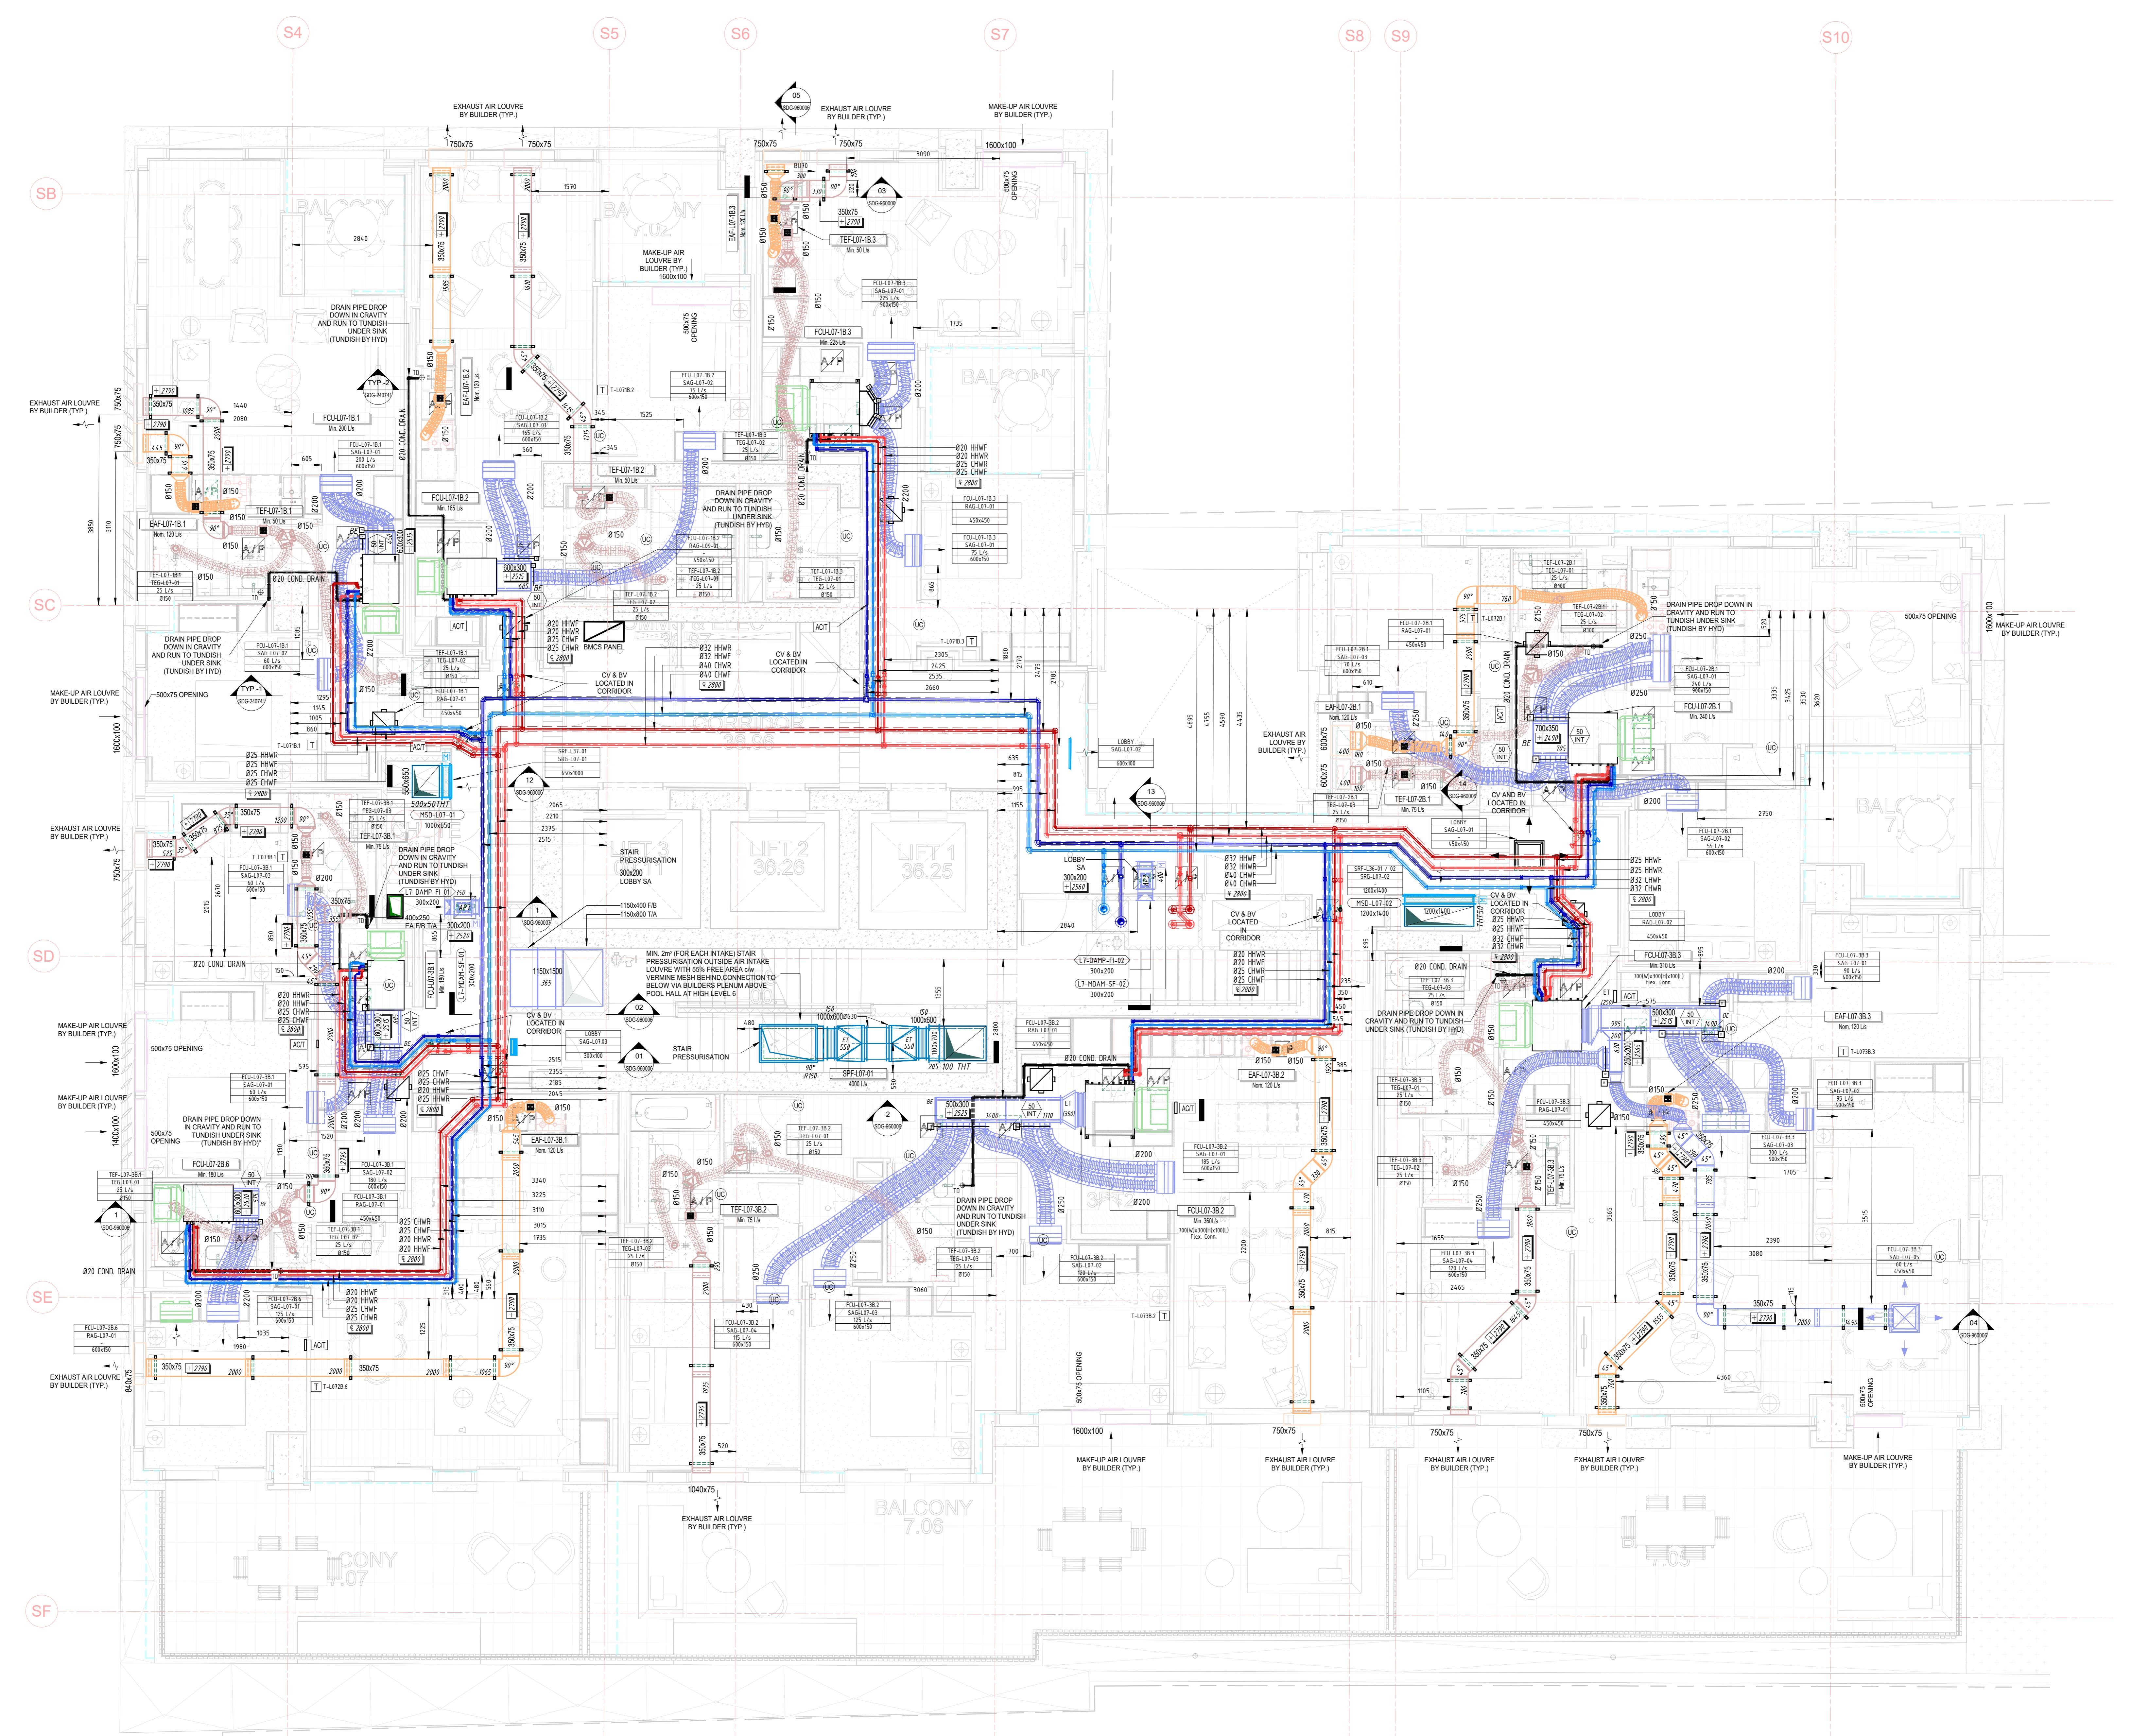


Regulated Design Record

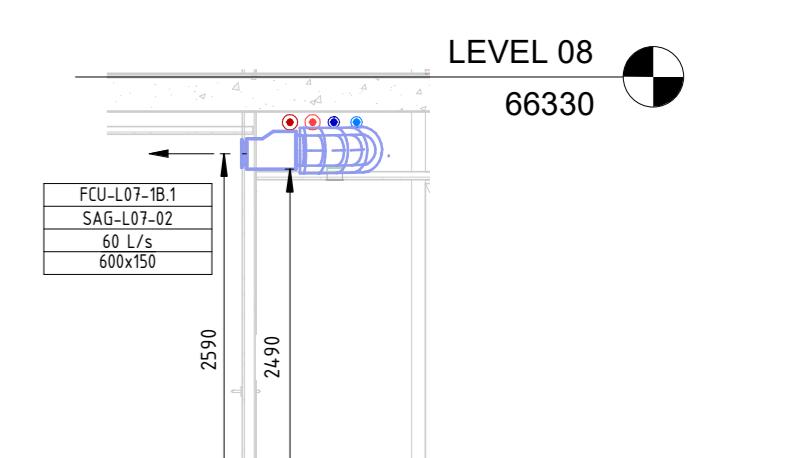
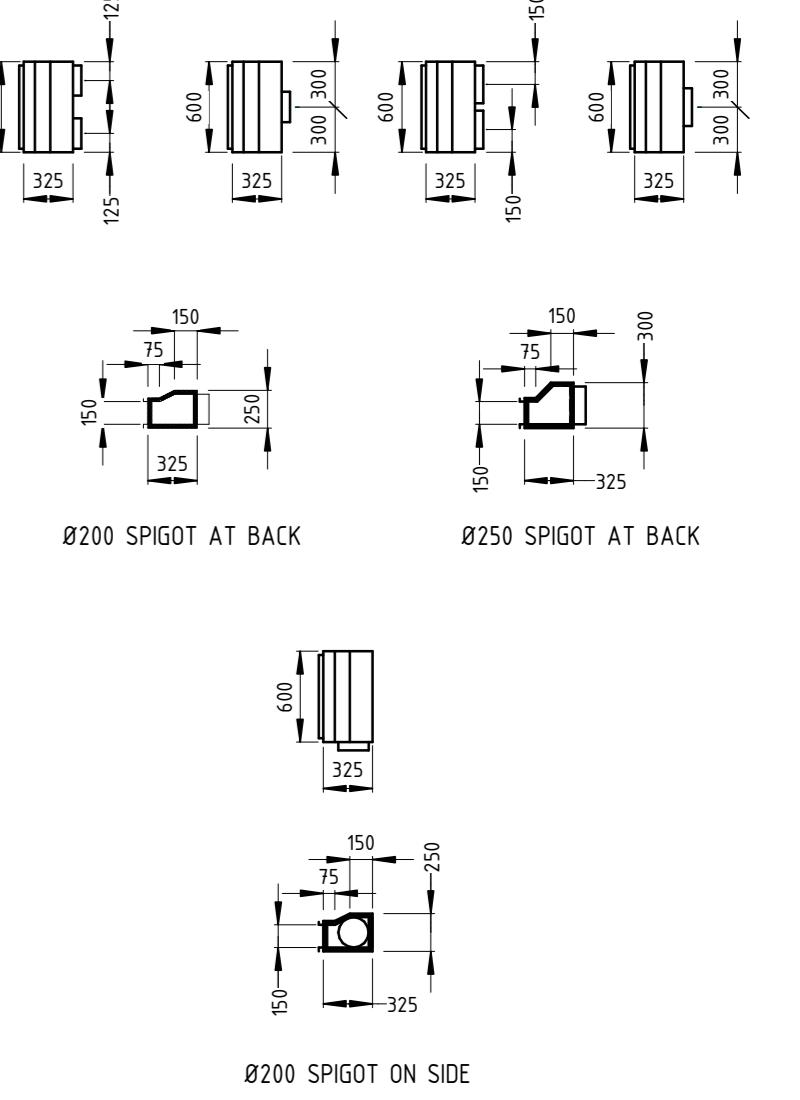
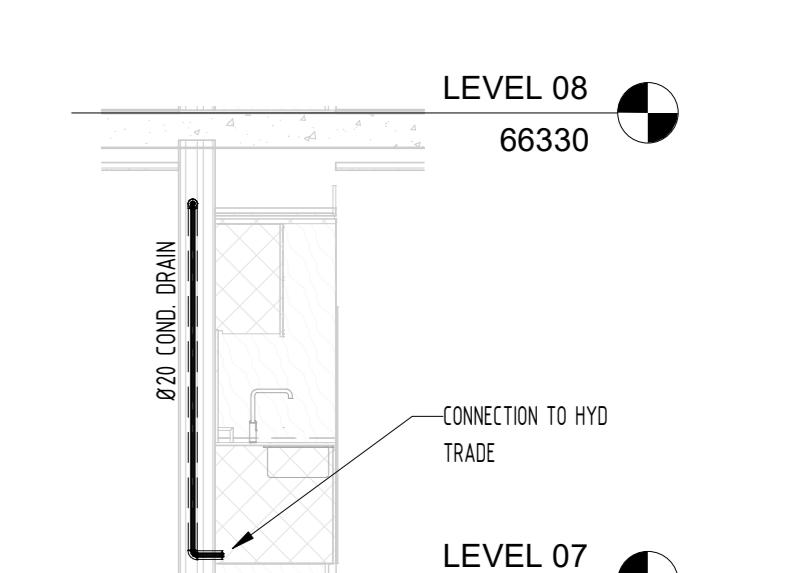
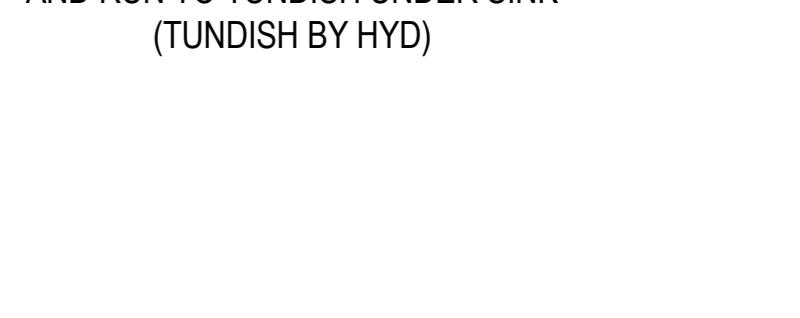
Project Address:			
Project Title:			
Consent No:	Body Corporate Reg No:		
Rev Date dd/mm/yy	Description	DP Full Name	Reg No
Drawing Title: DUCTWORK LEVEL 07 LAYOUT			
Drawing No:			



LEGEND:

	ADDITIONAL TEMPERATURE SENSOR BEDROOM 1 AT 1500AFL
	A/C CONTROLLER WITH TEMPERATURE SENSOR AT 1500AFL
	SYSTEM NAME GRILLE ID A/C CONTROLLER ID GRILLE SIZE
	MINOR SUPPLY OF EXHAUST OR RETURN AIR FLOW AT COMMISSIONING ANY HIGHER AIR FLOW IS ACCEPTABLE (SUBJECT TO ACOUSTIC APPROVAL)
	TUNISH BY HYDRAULIC TRADE, EQUIVALENT TO EACH FDU UNDERNEATH BASIN OR SINK
	RANGE-HOOD BOOSTER FAN, NOMINAL COOLING - NO VERIFICATION DURING COMMISSIONING IS REQUIRED
	MOTORIZED SINGLE SPOT ON/OFF (DAY/NIGHT MODE)
	MOTORIZED TWIN SPOT ON/OFF (DAY/NIGHT MODE)

## SUPPLY AIR GRILLE PLENUM DETAILS

TYPICAL SECTION FOR SUPPLY AIR  
GRILLE HEIGHT AND PLENUM BOXTYPICAL SECTION FOR  
DRAIN PIPE DROP DOWN IN CAVITY  
AND RUN TO TUNDISH UNDER SINK  
(TUNDISH BY HYD)

DRG No.	MECHANICAL SERVICES LEVEL 07 AIR CONDITIONING LAYOUT		
STATUS: FOR CONSTRUCTION	SHEET 1 OF 1		
METRO DRG No.		REV.	C

REV.	BY	DATE	DESCRIPTION	APPD.
A0 Original	Co-ordinate System:	Height Datum:	This sheet may be prepared using colour and may be incomplete if copied	

## SCALE

0

1

2

3

4

5

m

1:50 @ A0

CLIENT  
ISDP

NOTE: Do not scale from this drawing.