
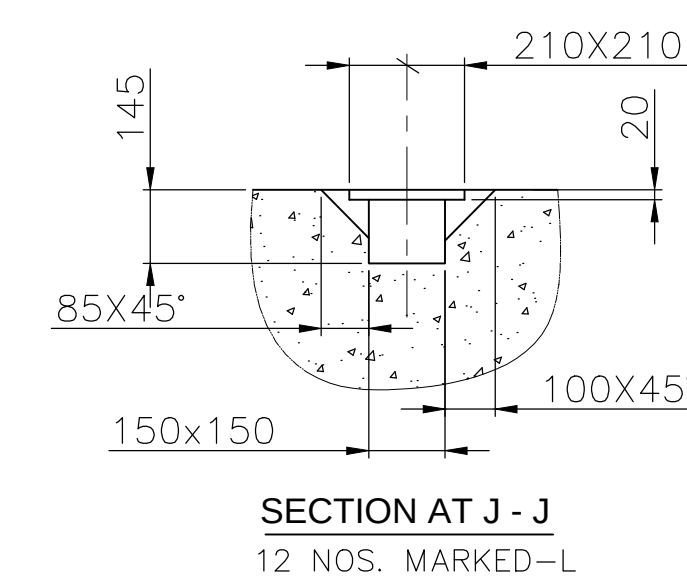
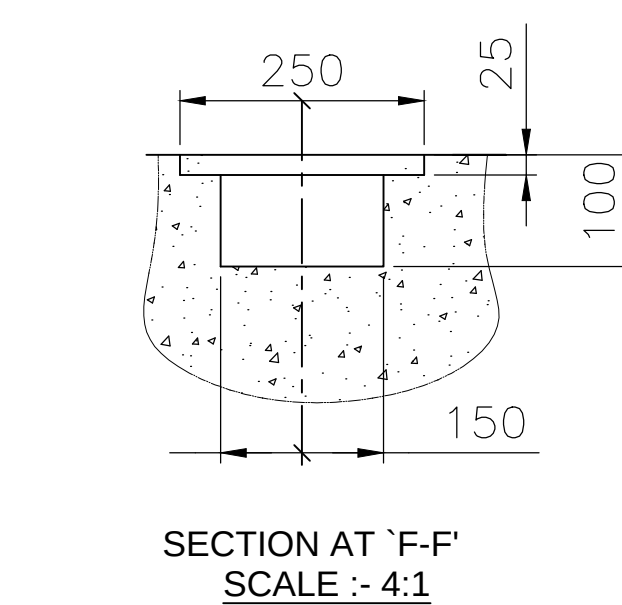
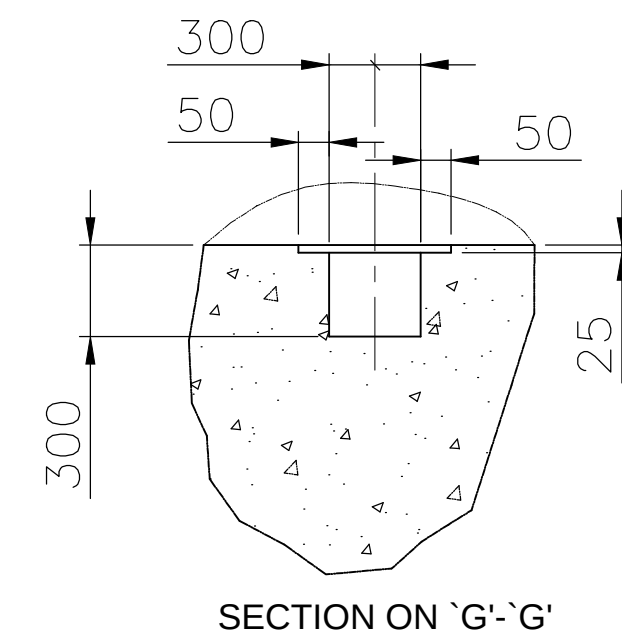
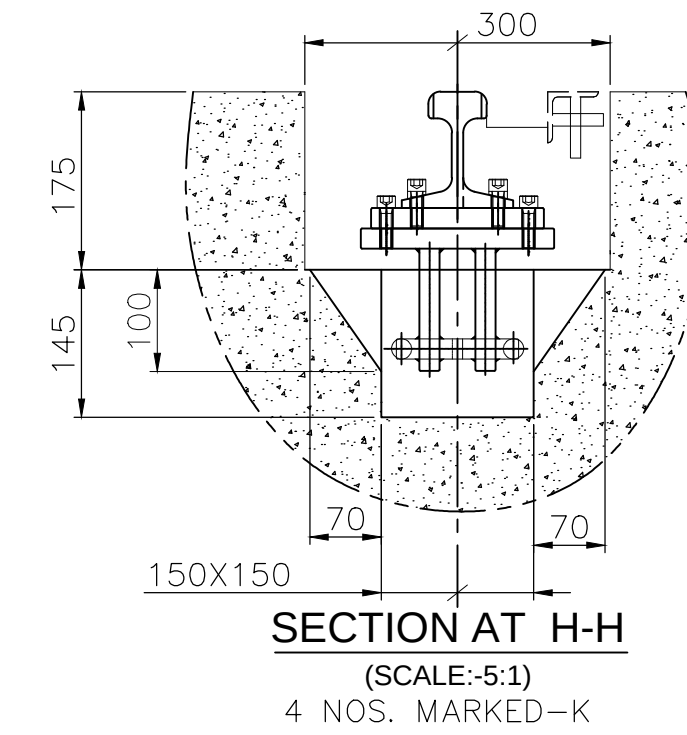
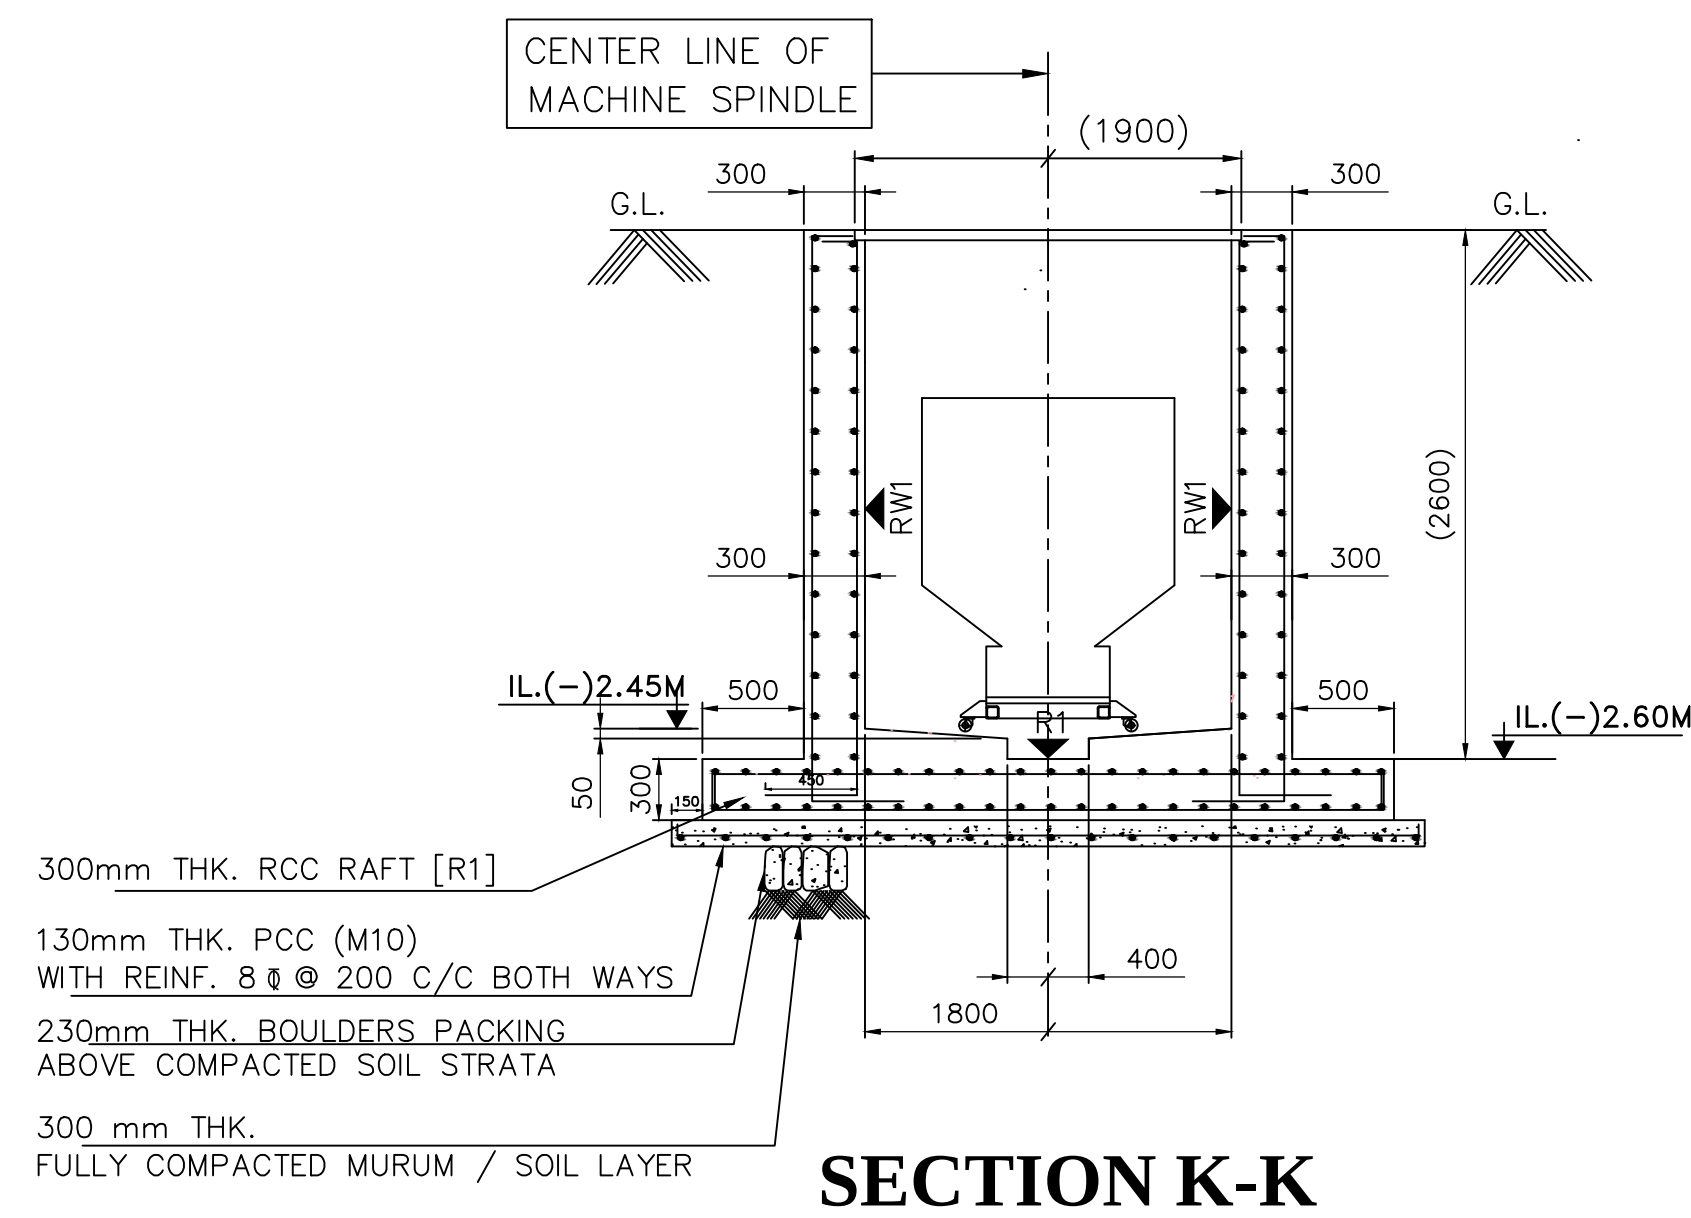
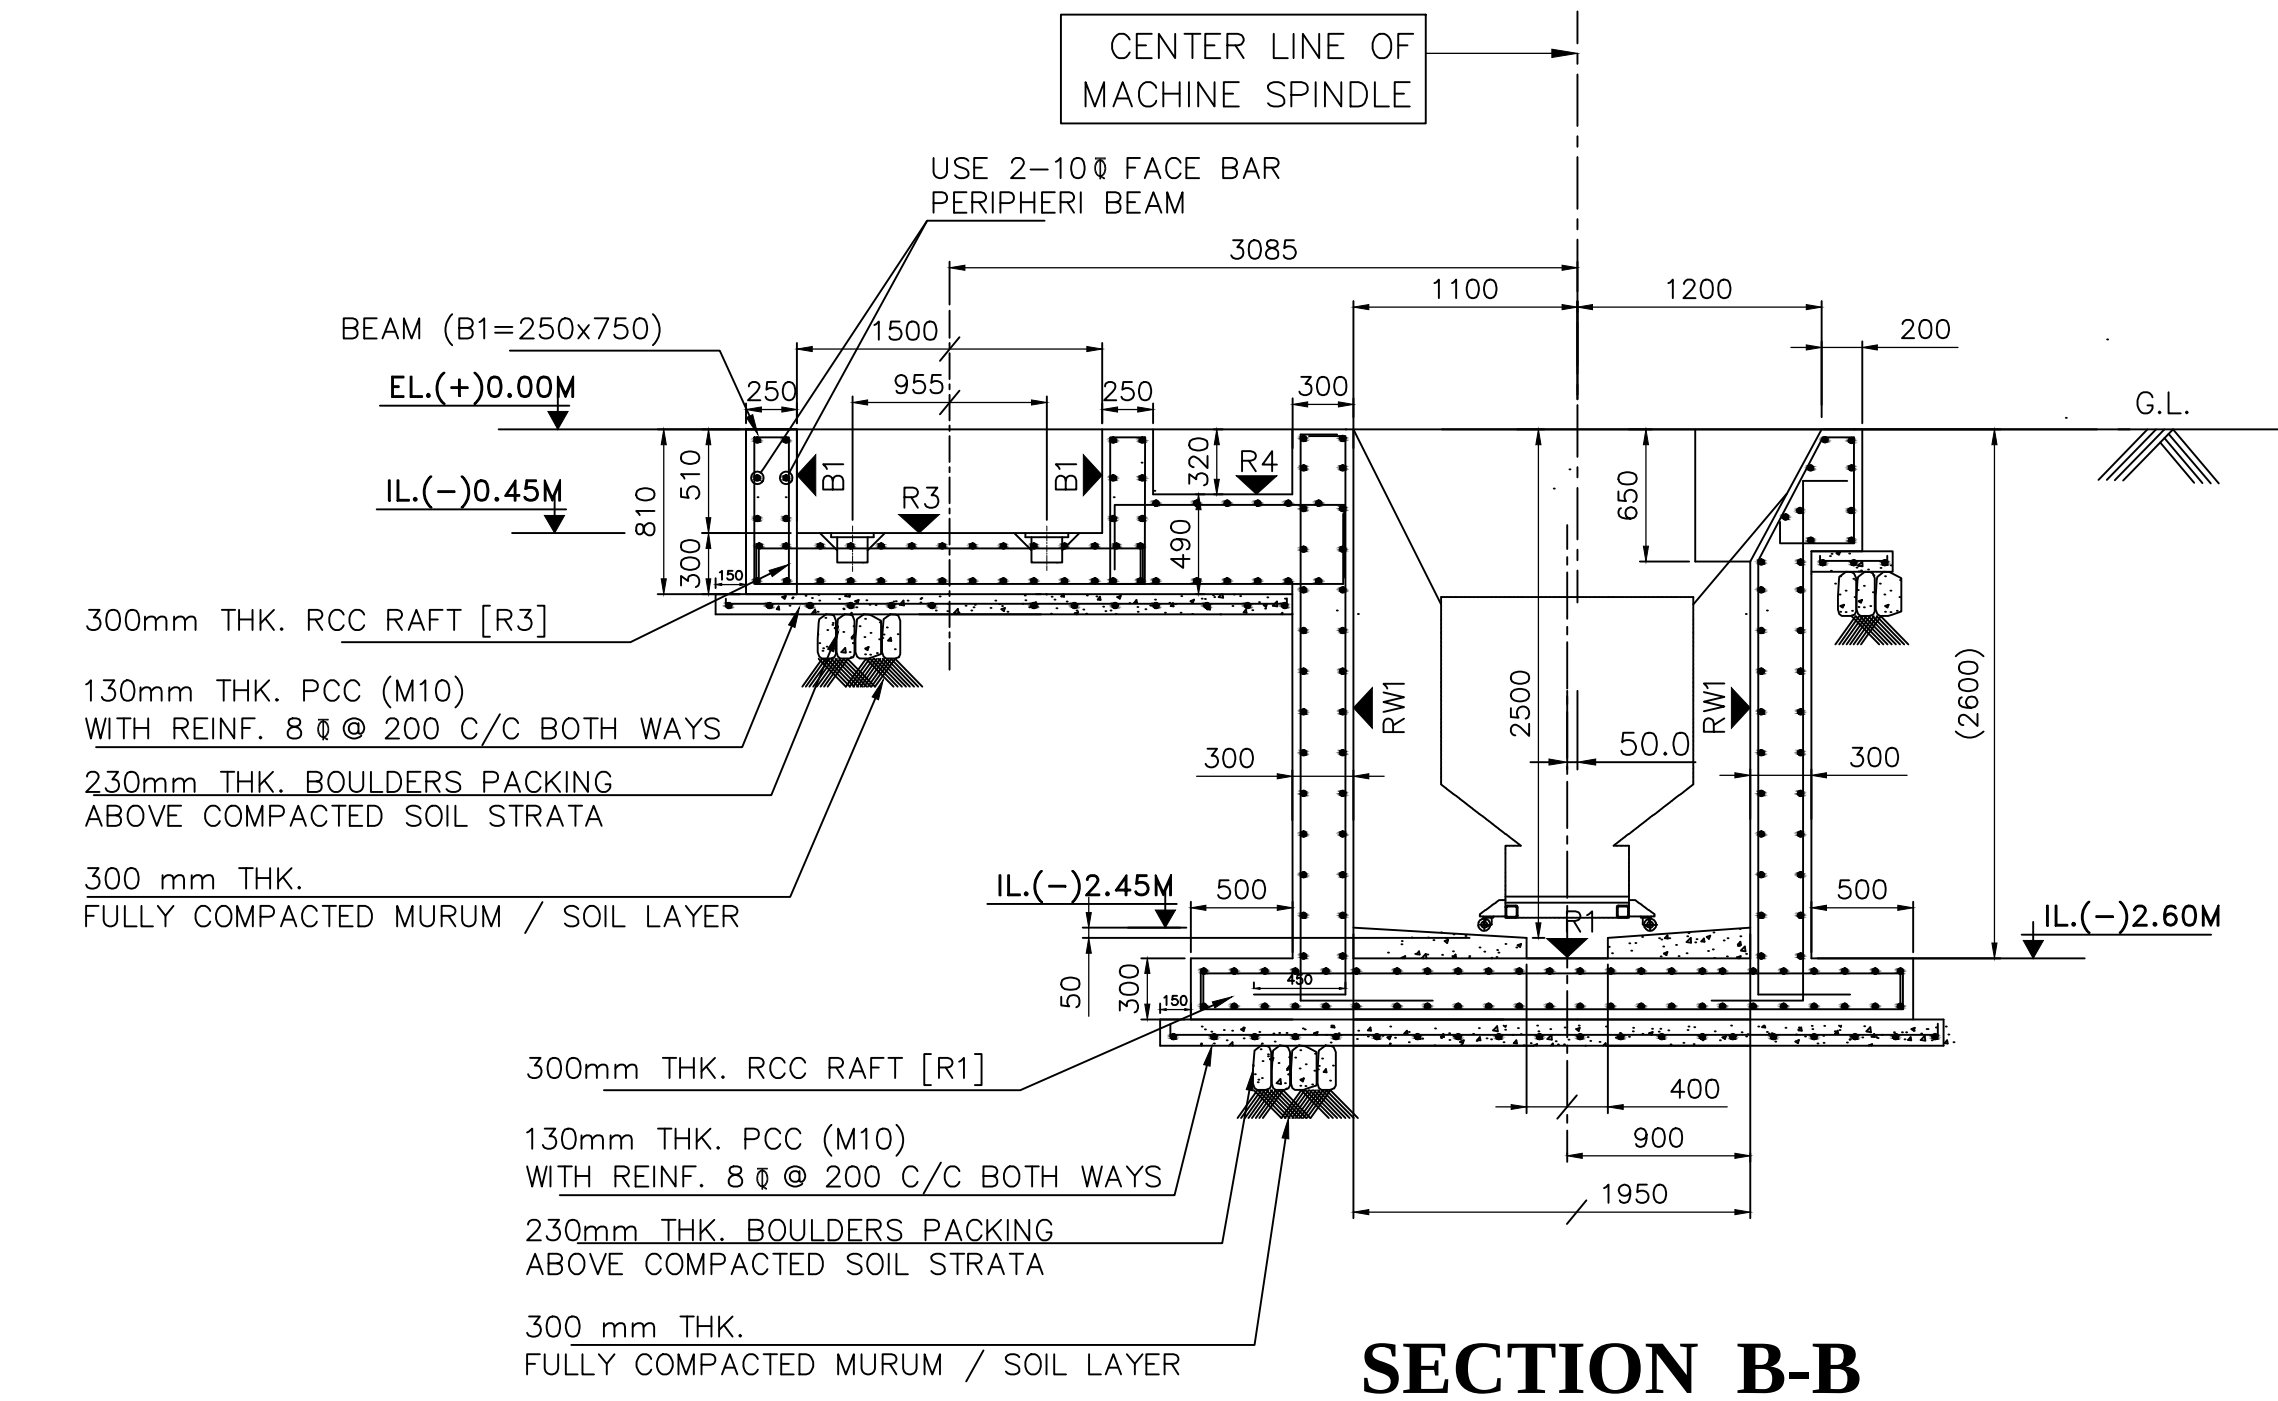


* ALL COMPACTION SHOULD BE DONE PLATE COMPACTOR.
* REFER TABLES FOR REINFORCEMENT DETAILS.

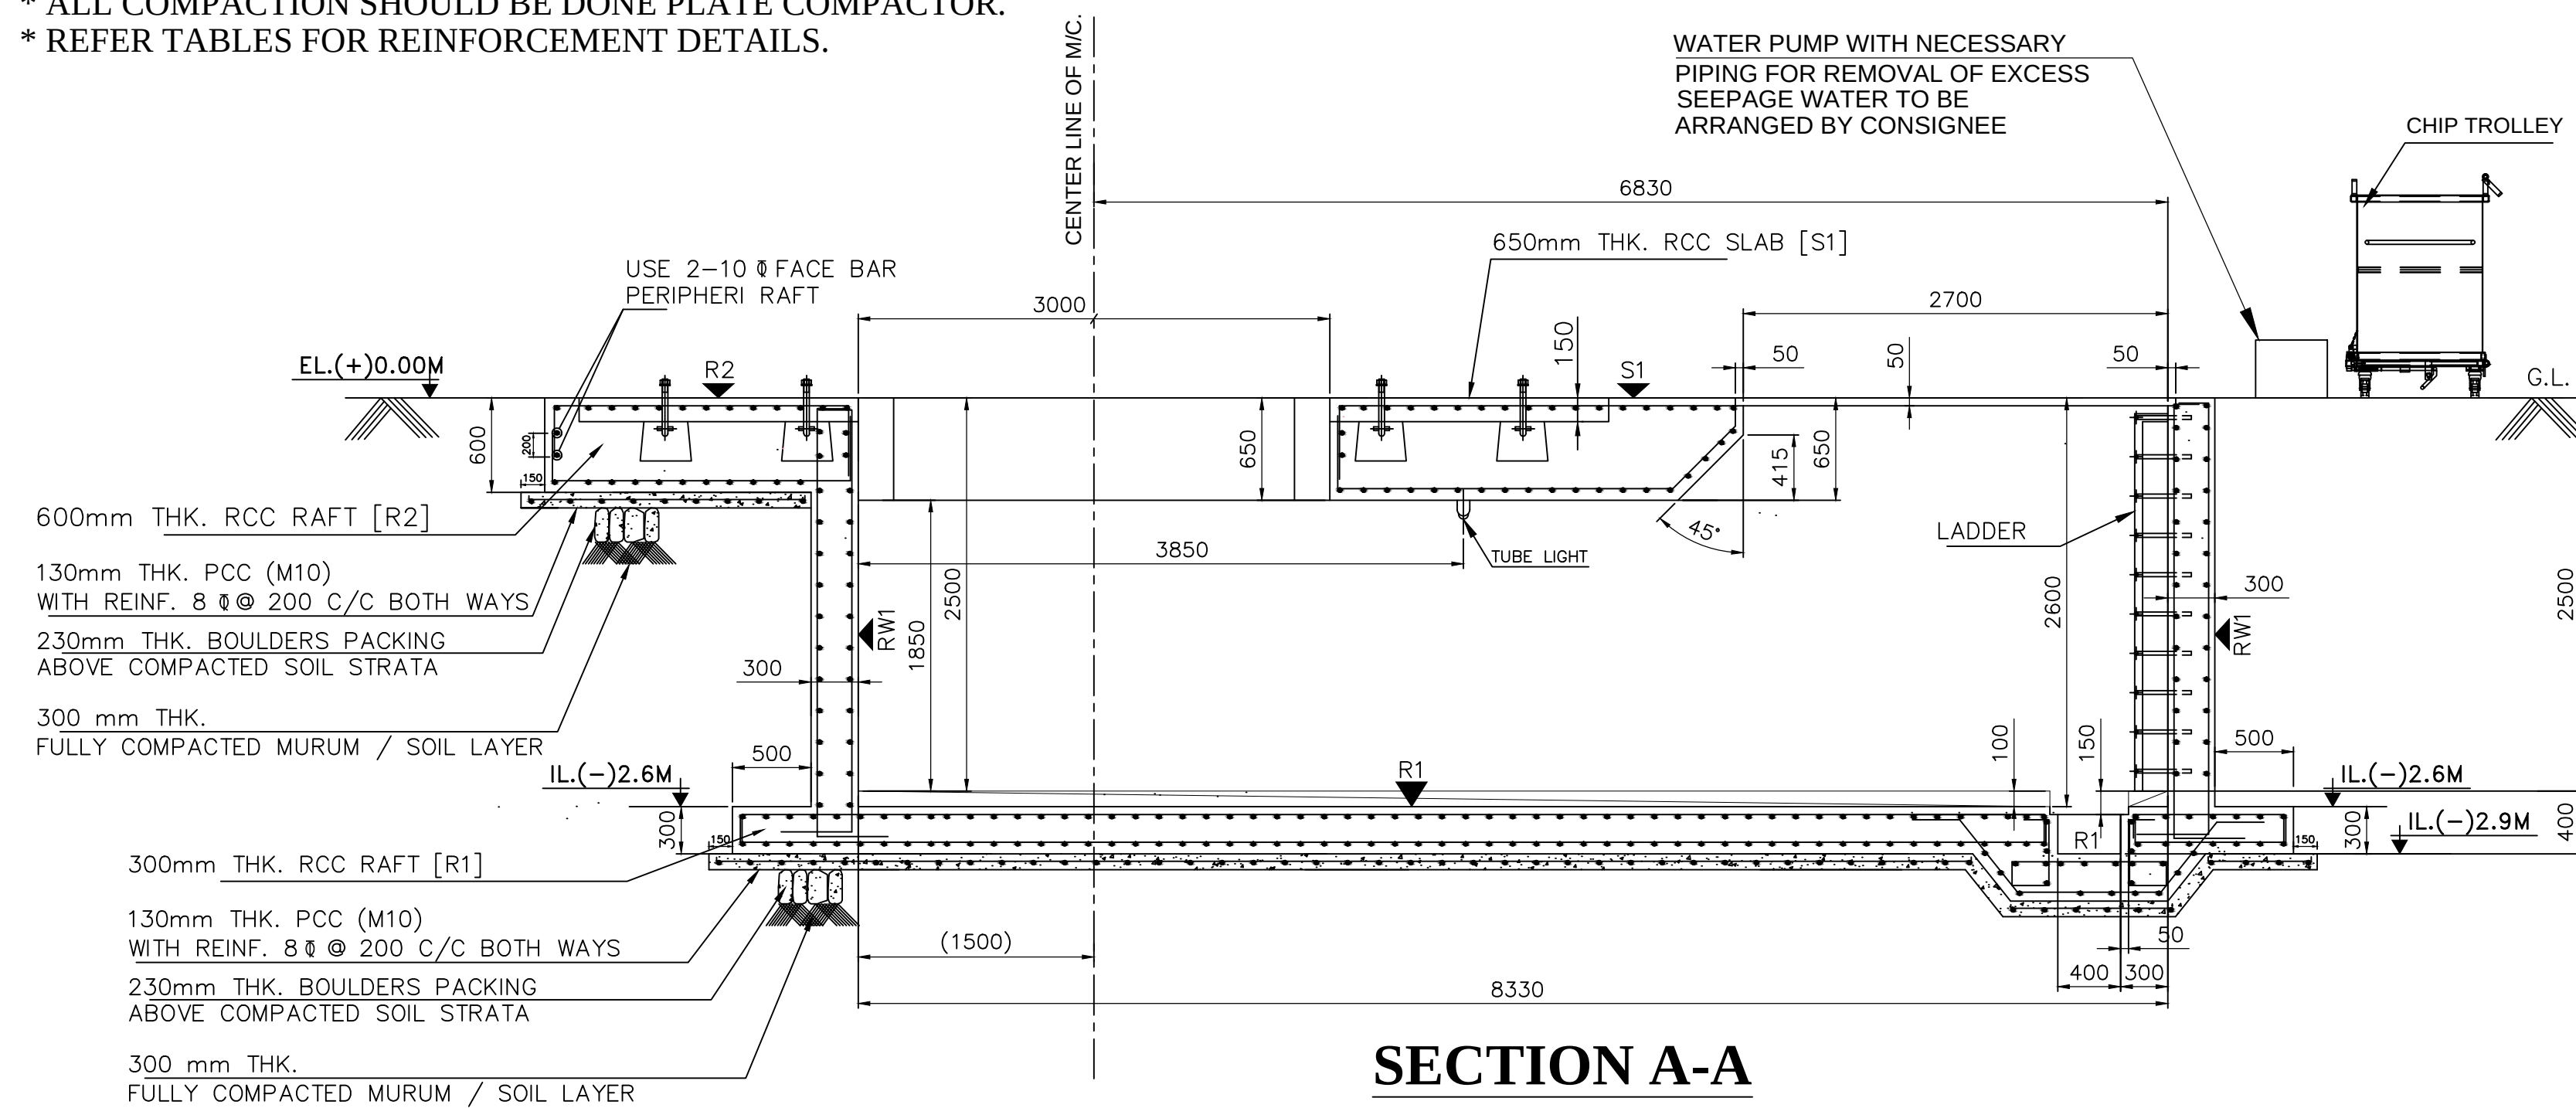

FOR PWL , AT- BHUSAWAL

* GRADE OF CONC. M 30

* STEEL FE 500

GENERAL NOTES :-

1. FOR GEOMETRIC DIMENSIONS REFER TO DRG NO.
2. CLEAR COVER TO STEEL REINFORCEMENT
RAFT : 50mm BEAM : 25mm SLAB : 50mm
RCC WALL : 30mm
3. SAFE BEARING CAPACITY OF SOIL ASSUMED : 7 T/Sq.m ASCERTAINED BEFORE CONCRETING.
4. LAP LENGTHS FOR MAIN REINFORCEMENTS IN : RAFT & WALL : 46 Ø
5. DESHUTTERING PERIOD OF VERTICAL FACES OF WALLS SHALL NOT BE LESS THAN 24 HOURS.
6. ANY DISCREPANCY BETWEEN OUR & MACHINE DRAWINGS SHALL BE BROUGHT TO OUR NOTICE BEFORE EXECUTION.
7. SHUTTERING AND QUALITY OF CONCRETE SHALL BE THE RESPONSIBILITY OF CONTRACTOR / HYT ENG. CO.PVT.LTD. PUNE.

SPECIAL NOTES :-

1. EXTRA DEPTH BEYOND REQUIRED DEPTH SHOULD BE REFILLED WITH COMPACTED MURUM. THE COMPACTION SHALL BE DONE IN LAYERS OF 300mm TO ACHIVE FULL COMPACTION.
2. CONCRETE MIX M30 TO GIVE A STRENGTH OF 30MPA AT 28 DAYS.
3. THE RAFT SLAB SHOULD REST ON PROFILE CUT GOOD STRATA BELOW WITH DESIGNED SBC.
4. THE UPPER LEVEL RAFT SHOULD REST ON COMPACTED MURUM FILLED UP IN LAYERS.
5. THE BOND BETWEEN OLD & NEW CONCRETE SHOULD BE ACHIEVED BY PLACING METAL IN THE TOP LAYER & USING ACRYLIC POLYMER MODIFIED CEMENT SLURRY TO SUCH JOINTS.
6. ALL INTERNAL SURFACES SHOULD BE TREATED WITH ACRYLIC POLYMER MODIFIED MORTAR TO AVOID WATER SEAPAGES INSIDES.
7. ALL THE HORIZONTAL JOINTS IN RCC WALLS & OTHER LOCATIONS SHOULD BE GROUTED PROPERLY BY ACRYLIC POLYMER MODIFIED CEMENT SLURRY TO AVOID SEAPAGES.



कारखाना परियोजना संगठन, पटना
भारतीय रेल
WORKSHOP PROJECTS ORGANISATION, PATNA
INDIAN RAILWAYS

R0	INITIAL SUBMITTED	ARN	VMW	26.11.2021
Rev.	Description	DRAWN BY	CHECKED BY	Date

REVISIONS	
1	Initial Design
2	Revised Design
3	Final Design

PROJECT :	FOUNDATION DWG. FOR CNC PORTAL WHEEL LATHE (PWL), ROH DEPOT AT BHUSAWAL, CENTRAL RAILWAY.		
SHOP :	WHEEL SHOP		
TITLE :	RCC DETAILS OF SECTION A-A, SECTION B-B & SECTION K-K		
CONTRACTOR :	HYT ENGINEERING CO,PVT.LTD.		
DRAWING NO. :	01		
GA. DWG. BY :	HYT	JOB NO. : 3049/21	REV. NO. : R0
CHKD. BY :	CE. VIKAS	DRAWN.BY: ARN	DATE : 26.11.2021

STRUCTURAL CONSULTANT :

VM CONSULTANTS

CIVIL, STRUCTURAL CONSULTANTS, Govt. App. VALUER & CHARTERED ENGINEER
3, NANDADEEP Apts, Opp: BMCC COLLEGE, SHIVAJINAGAR, PUNE - 04
TEL.: (020)25657701, CELL : +91 09922921747
Email : vmconsultantspune@gmail.com

THIS DRAWING IS COPYRIGHT AND PROPERTY OF VM CONSULTANTS
DRAWING IS VALID FOR CONSTRUCTION PROVIDE IT IS SIGNED & STAMPED BY OUR OFFICE

