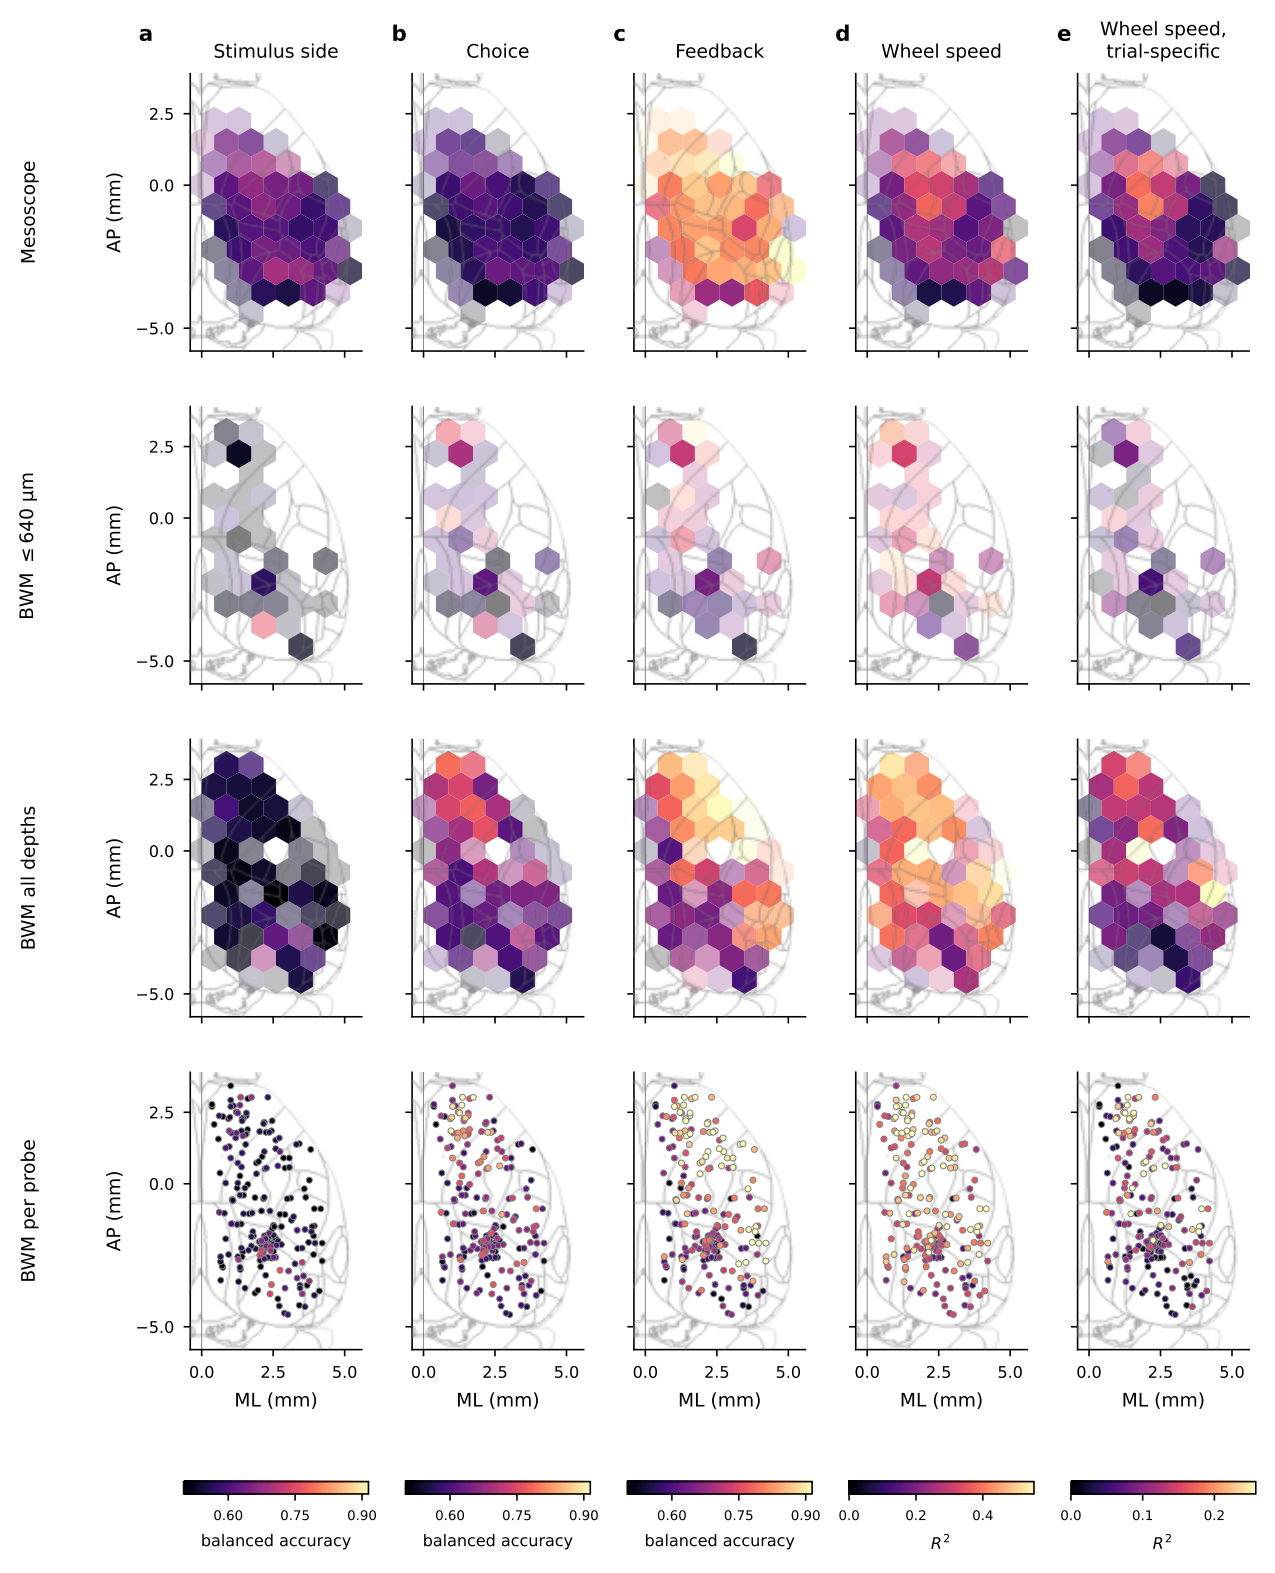

a
Stimulus side
b
Choice
c
Feedback
d
Wheel speed
e
Wheel speed, trial-specific
Mesoscope
BWM ≤ 640 µm
BWM all depths
BWM per probe
AP (mm)
2.5
0.0
−5.0
0.0
2.5
5.0
ML (mm)
0.60
0.75
0.90
balanced accuracy
0.0
0.2
0.4
R^2
0.1
0.2