


RESIDENTIAL FENCES



City of
SANTA ROSA
Planning & Economic
Development - Building Division

LAST UPDATED: 29 AUGUST 2023

THIS DRAWING DEPICTS MINIMUM CODE REQUIREMENTS PER THE 2022 CALIFORNIA CODE CYCLE - INFORMATION IS FOR REFERENCE ONLY AND IS NOT A SUBSTITUTE FOR ACCURATE DRAWINGS PREPARED FOR EACH PROPOSED CONSTRUCTION PROJECT

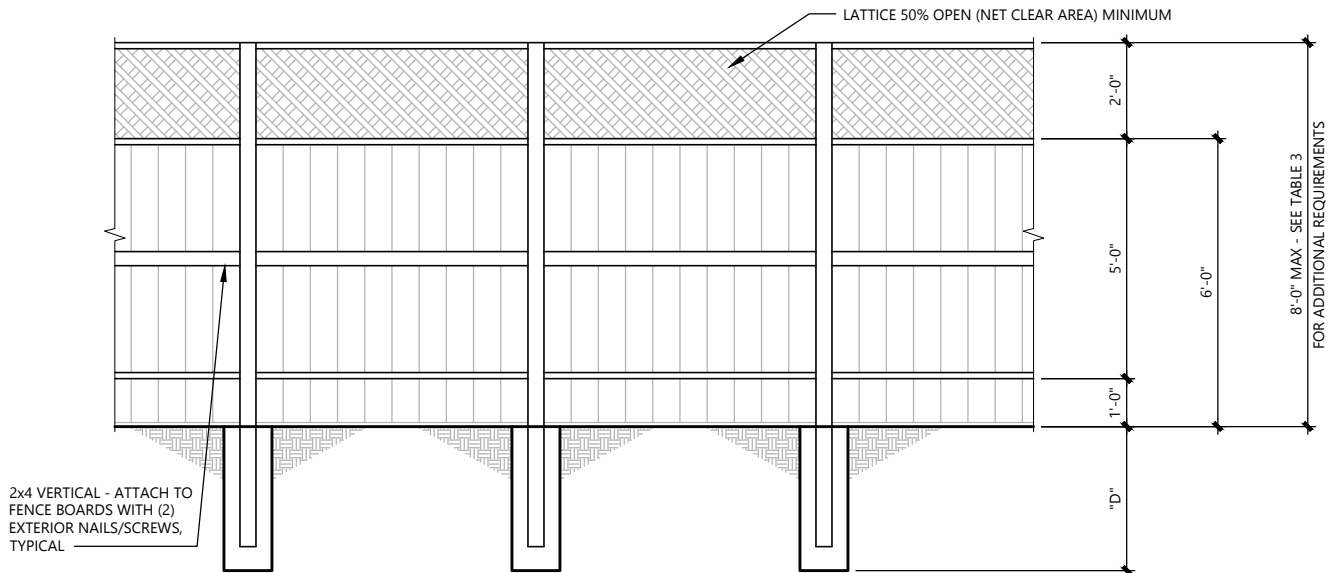

ELEVATION

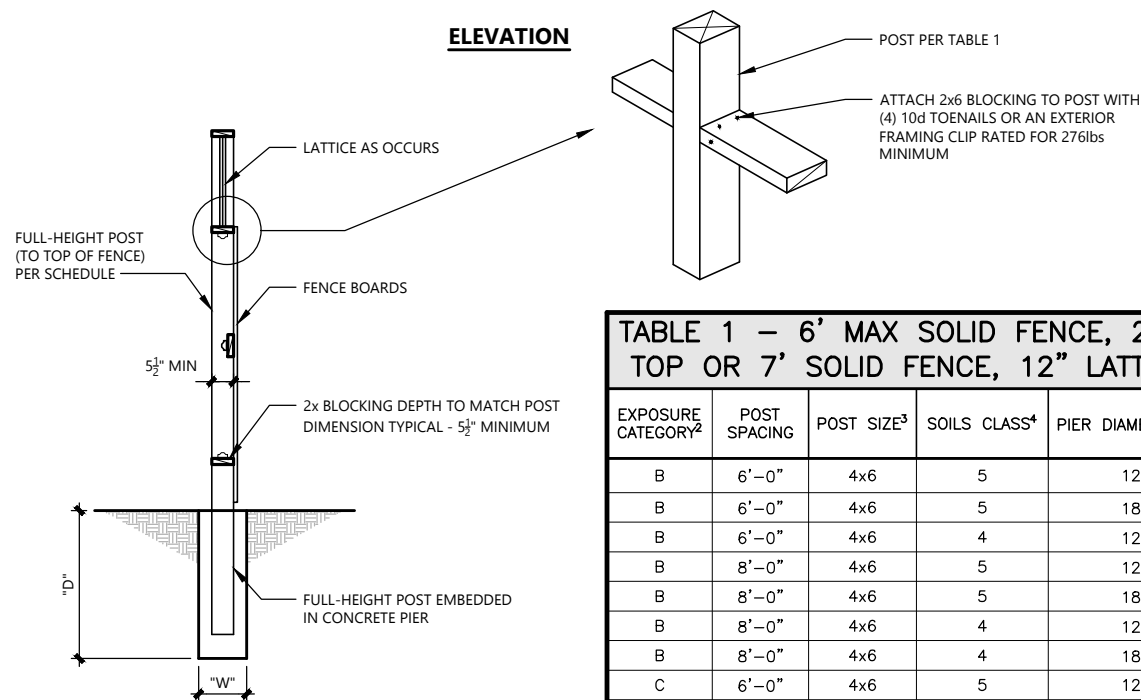


TABLE 1 – 6' MAX SOLID FENCE, 24" LATTICE ON TOP OR 7' SOLID FENCE, 12" LATTICE ON TOP^{1,5}

EXPOSURE CATEGORY ²	POST SPACING	POST SIZE ³	SOILS CLASS ⁴	PIER DIAMETER "W"	MINIMUM PIER DEPTH "D"
B	6'-0"	4x6	5	12"	3'-0"
B	6'-0"	4x6	5	18"	2'-8"
B	6'-0"	4x6	4	12"	2'-8"
B	8'-0"	4x6	5	12"	3'-5"
B	8'-0"	4x6	5	18"	2'-11"
B	8'-0"	4x6	4	12"	2'-11"
B	8'-0"	4x6	4	18"	2'-6"
C	6'-0"	4x6	5	12"	3'-6"
C	6'-0"	4x6	5	18"	3'-0"
C	6'-0"	4x6	4	12"	3'-0"
C	8'-0"	6x6	5	12"	4'-0"
C	8'-0"	6x6	5	18"	3'-5"
C	8'-0"	6x6	4	12"	3'-5"
C	8'-0"	6x6	4	18"	2'-11"

¹ TABLE ASSUMES RISK CATEGORY 1 WITH LATTICE 50% OPEN (NET CLEAR AREA) - SEE TABLE 2 FOR 8'-0" SOLID FENCE

² EXPOSURE CATEGORY PER DEFINITIONS SECTION

³ REDWOOD, CONSTRUCTION GRADE OR BETTER (ALTERNATE: PRESSURE TREATED DOUGLAS FIR, #2 OR BETTER) - 5 1/2" DIMENSION TO BE PERPENDICULAR TO FACE OF FENCE

⁴ SOIL CLASS BASED ON CBC TABLE 1806.2 - CLASS 5 SOILS ARE TO BE ASSUMED IF NO GEOTECHNICAL REPORT IS PROVIDED

⁵ FENCES OVER 7' IN HEIGHT REQUIRE A BUILDING PERMIT - SEE TABLE 3 FOR ADDITIONAL REQUIREMENTS

RESIDENTIAL FENCES



City of
SANTA ROSA
Planning & Economic
Development - Building Division

LAST UPDATED: 29 AUGUST 2023

THIS DRAWING DEPICTS MINIMUM CODE REQUIREMENTS PER THE 2022 CALIFORNIA CODE CYCLE - INFORMATION IS FOR REFERENCE ONLY AND IS NOT A SUBSTITUTE FOR ACCURATE DRAWINGS PREPARED FOR EACH PROPOSED CONSTRUCTION PROJECT

TABLE 2 – 8' MAX SOLID FENCE^{1,5}

EXPOSURE CATEGORY ²	POST SPACING	POST SIZE ³	SOILS CLASS ⁴	PIER DIAMETER "W"	MINIMUM PIER DEPTH "D"
B	6'-0"	4x6	5	12"	3'-2"
B	6'-0"	4x6	5	18"	2'-10"
B	6'-0"	4x6	4	12"	2'-10"
B	8'-0"	4x6	5	12"	3'-6"
B	8'-0"	4x6	5	18"	3'-0"
B	8'-0"	4x6	4	12"	3'-0"
B	8'-0"	4x6	4	18"	2'-8"
C	6'-0"	4x6	5	12"	3'-8"
C	6'-0"	4x6	5	18"	3'-2"
C	6'-0"	4x6	4	12"	3'-2"
C	8'-0"	6x6	5	12"	4'-0"
C	8'-0"	6x6	5	18"	3'-6"
C	8'-0"	6x6	4	12"	3'-6"
C	8'-0"	6x6	4	18"	3'-0"

- TABLE ASSUMES RISK CATEGORY 1, AND SOLID WIND LOADING FOR THE FULL 8'-0" ABOVE GRADE - SEE DETAILS ON OPPOSITE SIDE FOR MORE INFORMATION
- EXPOSURE CATEGORY PER DEFINITIONS SECTION
- REDWOOD CONSTRUCTION GRADE OR BETTER (ALTERNATE: PRESSURE TREATED DOUGLAS FIR #2 OR BETTER) - 5 1/2" DIMENSION TO BE PERPENDICULAR TO FACE OF FENCE
- SOIL CLASS BASED ON CBC TABLE 1806.2 - CLASS 5 SOILS ARE TO BE ASSUMED IF NO GEOTECHNICAL REPORT IS PROVIDED
- FENCES OVER 7' IN HEIGHT REQUIRE A BUILDING PERMIT - SEE TABLE 3 FOR ADDITIONAL REQUIREMENTS

TABLE 3 – MAXIMUM HEIGHT OF FENCES¹

LOCATION	MAXIMUM HEIGHT ¹
WITHIN A VISION TRIANGLE ²	0'-0"
WITHIN REQUIRED FRONT YARD SETBACK	3'-0"
WITHIN EXTERIOR SIDE SETBACK	3'-0"
WITHIN INTERIOR SIDE OR REAR YARD SETBACK ³	6'-0"
OUTSIDE OF A REQUIRED SETBACK ³	6'-0"

- FOR FENCE HEIGHT GUIDELINES WITH AN -H (HISTORIC) COMBINING DISTRICT, SEE THE CITY'S "PROCESSING REVIEW PROCEDURES FOR OWNERS OF HISTORIC PROPERTIES" - HEIGHTS MAY EXCEED THE VALUES IN THIS TABLE (EXCEPT IN A VISION TRIANGLE) IF A MINOR CONDITIONAL USE PERMIT IS APPROVED (SEE ADDITIONAL REQUIREMENTS ON THIS SHEET)
- SEE SANTA ROSA CITY CODE (SRCC) SECTION 20-30.070.E FOR EXCEPTIONS
- A 6' FENCE WITH 24" OF LATTICE IS ALLOWED BY RIGHT (WHERE FOOTNOTE ³ IS SPECIFIED IN TABLE 3), BUT A BUILDING PERMIT IS REQUIRED FOR FENCES OVER 7' IN HEIGHT

ADDITIONAL REQUIREMENTS FOR FENCES:

SANTA ROSA CITY CODE (SRCC) SECTION 18-22R337.10.3 REQUIRES NEW, ALTERED, OR ADDED FENCES CONNECTED TO DWELLINGS OR ACCESSORY STRUCTURES IN WILDLAND URBAN INTERFACE FIRE AREAS (WUI) TO CONSTRUCT THE ATTACHMENT AND FIRST FIVE FEET OF THE FENCE WITH NONCOMBUSTIBLE MATERIALS (EXCEPTION FOR SPRINKLERED BUILDINGS LOWERS THE FIVE FOOT REQUIREMENT TO THREE FEET).

A MINOR USE PERMIT CANNOT BE APPROVED UNLESS THE REVIEW AUTHORITY MAKES ALL OF THE FOLLOWING FINDINGS (IN ADDITION TO THOSE REQUIRED FOR MINOR CONDITIONAL USE PERMITS BY SANTA ROSA CITY CODE (SRCC) SECTION 20-52.050):

- THE ISSUANCE OF THE PERMIT IS REASONABLY NECESSARY, BY REASON OF UNUSUAL OR SPECIAL CIRCUMSTANCES OR CONDITIONS RELATING TO THE PROPERTY, FOR THE PRESERVATION OF VALUABLE PROPERTY RIGHTS OR THE FULL USE AND ENJOYMENT OF THE PROPERTY
- THE FENCE WILL NOT CREATE A SAFETY HAZARD TO PEDESTRIANS OR VEHICULAR TRAFFIC
- THE APPEARANCE OF THE FENCE IS COMPATIBLE WITH THE DESIGN AND APPEARANCE OF OTHER EXISTING BUILDINGS AND STRUCTURES WITHIN THE NEIGHBORHOOD
- THE FENCE IS A PLANNED ARCHITECTURAL FEATURE TO AVOID DOMINATING THE SITE OR OVERWHELMING THE ADJACENT PROPERTIES AND STRUCTURES
- THE ORIENTATION AND LOCATION OF THE FENCE IS IN PROPER RELATION TO THE PHYSICAL CHARACTERISTICS OF THE SITE AND THE SURROUNDING NEIGHBORHOOD
- THE FENCE WILL BE OF SOUND CONSTRUCTION
- THE FENCE WILL NOT INTERFERE WITH FIRE DEPARTMENT ACCESS TO BUILDINGS IN THE VICINITY
- BARBED WIRE WILL NOT BE USED EXCEPT IN AGRICULTURAL, OPEN SPACE, OR INDUSTRIAL AREAS

MAIN CODE REFERENCES:

SANTA ROSA CITY CODE (SRCC), TITLE 20, DIVISION 3, CHAPTER 20-30.060
CALIFORNIA RESIDENTIAL CODE
CALIFORNIA BUILDING CODE

DEFINITIONS:


EXPOSURE CATEGORY B: STRUCTURES LOCATED WHERE THE GROUND SURFACE ROUGHNESS, AS DEFINED BY "SURFACE ROUGHNESS B," PREVAILS IN THE UPWIND DIRECTION FOR A DISTANCE GREATER THAN 1500 FEET

EXPOSURE CATEGORY C: STRUCTURES LOCATED WHERE NEITHER EXPOSURE CATEGORY B NOR EXPOSURE CATEGORY D APPLY

EXPOSURE CATEGORY D: STRUCTURES LOCATED WHERE GROUND SURFACE ROUGHNESS, AS DEFINED BY "SURFACE ROUGHNESS D," PREVAILS IN THE UPWIND DIRECTION FOR A DISTANCE GREATER THAN 5000 FEET

FENCE: A BARRIER, RAILING, OR OTHER UPRIGHT STRUCTURE ENCLOSING AN AREA OF GROUND TO MARK A BOUNDARY, CONTROL ACCESS, OR PREVENT ESCAPE - INCLUDES FENCES, HEDGES, WALLS, OR STRUCTURES IN THE NATURE OF A FENCE

FENCE HEIGHT: A FENCE SHALL BE MEASURED AS THE VERTICAL DISTANCE BETWEEN THE FINISHED GRADE AT THE BASE OF THE FENCE, AND THE TOP EDGE OF THE FENCE MATERIAL - THE HEIGHT OF FENCING ATOP A WALL SHALL BE MEASURED FROM THE BASE OF THE WALL - WHERE THE GROUND ELEVATION WITHIN SIX FEET OF THE BASE OF A FENCE DIFFERS FROM ONE SIDE OF THE FENCE TO THE OTHER (AS WHEN A FENCE IS PLACED AT THE TOP OF A SLOPE OR ON A RETAINING WALL), THE HEIGHT SHALL BE MEASURED FROM THE SIDE WITH THE LOWEST NATURAL GRADE, EXCEPT THAT A SAFETY FENCE WITH A HEIGHT OF 42 INCHES SHALL BE ALLOWED ON THE TOP OF A RETAINING WALL OF 30 INCHES OR MORE IN HEIGHT WITH MINOR USE PERMIT APPROVAL (SEE DETAIL BELOW)

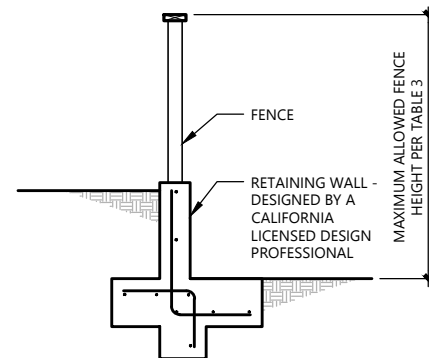


NET CLEAR AREA: PROJECTED AREA, PERPENDICULAR TO THE LATTICE, WHERE AIR CAN PASS ENTIRELY THROUGH THE FENCE WITHOUT CHANGING DIRECTION

SURFACE ROUGHNESS B: URBAN AND SUBURBAN AREAS, WOODED AREAS, OR OTHER TERRAIN WITH NUMEROUS CLOSELY SPACED OBSTRUCTIONS HAVING THE SIZE OF SINGLE-FAMILY DWELLINGS OR LARGER

SURFACE ROUGHNESS C: OPEN TERRAIN WITH SCATTERED OBSTRUCTIONS HAVING HEIGHTS GENERALLY LESS THAN 30 FEET; THIS CATEGORY INCLUDES FLAT OPEN COUNTRY AND GRASSLANDS

SURFACE ROUGHNESS D: FLAT, UNOBSTRUCTED AREAS AND WATER SURFACES; THIS CATEGORY INCLUDES SMOOTH MUD FLATS, SALT FLATS, AND UNBROKEN ICE

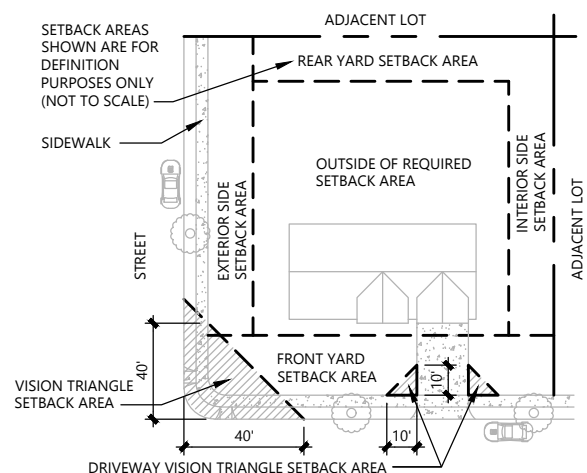

FREE ACCESS TO CALIFORNIA CODES: <https://www.dgs.ca.gov/BSC/Codes#@ViewBag.JumpTo>