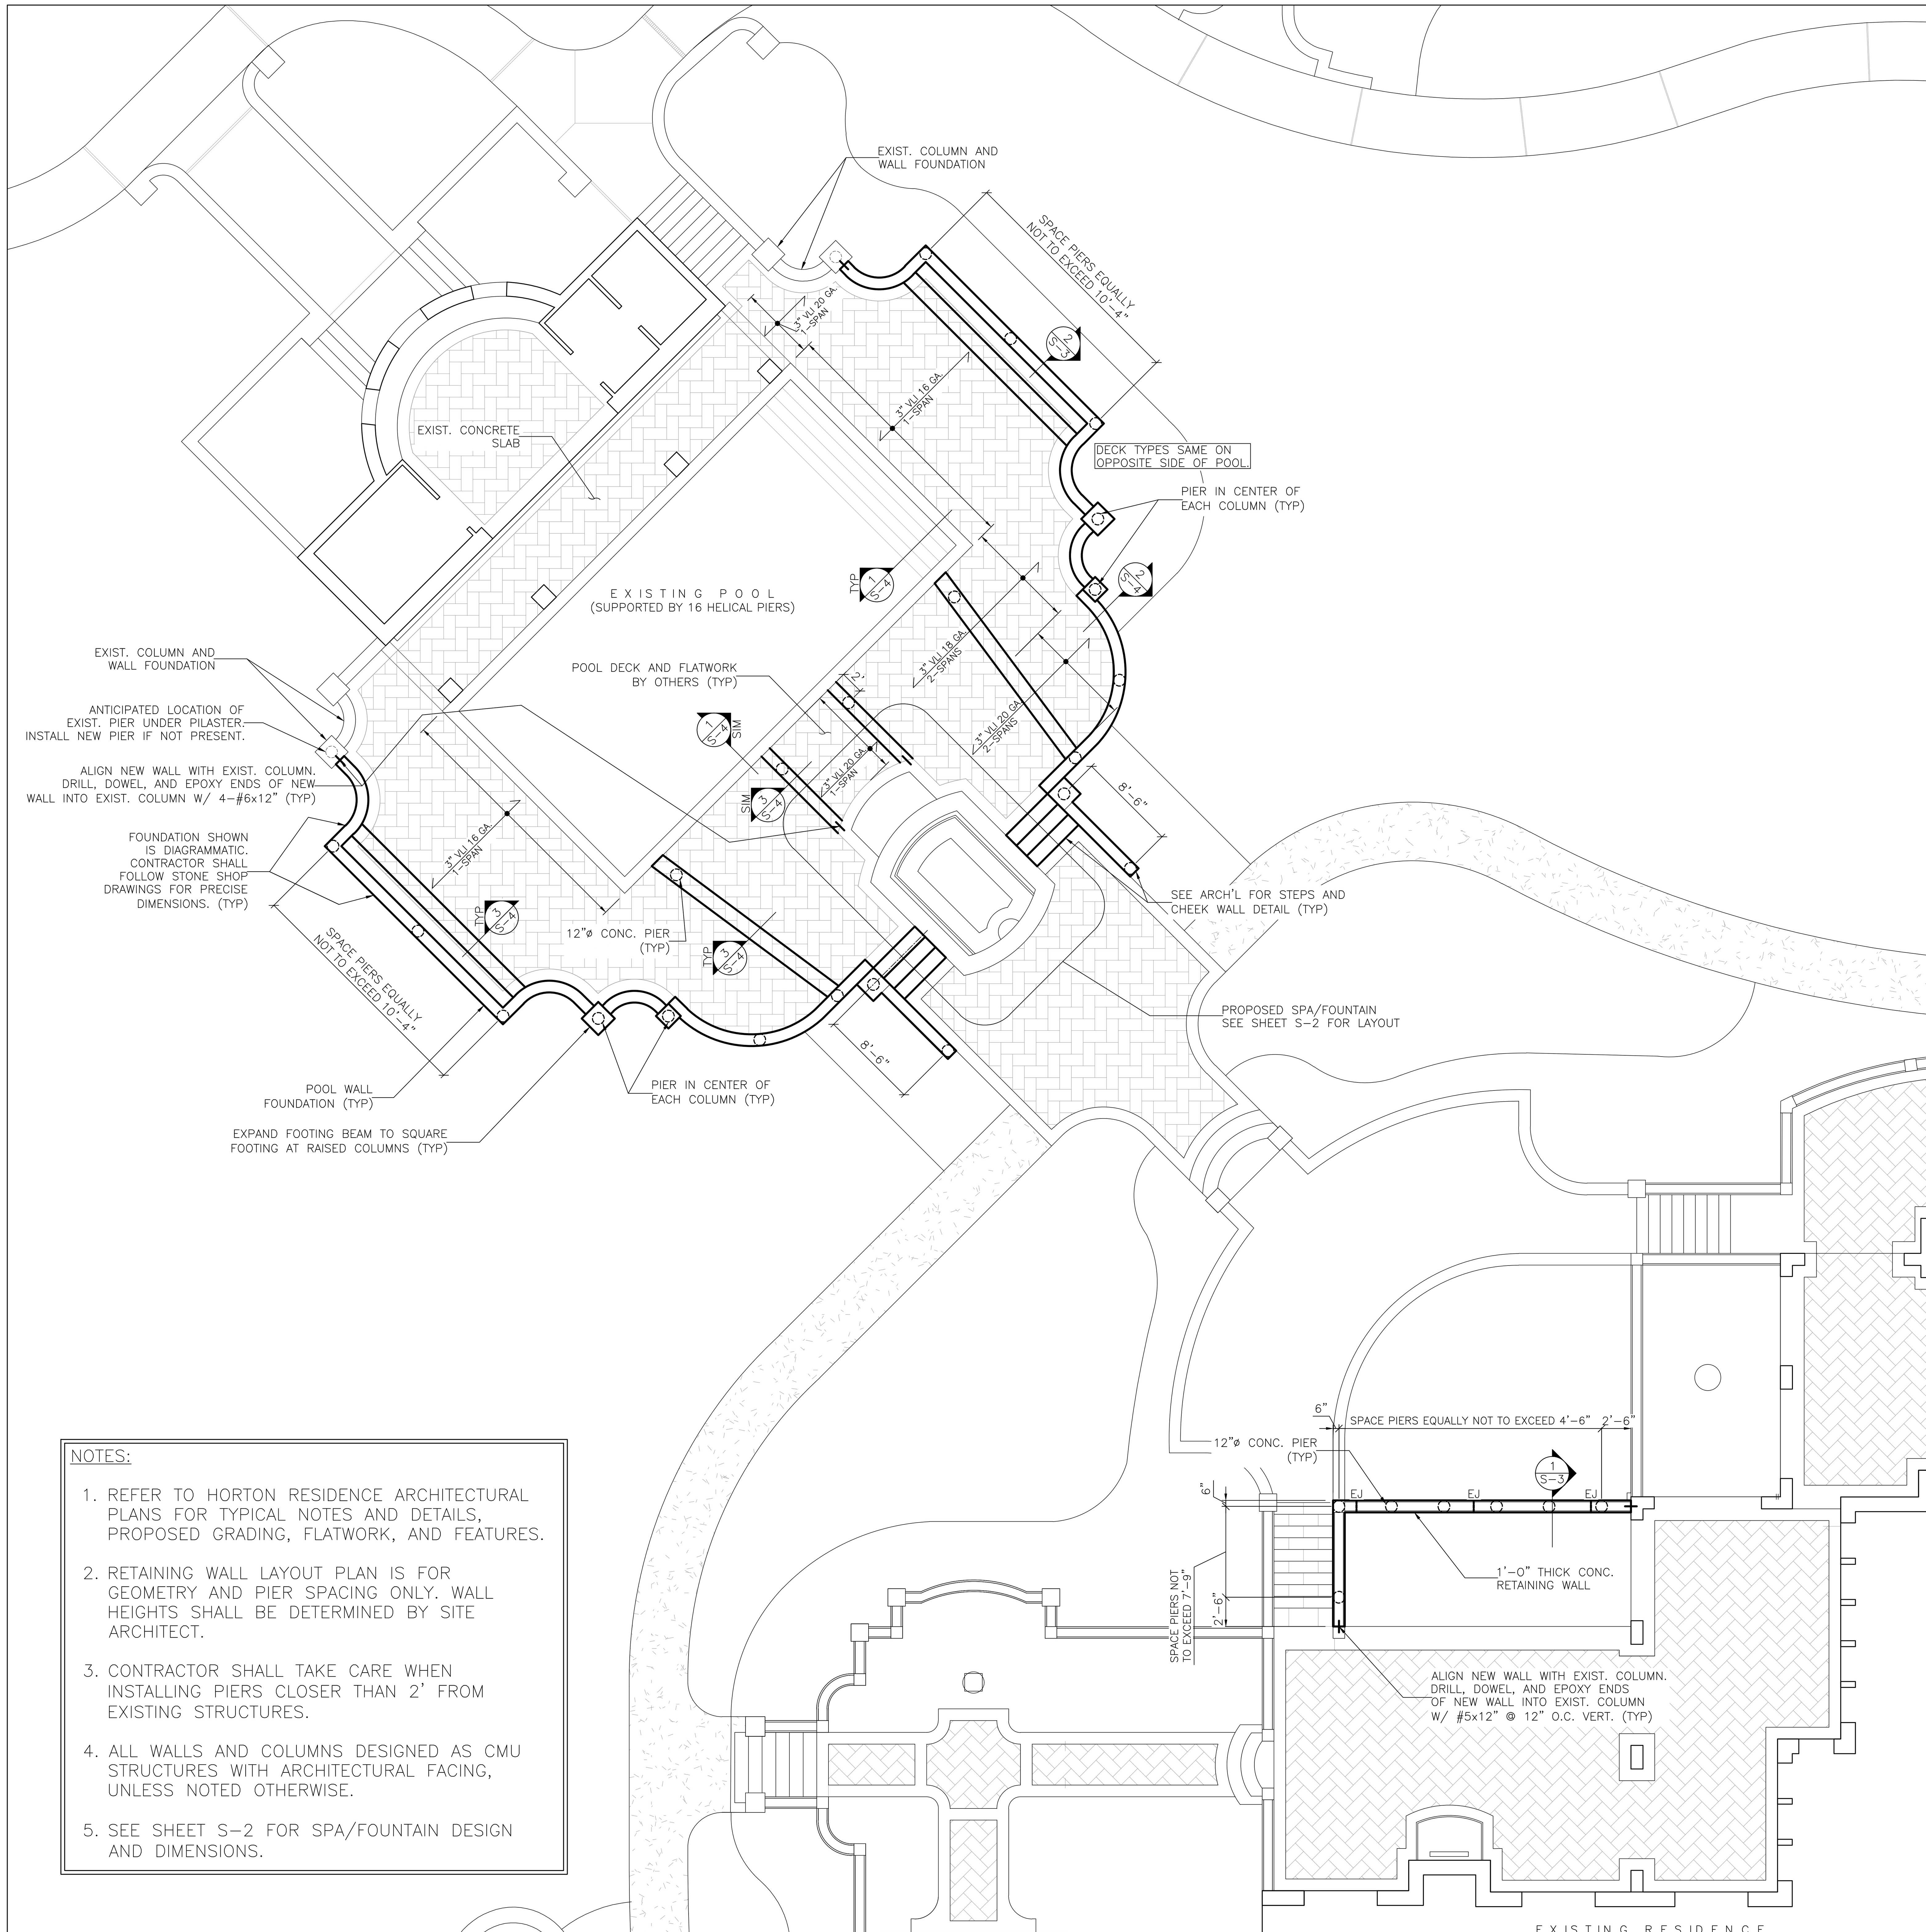

NOTES:

1. REFER TO HORTON RESIDENCE ARCHITECTURAL PLANS FOR TYPICAL NOTES AND DETAILS, PROPOSED GRADING, FLATWORK, AND FEATURES.
2. RETAINING WALL LAYOUT PLAN IS FOR GEOMETRY AND PIER SPACING ONLY. WALL HEIGHTS SHALL BE DETERMINED BY SITE ARCHITECT.
3. CONTRACTOR SHALL TAKE CARE WHEN INSTALLING PIERS CLOSER THAN 2' FROM EXISTING STRUCTURES.
4. ALL WALLS AND COLUMNS DESIGNED AS CMU STRUCTURES WITH ARCHITECTURAL FACING, UNLESS NOTED OTHERWISE.
5. SEE SHEET S-2 FOR SPA/FOUNTAIN DESIGN AND DIMENSIONS.

NORTH

SITE RETAINING WALL AND POOL DECK LAYOUT PLAN – NORTH

SCALE: 1/8" = 1'-0"

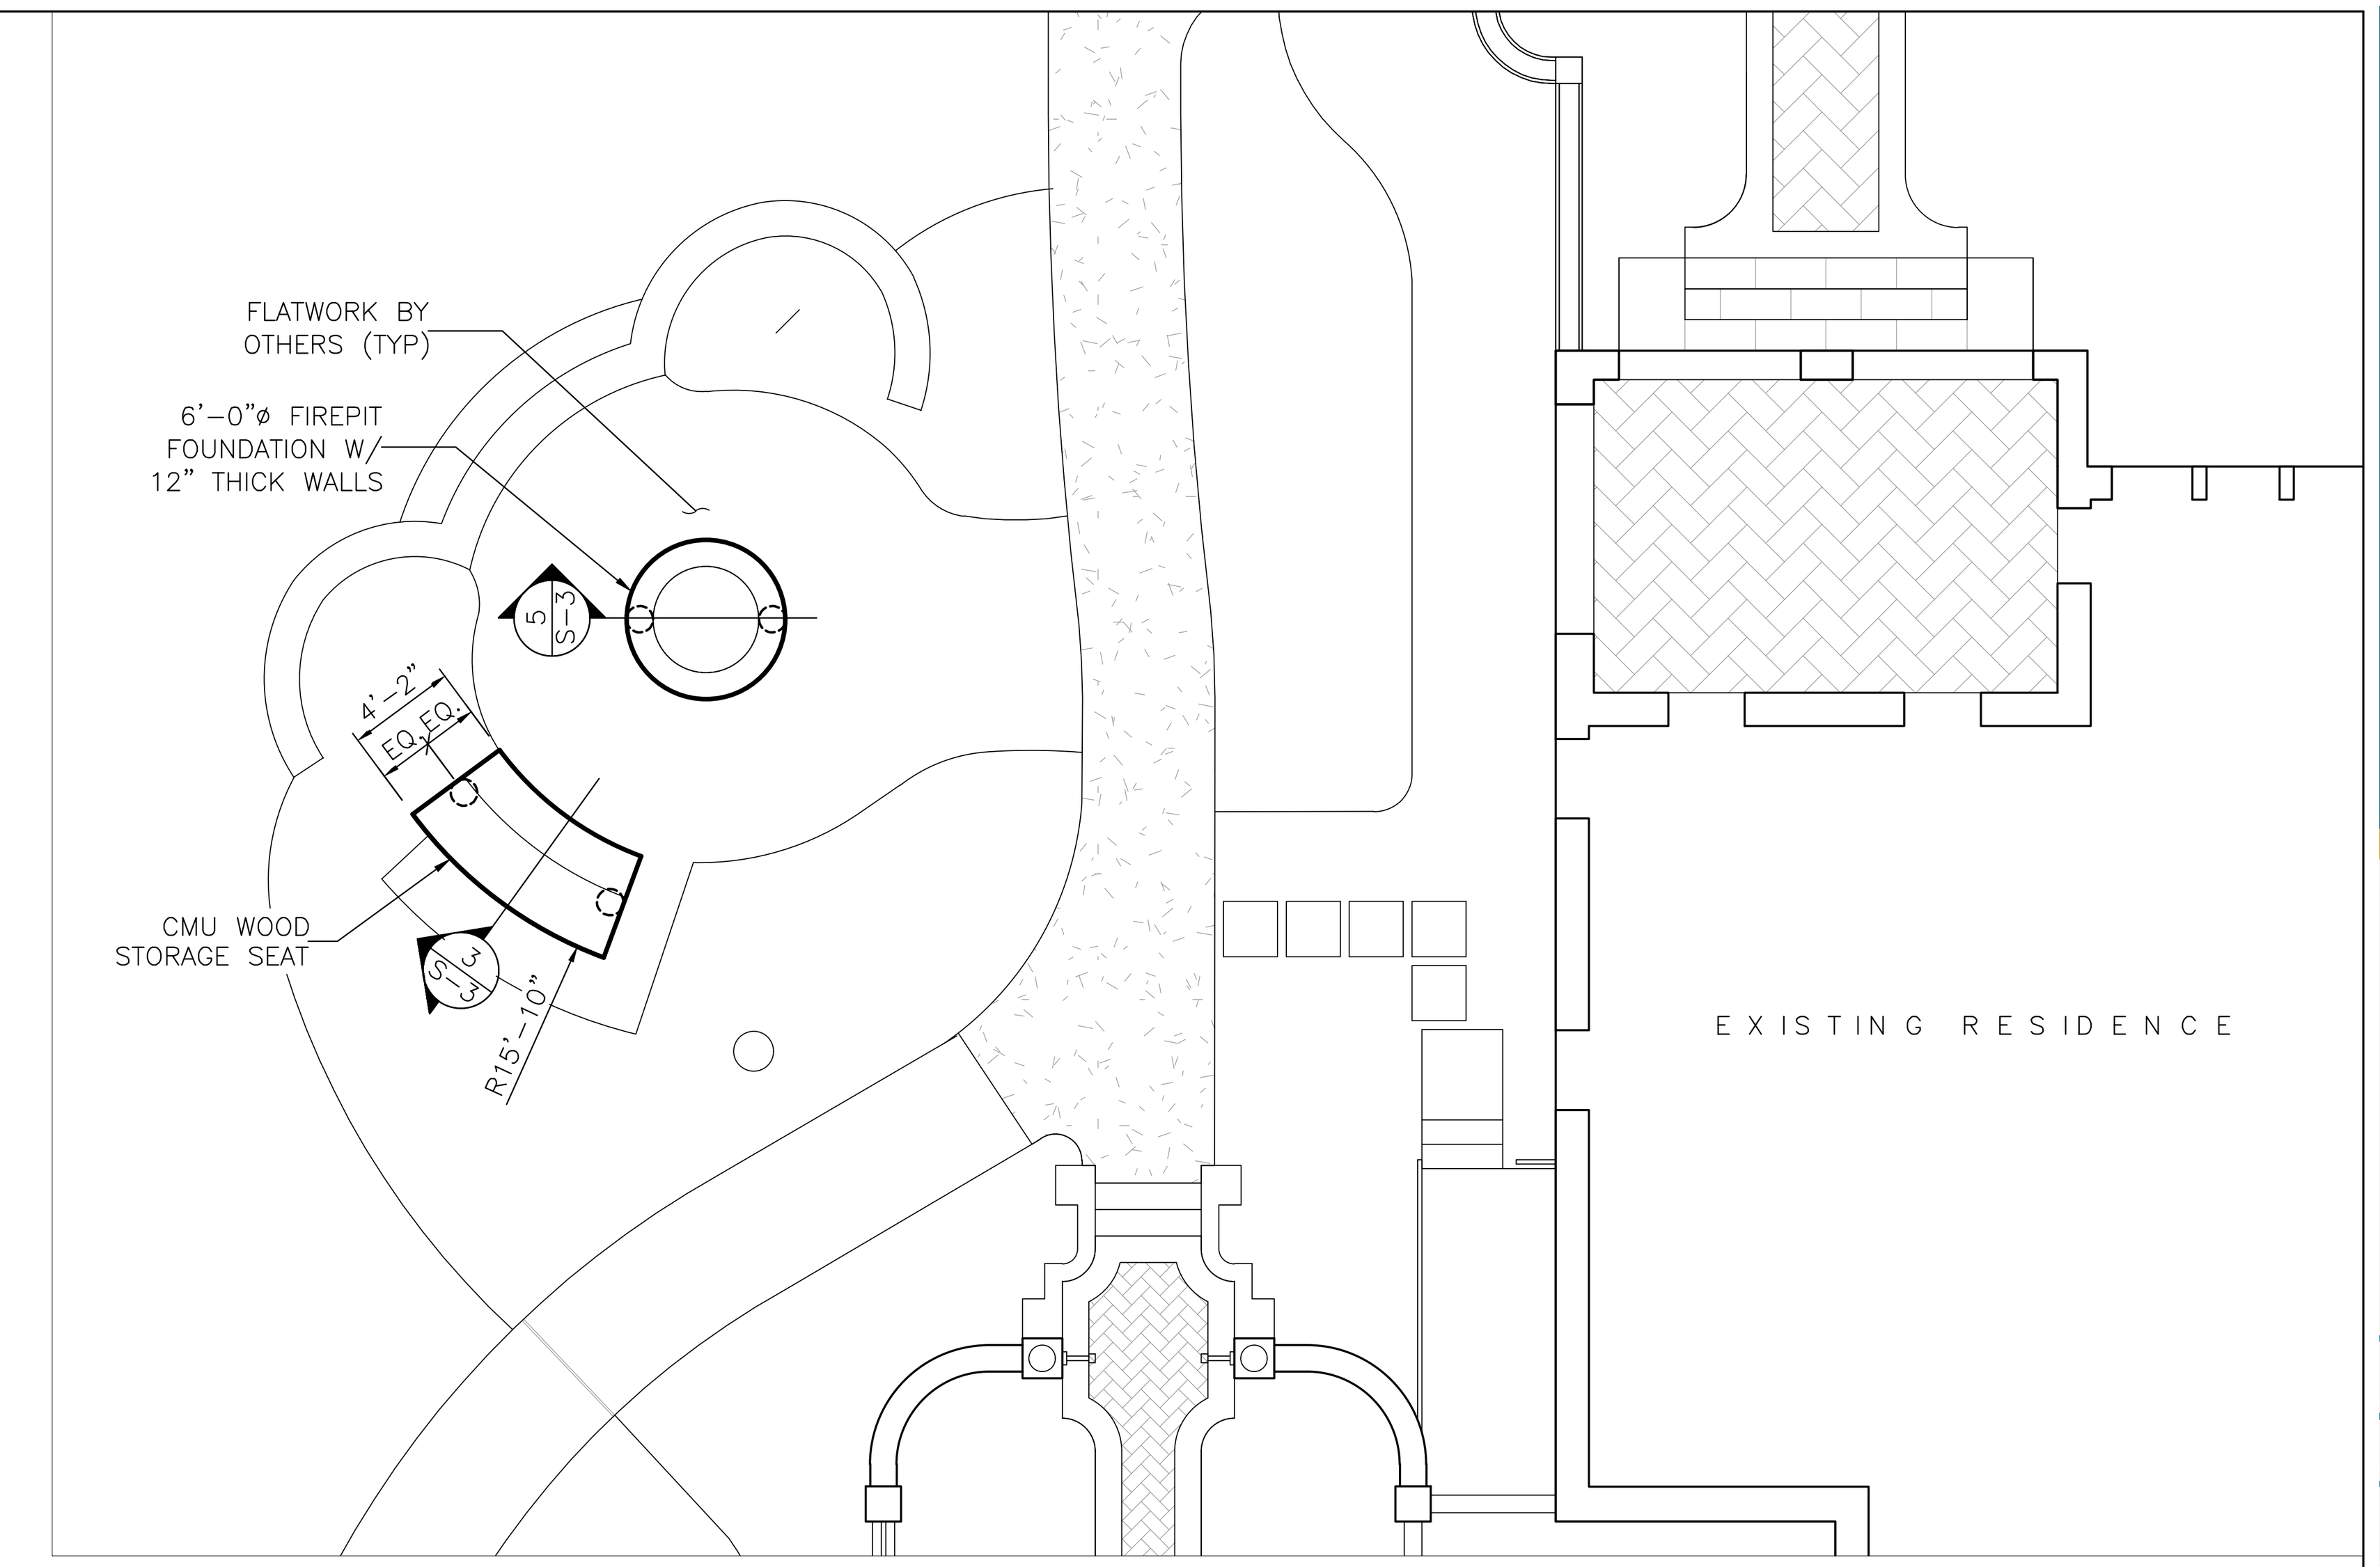

NORTH

FIREPIT PLAN

SCALE: 1/8" = 1'-0"

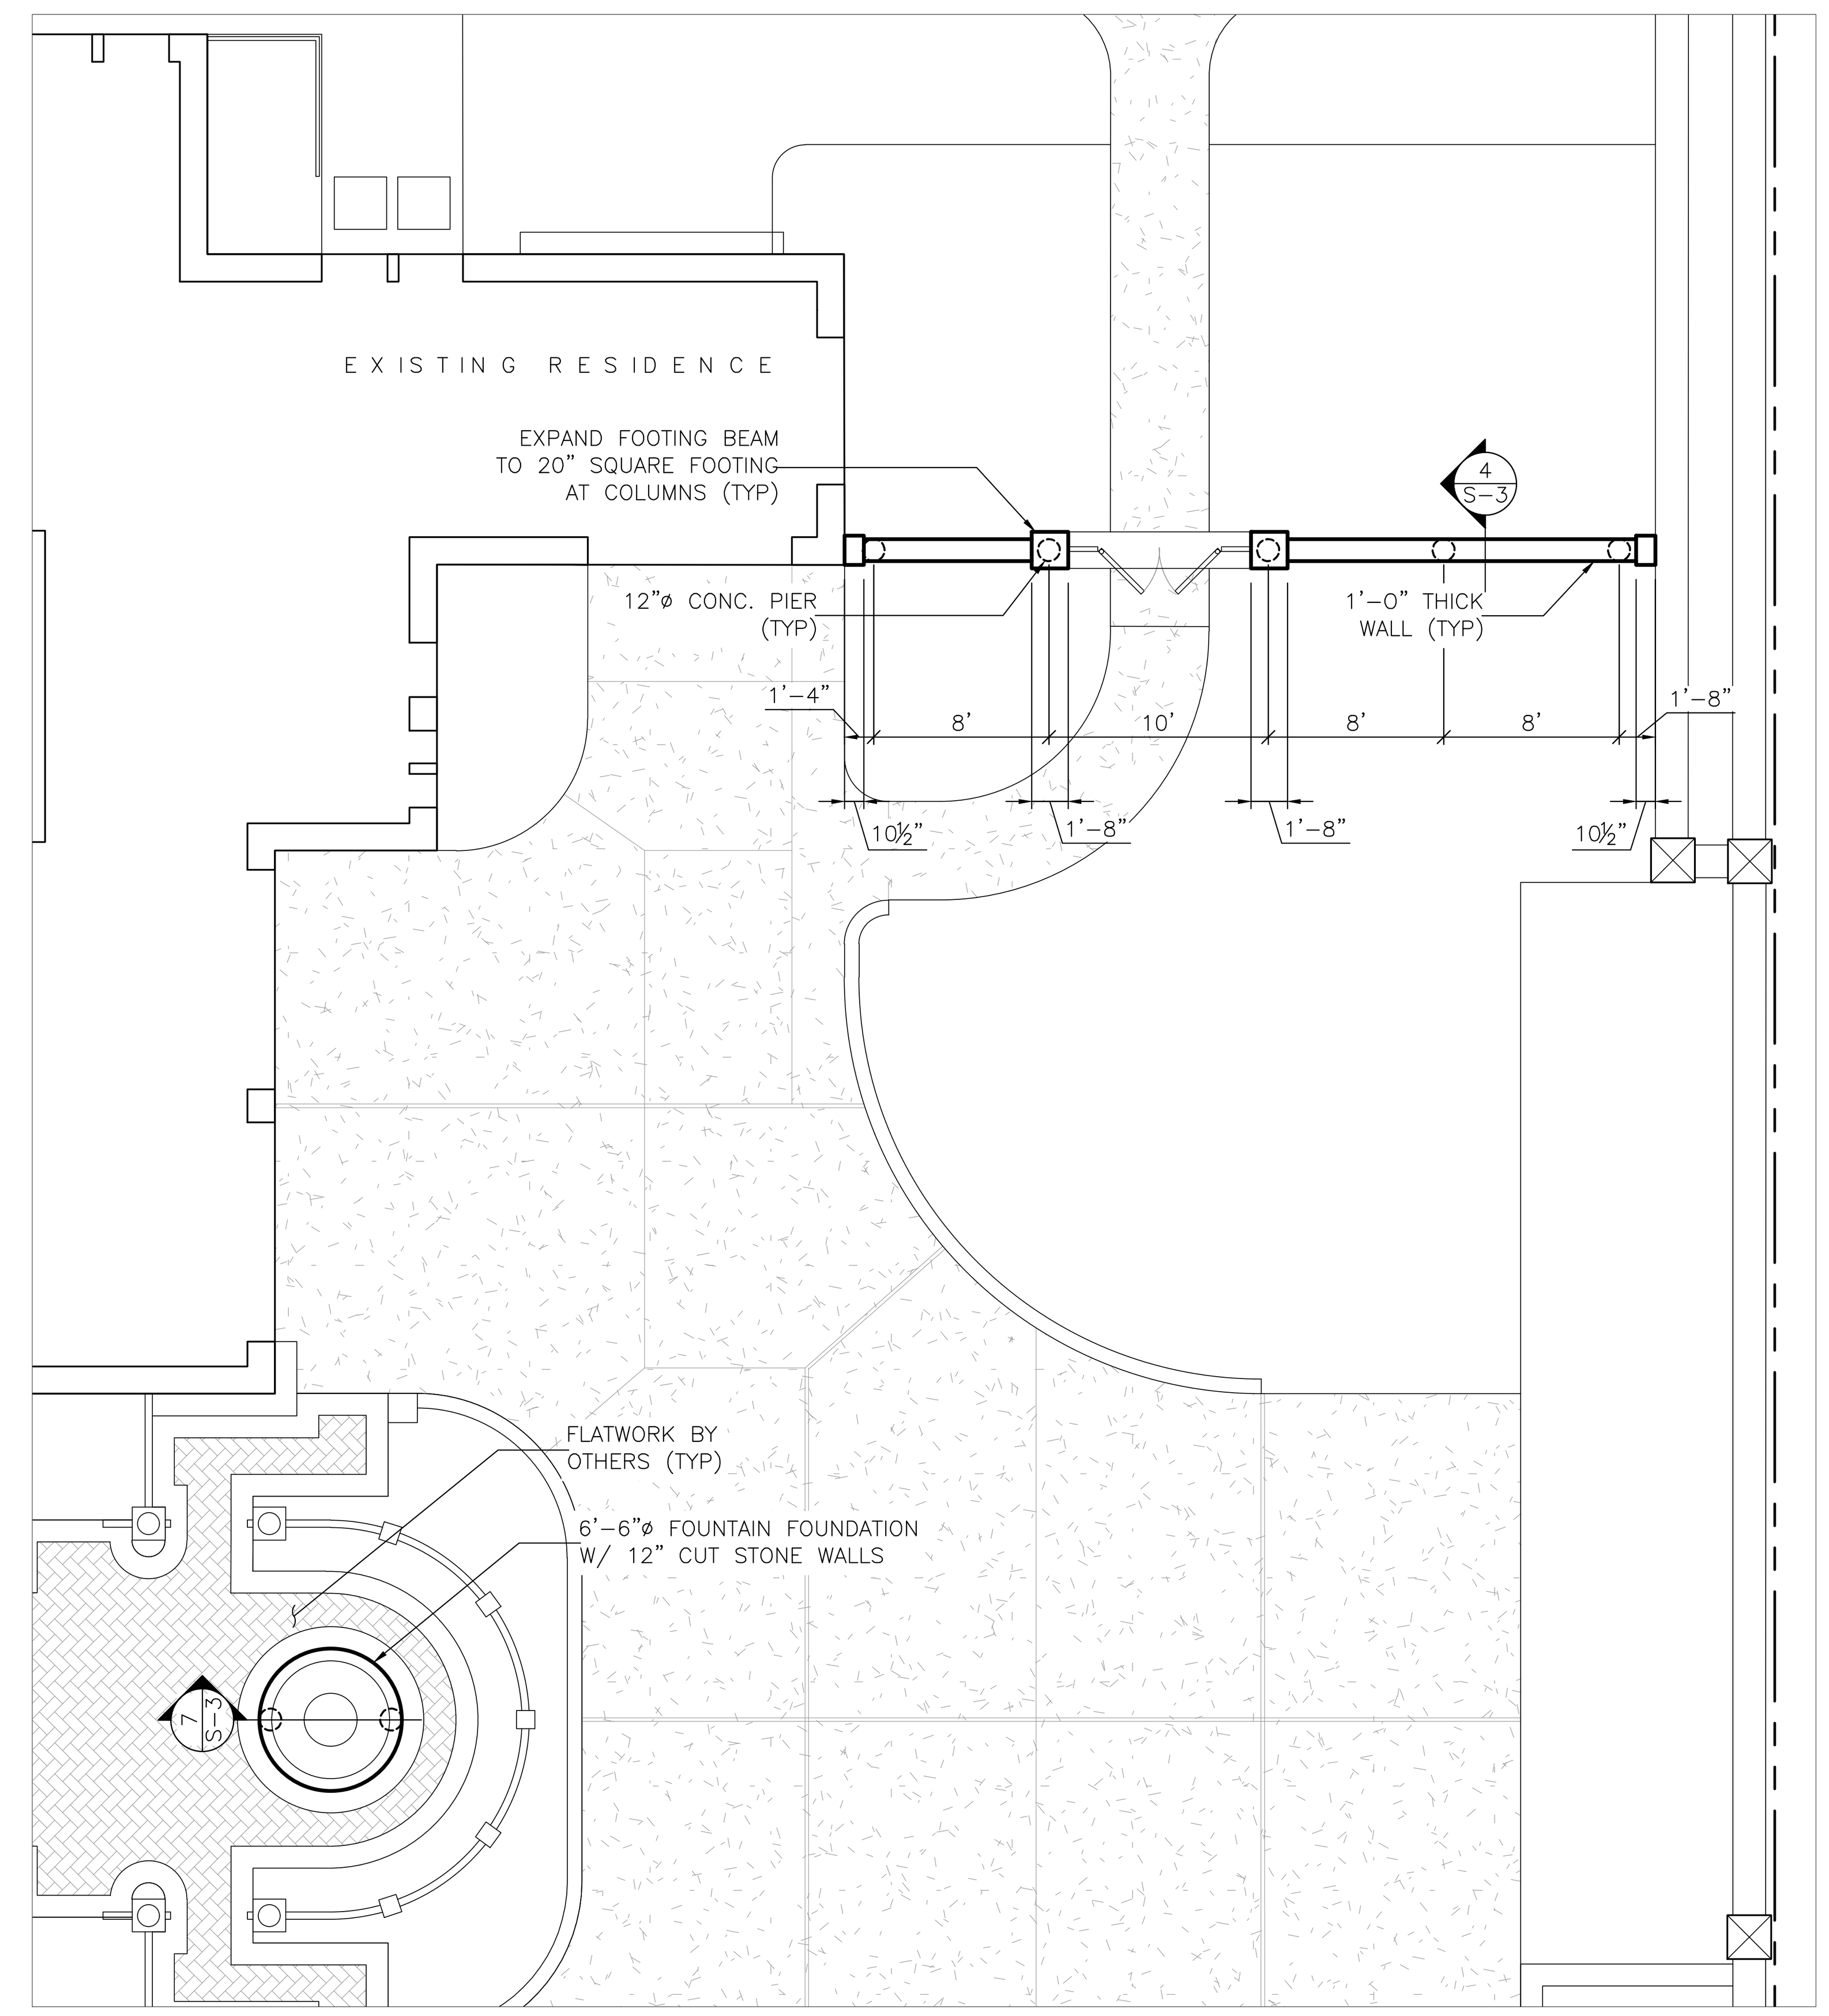

NORTH

ENTRY ARBOR PLAN – SOUTH

SCALE: 1/8" = 1'-0"

Need your project to look like this?

Ira can do it

iracad
Consulting & Design

Contact Us

214-717-8407
ira@iracad.com

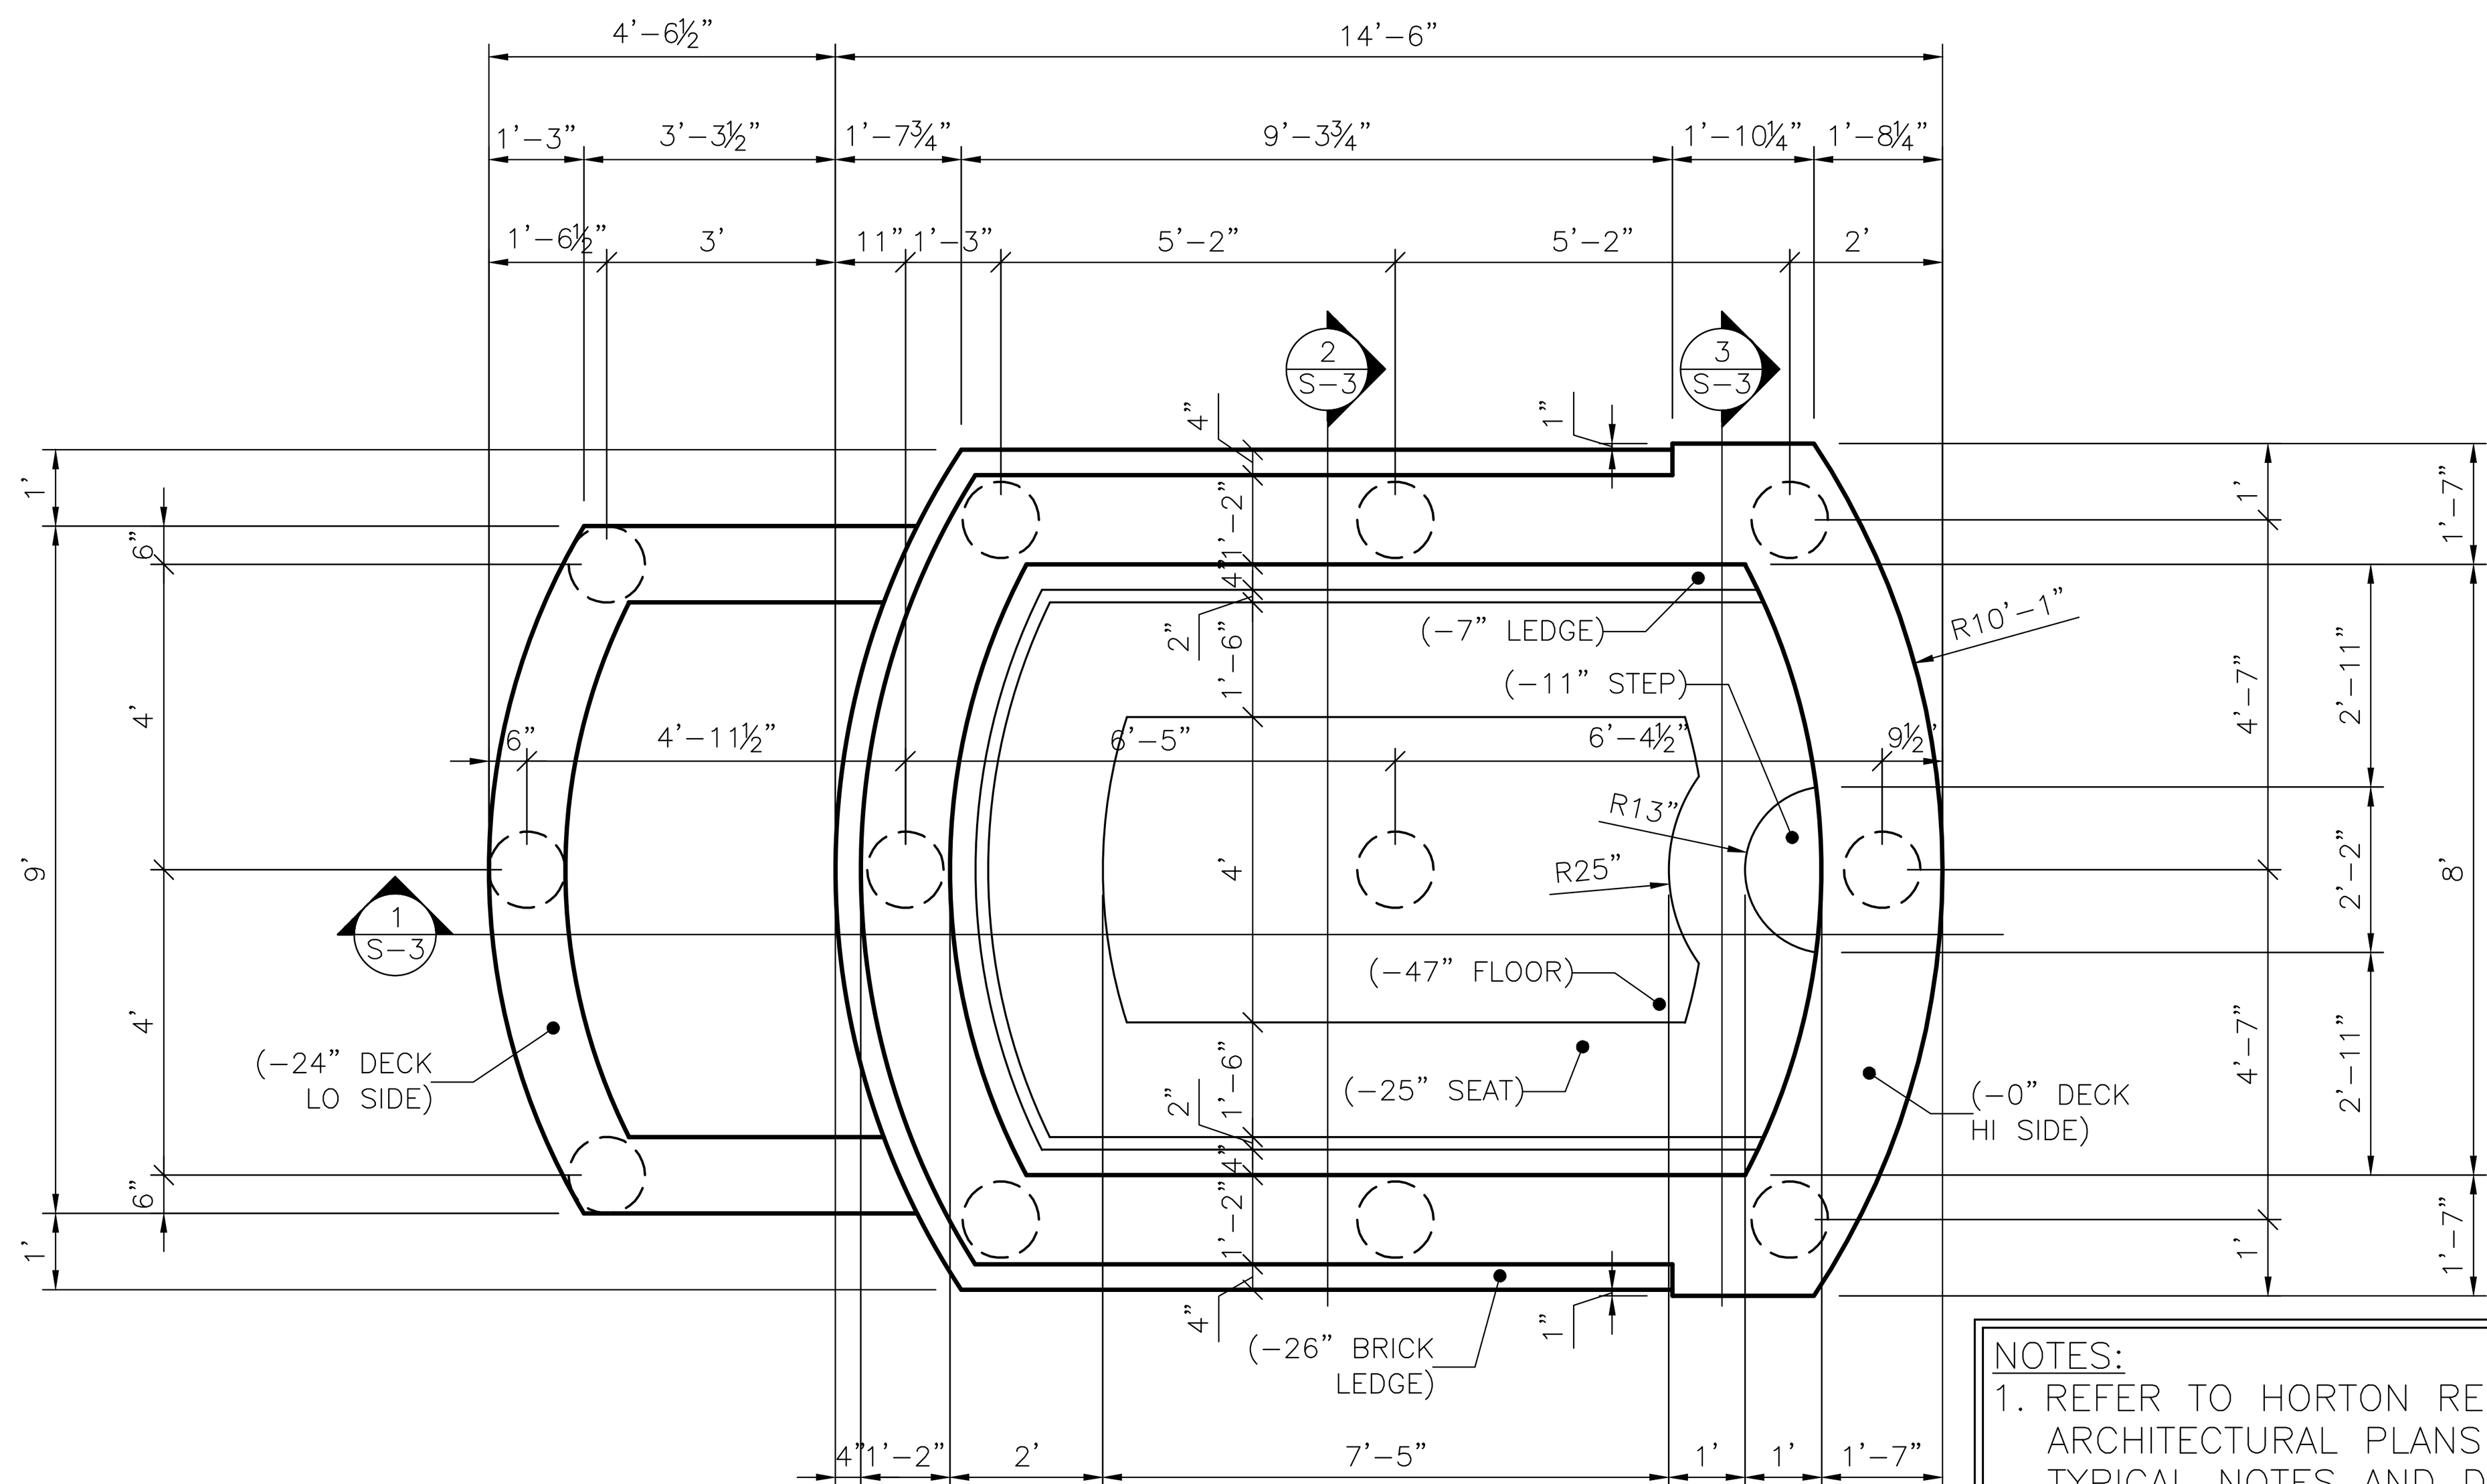

NOTES:
1. REFER TO HORTON RESIDENCE ARCHITECTURAL PLANS FOR TYPICAL NOTES AND DETAILS FOR FLATWORK, LIGHTING, AND WATER FEATURES.

STRUCTURAL LEGEND	
———	POOL SHELL EDGE
◯	12"ø CONCRETE PIER

NORTH

SPA/FOUNTAIN LAYOUT PLAN
SCALE: 3/8" = 1'-0"

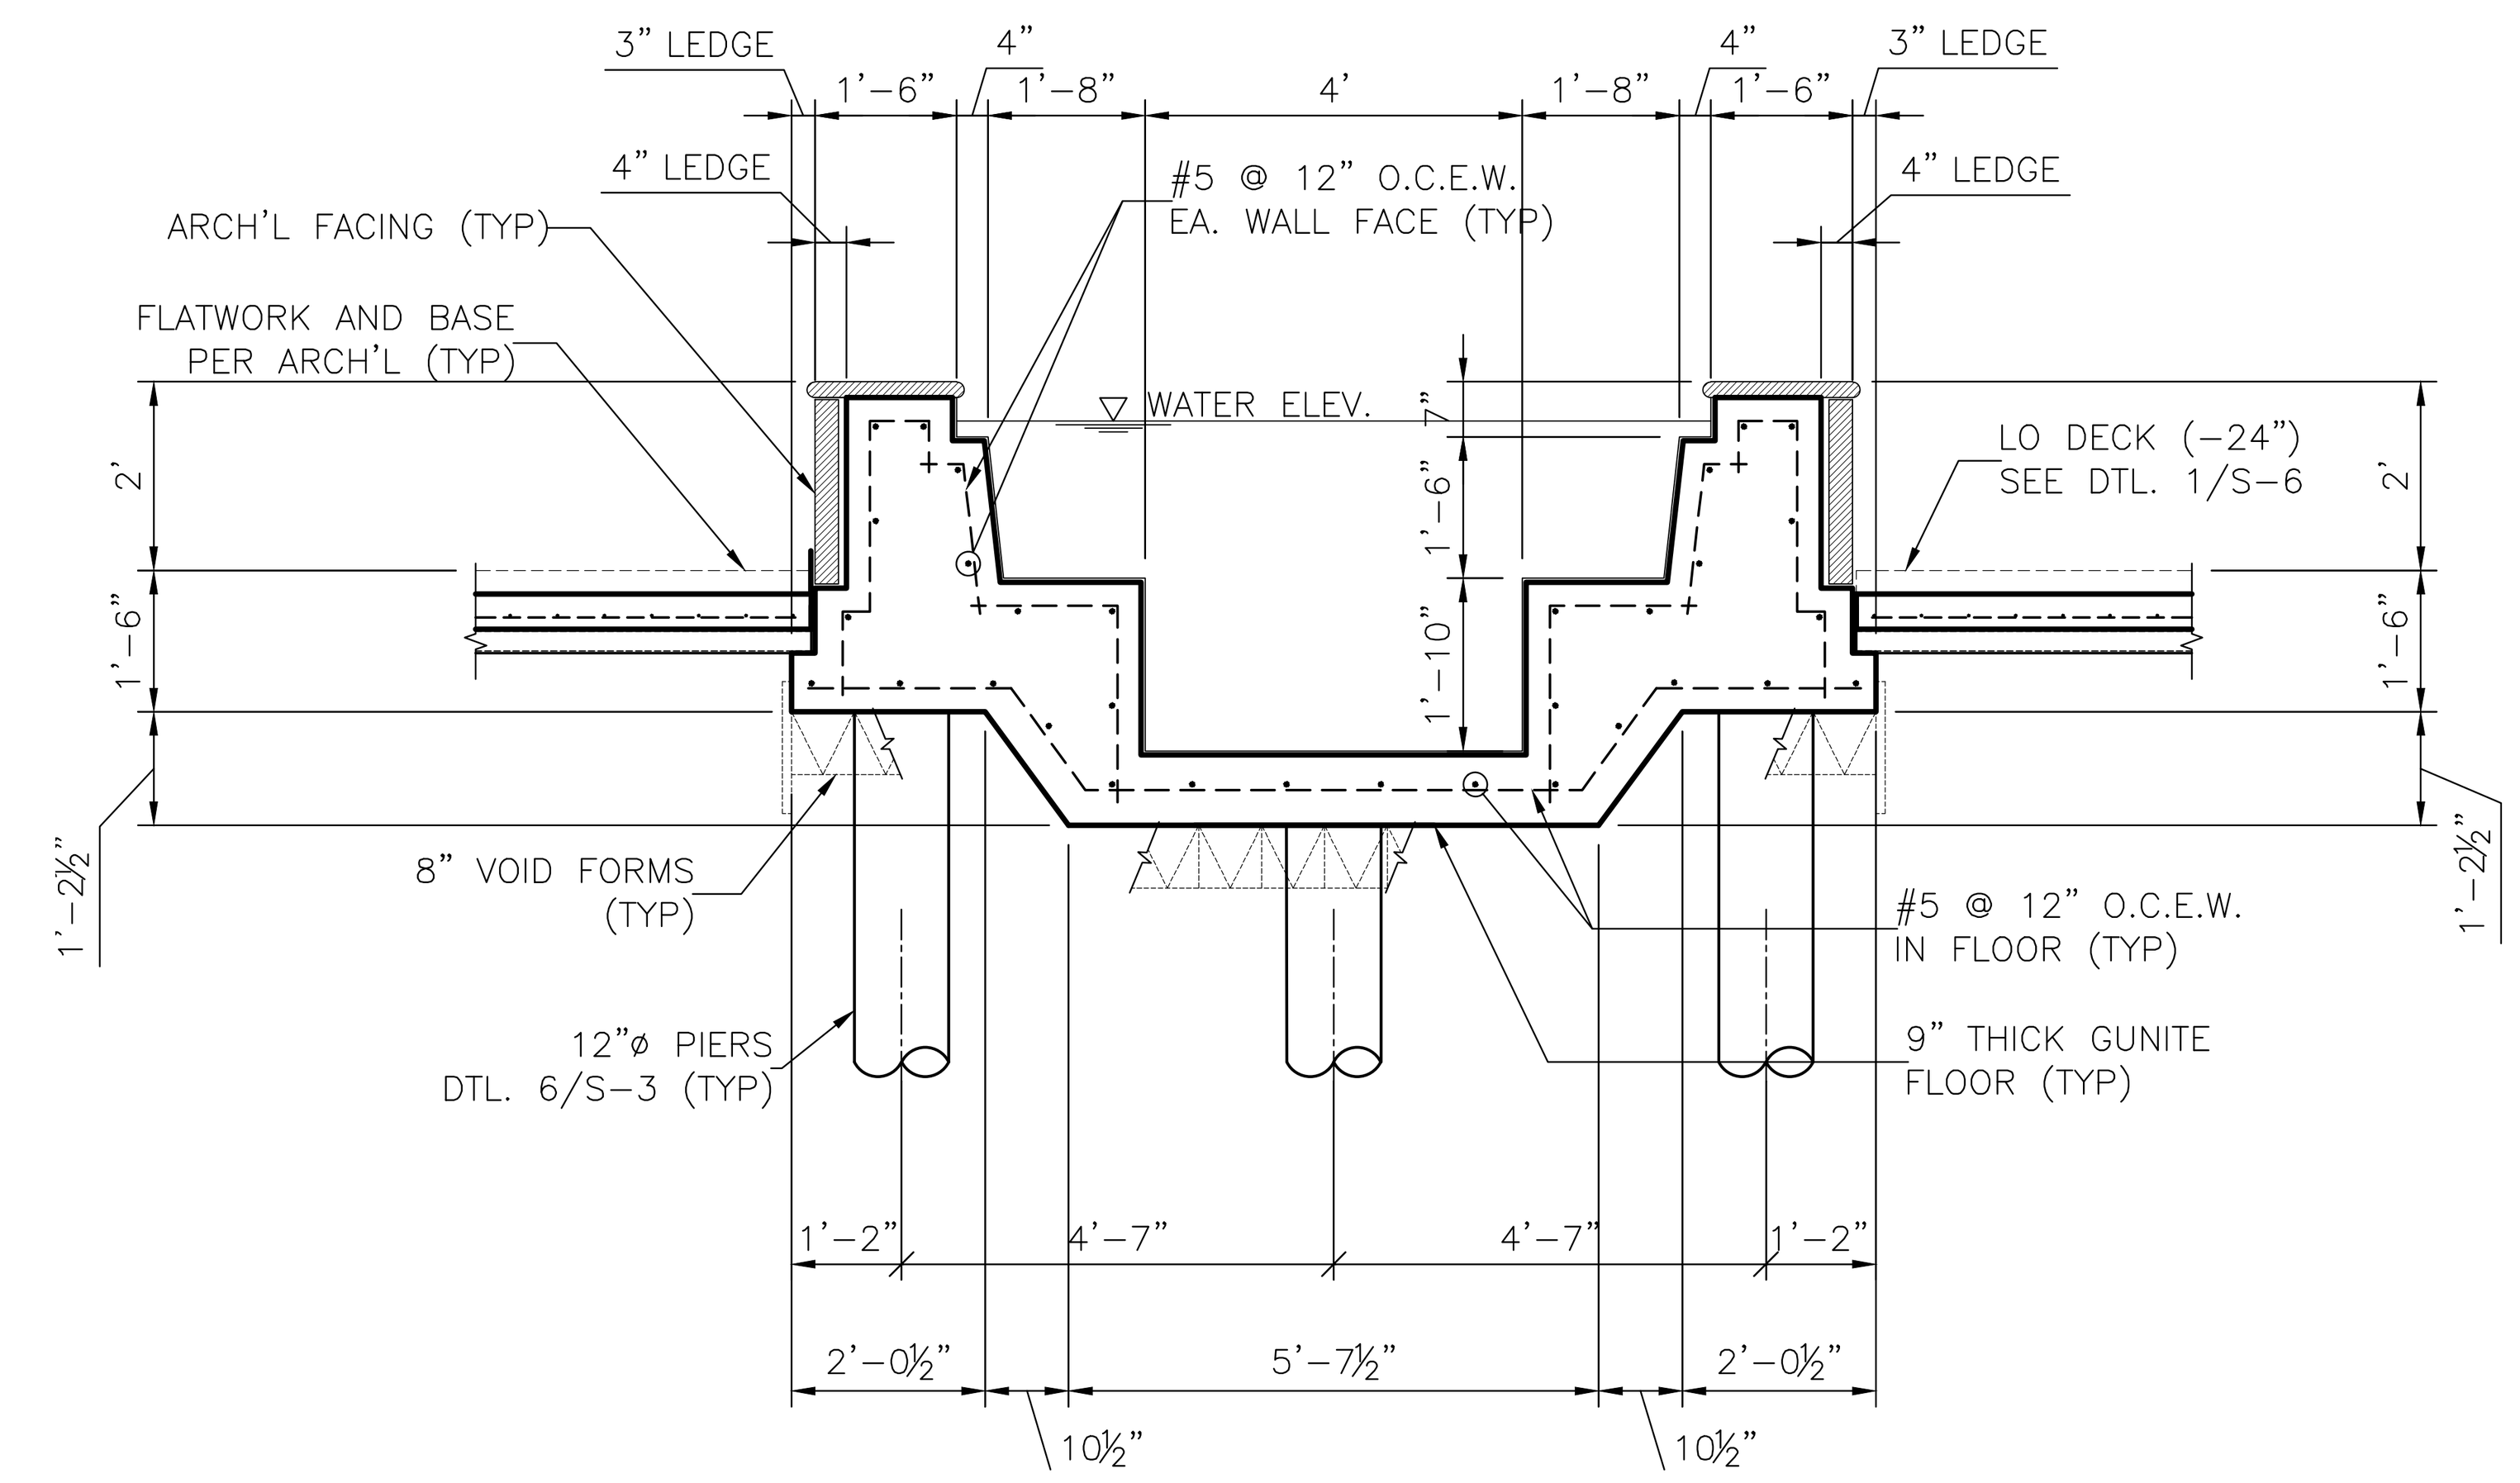

2 SPA TRANSVERSE SECTION–LO
SCALE: 3/8" = 1'-0"

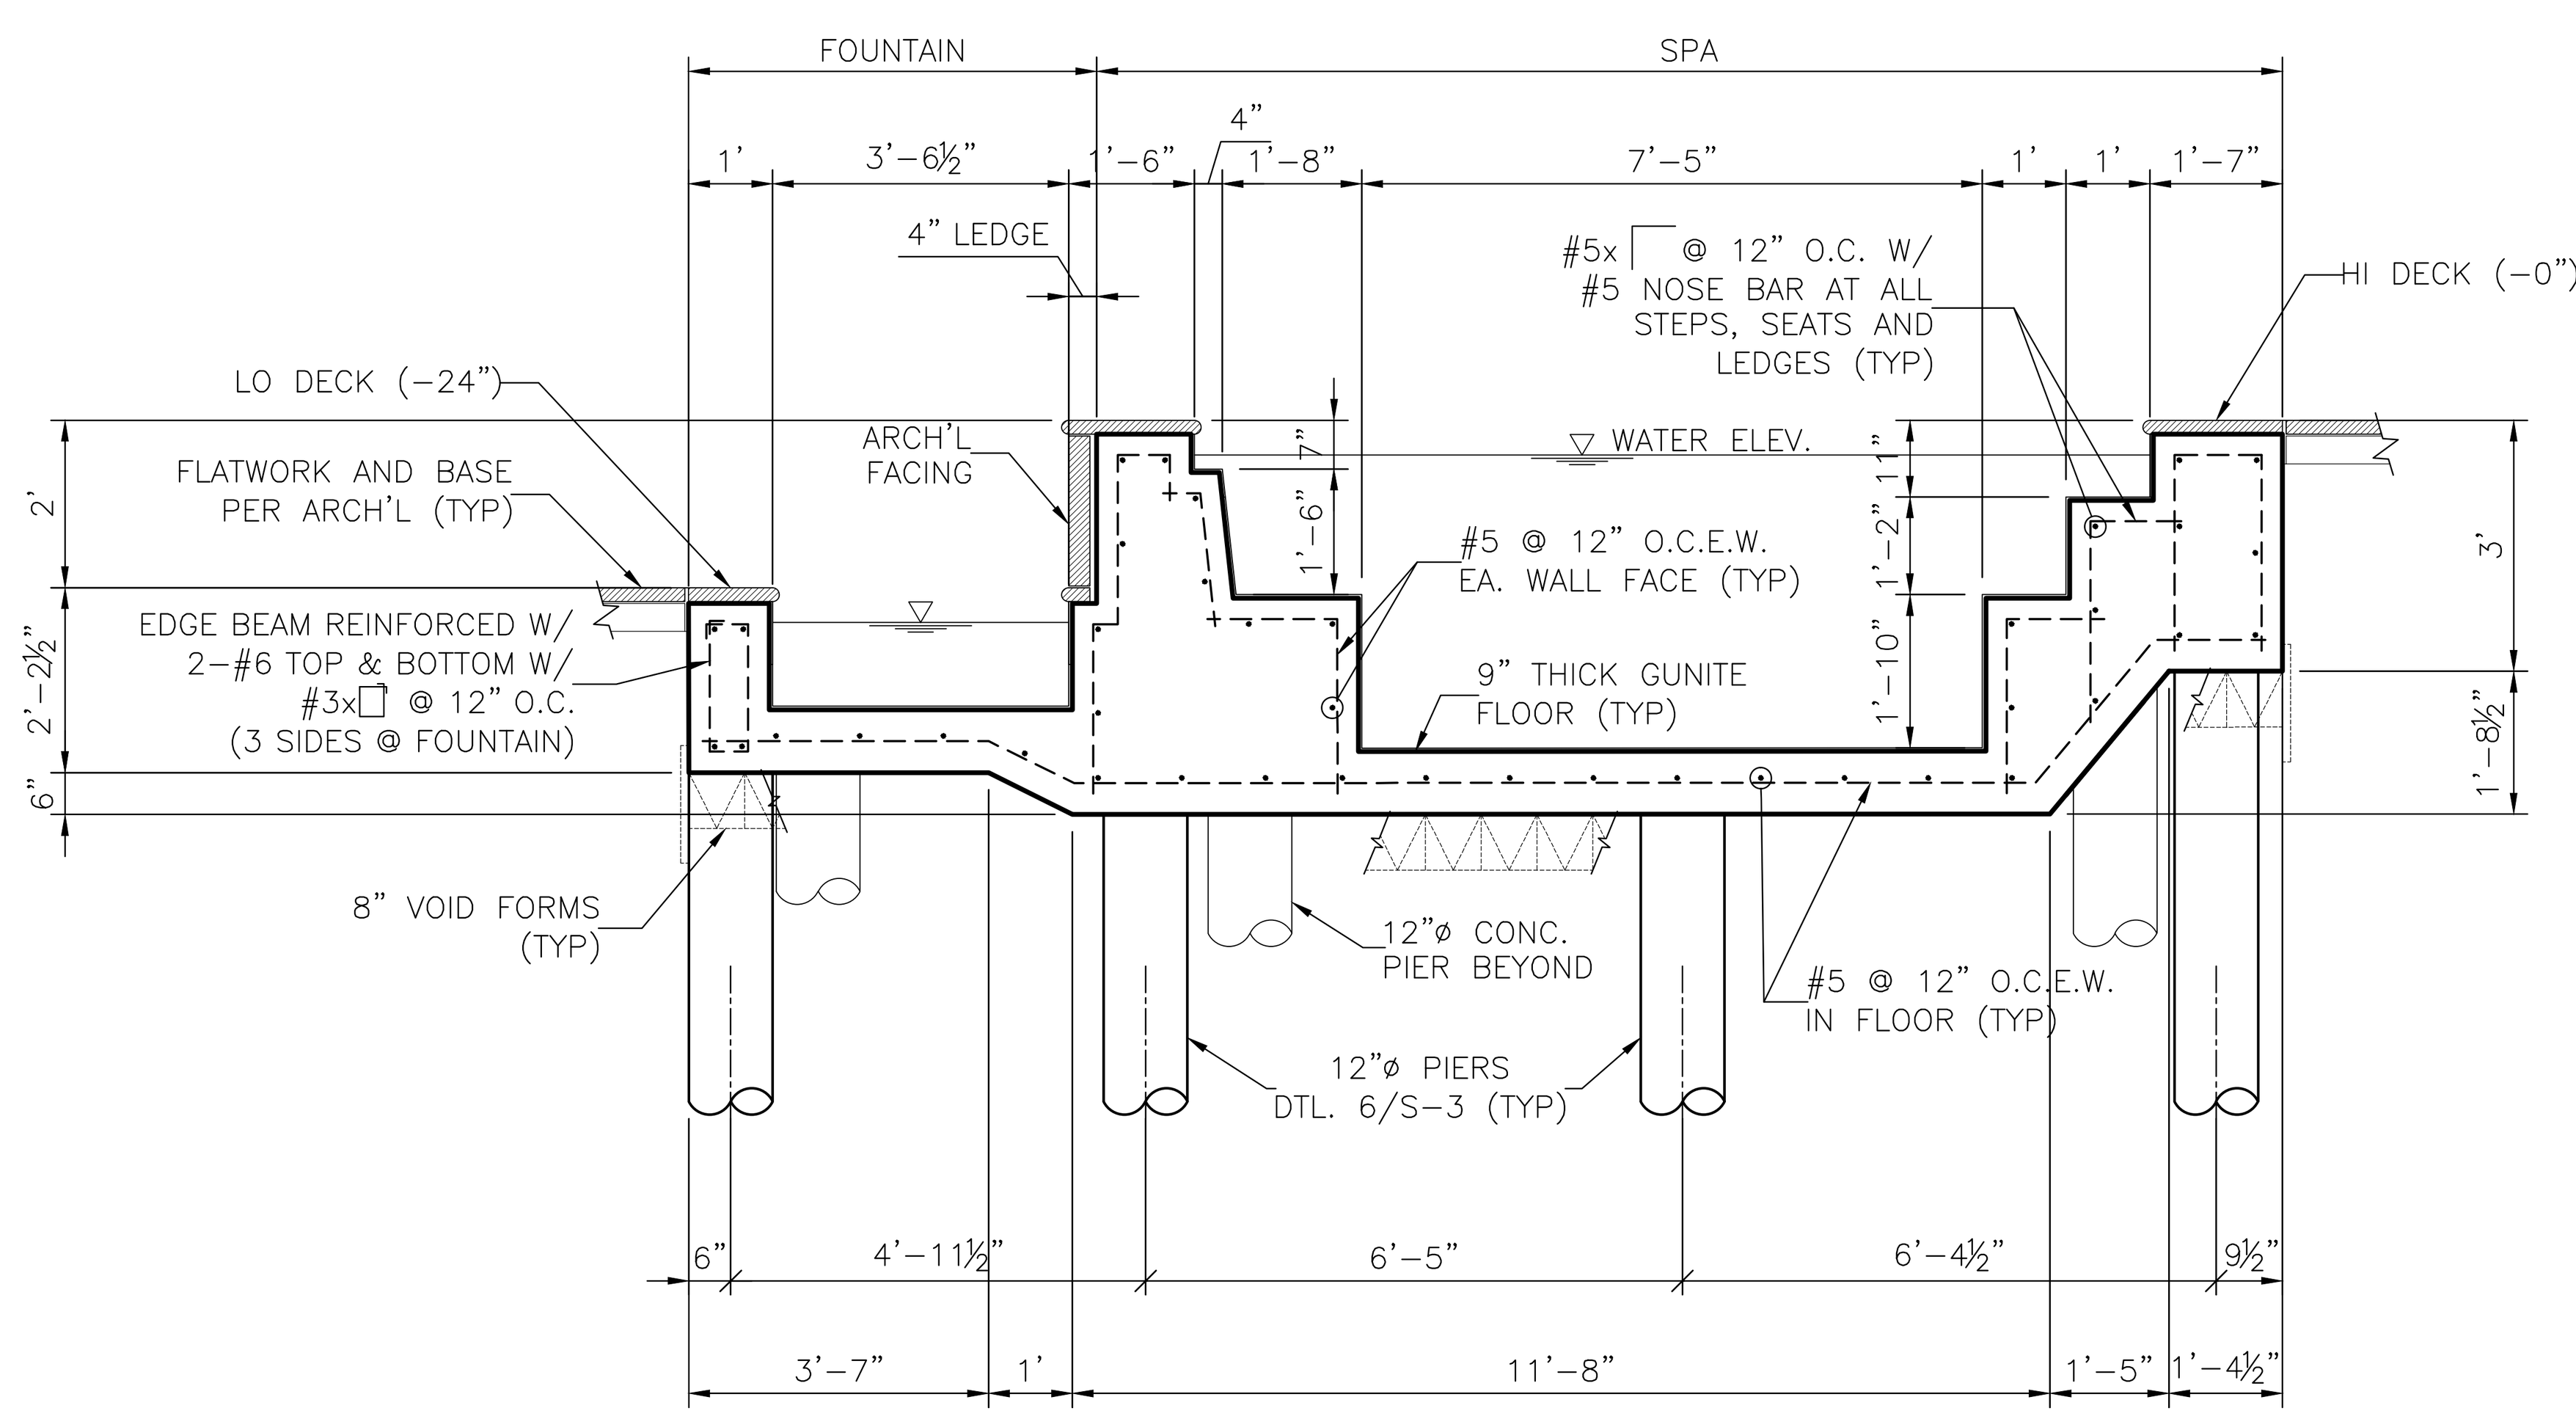

1 SPA LONGITUDINAL SECTION
SCALE: 3/8" = 1'-0"

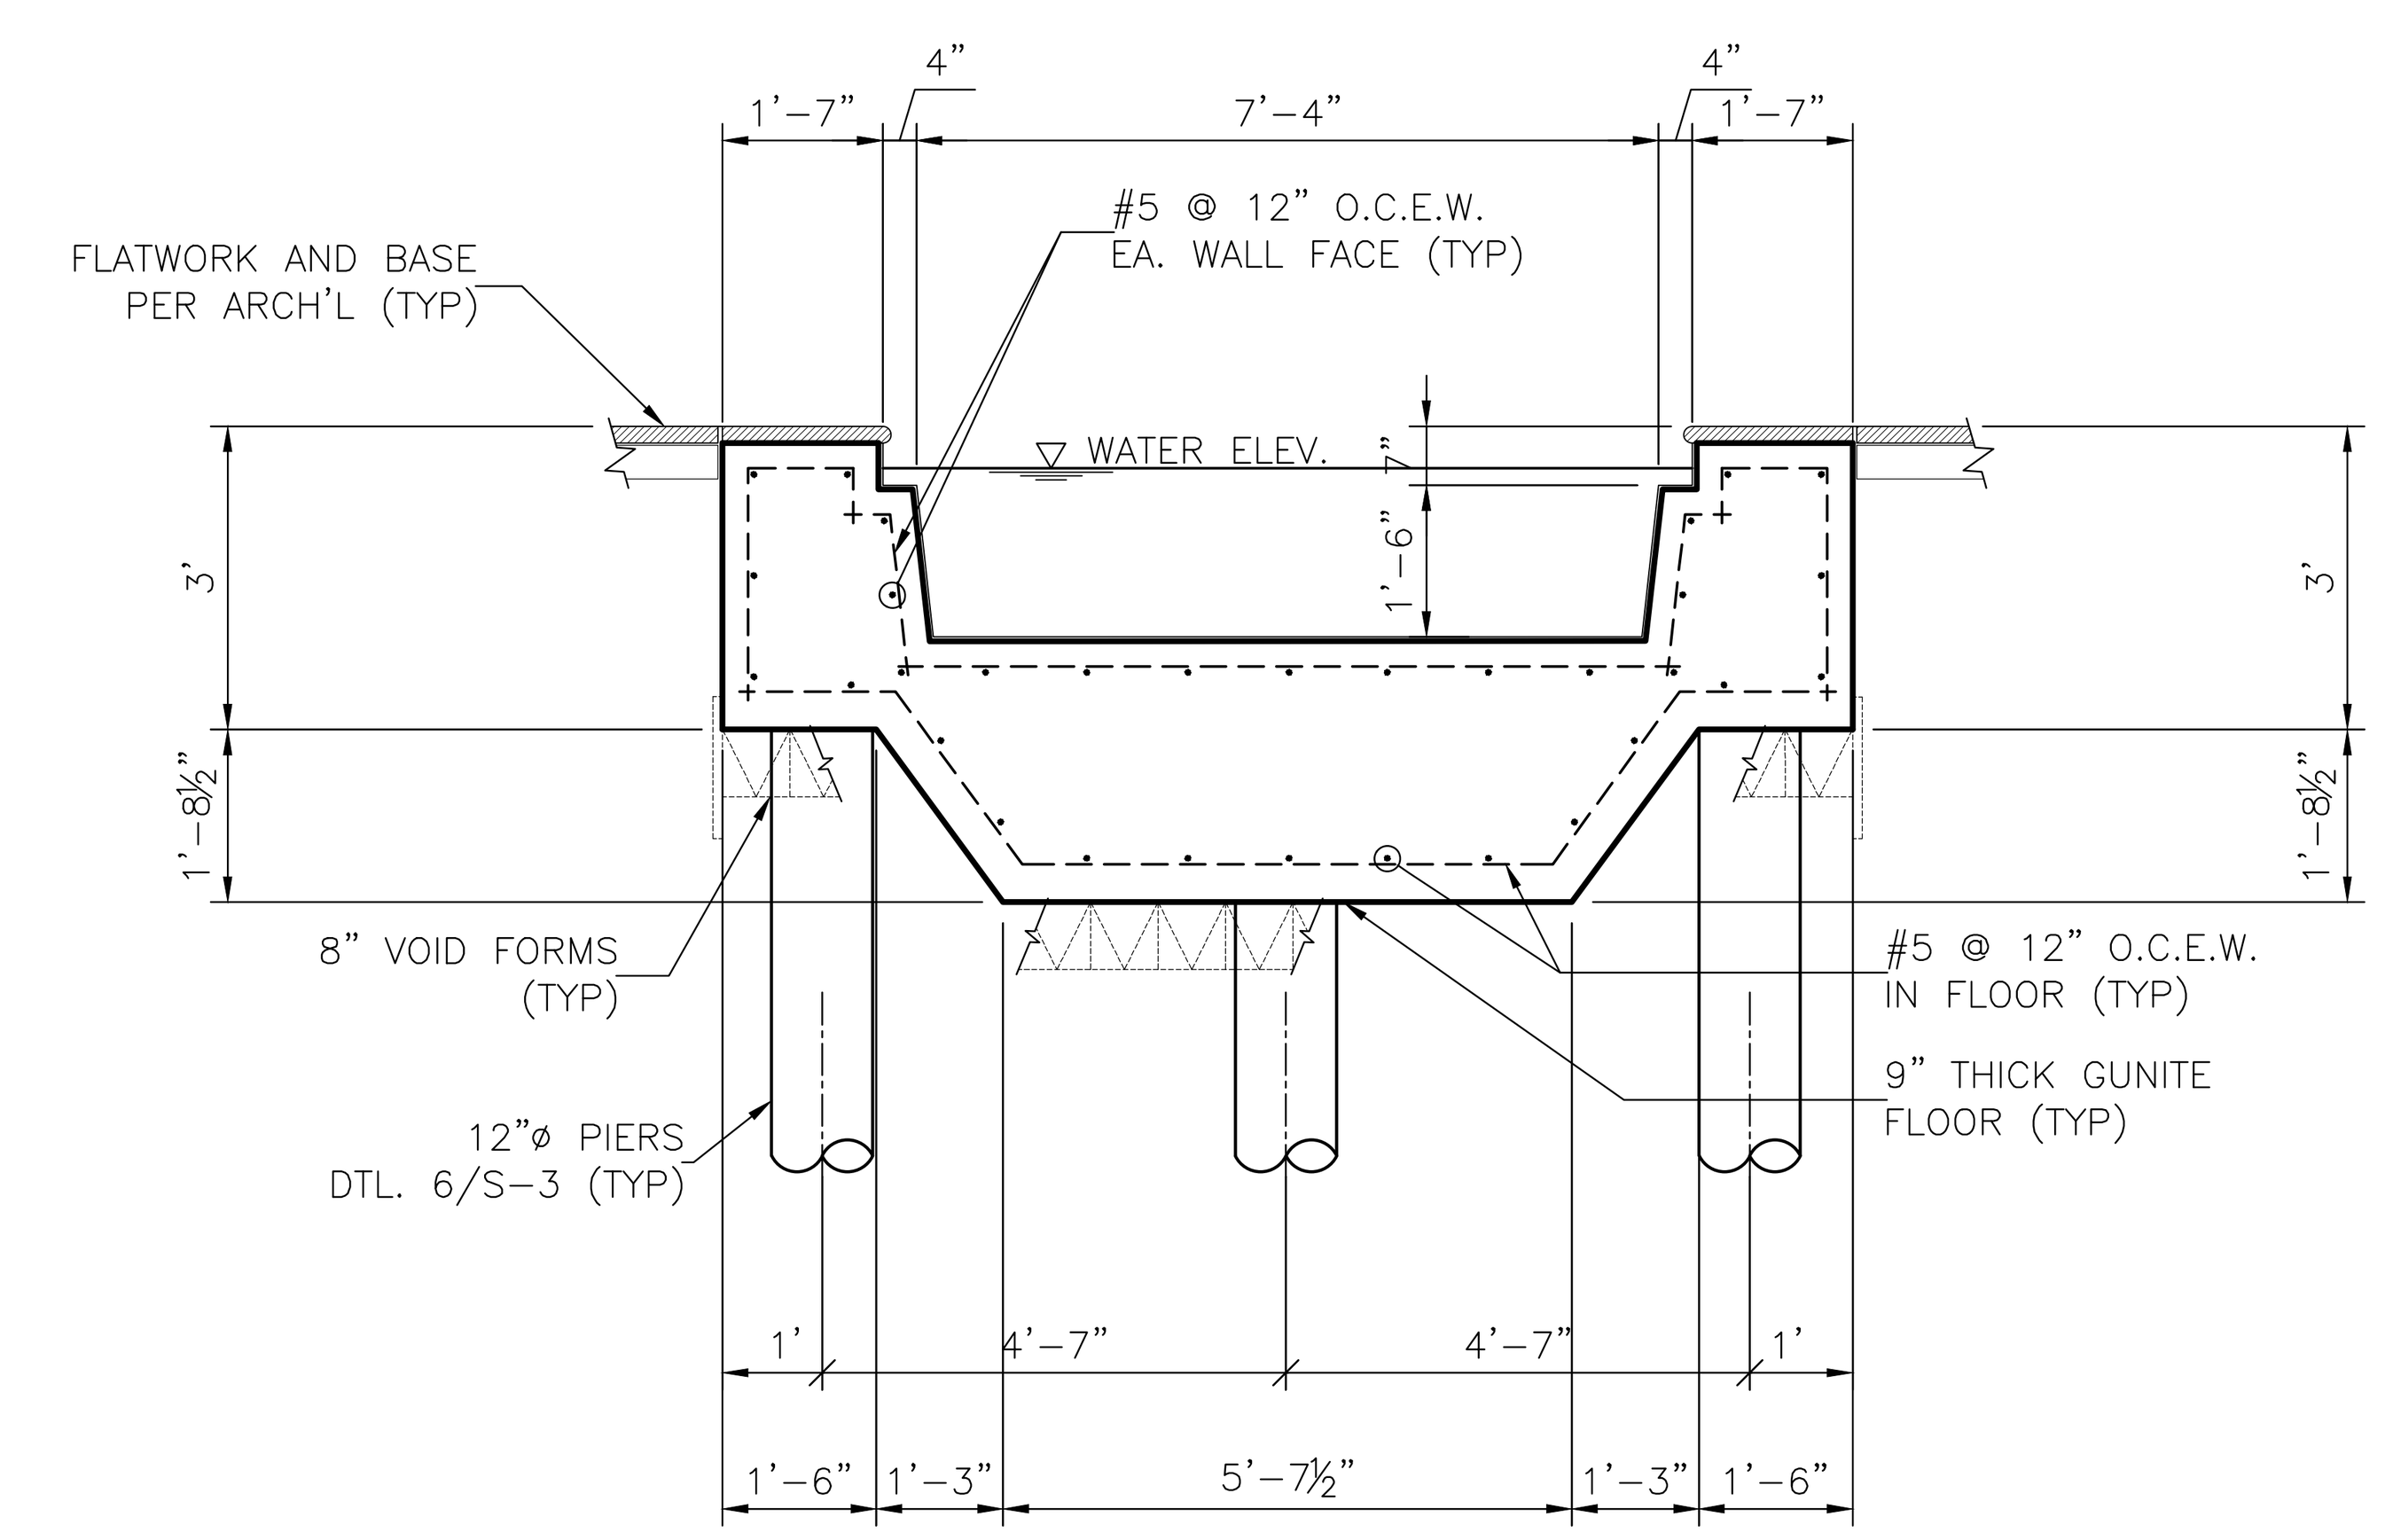

3 SPA TRANSVERSE SECTION–HI
SCALE: 3/8" = 1'-0"

Contact Us

214-717-8407
ira@iracad.com

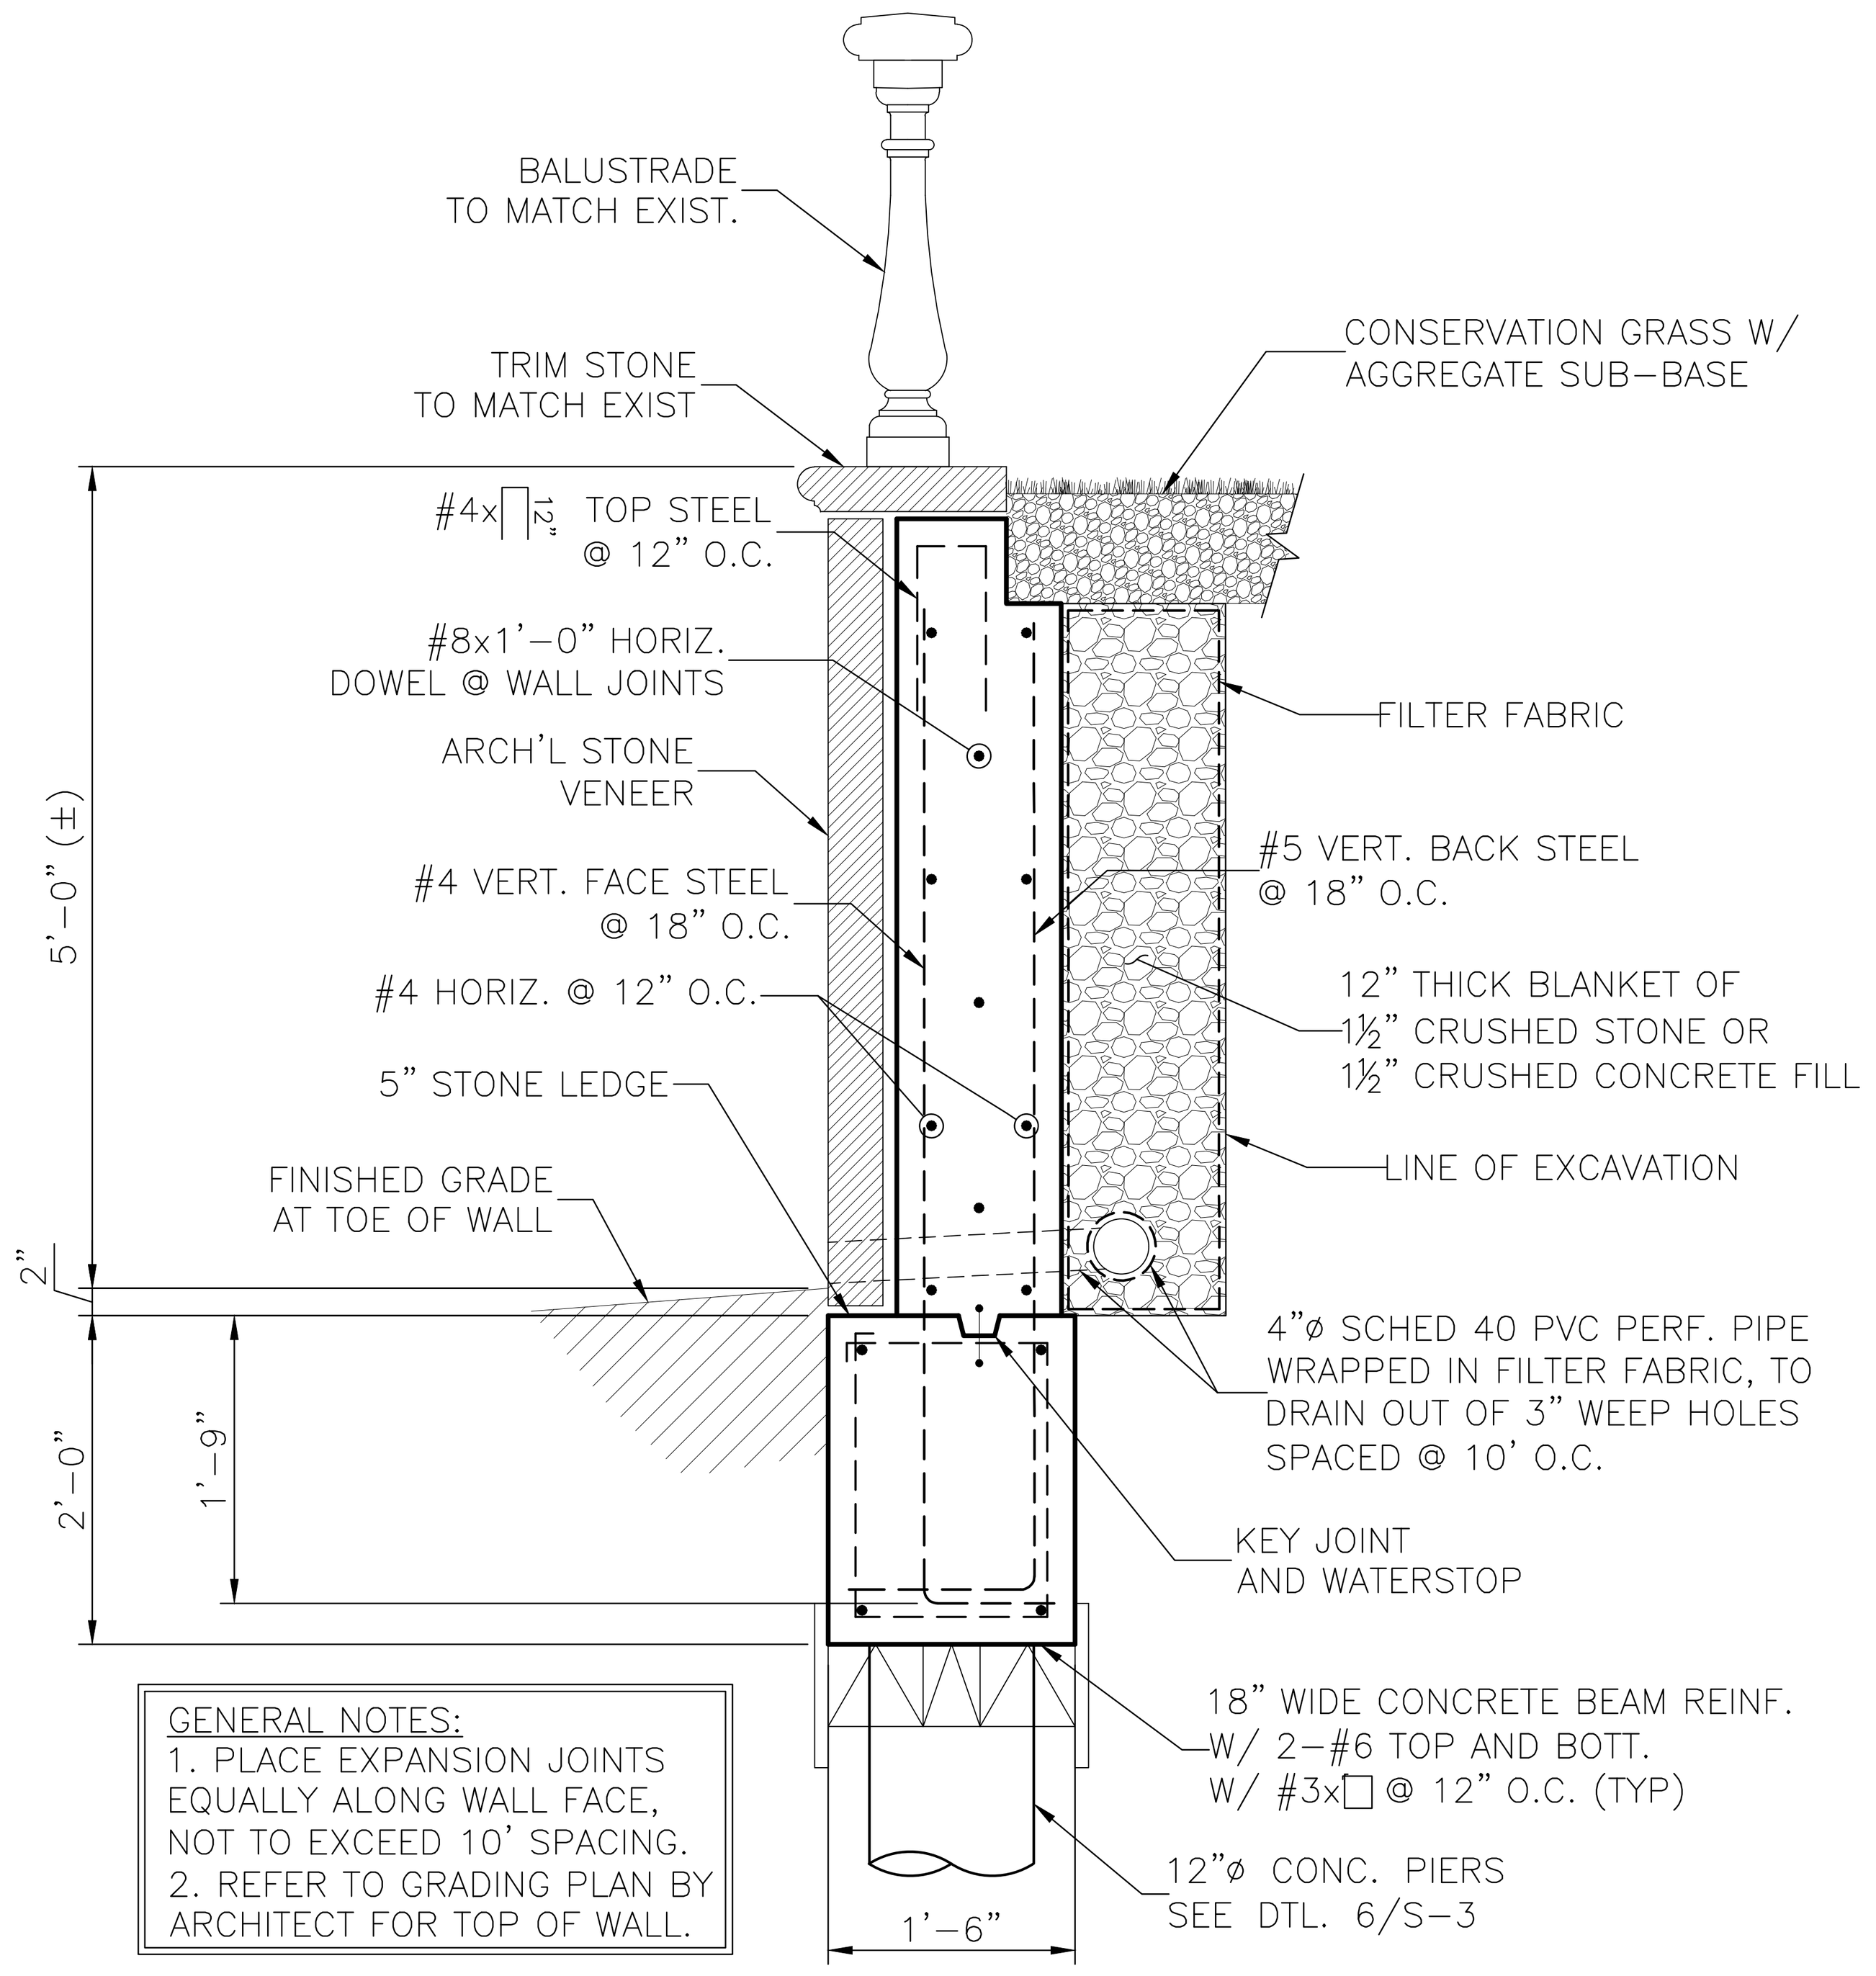

1 RETAINING WALL DETAIL
SCALE: 3/4" = 1'-0"

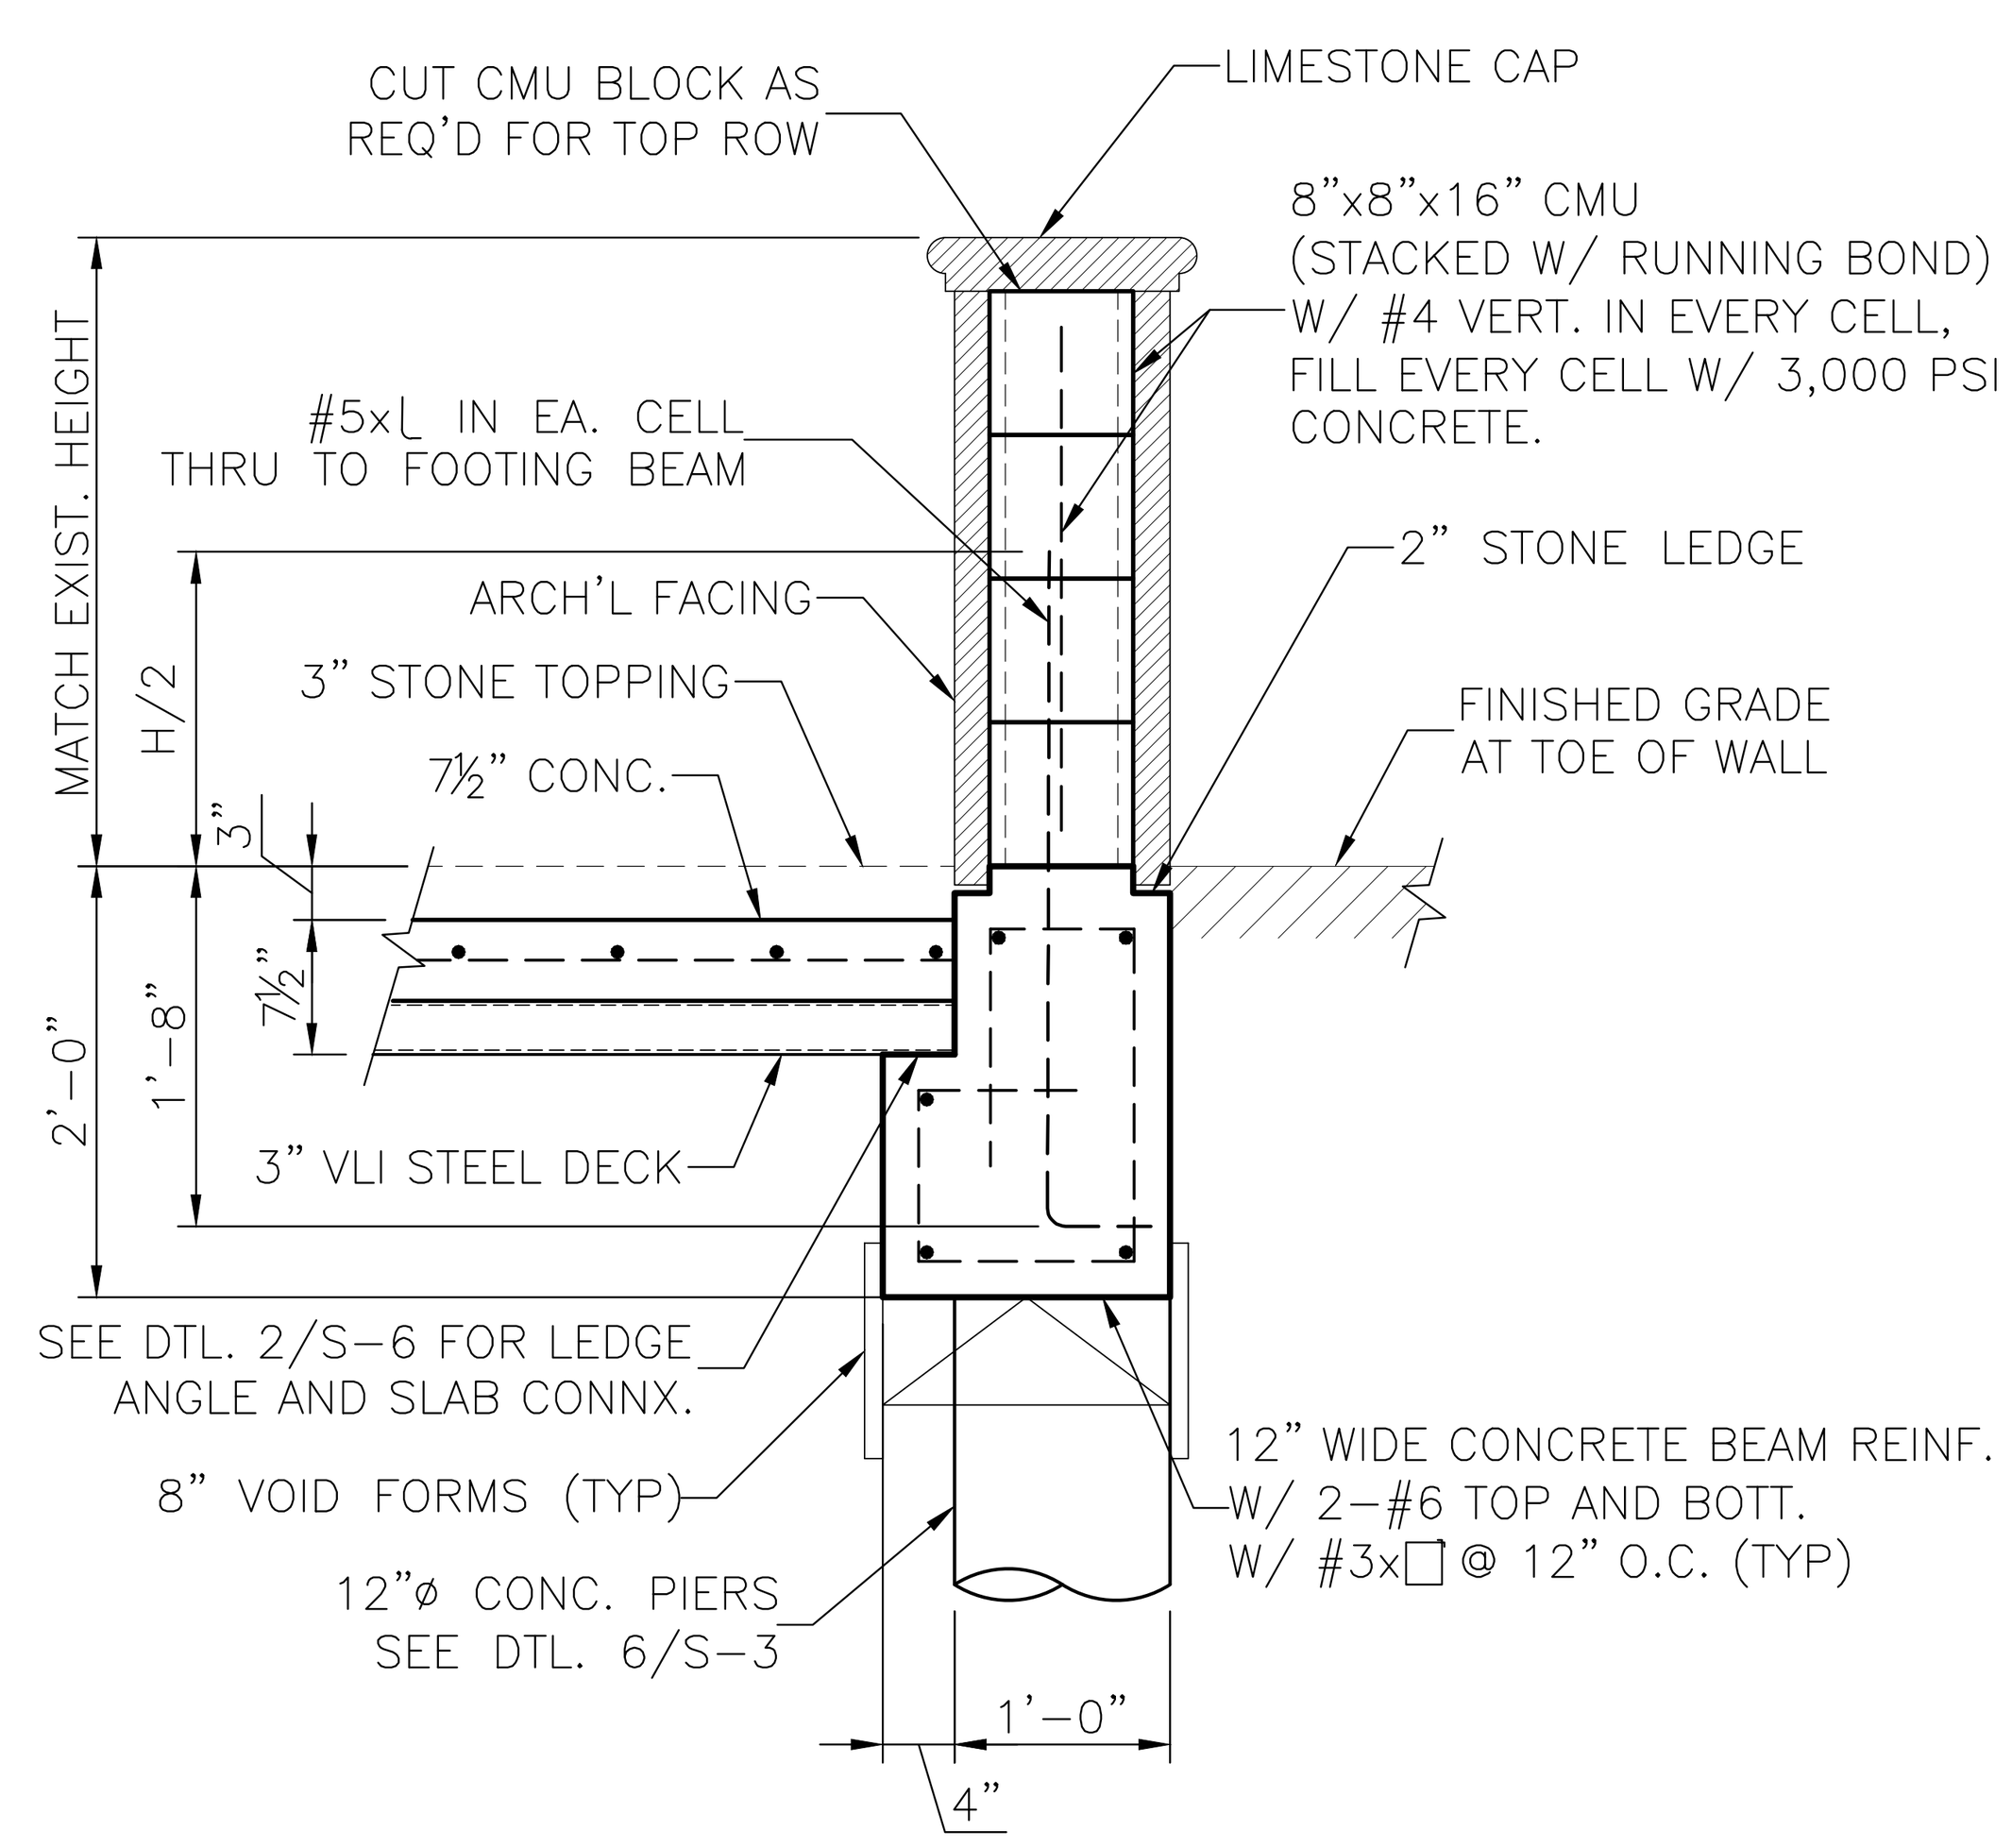

2 TYP. POOL WALL/DECK DTL.
SCALE: 3/4" = 1'-0"

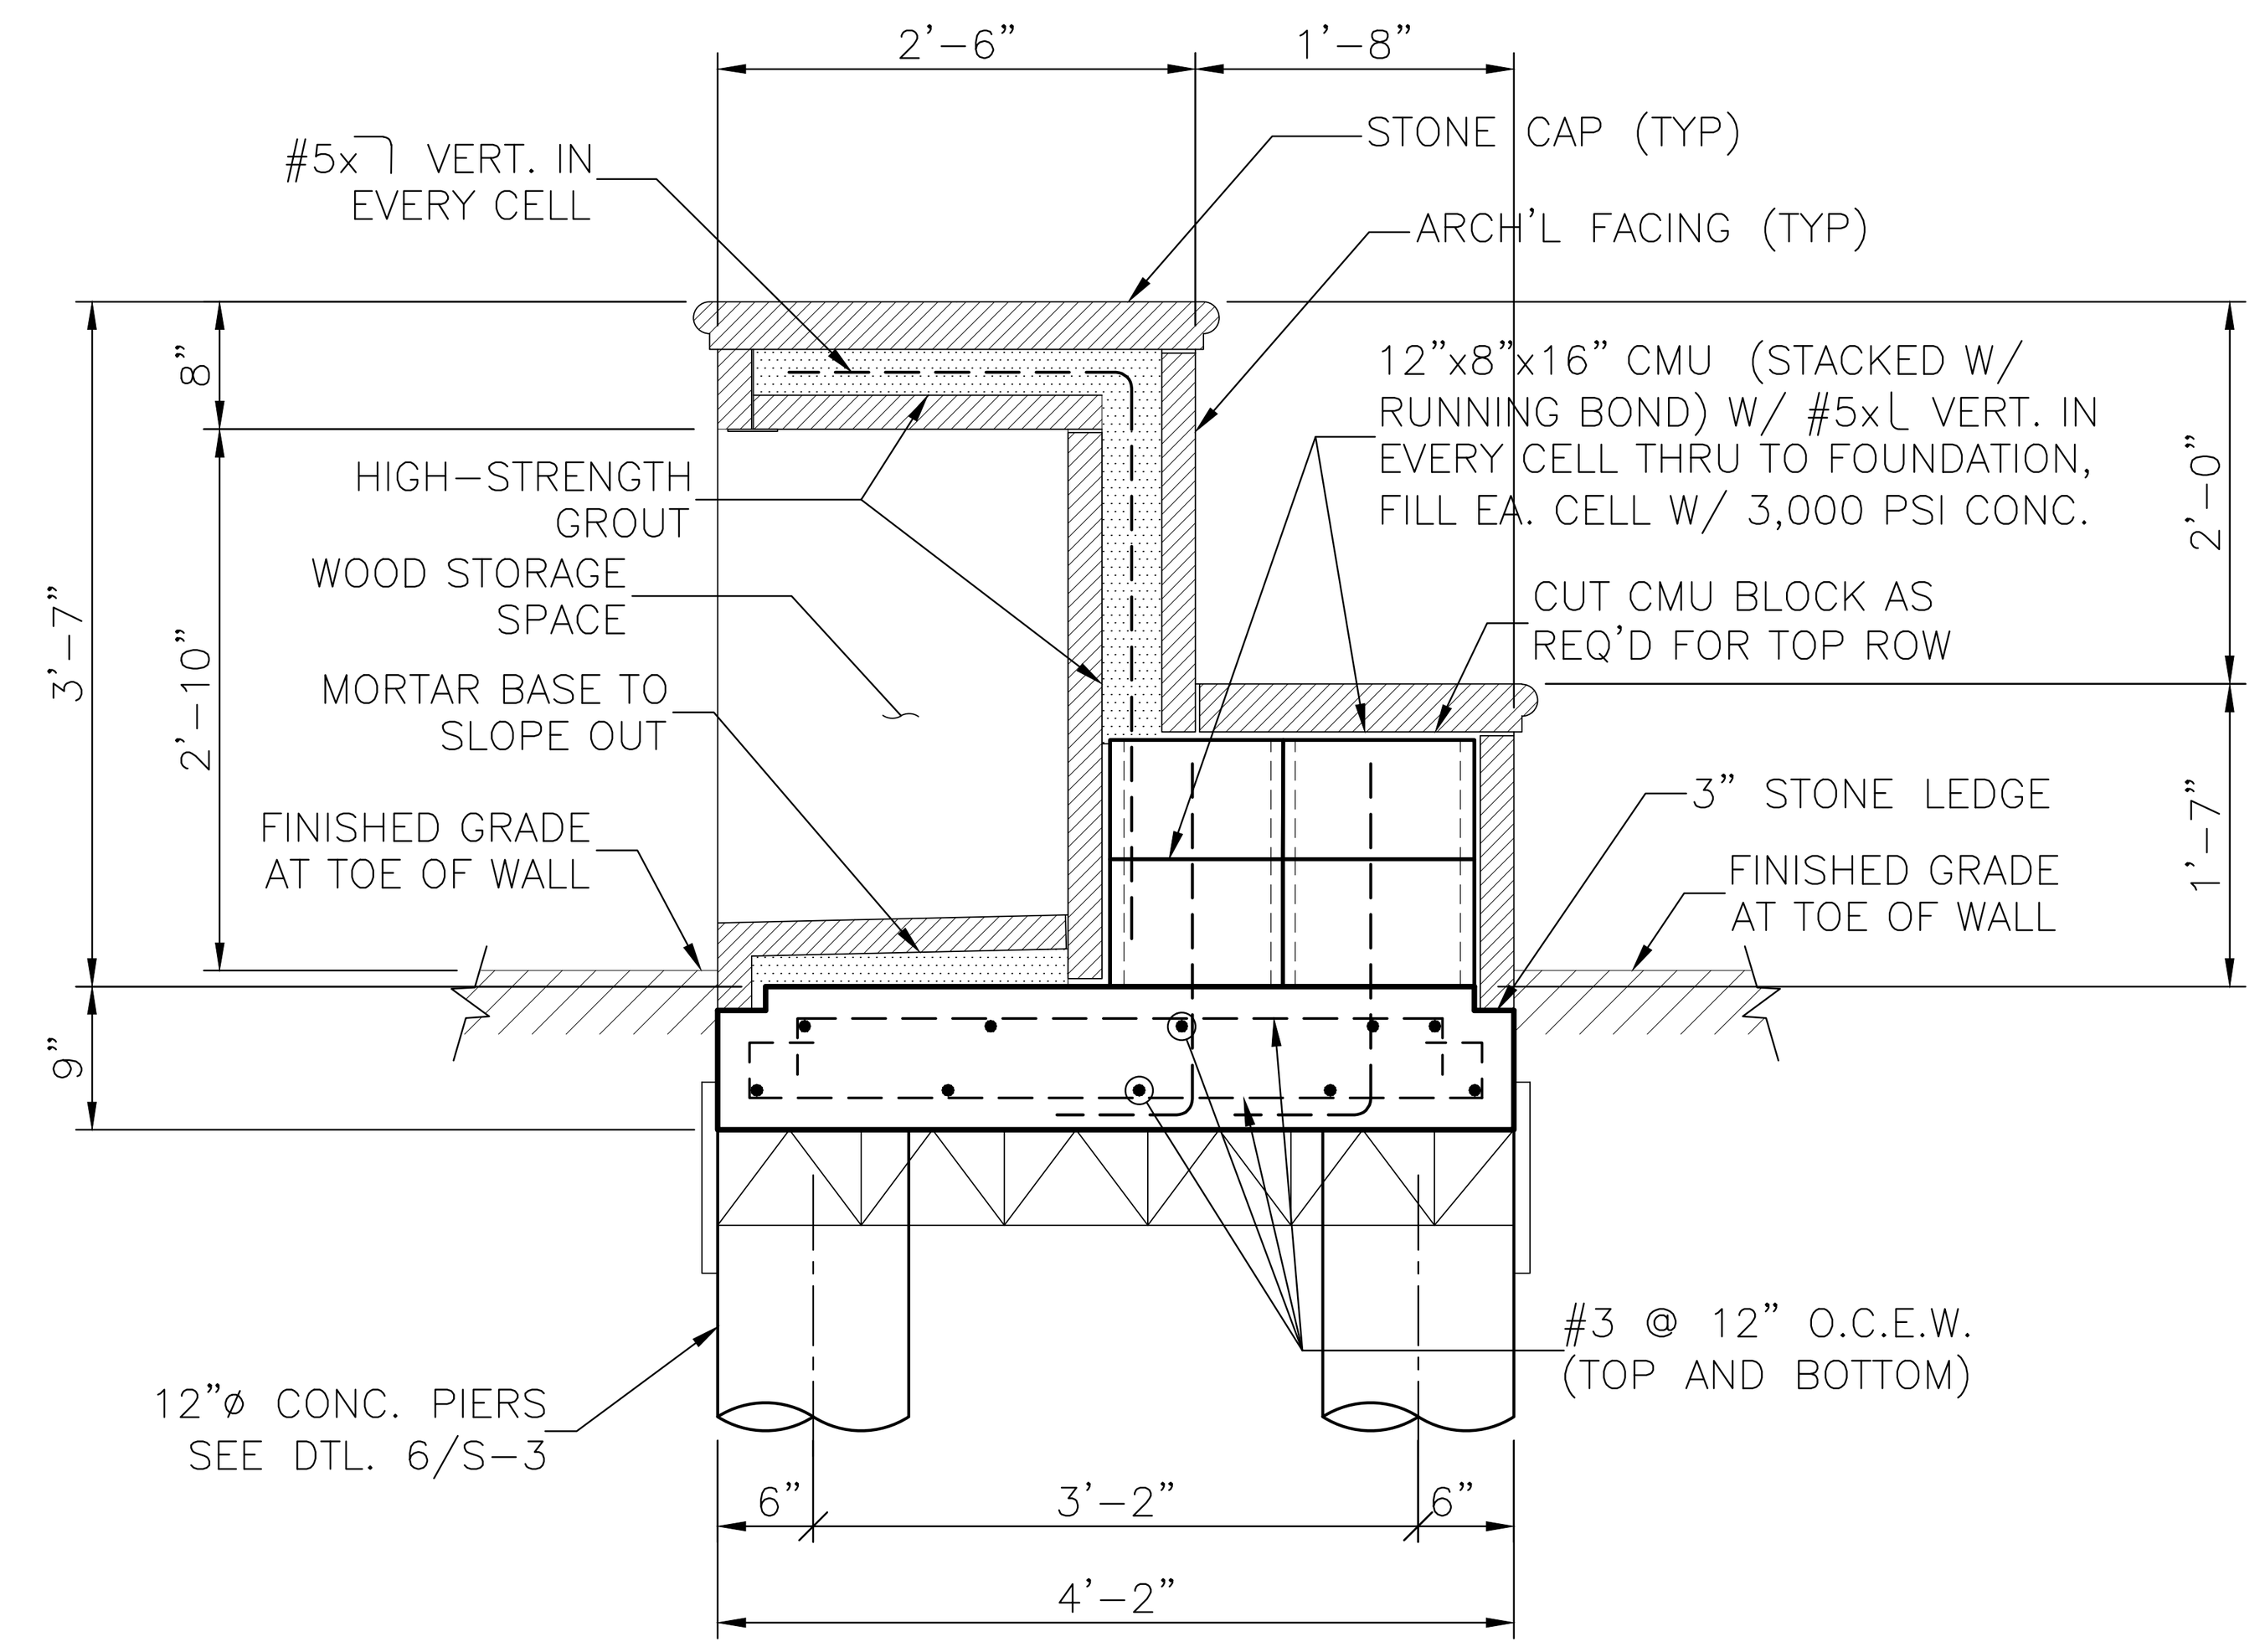

3 WOOD STORAGE SEAT DTL.
SCALE: 3/4" = 1'-0"

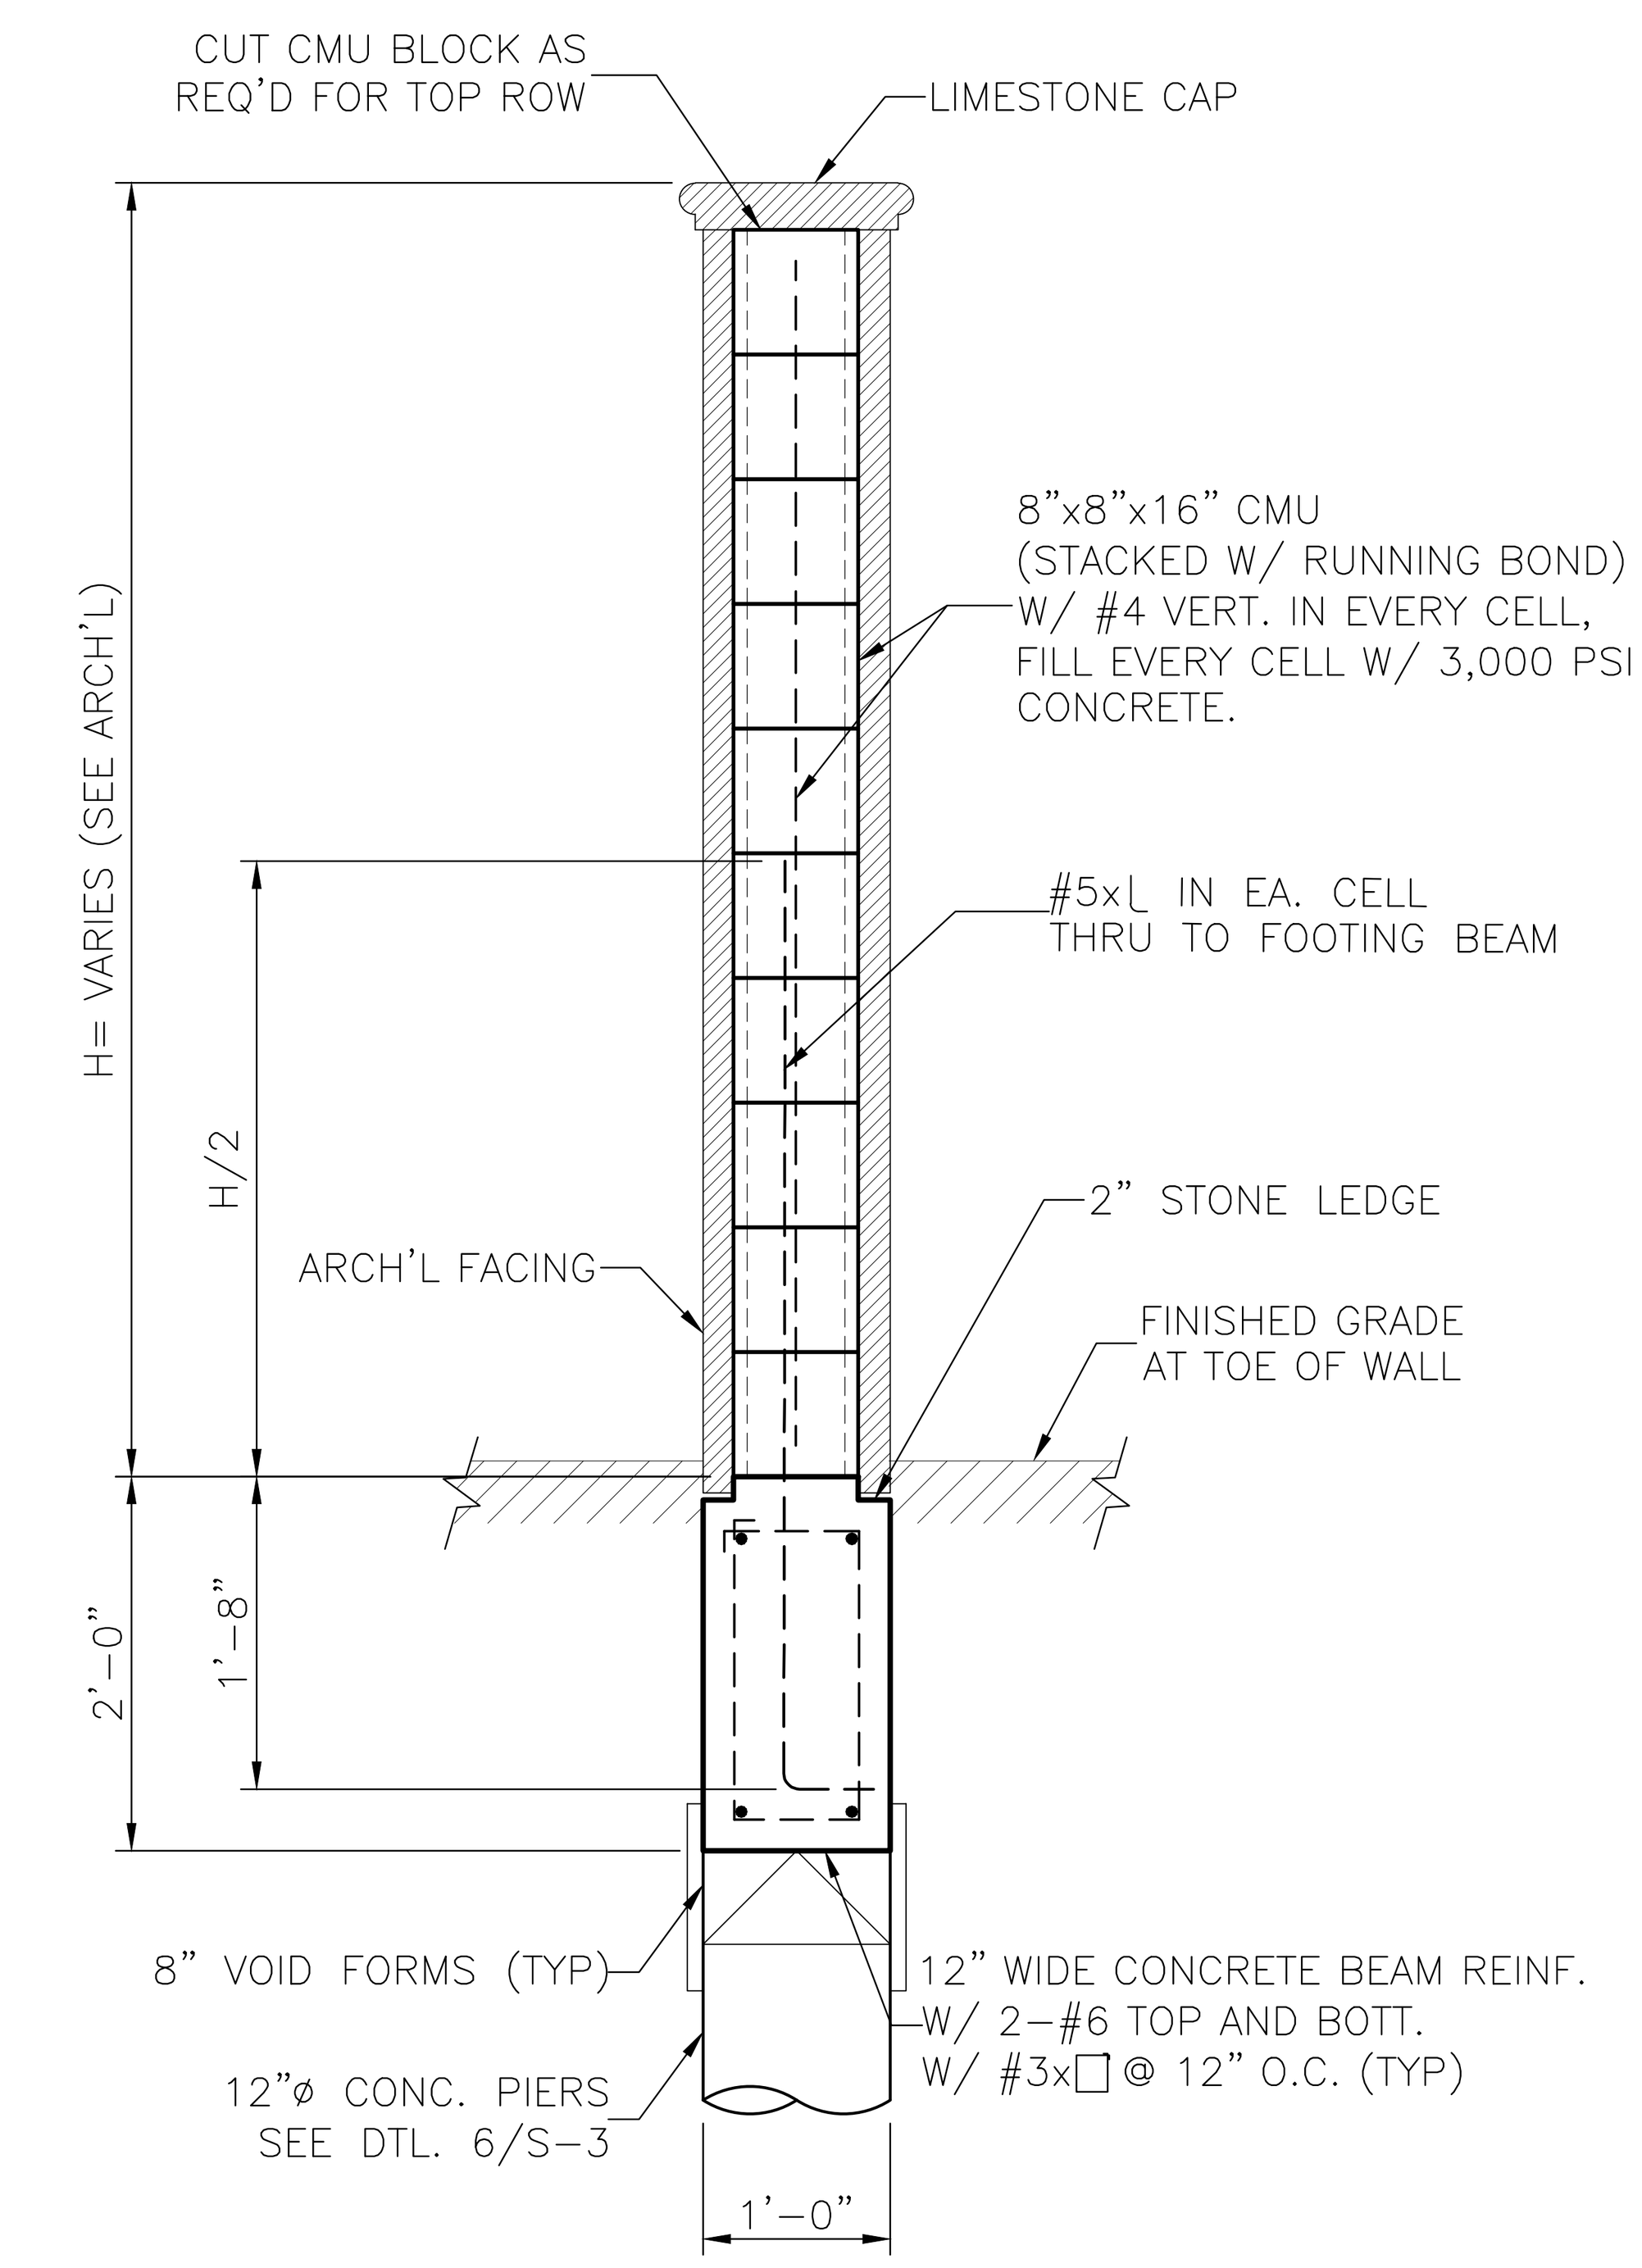

4 ENTRY GATE WALL DTL.
SCALE: 3/4" = 1'-0"

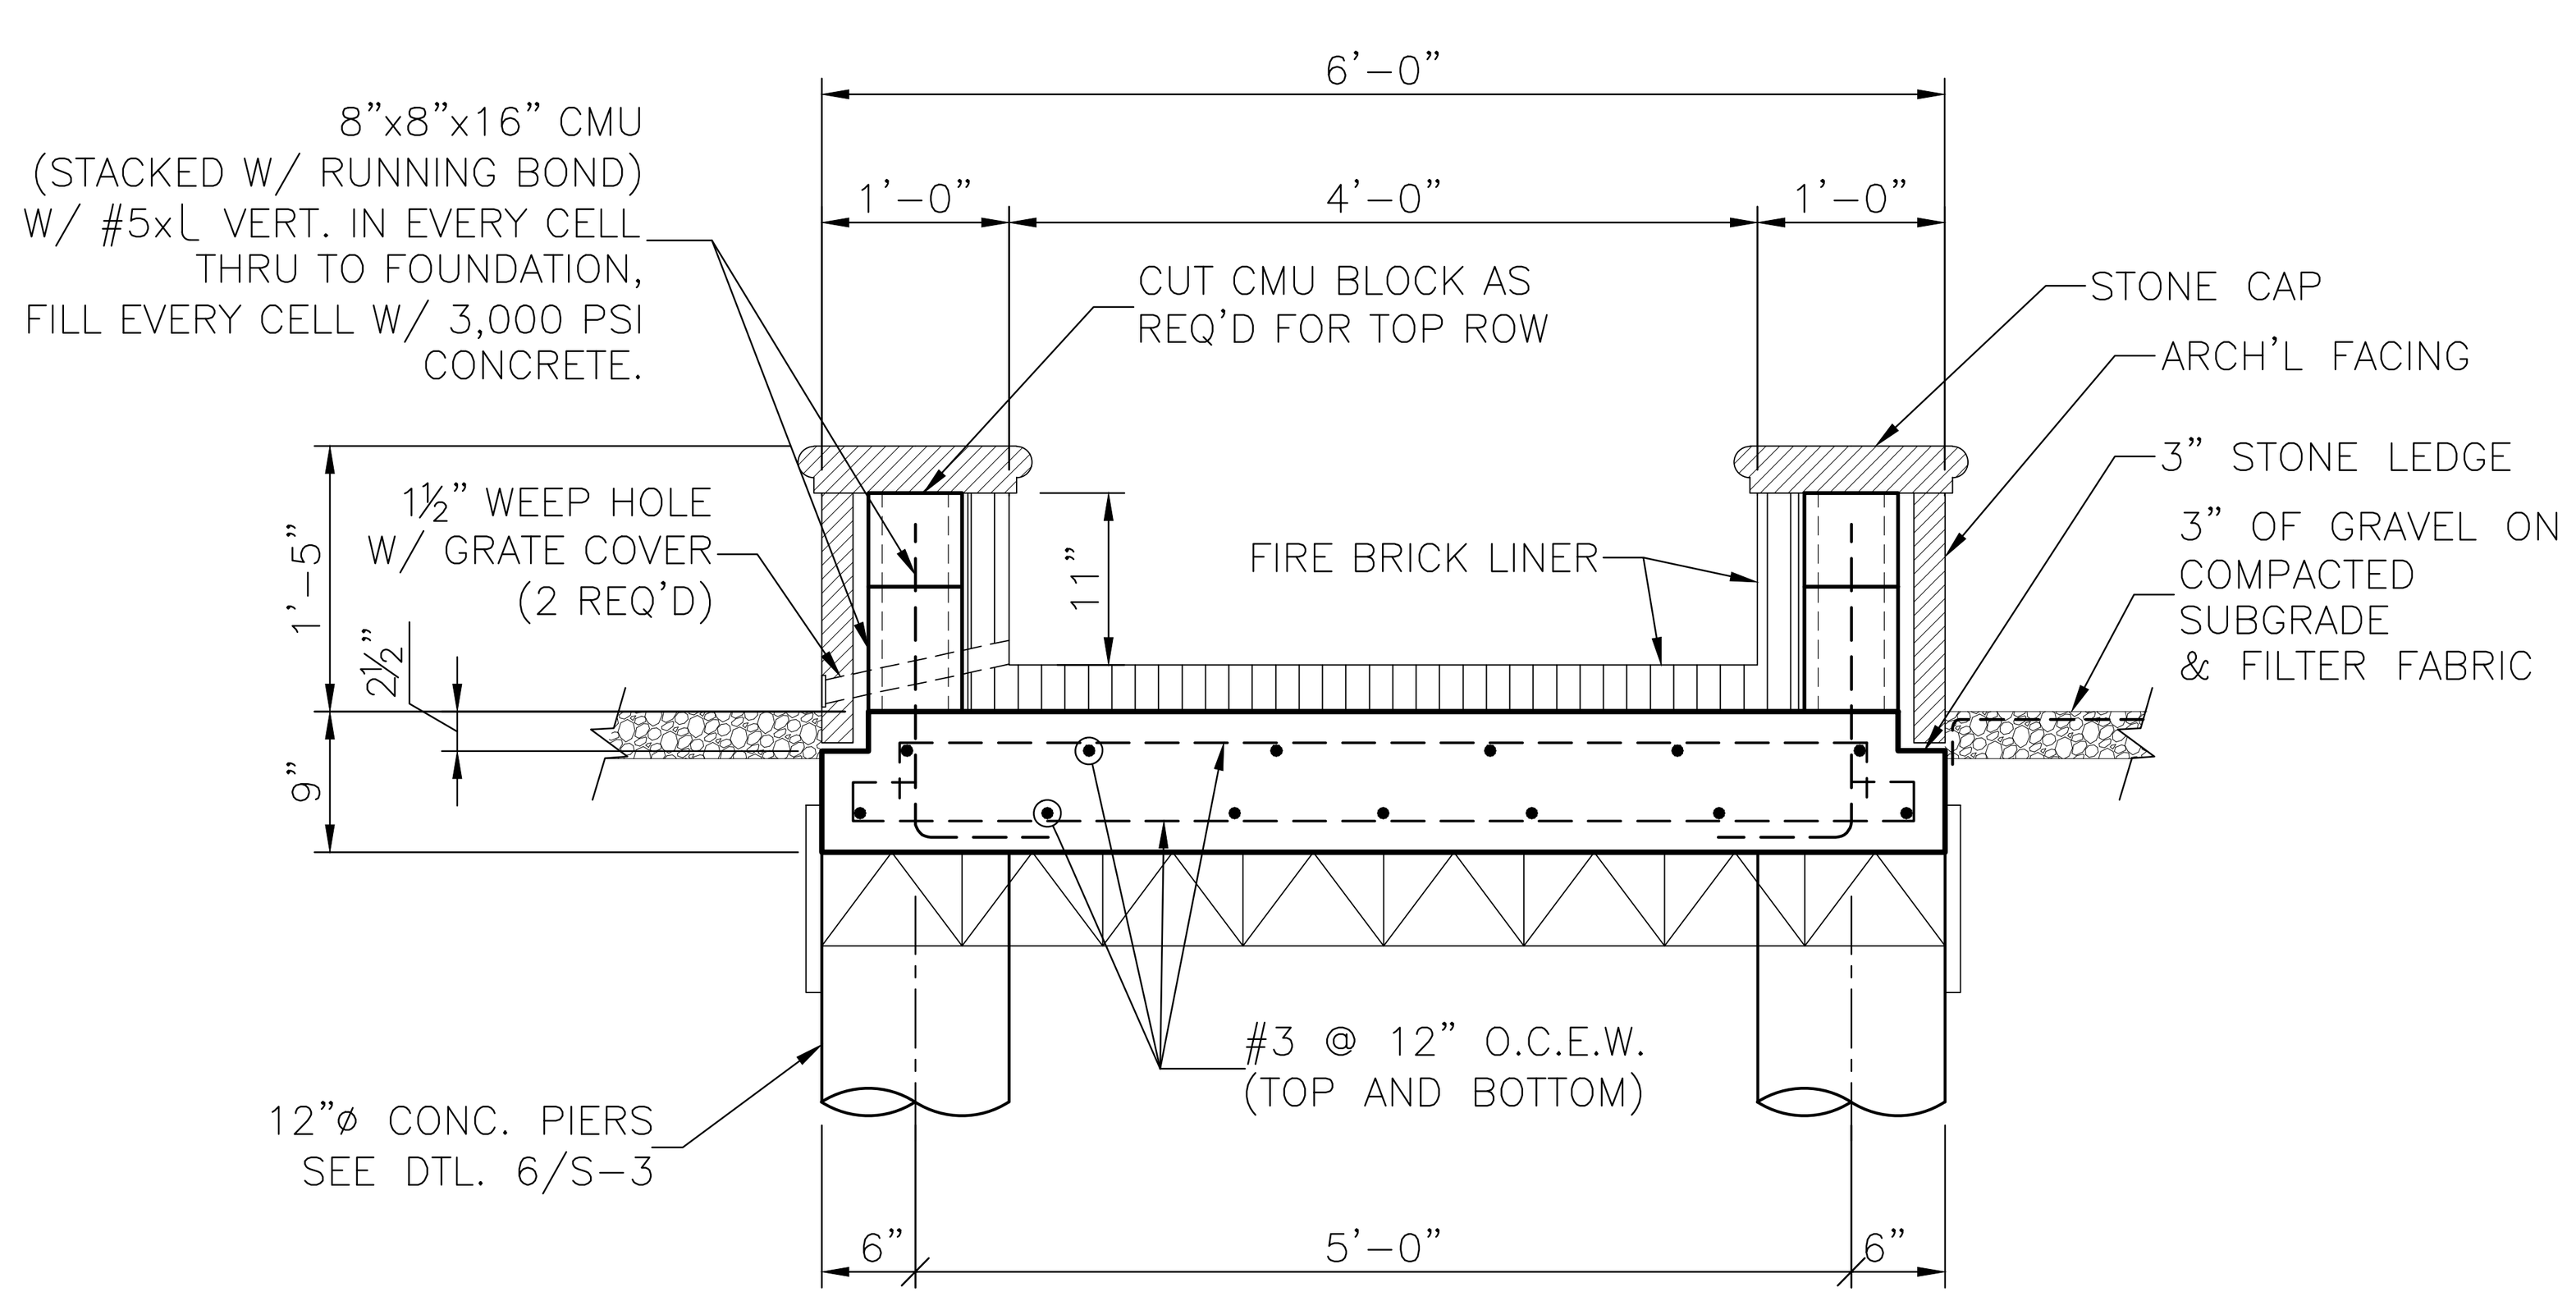

5 FIRE PIT DETAIL
SCALE: 3/4" = 1'-0"

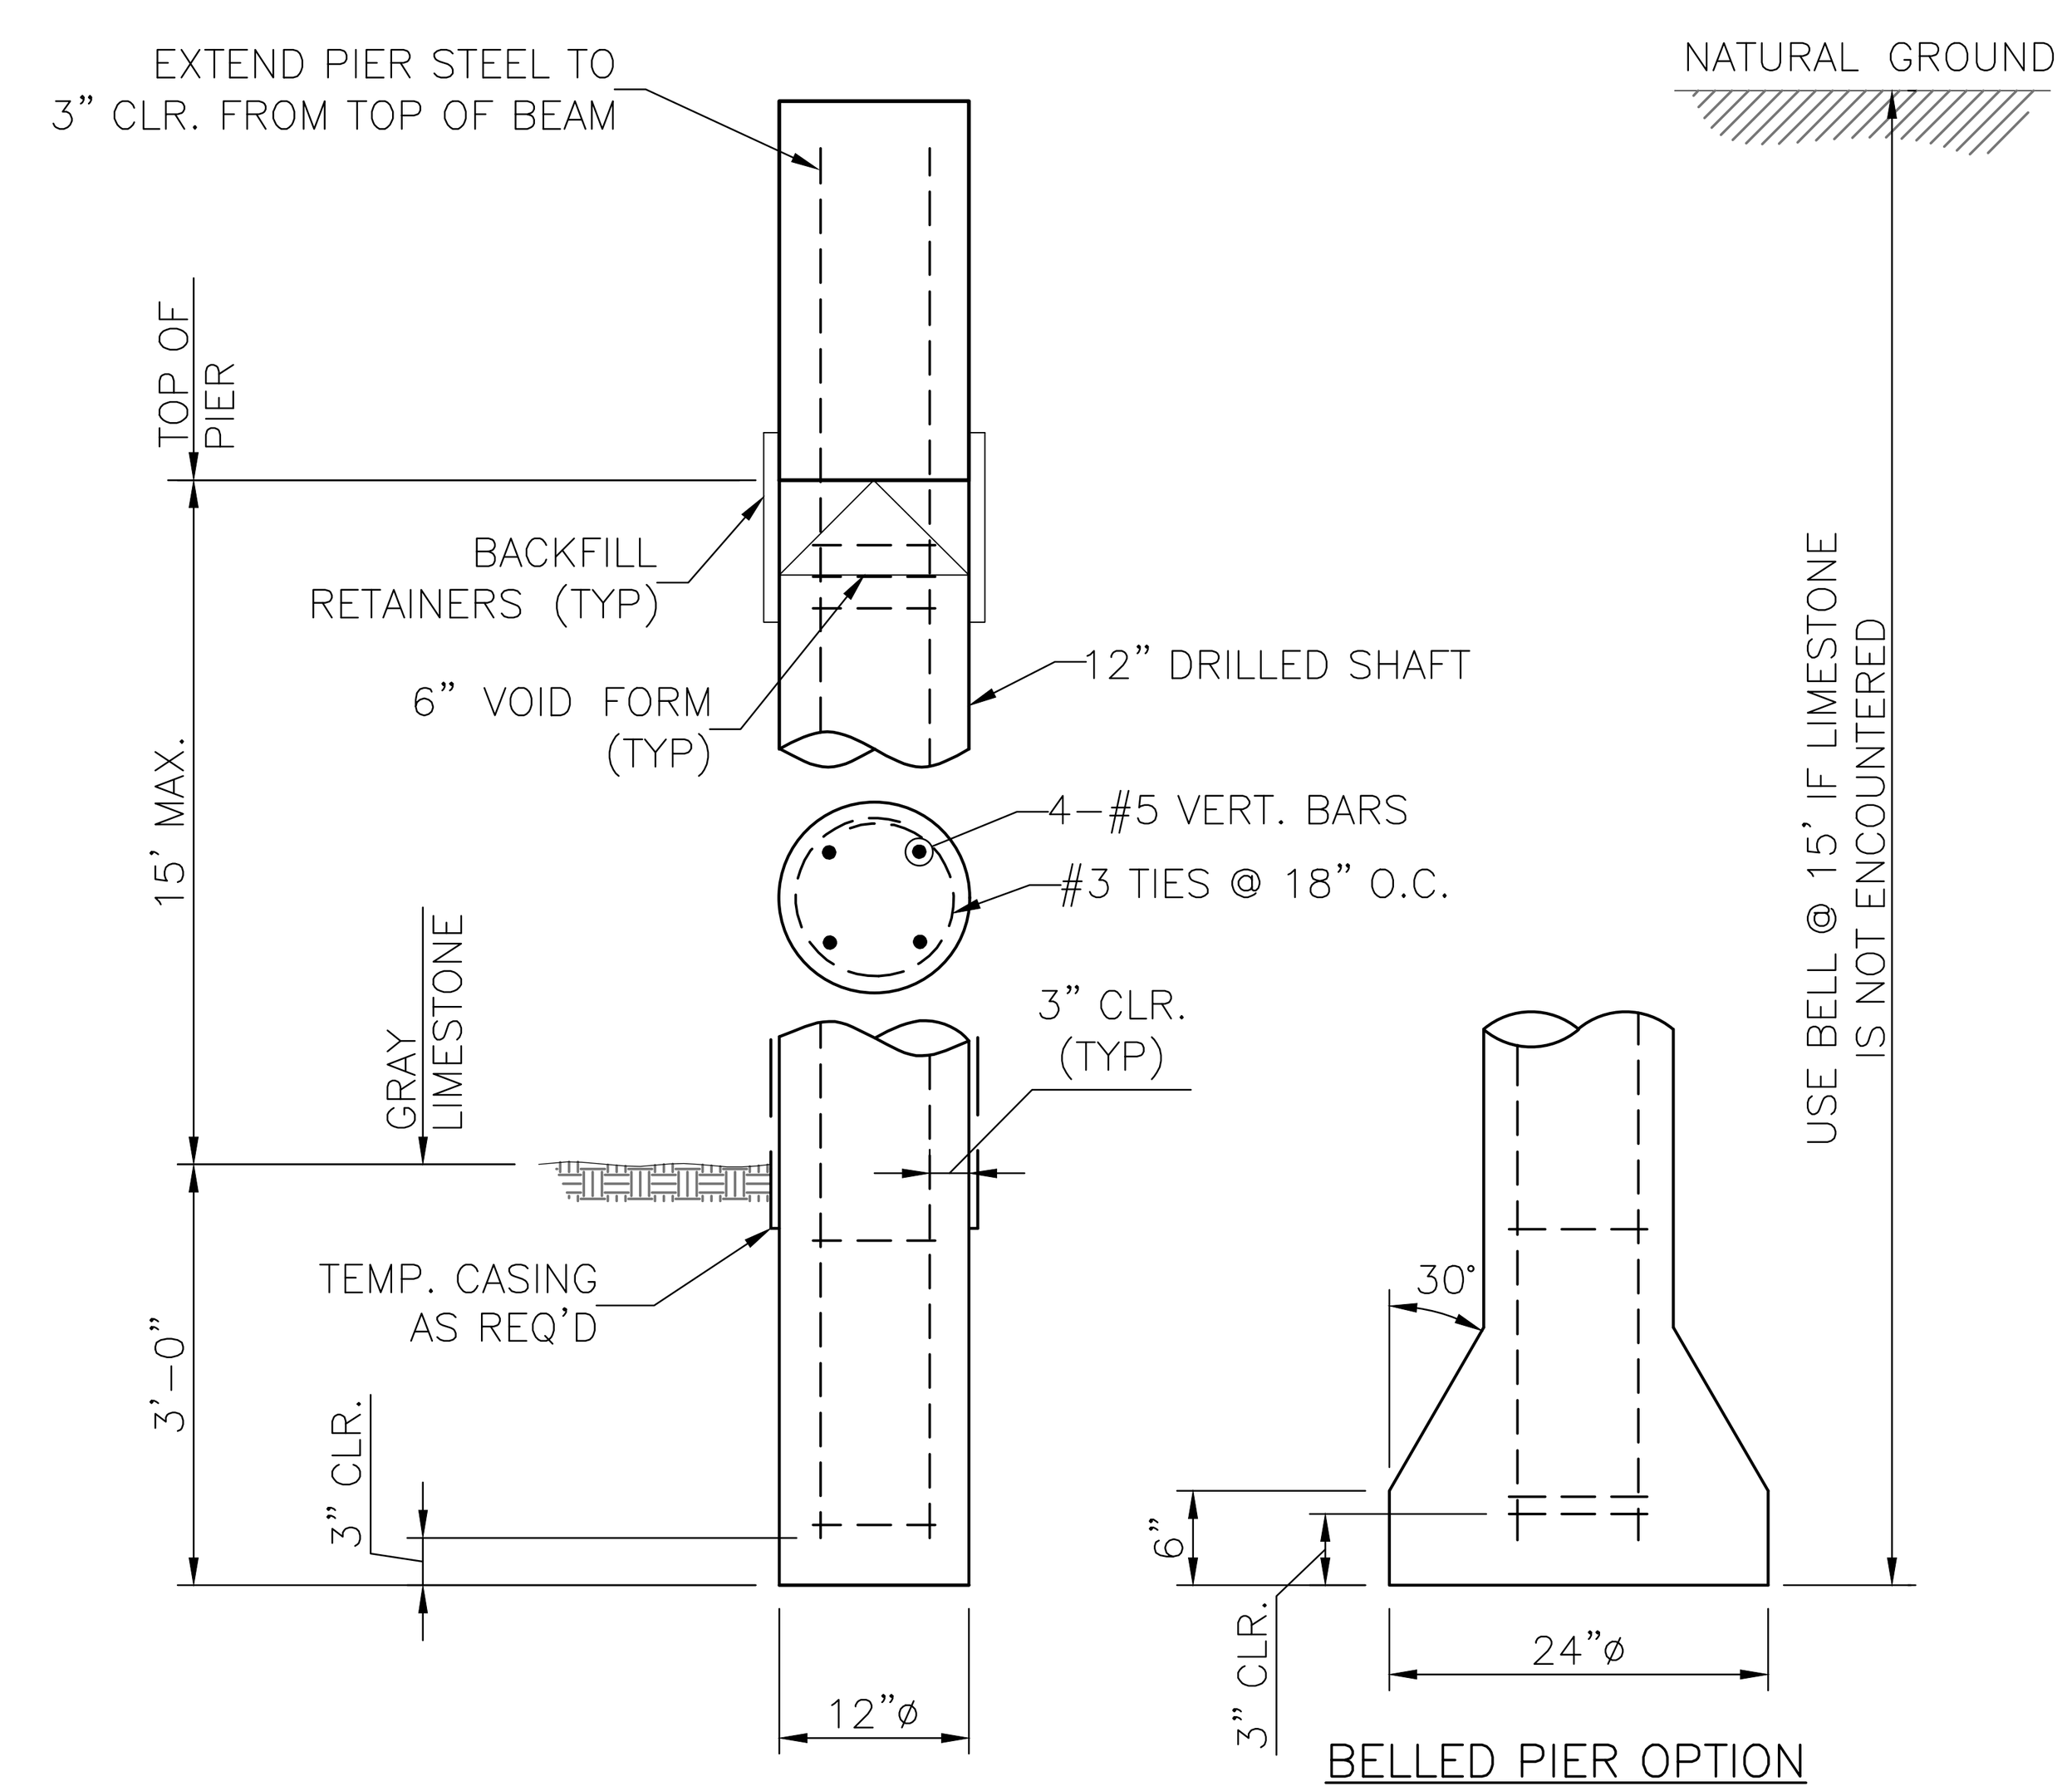

6 TYPICAL PIER DETAIL
SCALE: NTS

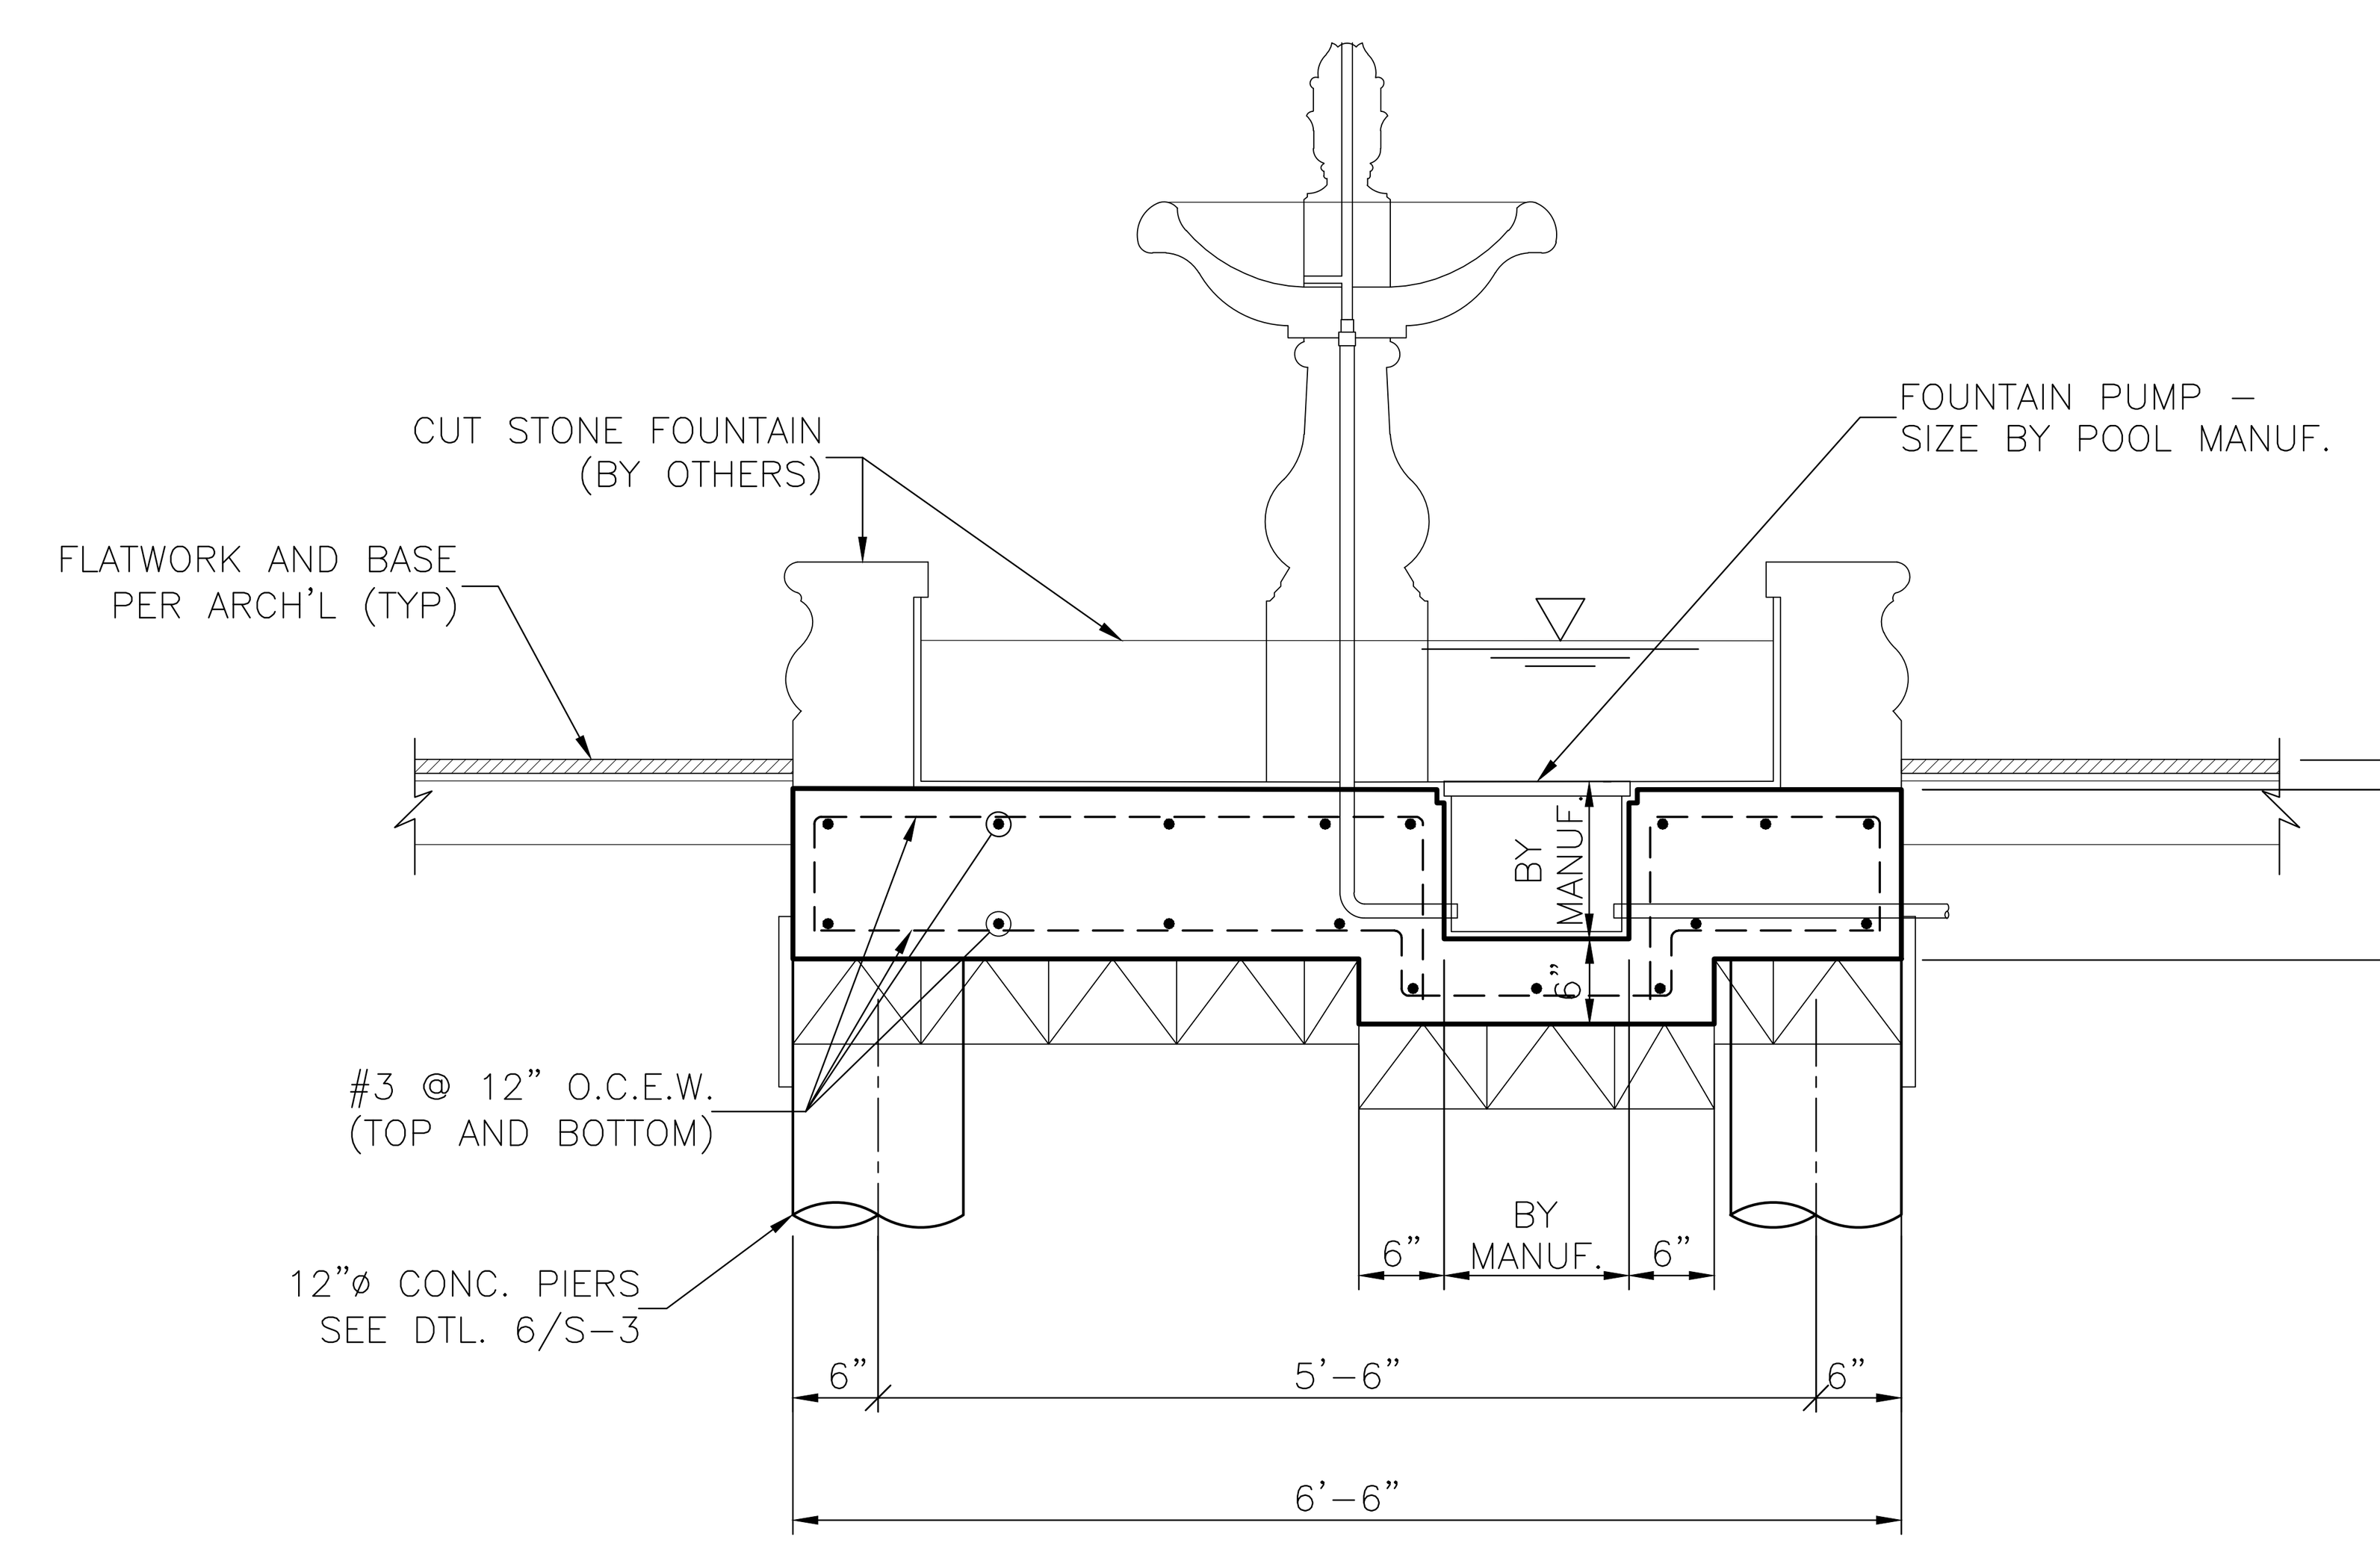

7 CUT STONE FOUNTAIN DETAIL
SCALE: 3/4" = 1'-0"

Need your project to look like this?

Ira can do it

iracad
Consulting & Design

Contact Us

214-717-8407
ira@iracad.com

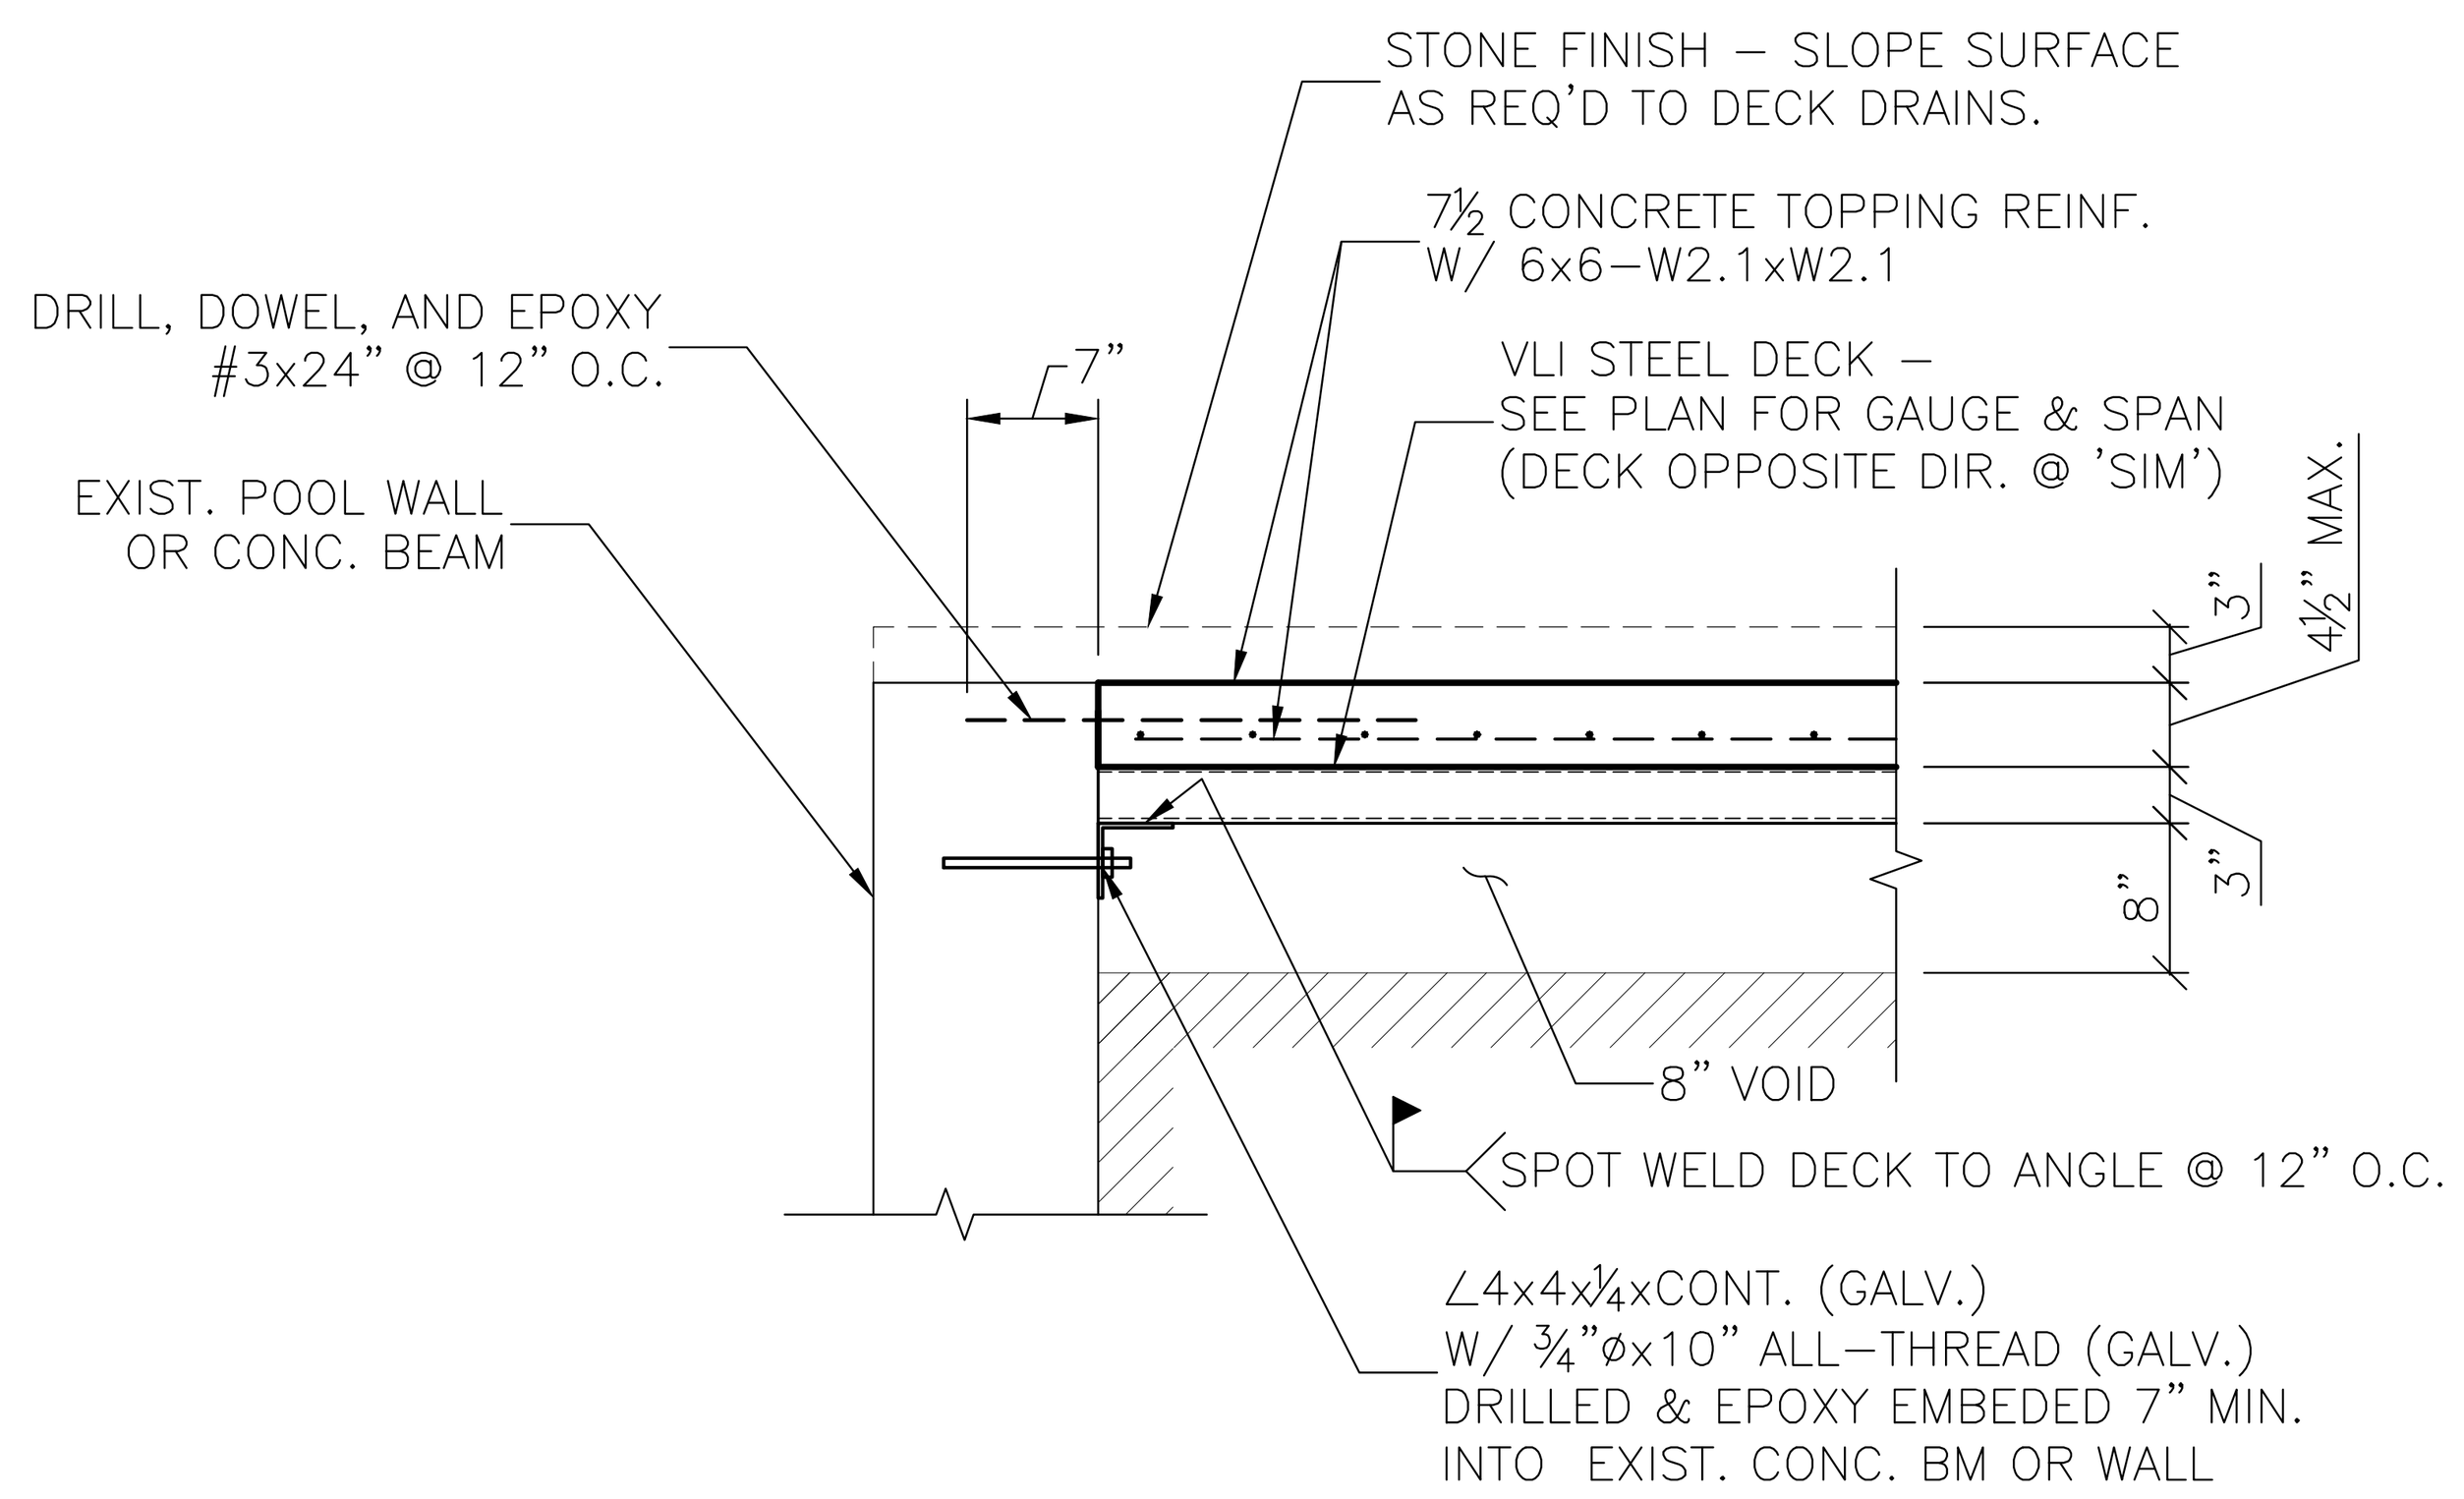

1 DECK–TO–EXIST. BEAM OR WALL

SCALE: 3/4" = 1'–0"

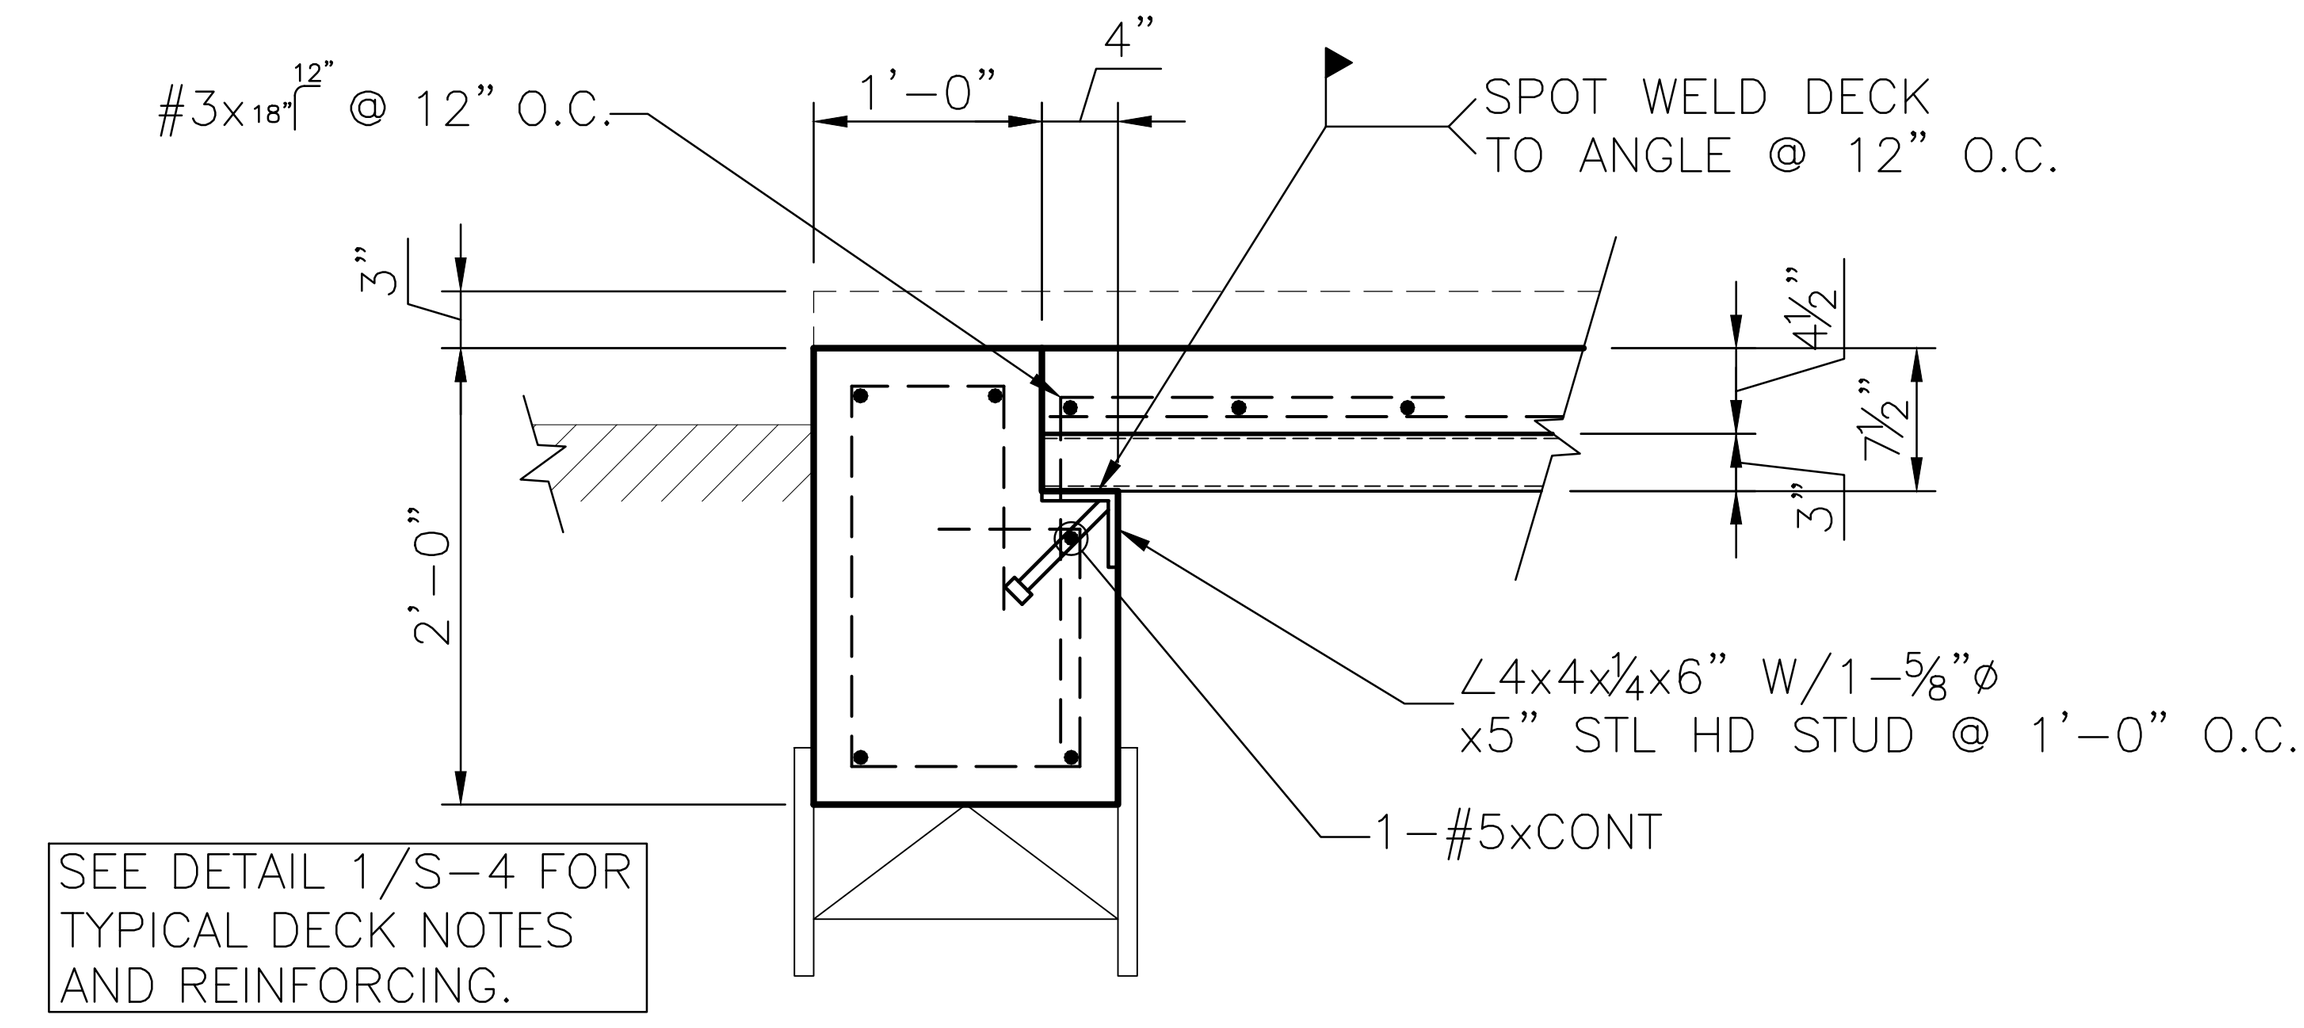

2 DECK–TO–BEAM DETAIL AT EDGE

SCALE: 3/4" = 1'–0"

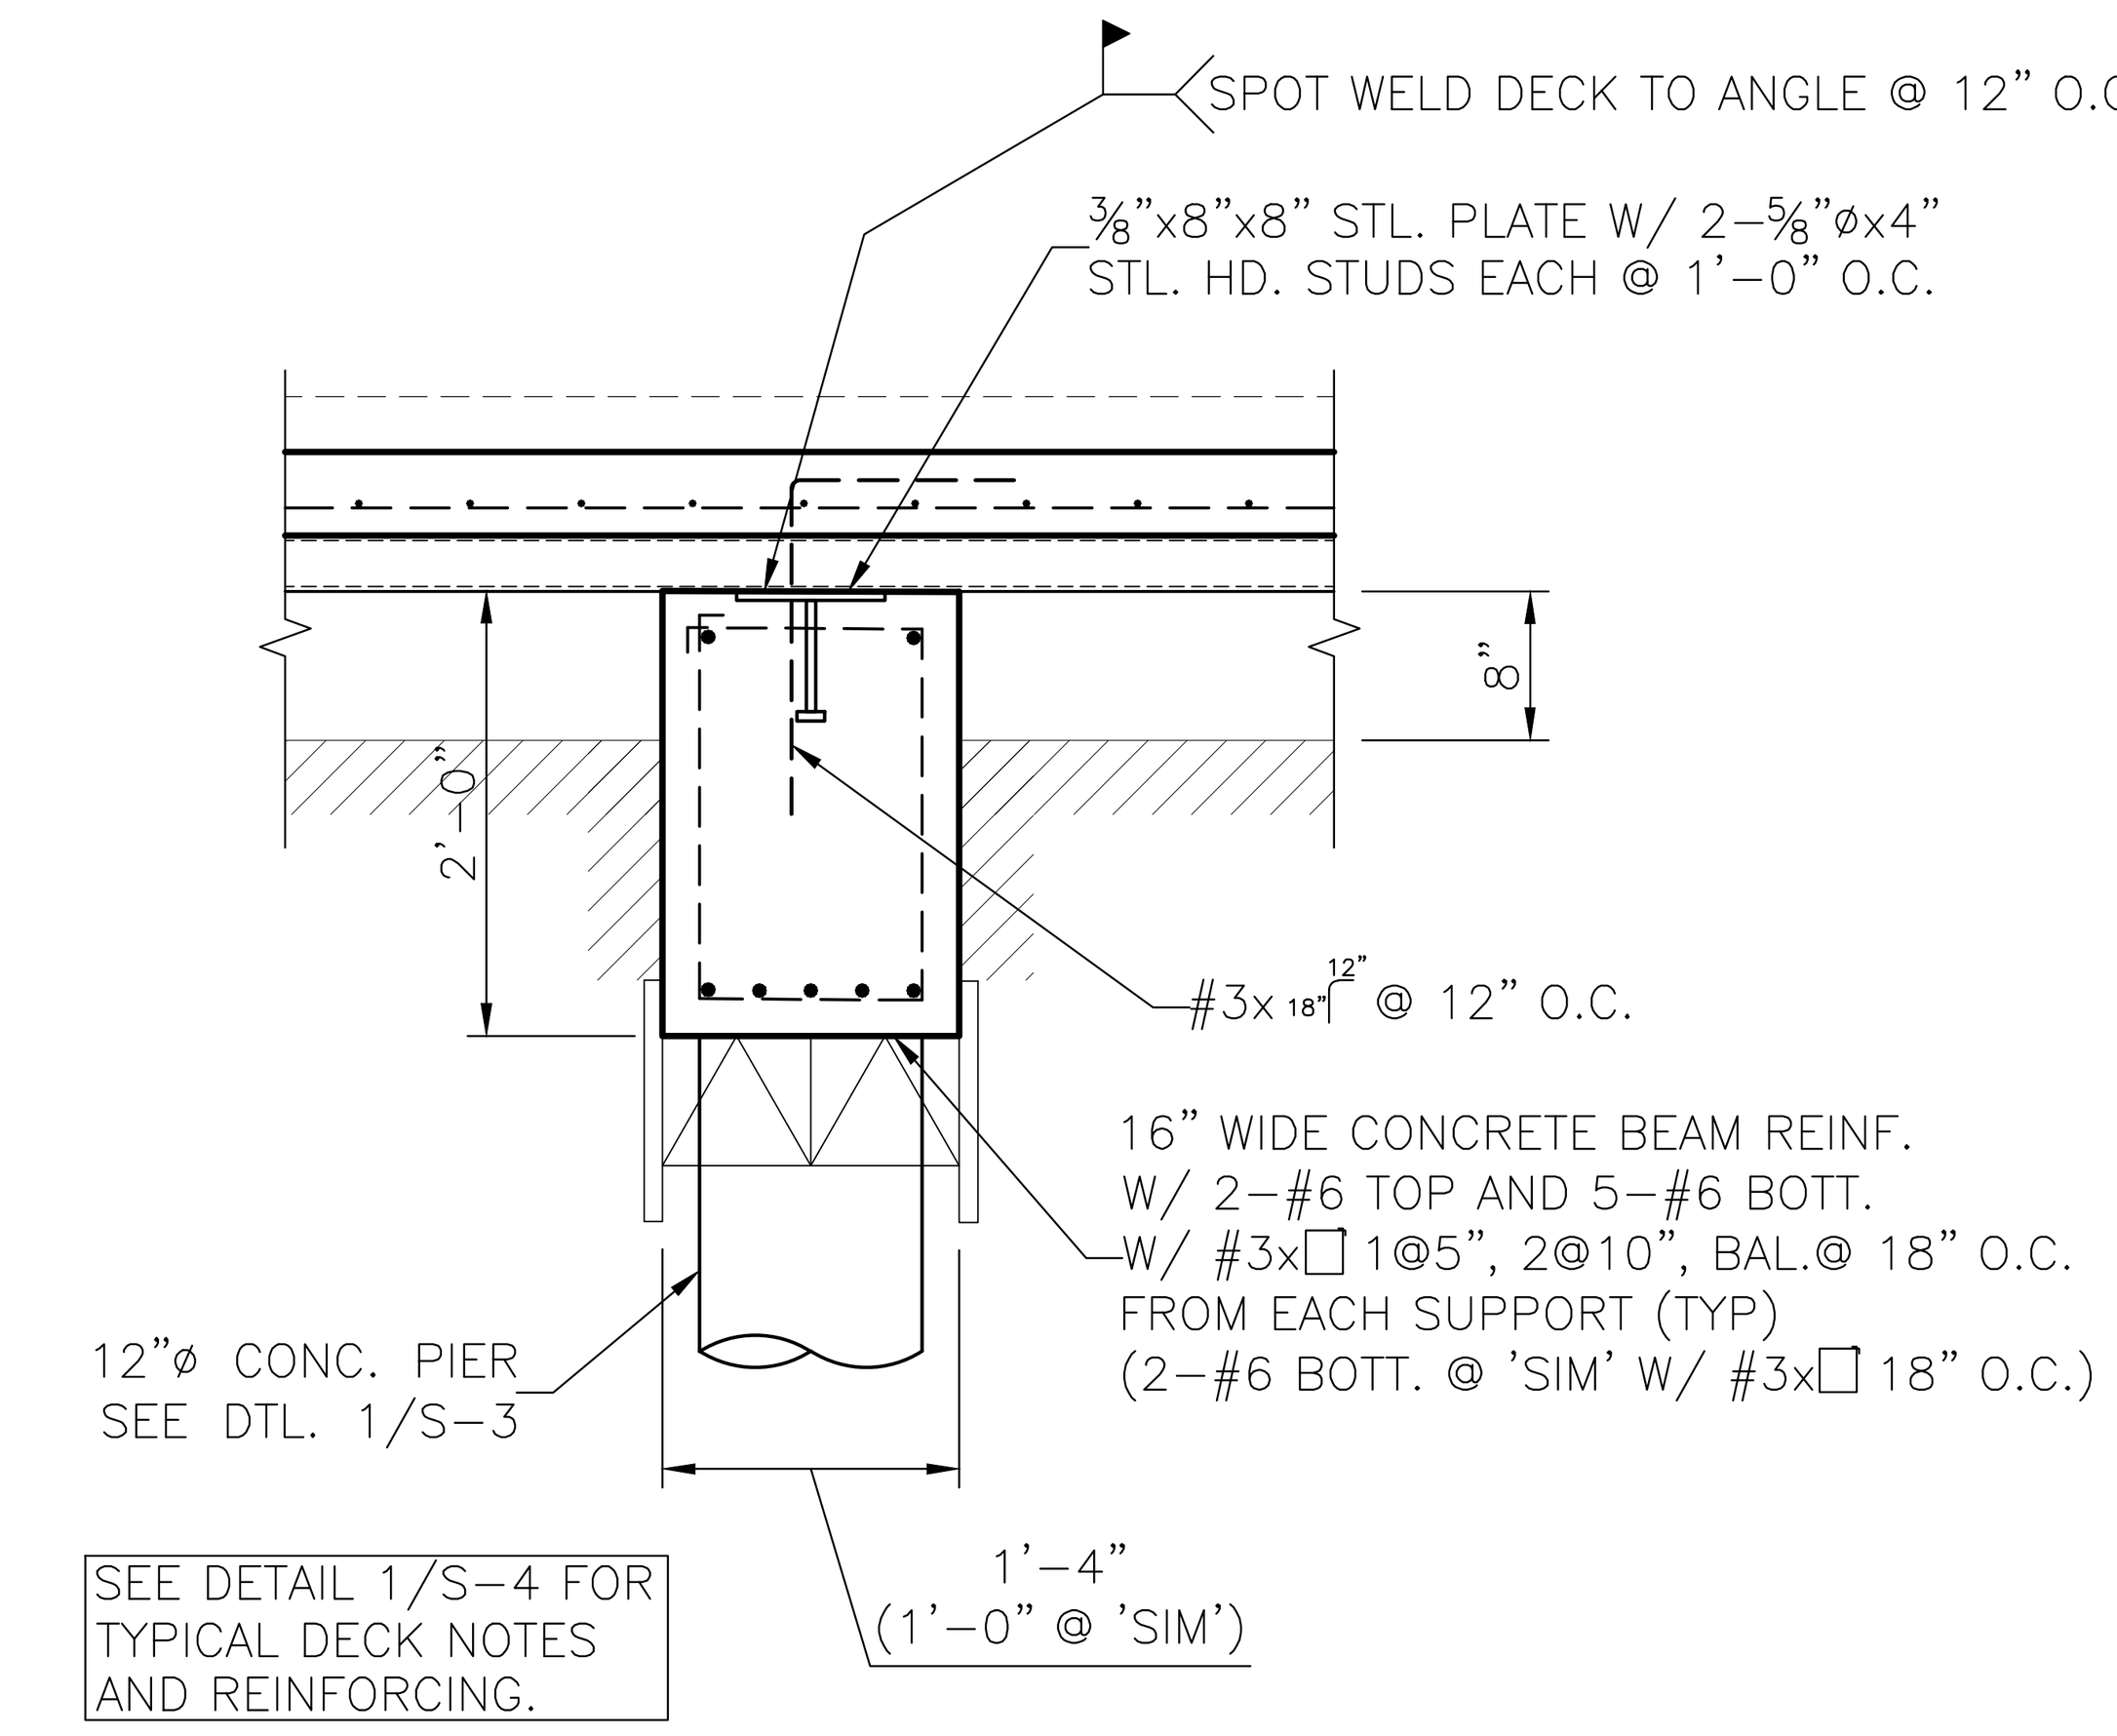

3 DECK–TO–BEAM SUPPORT DETAIL

SCALE: 3/4" = 1'–0"

GENERAL NOTES

THE FOLLOWING LOADS WERE USED FOR THE DESIGN OF THE PROJECT:

1. WIND VELOCITY: 120 MPH

2. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND OPENING LOCATIONS, AND COORDINATE ALL TRADES PRIOR TO BEGINNING CONSTRUCTION OF THE PROJECT

3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TEMPORARY SHORING AND BRACING OF STRUCTURAL ELEMENTS DURING CONSTRUCTION

EARTHWORK

1. ALL VEGETATION AND TOPSOIL CONTAINING ORGANIC MATTER, AND ANY OTHER DEBRIS, SHALL BE CLEARED, GRUBBED AND LEGALLY REMOVED FROM THE SITE AT THE BEGINNING OF EARTHWORK CONSTRUCTION.

2. AFTER VEGETATION HAS BEEN STRIPPED FROM BUILDING AREA, THE TOPSOIL DOWN TO THE LEVEL OF THE LIMESTONE SHALL BE REMOVED.

3. ALL SELECT FILL SHALL BE USED IMMEDIATELY BENEATH SLABS. THE SELECT FILL SHALL BE A NON-EXPANSIVE SOIL WITH A PLASTICITY INDEX BETWEEN 10 AND 20. THE SELECT FILL SHALL BE PLACED IN THIN LIFTS (6 TO 12 INCHES) AND COMPACTED TO A MINIMUM OF 95 PERCENT OF ASTM D698 (STANDARD PROCTOR) MAXIMUM DENSITY. MOISTURE CONTENT OF THE SELECT FILL SHALL BE BETWEEN -2 AND +4 PERCENT OF OPTIMUM DURING COMPACTION.

CONCRETE FORMWORK

1. ALL CONCRETE FORMWORK SHALL BE SQUARE, PLUMB, AND STRAIGHT WITHOUT SAGS OR BULGES.

2. ALL CONCRETE FORMWORK SHALL BE DESIGNED WITH ADEQUATE SUPPORT FOR THE LOADS, LATERAL PRESSURE AND ALLOWABLE STRESSES AS OUTLINED IN ACI 347, CHAPTER 1 AND 2.

3. ALL EXPOSED FINISH CONCRETE SURFACES SHALL BE SMOOTH WITHOUT FORM MARKS, KNOTS, HOLES, DENTS AND OTHER SURFACE DEFECTS.

4. ALL BRICK LEDGE EDGES SHALL BE FORMED SQUARE WITH NO CHAMFERS.

5. FORMS SHALL BE SUBSTANTIAL AND SUFFICIENTLY TIGHT TO PREVENT LEAKAGE OF MORTAR.

6. FORMS SHALL BE BRACED OR TIED TO MAINTAIN DESIRED POSITION, SHAPE AND ALIGNMENT DURING AND AFTER CONCRETE PLACEMENT.

7. EARTH CUTS SHALL NOT BE USED AS FORMS FOR VERTICAL SURFACES.

8. VOID FORMS SHALL BE ASSEMBLED AND PLACED IN ACCORDANCE WITH MANUFACTURER'S PRINTED INSTRUCTIONS. IF VOID FORM IS WRAPPED WITH POLYETHYLENE, THE POLYETHYLENE SHALL BE REMOVED FROM SIDES OF THE FORM VOID BEFORE BACKFILLING. VOID FORM BELOW SLABS SHALL NOT BE WRAPPED.

9. CONCRETE FORMS SHALL NOT BE REMOVED OR DISTURBED UNTIL CONCRETE HAS ATTAINED SUFFICIENT STRENGTH TO SUPPORT ALL DEAD AND LIVE LOADS.

10. CARE SHALL BE TAKEN IN FORM REMOVAL TO PREVENT SURFACE GOUGING, CORNER OR EDGE BREAKAGE AND OTHER OTHER DAMAGE TO THE CONCRETE.

CONCRETE

1. ALL CONCRETE SHALL UTILIZE CRUSHED LIMESTONE AGGREGATE AND SHALL DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS.

2. MAXIMUM SIZE OF COARSE AGGREGATE SHALL BE 1 1/2".

3. ALL CONCRETE SHALL BE DESIGNED, MIXED, TRANSPORTED, AND PLACED IN ACCORDANCE WITH THE LATEST SPECIFICATIONS OF THE AMERICAN CONCRETE INSTITUTE.

DRILLED PIERS

1. DRILLED PIERS ARE TO BE FOUNDED AS SHOWN ON THE DRAWING.

2. THE BOTTOM OF ALL PIERS SHALL BE SMOOTH, DRY AND FREE OF ALL LOOSE MATERIAL BEFORE POURING CONCRETE.

3. DRILLED PIERS SHALL BE CONCRETED WITHIN FOUR (4) HOURS OF EXCAVATION.

4. THE CONTRACTOR SHALL VERIFY THE DEPTH OF THE PIER PRIOR TO CUTTING PIER REINFORCING CAGES. PIER STEEL SHALL BE DELIVERED TO THE JOB SITE IN STANDARD 60 FOOT LENGTHS AND CUT AS REQUIRED.

5. CONTINUOUS INSPECTION OF PIER DRILLING OPERATIONS BY A GEOTECHNICAL OR STRUCTURAL ENGINEER IS REQUIRED TO ASSURE PROPER BEARING STRATUM IS PENETRATED, THAT THE PIER HOLES ARE CLEAN AND DRY AT TIME OF CONCRETING, AND PROPER CONCRETING PROCEDURES ARE USED IN CONSTRUCTING THE PIERS.

ANCHOR BOLTS

1. ANCHOR BOLTS AND THREADED ROD STEEL SHALL CONFORM TO ASTM A307

2. OTHER ANCHOR BOLTS SHALL CONFORM TO THE PROVISIONS OF THE NINTH EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.

3. BOLT THREADS AT THE EMBEDDED END SHALL BE STAKED BELOW THE NUT.

4. ALL BOLTS SHALL BE BROUGHT TO A SNUG TIGHT CONDITION AS DEFINED BY AISC TO ENSURE GOOD CONTACT BETWEEN ATTACHMENTS.

5. THE CONCRETE SHALL BE AT LEAST 14 DAYS OLD PRIOR TO TIGHTENING THE ANCHOR BOLTS TO PREVENT BOLT ROTATION.

6. MINIMUM EMBEDMENT FOR ANCHOR BOLTS SHALL BE: 4½"

REINFORCEMENT

1. ALL #3 BARS SHALL CONFORM TO ASTM SPECIFICATION A615, GRADE 40. ALL OTHER REINFORCING STEEL SHALL CONFORM TO ASTM A615, GRADE 60. FOREIGN STEEL IS ACCEPTABLE IF MILL CERTIFICATES OF COMPLIANCE WITH ASTM ARE PROVIDED.

2. ALL REINFORCEMENT SHALL BE DESIGNED AND DETAILED IN ACCORDANCE WITH THE LATEST EDITION OF THE ACI "MANUAL OF STANDARD PRACTICE FOR DETAILING CONCRETE STRUCTURES" (ACI 315).

3. ALL REINFORCING BAR BENDS SHALL BE MADE COLD. GRADE 60 BARS MAY BE BENT IN THE FIELD ONE TIME ONLY.

4. WHERE SPLICES ARE REQUIRED IN CONCRETE SLAB REINFORCEMENT, BARS SHALL BE SPLICED A MINIMUM OF AN ACI CLASS "C" SPLICE FOR THE SIZE BAR UTILIZED.

5. HOOK ALL BEAM BARS AT DISCONTINUOUS ENDS.

6. ALL HOOKS SHALL BE ACI STANDARD 90 DEGREE HOOKS UNLESS DETAILED OTHERWISE.

7. REINFORCEMENT IN FOUNDATION SHALL BE SUPPORTED TO PROVIDE THE FOLLOWING MINIMUM CONCRETE COVER:

CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH	3 INCHES
FORMED, EXPOSED TO EARTH OR WEATHER	2 INCHES

8. ALL BAR LENGTH AND DIMENSIONS ARE OUT-TO-OUT AND DO NOT INCLUDE HOOKS AND BENDS.

9. STIRRUPS OF THE SIZE AND SPACING SCHEDULED SHALL PROVIDE THE COVER LISTED ABOVE. HOOKS ON STIRRUPS SHALL BE 90 DEGREES AND SHALL HAVE 4 INCH MINIMUM EXTENSIONS.

10. WHERE SPLICES OCCUR IN CONCRETE BEAM REINFORCING, BOTTOM BARS SHALL BE SPLICED AT THE CENTERLINE OF SUPPORTS (PIERS), AND TOP BARS SHALL BE SPLICED BY LAPPING AT THE CENTERLINE OF THE SPAN. SPLICES FOR BOTTOM BARS SHALL BE 1'-0" LONG. SPLICES FOR TOP BARS SHALL BE A LENGTH EQUAL TO AN ACI CLASS B TENSION SPLICE FOR THE BAR SIZES USED PER THE CHART BELOW (SEE DTL. 2/S-5):

BAR SIZE	SPLICE LENGTH
#3	1'-4"
#4	1'-10"
#5	2'-3"
#6	2'-11"
#7	3'-6"

11. PLACE CORNER BARS AT ALL EXTERIOR BEAM INTERSECTIONS AS SHOWN ON DETAIL 1/S-5

STRUCTURAL MASONRY

1. DESIGN AND CONSTRUCTION SHALL CONFORM TO THE SPECIFICATIONS OF "BUILDING CODE REQUIREMENTS FOR CONCRETE MASONRY STRUCTURES", ACI 530. THE GROSS DESIGN COMPRESSIVE STRENGTH (F'M) OF THE STRUCTURAL MASONRY SYSTEM ON THIS PROJECT IS 1500psi.

2. HOLLOW CONCRETE MASONRY UNITS SHALL MEET THE REQUIREMENTS OF ASTM C90 AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 1900 psi. SOLID CONCRETE MASONRY UNITS SHALL MEET THE REQUIREMENTS OF ASTM C145 AND HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2000psi. MORTAR SHALL MEET THE REQUIREMENTS OF ASTM C270, TYPE M, 2500 psi.

3. ALL CONCRETE BLOCK UNITS SHALL BE GROUTED SOLID USING A 5 SACK - 3000 psi NORMAL WEIGHT CONCRETE MIX.

4. ALL REINFORCING AND SOLID GROUTED SECTIONS SHALL BE CONTINUOUS AT PILASTER AND BOND BEAM INTERSECTIONS.

5. ALL WALLS SHALL BE "RUNNING BOND", UNLESS SPECIFICALLY SHOWN OTHERWISE.

7. PROVIDE DOWELS OF EQUIVALENT SIZE AND SPACING TO MATCH VERTICAL WALL REINFORCING AT THE FOUNDATION LEVEL. LENGTH SHALL PROVIDE MINIMUM COMPRESSION LAP SPLICE AND COMPRESSION EMBEDMENT LENGTH. MINIMUM LENGTH OF DOWELS SHALL BE 48 BAR DIAMETERS.

8. REINFORCE WALLS WITH HORIZONTAL WALL REINFORCING CONSISTING OF TRUSS TYPE GALVANIZED NO. 9 WIRE MEETING ASTM A116, CLASS I. JOINTS SHALL BE REINFORCED EVERY OTHER COURSE.

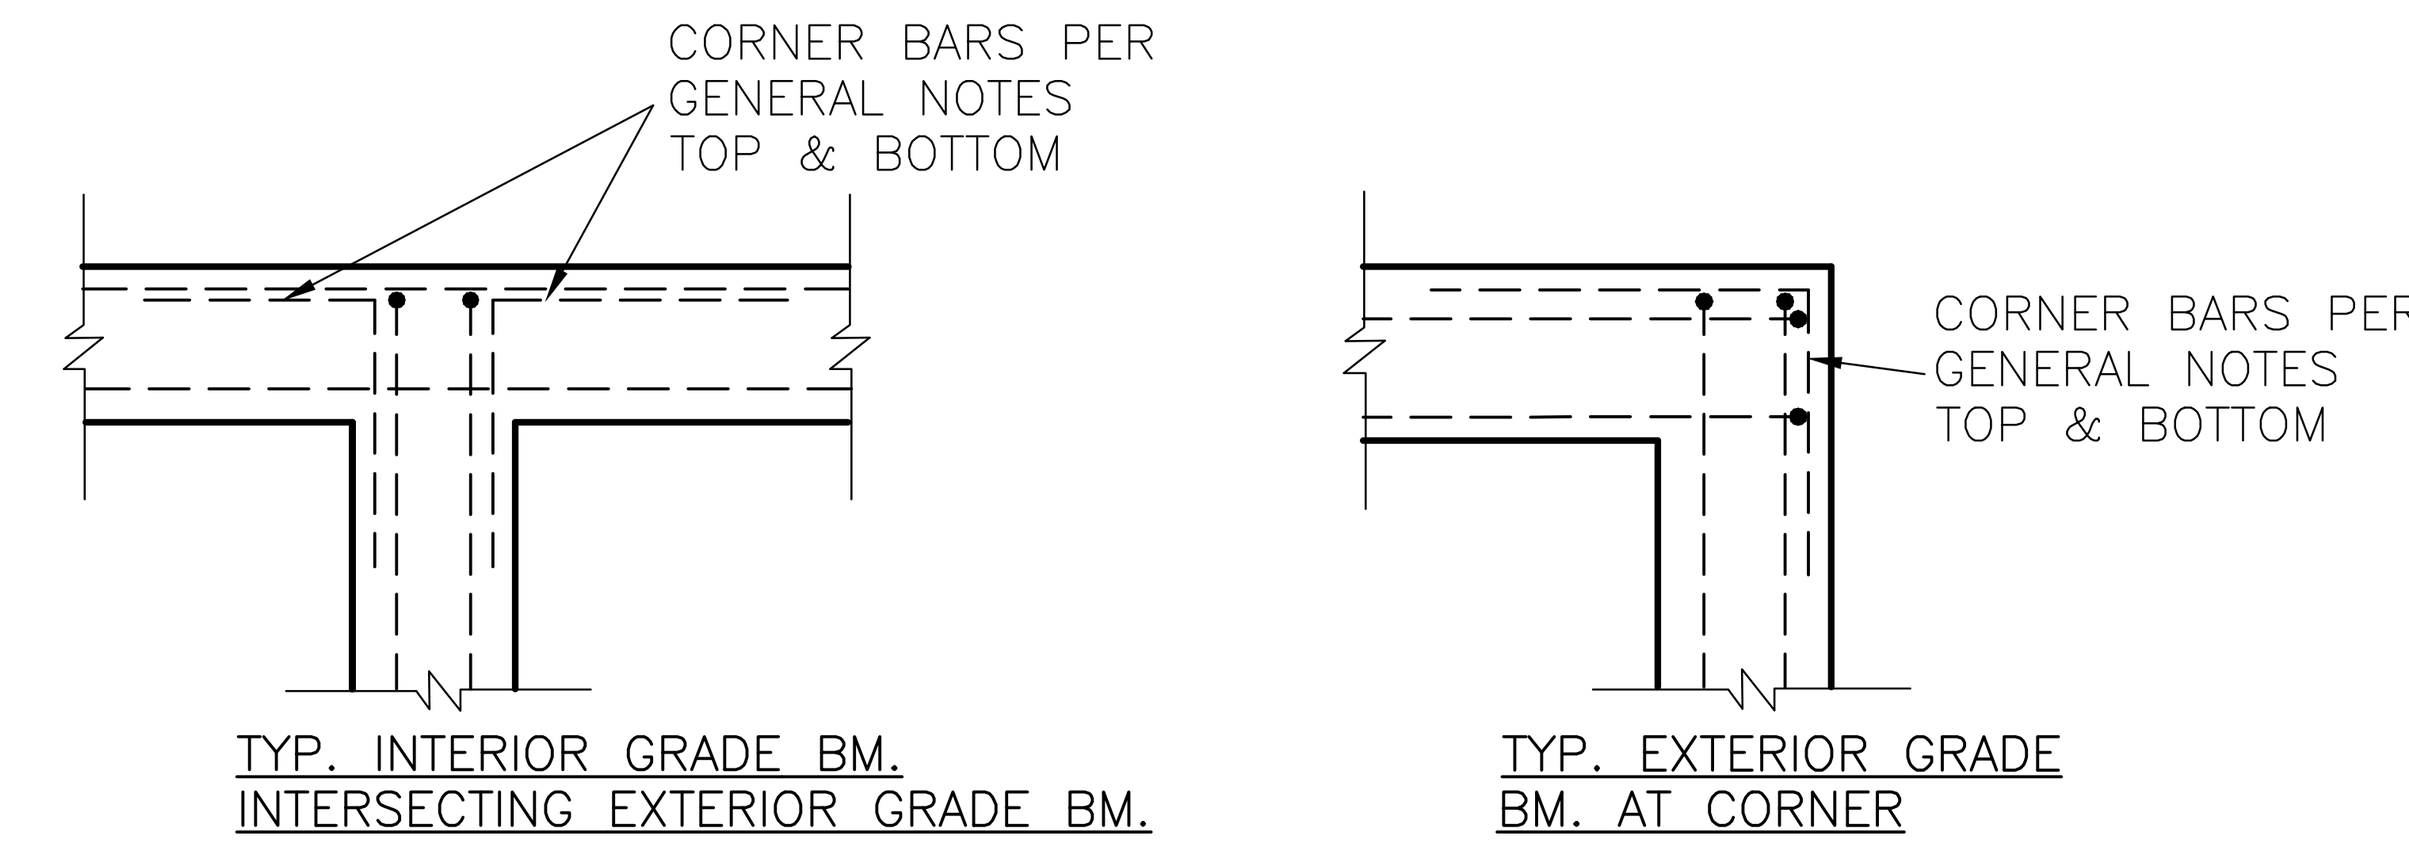

1 TYP. CORNER BAR DETAIL
SCALE: NTS

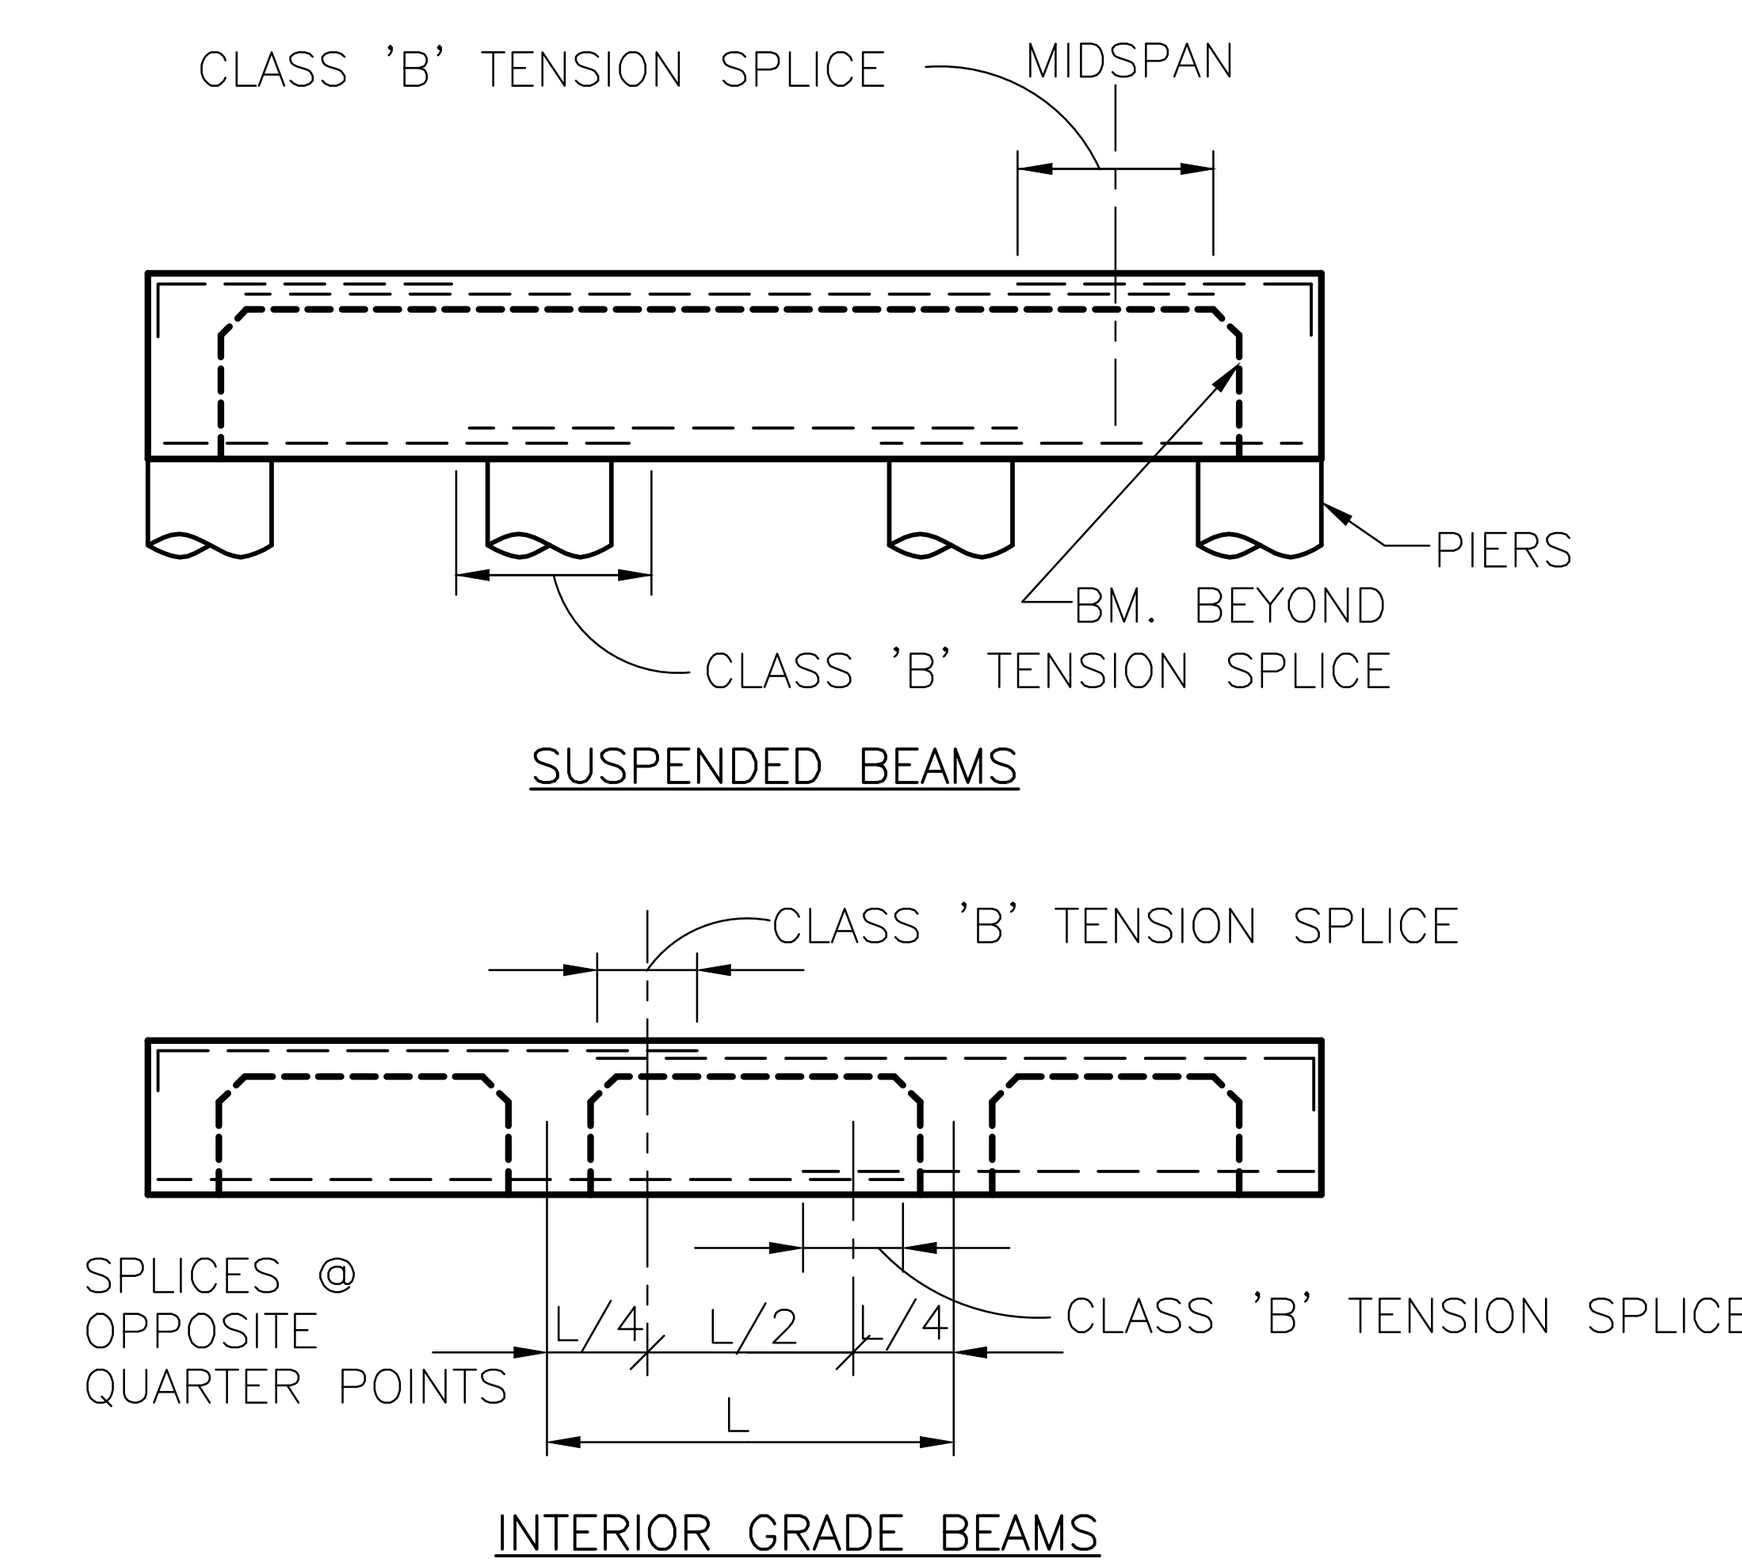

2 TYP. REINF. SPLICE DETAIL
SCALE: NTS

Need your project to look like this?

Ira can do it

iracad
Consulting & Design

Contact Us

214-717-8407
ira@iracad.com