


Controller timing trace with independent flow-meter closure

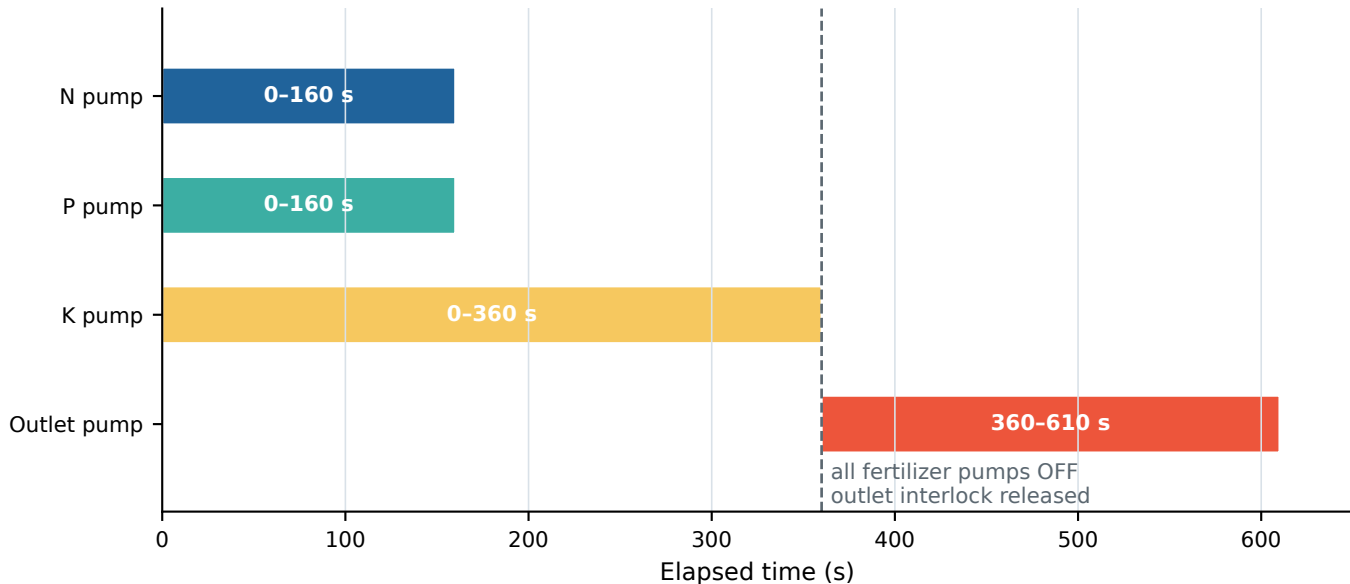

Illustrative deterministic trace: N=4.0 L at 1.5 L min⁻¹; P=2.0 L at 0.75 L min⁻¹; K=6.0 L at 1.0 L min⁻¹.