


Per-lobe electrical dose response
 Points: median of capture-level bin medians; bands: 95% moving-block capture bootstrap

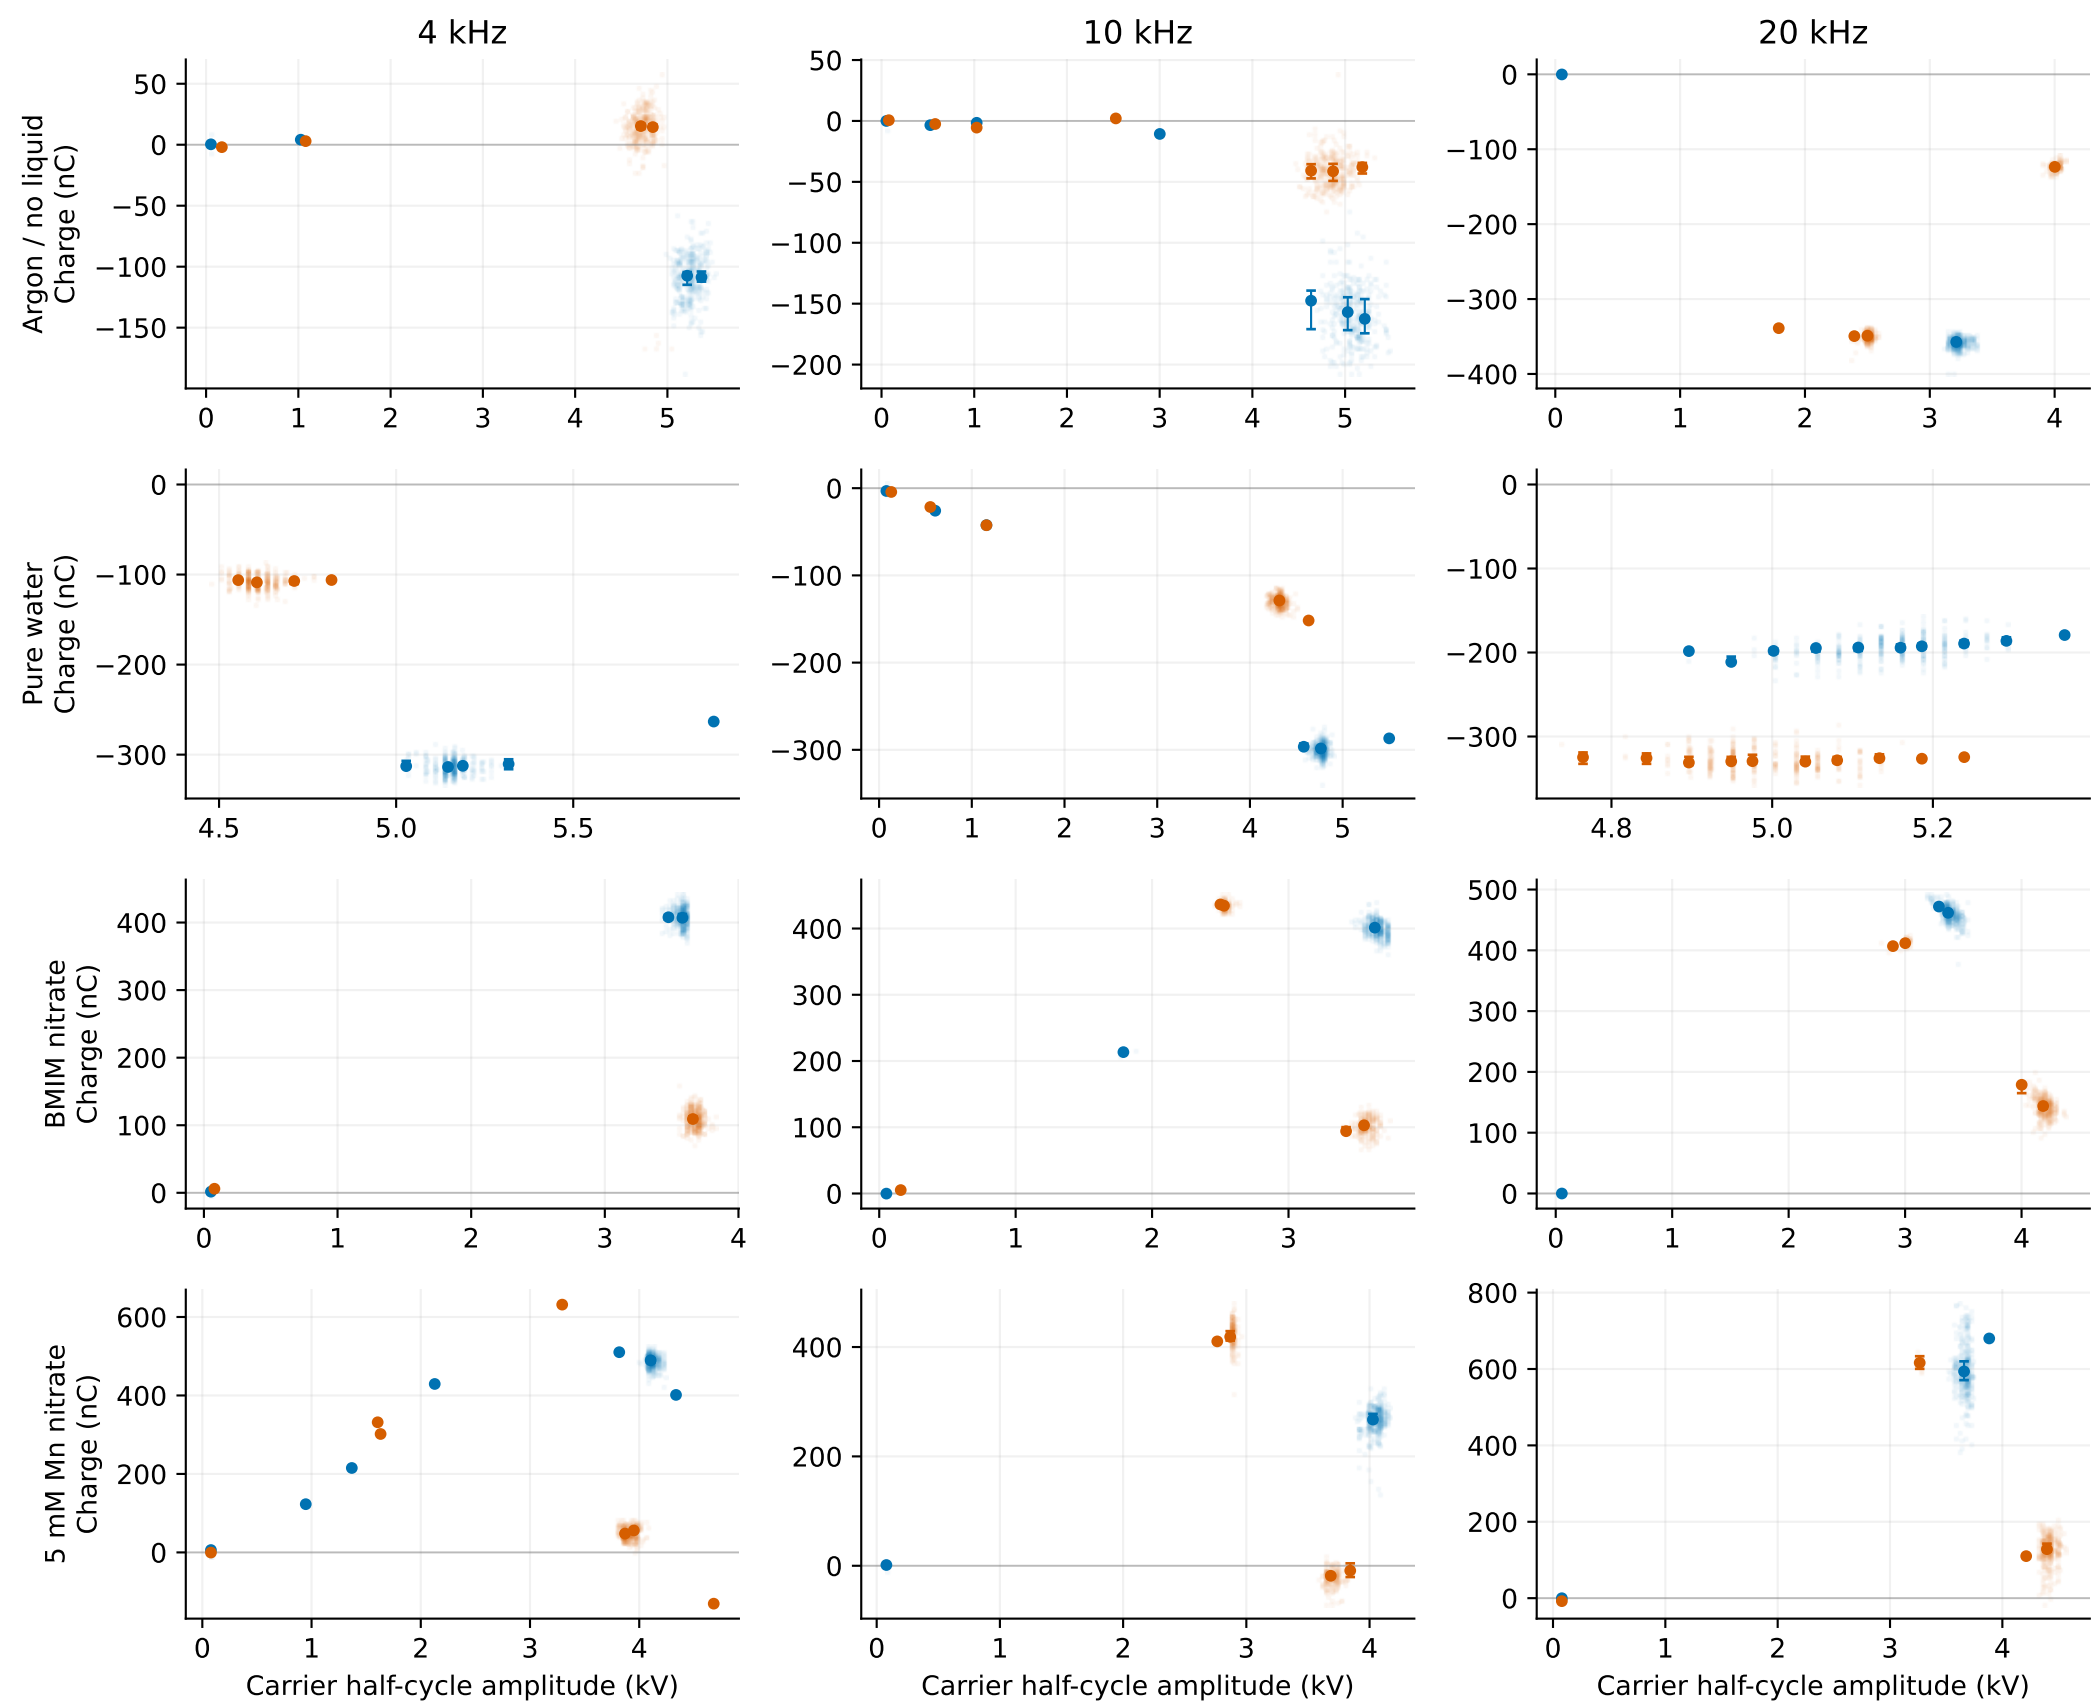

—●— Negative charge —●— Positive charge