
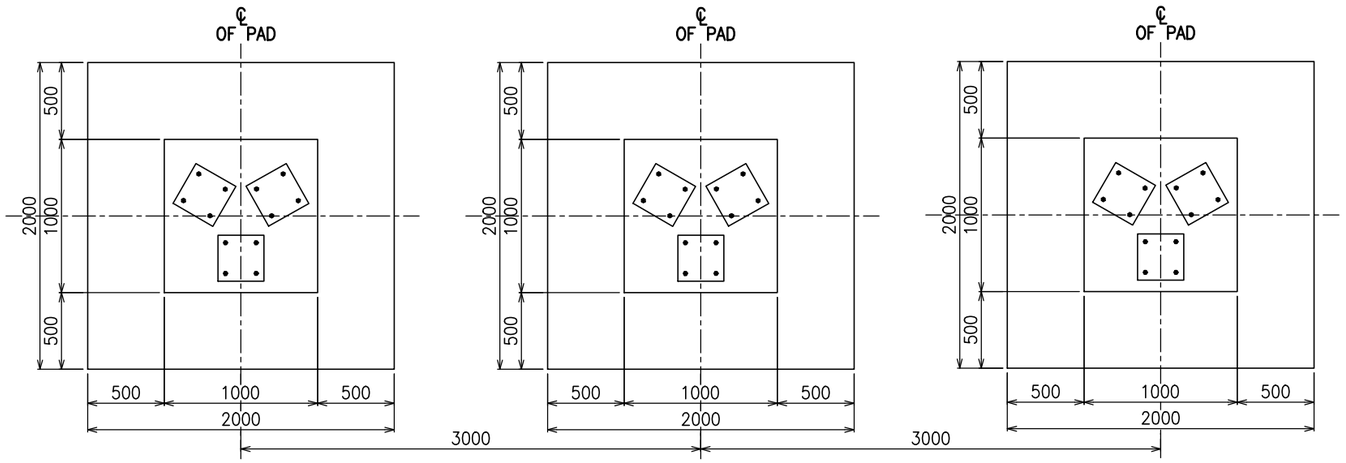



A FOUNDATION LAYOUT
SCALE 1:40

NOTES:


1. ALL DIMENSION ARE IN MILLIMETER UNLESS OTHERWISE INDICATED.
2. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH @ 28 DAYS OF f'c = 20.7 MPa (3000 PSI) LEAN CONCRETE, f'c = 14 MPa (2000 PSI).
3. ALL GRADE BARS SHALL CONFORM TO THE "STANDARD SPECIFICATION FOR DEFORMED AND PLANE BILLET STEEL BARS FOR CONCRETE REINFORCEMENT" ASTM 615M WITH THE FOLLOWING STRENGTH:
   FY = 414 MPa (ø16 OR GREATER)
   FY = 275 MPa (ø12 OR LESSER)
4. CONCRETE COVER MAY RANGE FROM 50 TO 75mm.
5. THE NET ALLOWABLE SOIL BEARING CAPACITY USED IS 98.17 kPa AT MINIMUM FOUNDING LEVEL OF 1.00M.
6. EQUIPMENT FOUNDATION MAY BE EMBEDDED DEEPER THAN THE INDICATED MINIMUM DEPTH TO AVOID COLLISION WITH OTHER CIVIL STRUCTURES ON SITE.

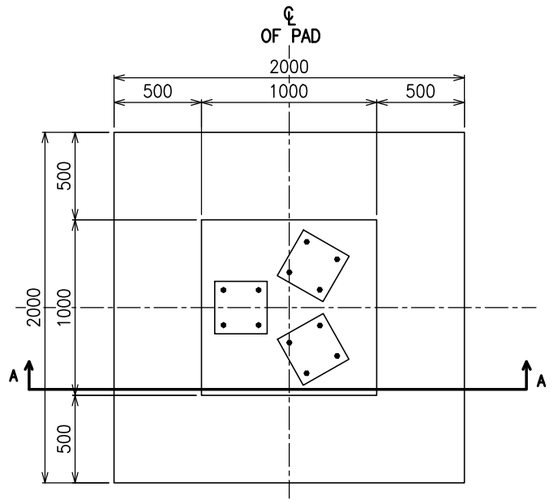

B FOUNDATION PLAN
SCALE 1:35

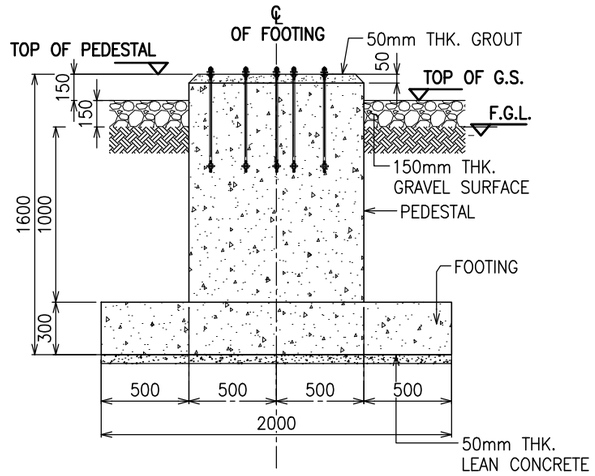


C FOUNDATION ELEVATION
SCALE 1:35

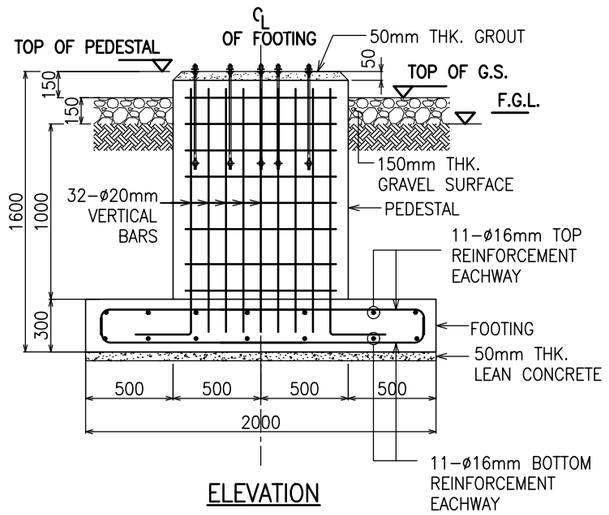


ELEVATION

D SECTION A
SCALE 1:35

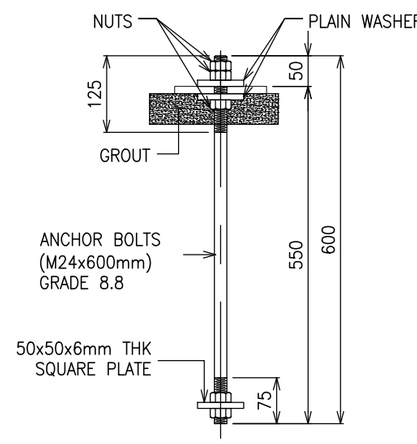


G ANCHOR BOLT DETAIL
SCALE NTS


NOTE:
* ALWAYS VERIFY DISTANCES & MEASUREMENTS AS PER ACTUAL CONDITION

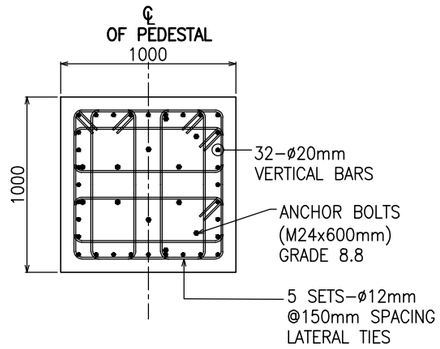


E PEDESTAL REINFORCEMENT DETAIL
SCALE 1:35

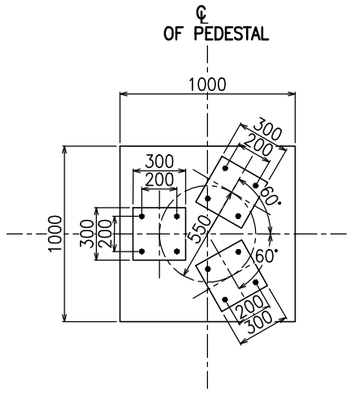

F ANCHOR BOLT LAYOUT
SCALE 1:35

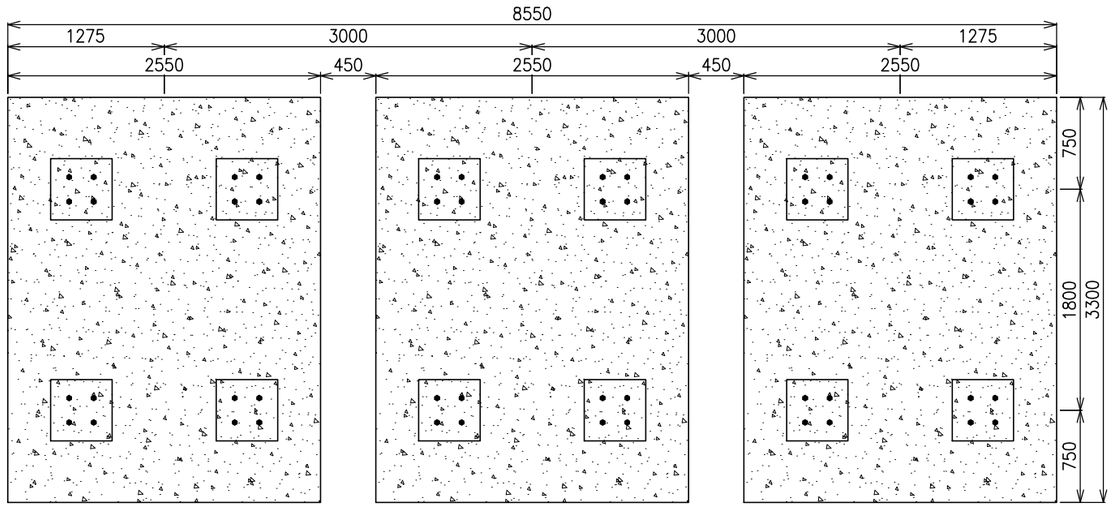


A FOUNDATION LAYOUT
SCALE 1:50

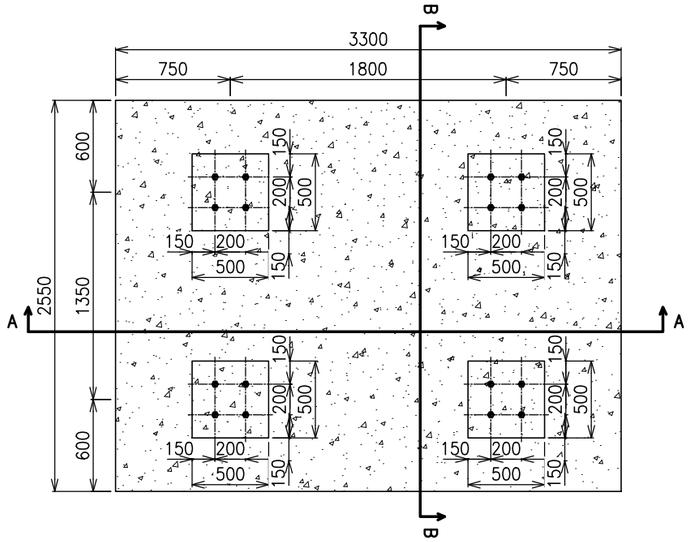


B FOUNDATION PLAN
SCALE 1:40

NOTES:


1. ALL DIMENSION ARE IN MILLIMETER UNLESS OTHERWISE INDICATED.
2. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH @ 28 DAYS OF f'c = 20.7 MPa (3000 PSI) LEAN CONCRETE, f'c = 14 MPa (2000 PSI).
3. ALL GRADE BARS SHALL CONFORM TO THE "STANDARD SPECIFICATION FOR DEFORMED AND PLANE BILLET STEEL BARS FOR CONCRETE REINFORCEMENT" ASTM 615M WITH THE FOLLOWING STRENGTH:
   FY = 414 MPa (ø16 OR GREATER)
   FY = 275 MPa (ø12 OR LESSER)
4. CONCRETE COVER MAY RANGE FROM 50 TO 75mm.
5. THE NET ALLOWABLE SOIL BEARING CAPACITY USED IS 98.17 kPa AT MINIMUM FOUNDING LEVEL OF 1.00M.
6. EQUIPMENT FOUNDATION MAY BE EMBEDDED DEEPER THAN THE INDICATED MINIMUM DEPTH TO AVOID COLLISION WITH OTHER CIVIL STRUCTURES ON SITE.

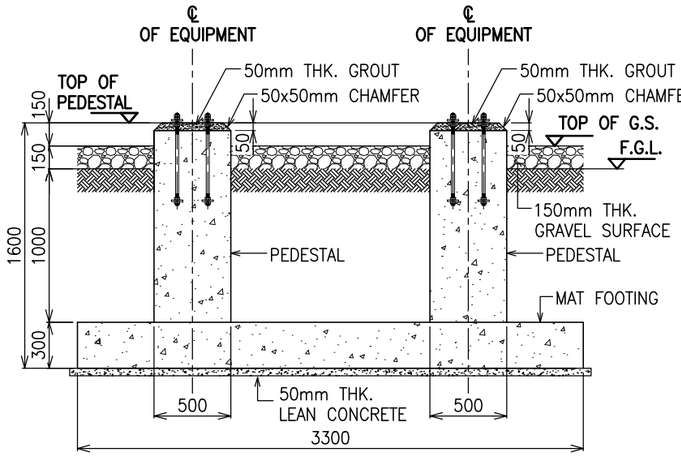


C FOUNDATION ELEVATION A
SCALE 1:40

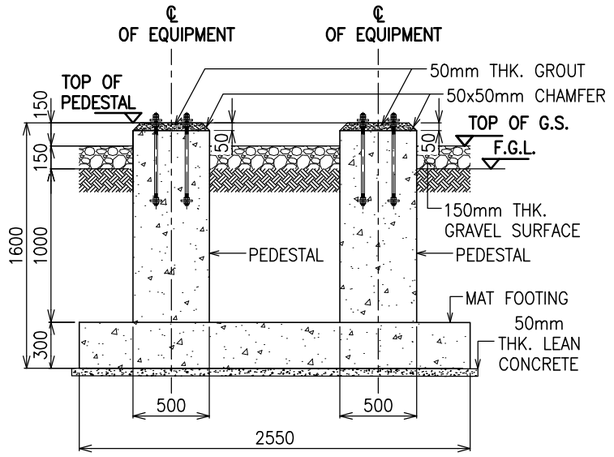


D FOUNDATION ELEVATION B
SCALE 1:40

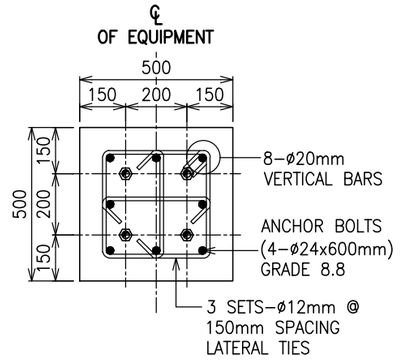


G PEDESTAL DETAIL
SCALE 1:20

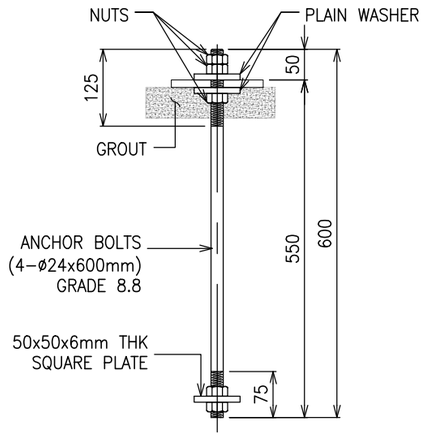

H ANCHOR BOLT DETAIL
SCALE 1:10

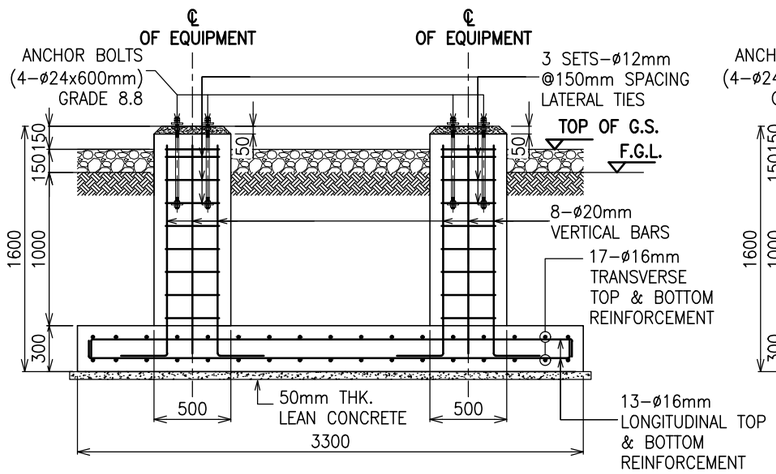


E SECTION A
SCALE 1:40

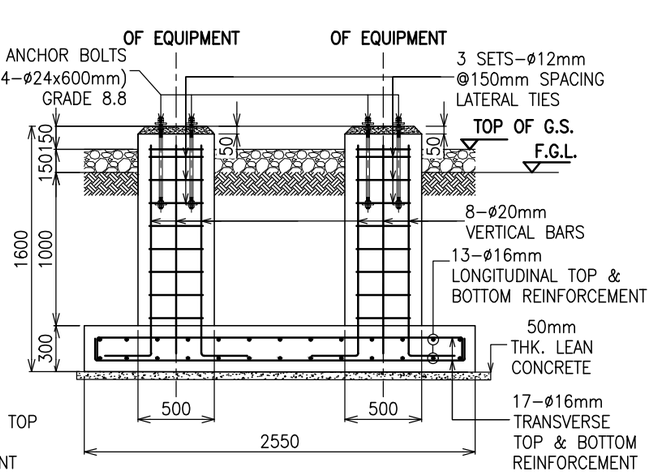


F SECTION B
SCALE 1:40


69kV GANTRY	DIMENSIONAL PROPERTIES						SCHEDULE OF REINFORCEMENT			
	a	B	H	D	d	b	LATERAL TIES	REBAR "A"	REBAR "B"	REBAR "C"
F-1	1000	4600	2000	2200	500	1800	2-SETS OF 12mmØ, 1@50, REST @100mm O.C.	24-25mmø	25-20mmØ EQ. SPACED, B.W.	25-20mmØ EQ. SPACED, B.W.

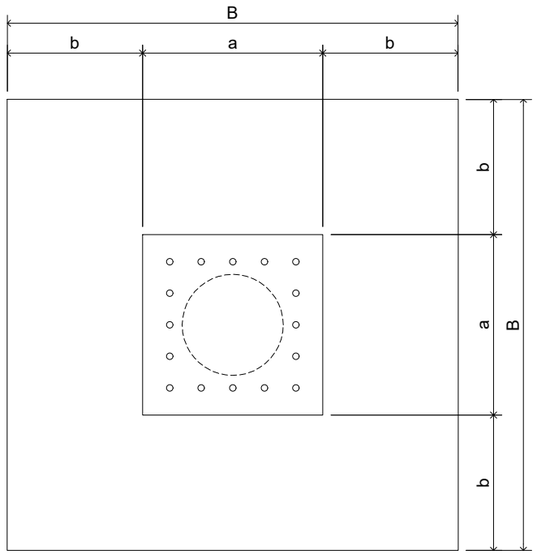

A FOUNDATION PLAN
SCALE 1:20

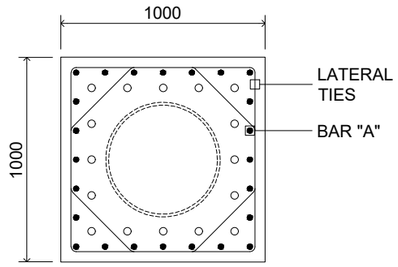

C PEDESTAL DETAIL
SCALE 1:30

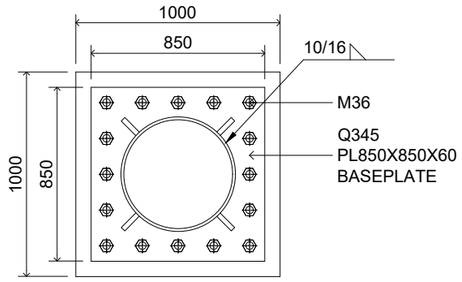

D BASE PLATE & ANCHOR BOLT LAYOUT
SCALE 1:30

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. ALL STRUCTURAL MEMBERS SHALL BE HOT-DIPPED GALVANIZED, ASTM A123 & ASTM A153 OR 5.4.3. 600g/sq.m. ZINC (min.)
3. ALLOWABLE SOIL BEARING CAPACITY = 198kPa
4. DETAILS OF REINFORCING BARS (SPLICES, BENDS, HOOKS, ETC.) SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ACI CODE.
5. FOR WELDING SPECIFICATIONS, REFER TO NOTES ON EQUIPMENT STEEL STRUCTURE.
6. ALL ASPECTS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF THE ACI CODE.
7. STRENGTH OF MATERIALS;
   STEEL MEMBERS, ALL
   - HIGH TENSILE STEEL : A572G50 Fy = 345MPa, Fu = 450MPa
   BOLTS, NUTS & WASHERS
   - STEEL NUTS : ASTM A563
   - STEEL WASHERS : ASTM F436
   - ANCHOR BOLTS : CLASS 8.8

   fc' = 211 kg./sq. cm FOR REINF. CONC. @ 28-DAY
   fc' = 141 kg./sq. cm FOR LEAN CONCRETE


   REINFORCING BARS, PNS STD
   : fy = 275MPa (Gr. 40), ≤12mmø
   : fy = 420MPa (Gr. 60), ≥16mmø

NOMENCLATURES:


FGS	-	FINISH GRAVEL SURFACE
FGL	-	FINISH GROUND LEVEL
TCP	-	TOP OF CONCRETE PEDESTAL

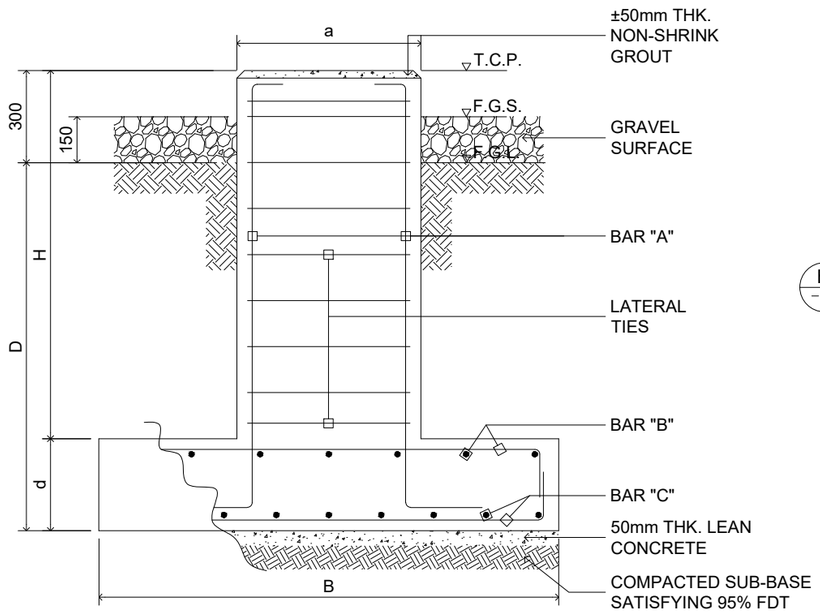


B ELEVATION
SCALE NTS

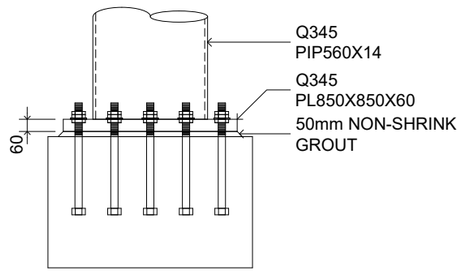


E BASE PLATE & ANCHOR BOLT SECTION
SCALE 1:30



G STIFFENER DETAIL
SCALE 1:15

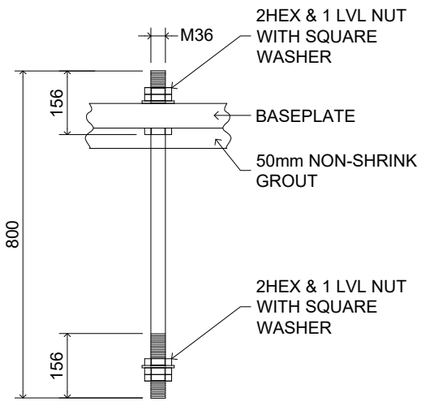


F ANCHOR BOLT DETAIL
SCALE 1:15

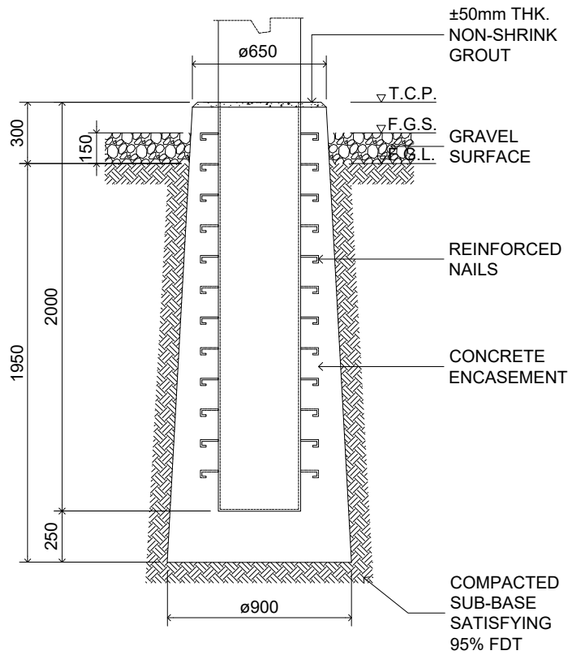


A ELEVATION

SCALE NTS

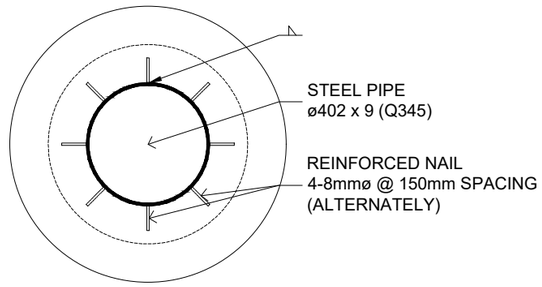

B FOUNDATION PLAN

SCALE 1:30

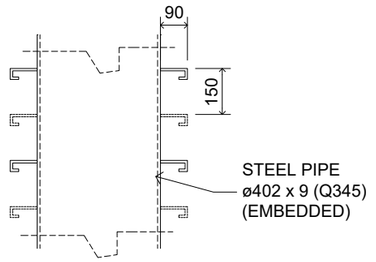

C EMBEDMENT DETAIL

SCALE 1:20

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE INDICATED.
2. ALL STRUCTURAL MEMBERS SHALL BE HOT-DIPPED GALVANIZED, ASTM A123 & ASTM A153 OR 5.4.3. 600g/sq.m. ZINC (min.)
3. ALLOWABLE SOIL BEARING CAPACITY = 198kPa
4. DETAILS OF REINFORCING BARS (SPLICES, BENDS, HOOKS, ETC.) SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF ACI CODE.
5. FOR WELDING SPECIFICATIONS, REFER TO NOTES ON EQUIPMENT STEEL STRUCTURE.
6. ALL ASPECTS OF CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE PROVISIONS OF THE ACI CODE.
7. STRENGTH OF MATERIALS;
   STEEL MEMBERS, ALL
   - HIGH TENSILE STEEL : A572G50 Fy = 345MPa
     Fu = 450MPa


   BOLTS, NUTS & WASHERS
   - STEEL NUTS : ASTM A563
   - STEEL WASHERS : ASTM F436
   - ANCHOR BOLTS : CLASS 8.8

   fc' = 211 kg./sq. cm FOR REINF. CONC. @ 28-DAY
   fc' = 141 kg./sq. cm FOR LEAN CONCRETE

   REINFORCING BARS, PNS STD
   : fy = 275MPa (Gr. 40), ≤12mmø
   : fy = 420MPa (Gr. 60), ≥16mmø

NOMENCLATURES:

FGS	-	FINISH GRAVEL SURFACE
FGL	-	FINISH GROUND LEVEL
TCP	-	TOP OF CONCRETE PEDESTAL

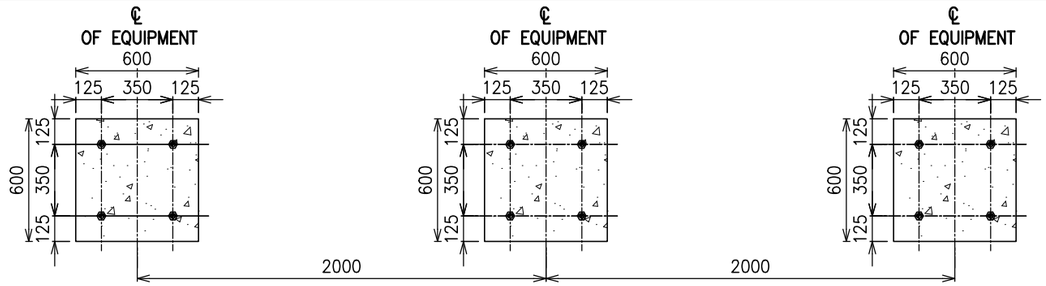


PLAN AT BASE

A — PEDESTAL LAYOUT

SCALE 1:30


NOTES:

1. ALL DIMENSION ARE IN MILLIMETER UNLESS OTHERWISE INDICATED.
2. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH @ 28 DAYS OF f'c = 20.7 MPa (3000 PSI) LEAN CONCRETE, f'c = 14 MPa (2000 PSI).
3. ALL GRADE BARS SHALL CONFORM TO THE "STANDARD SPECIFICATION FOR DEFORMED AND PLANE BILLET STEEL BARS FOR CONCRETE REINFORCEMENT" ASTM 615M WITH THE FOLLOWING STRENGTH:
   FY = 414 MPa (ø16 OR GREATER)
   FY = 275 MPa (ø12 OR LESSER)
4. CONCRETE COVER MAY RANGE FROM 50 TO 75mm.
5. THE NET ALLOWABLE SOIL BEARING CAPACITY USED IS 98.17 kPa AT MINIMUM FOUNDING LEVEL OF 1.00M.
6. EQUIPMENT FOUNDATION MAY BE EMBEDDED DEEPER THAN THE INDICATED MINIMUM DEPTH TO AVOID COLLISION WITH OTHER CIVIL STRUCTURES ON SITE.

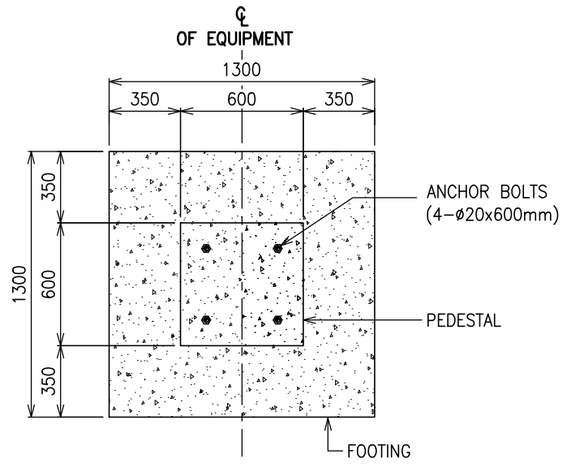


B — FOUNDATION PLAN

SCALE 1:30

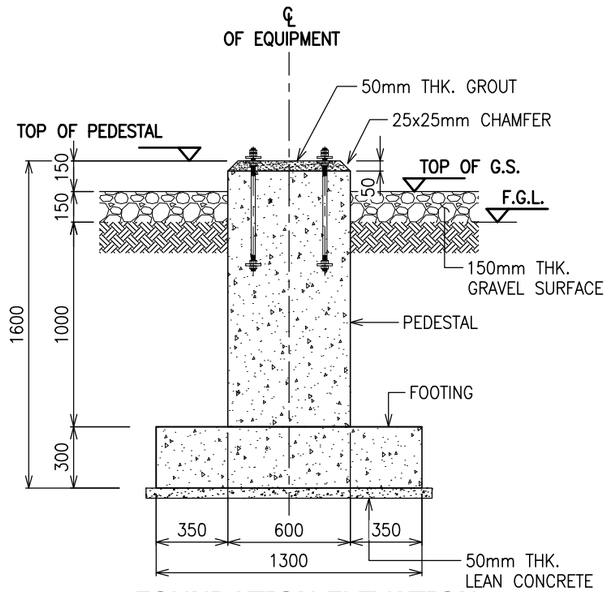


C — FOUNDATION ELEVATION

SCALE 1:30

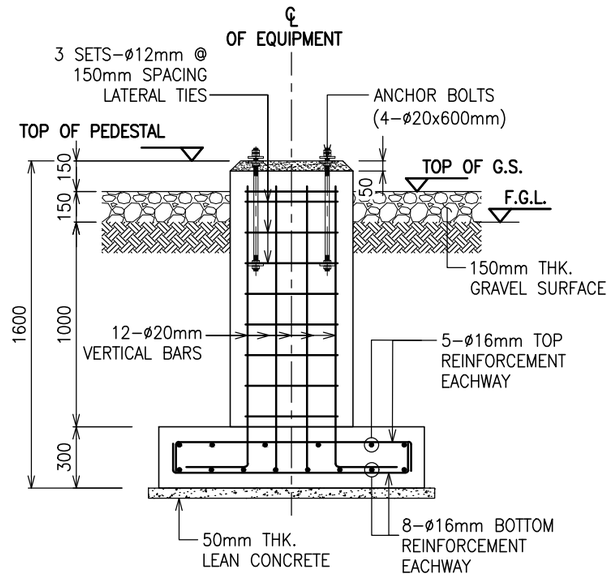


D — TYPICAL FOUNDATION DETAILS

SCALE 1:30

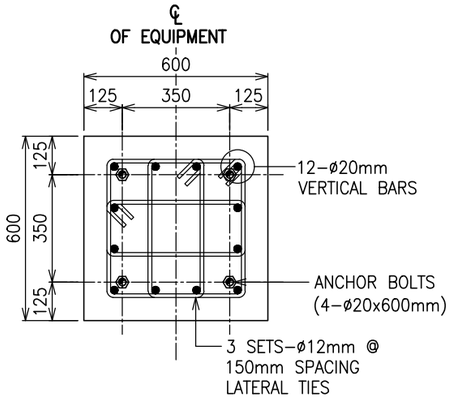

E — PEDESTAL DETAIL

SCALE 1:20

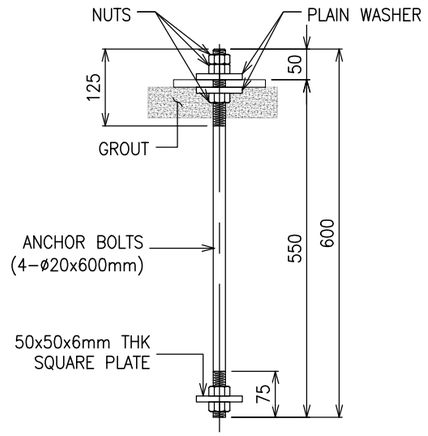

F — ANCHOR BOLT DETAIL

SCALE 1:10