



Y
X
Z

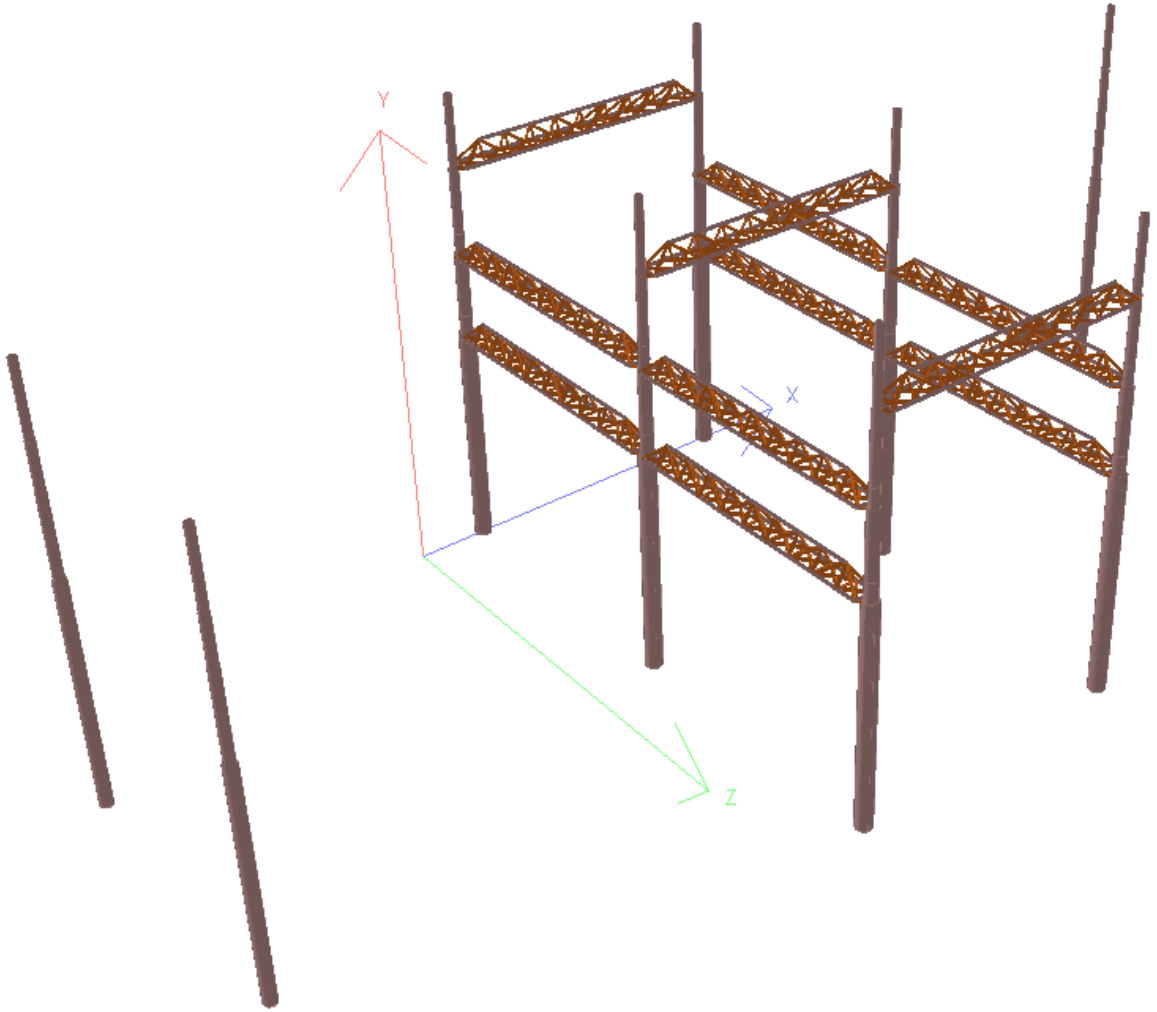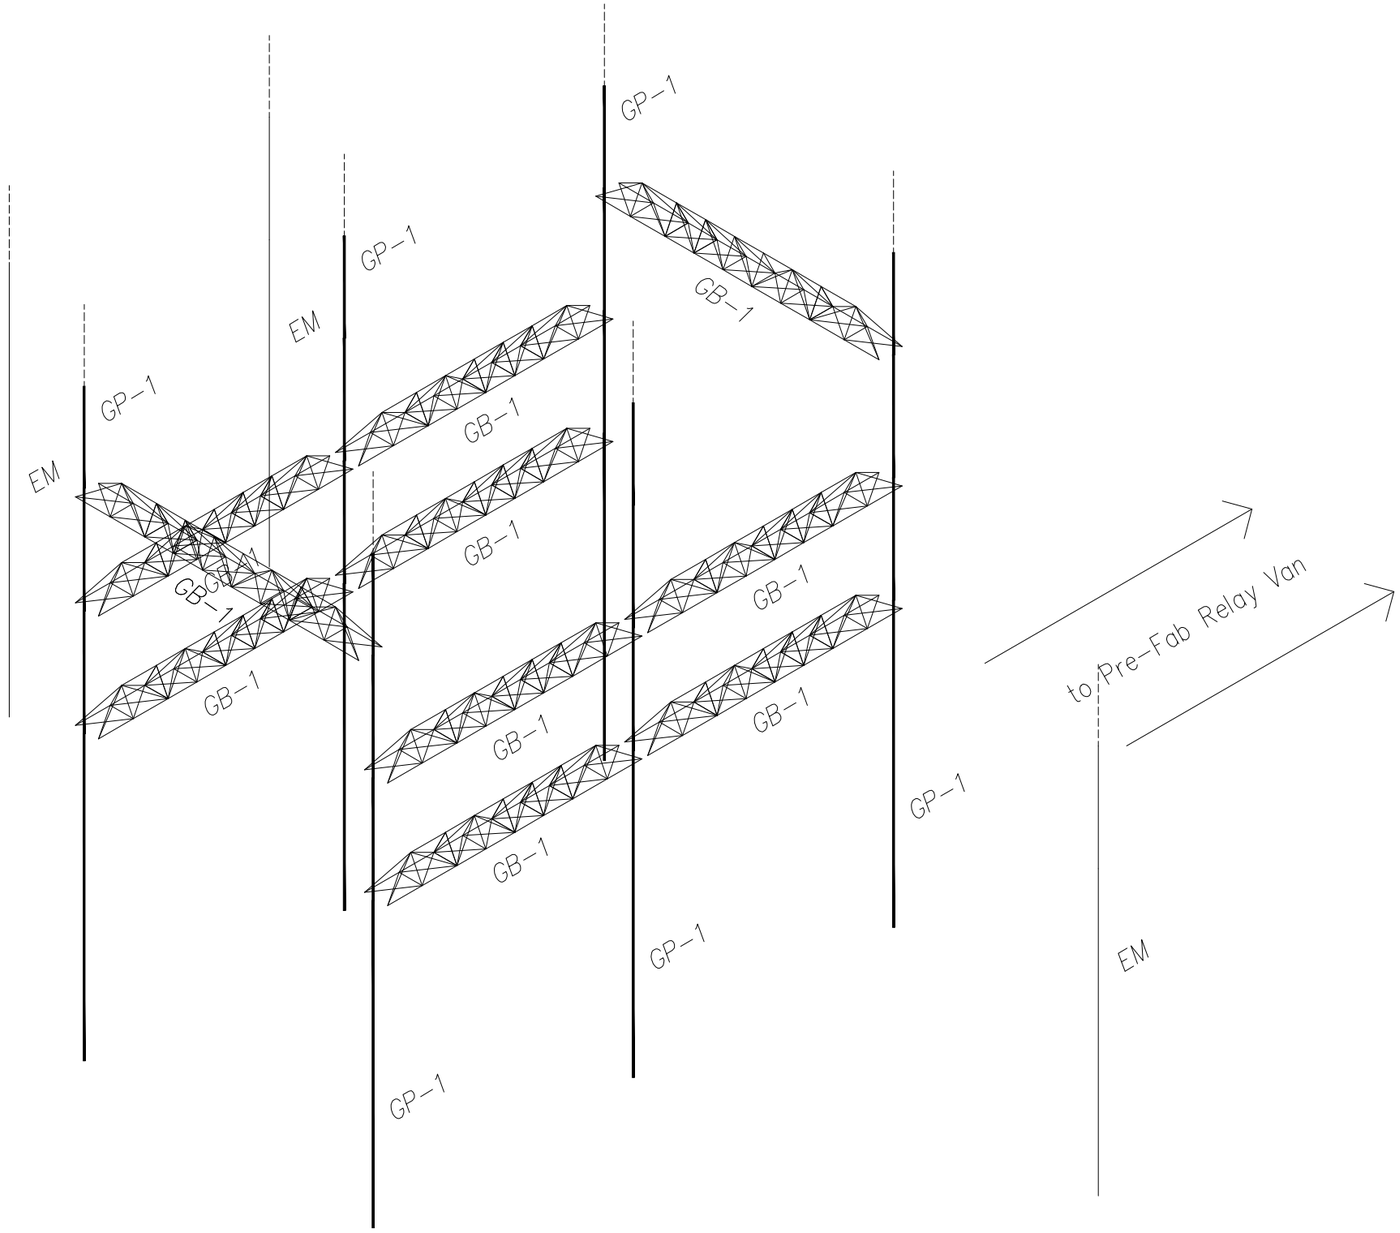


A 69kV GANTRY & EARTHING MAST PERSPECTIVE

SCALE NTS

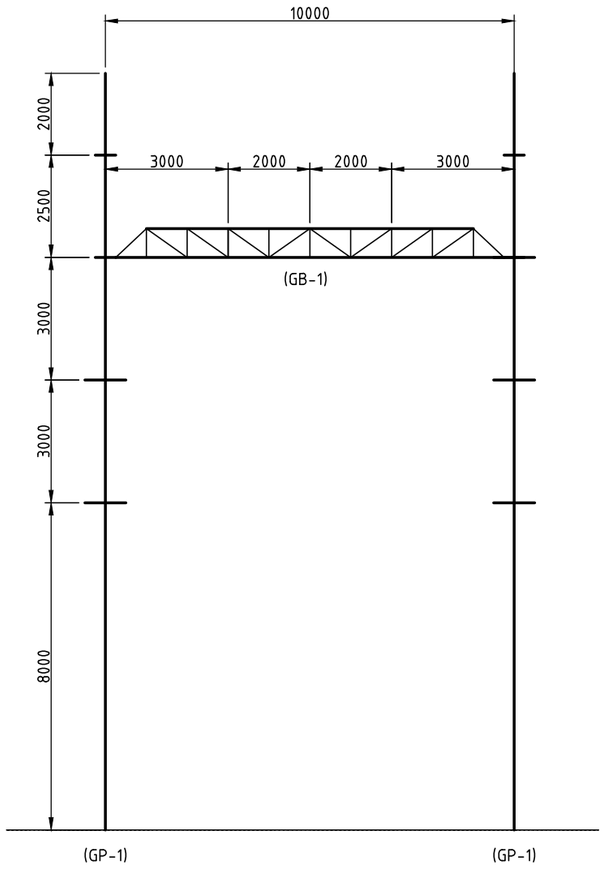

A ELEVATION 1
SCALE 1:150

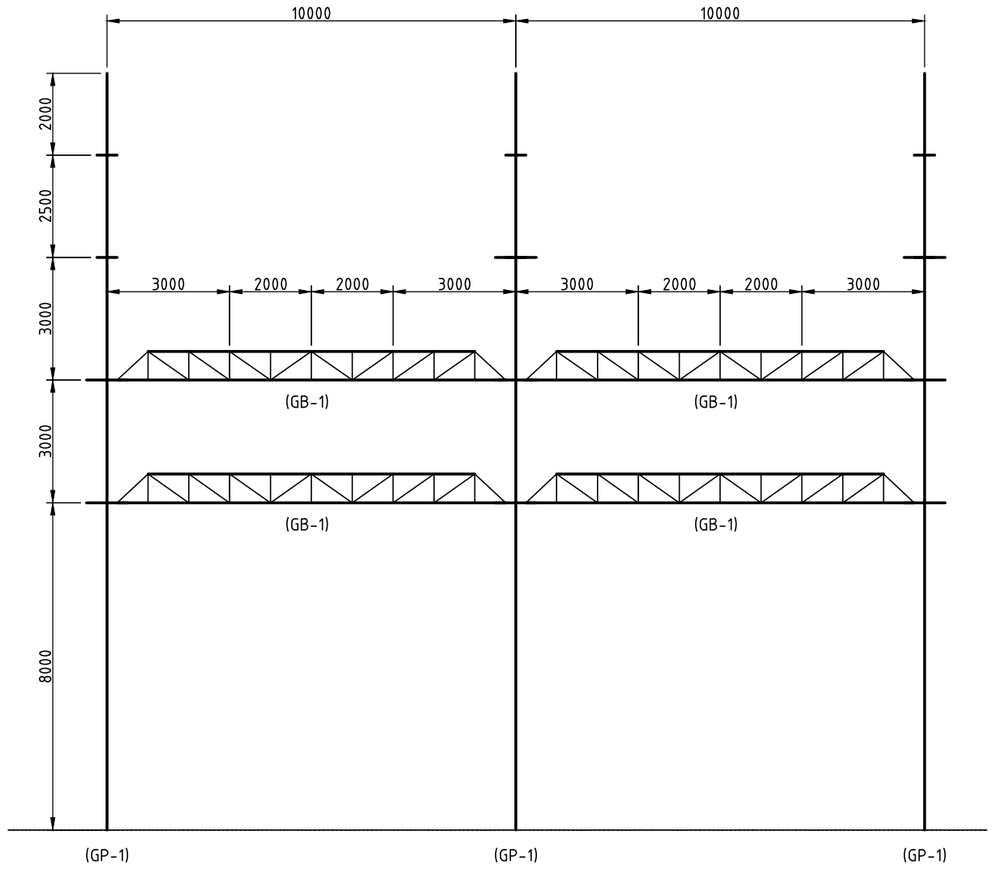


B ELEVATION 2
SCALE 1:150

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS.
2. MATERIALS
   a. STRUCTURAL STEEL :
      HIGH STRENGTH Fy = 345MPa (min)
      Fu = 450MPa (min)
   b. BOLTS, NUTS & WASHER
      – CONNECTION BOLTS : ASTM A325
      – STEEL NUTS : ASTM A563
      – STEEL WASHERS : ASTM F436
      – STEP BOLTS : ASTM A325
      – ANCHOR BOLTS : ASTM A325
3. ALL MATERIALS SUCH AS STRUCTURES, BOLTS, NUTS AND PLATES SHALL BE HOT– DIPPED GALVANIZED.
4. EARTHING POINT HOLE WILL BE REFLECTED IN THE SHOP DRAWING.
5. ALL OTHER ACCESSORIES (PHASE INDICATION PLATES, STEP BOLTS, LIGHTNING ROD, CONDUCTOR ATTACHMENT, ETC.) AS REQUIRED IN THE STEEL STRUCTURES SPECIFICATIONS WILL BE REFLECTED IN THE SHOP/FABRICATION DRAWING.

T.O.P. – TOP OF (CONCRETE) PEDESTAL

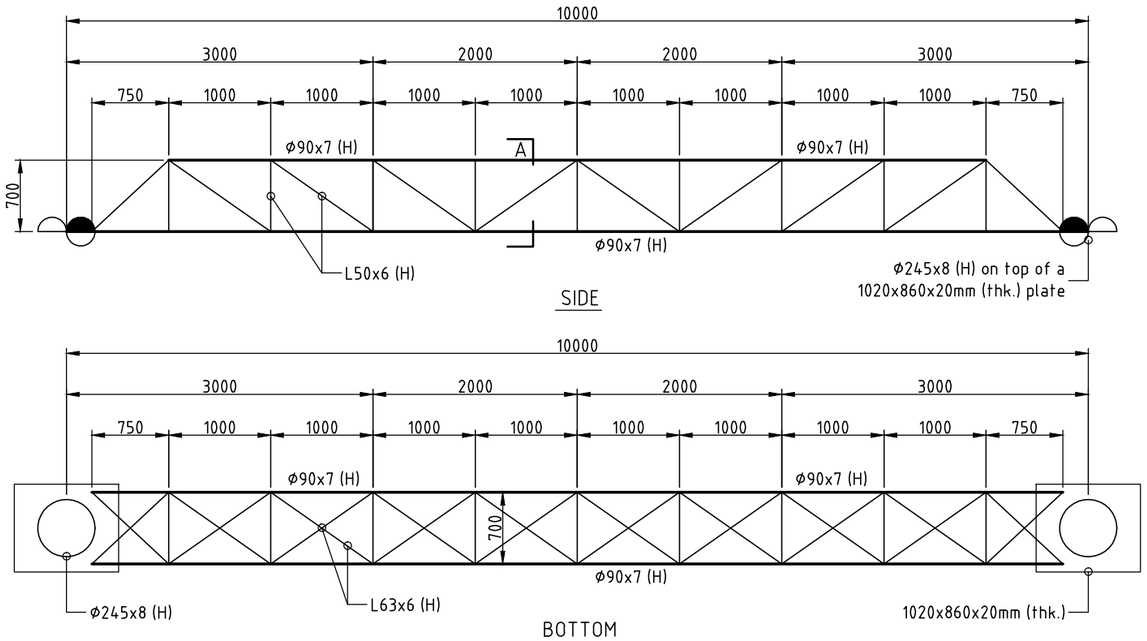

A — GANTRY BEAM (GB-1)

SCALE 1:60




SECTION A-A

SCALE: 1:60

NOTES:


1. ALL DIMENSIONS ARE IN MILLIMETERS.
2. MATERIALS
   a. STRUCTURAL STEEL :
      HIGH STRENGTH Fy = 345MPa (min)
      Fu = 450MPa (min)
   b. BOLTS, NUTS & WASHER
      - CONNECTION BOLTS : ASTM A325
      - STEEL NUTS : ASTM A563
      - STEEL WASHERS : ASTM F436
      - STEP BOLTS : ASTM A325
      - ANCHOR BOLTS : ASTM A325
3. ALL MATERIALS SUCH AS STRUCTURES, BOLTS, NUTS AND PLATES SHALL BE HOT– DIPPED GALVANIZED.
4. EARTHING POINT HOLE WILL BE REFLECTED IN THE SHOP DRAWING.
5. ALL OTHER ACCESSORIES (PHASE INDICATION PLATES, STEP BOLTS, LIGHTNING ROD, CONDUCTOR ATTACHMENT, ETC.) AS REQUIRED IN THE STEEL STRUCTURES SPECIFICATIONS WILL BE REFLECTED IN THE SHOP/FABRICATION DRAWING.

T.O.P. – TOP OF (CONCRETE) PEDESTAL

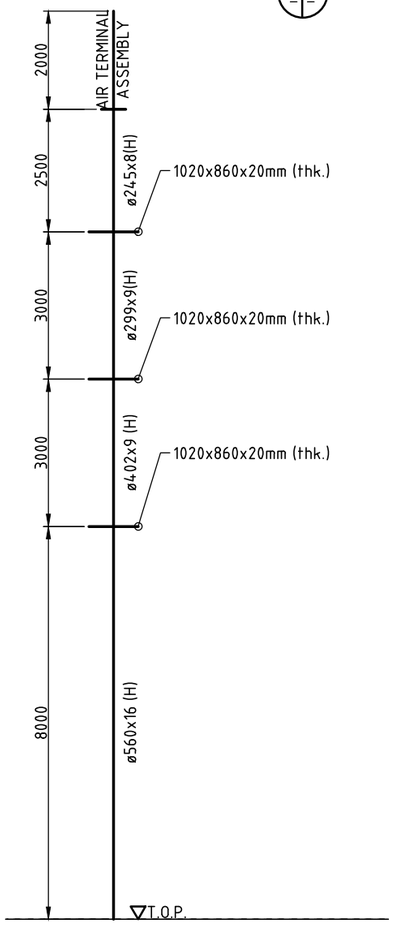

B — GANTRY POST (GP-1)

SCALE 1:125

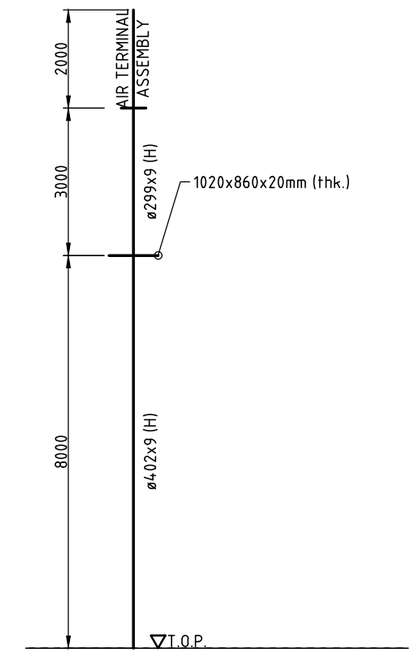

C — EARTHING MAST (EM)

SCALE 1:125