




AI closed loop vs rule-based baseline — comfort preserved energyplus · qwen2.5:3b · run submission

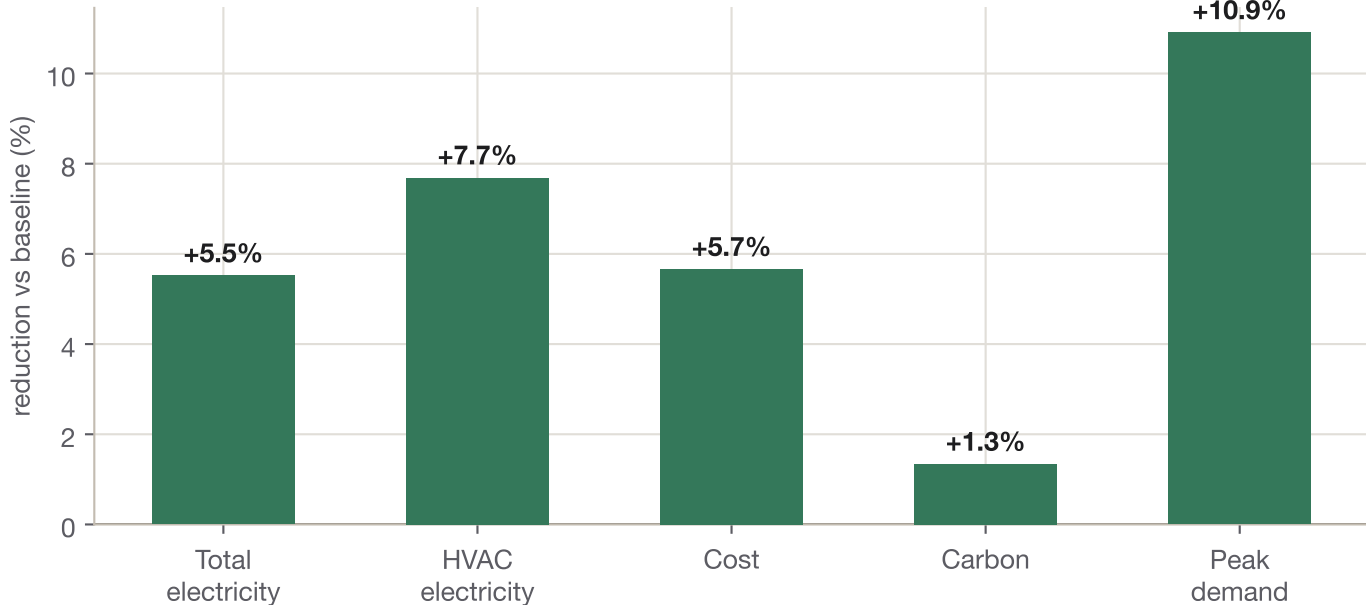

Cumulative electricity — the gap is the saving

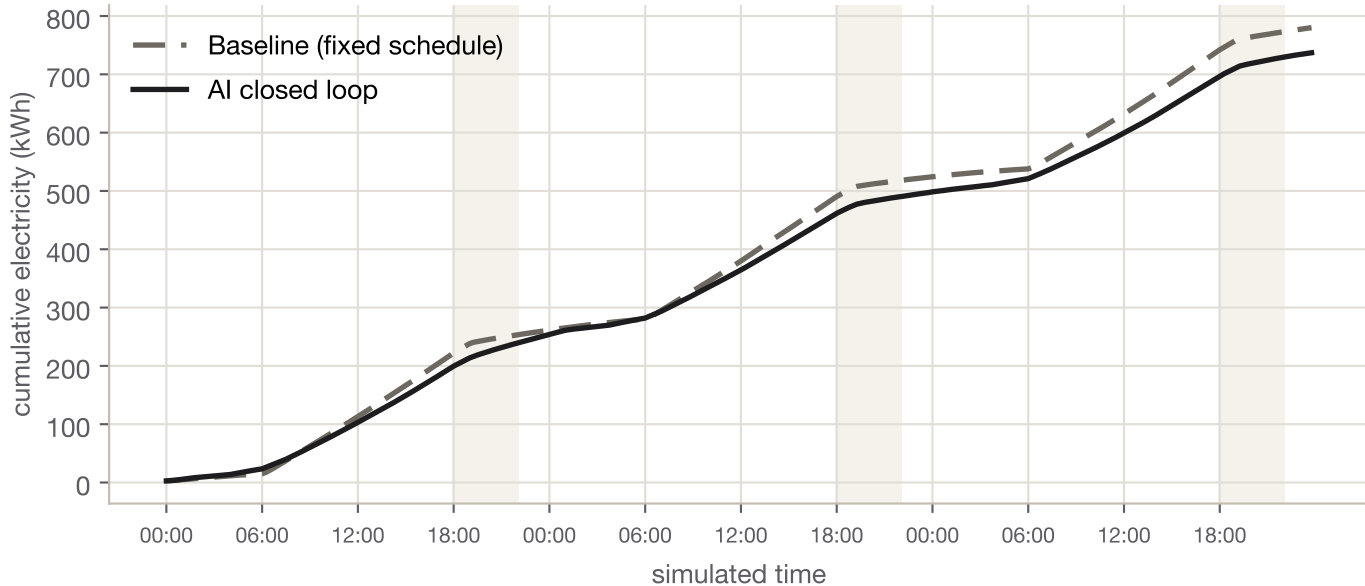

Zone temperature against the comfort envelope

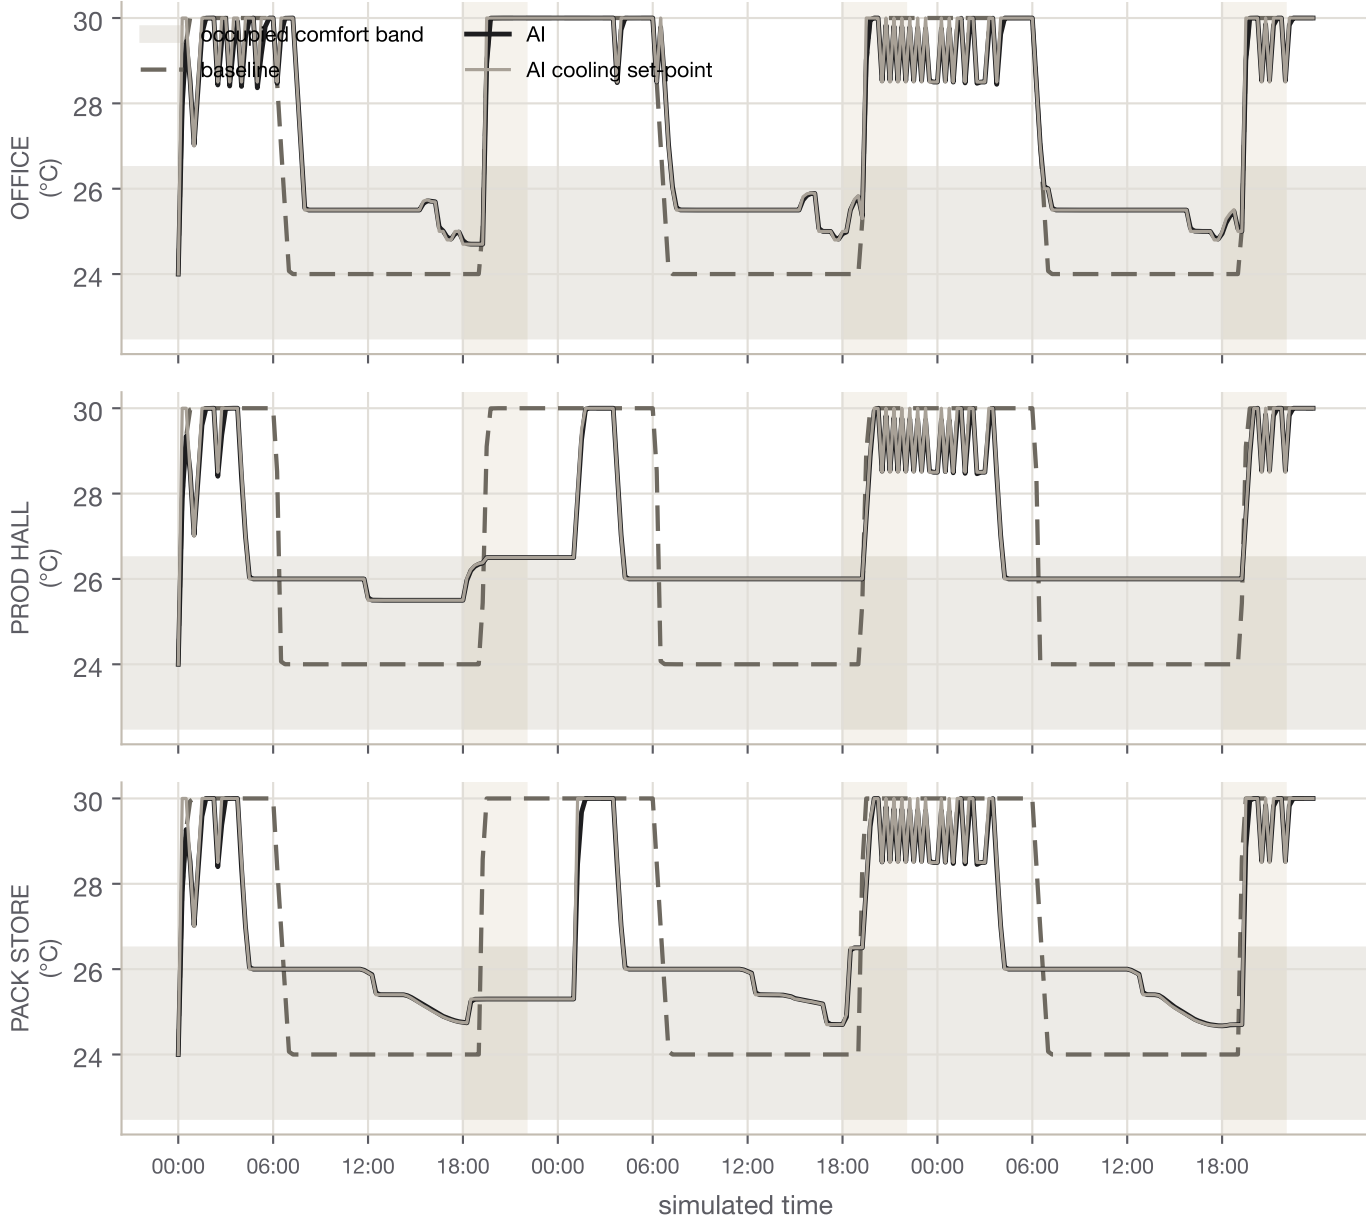

Comfort and air quality — the constraint side of the ledger

hatched spans are unoccupied and are not counted against comfort

