


PLANT ELECTRICAL DISTRIBUTION

CONSOLIDATED SINGLE-LINE DIAGRAM / POWER, PROTECTION AND METERING

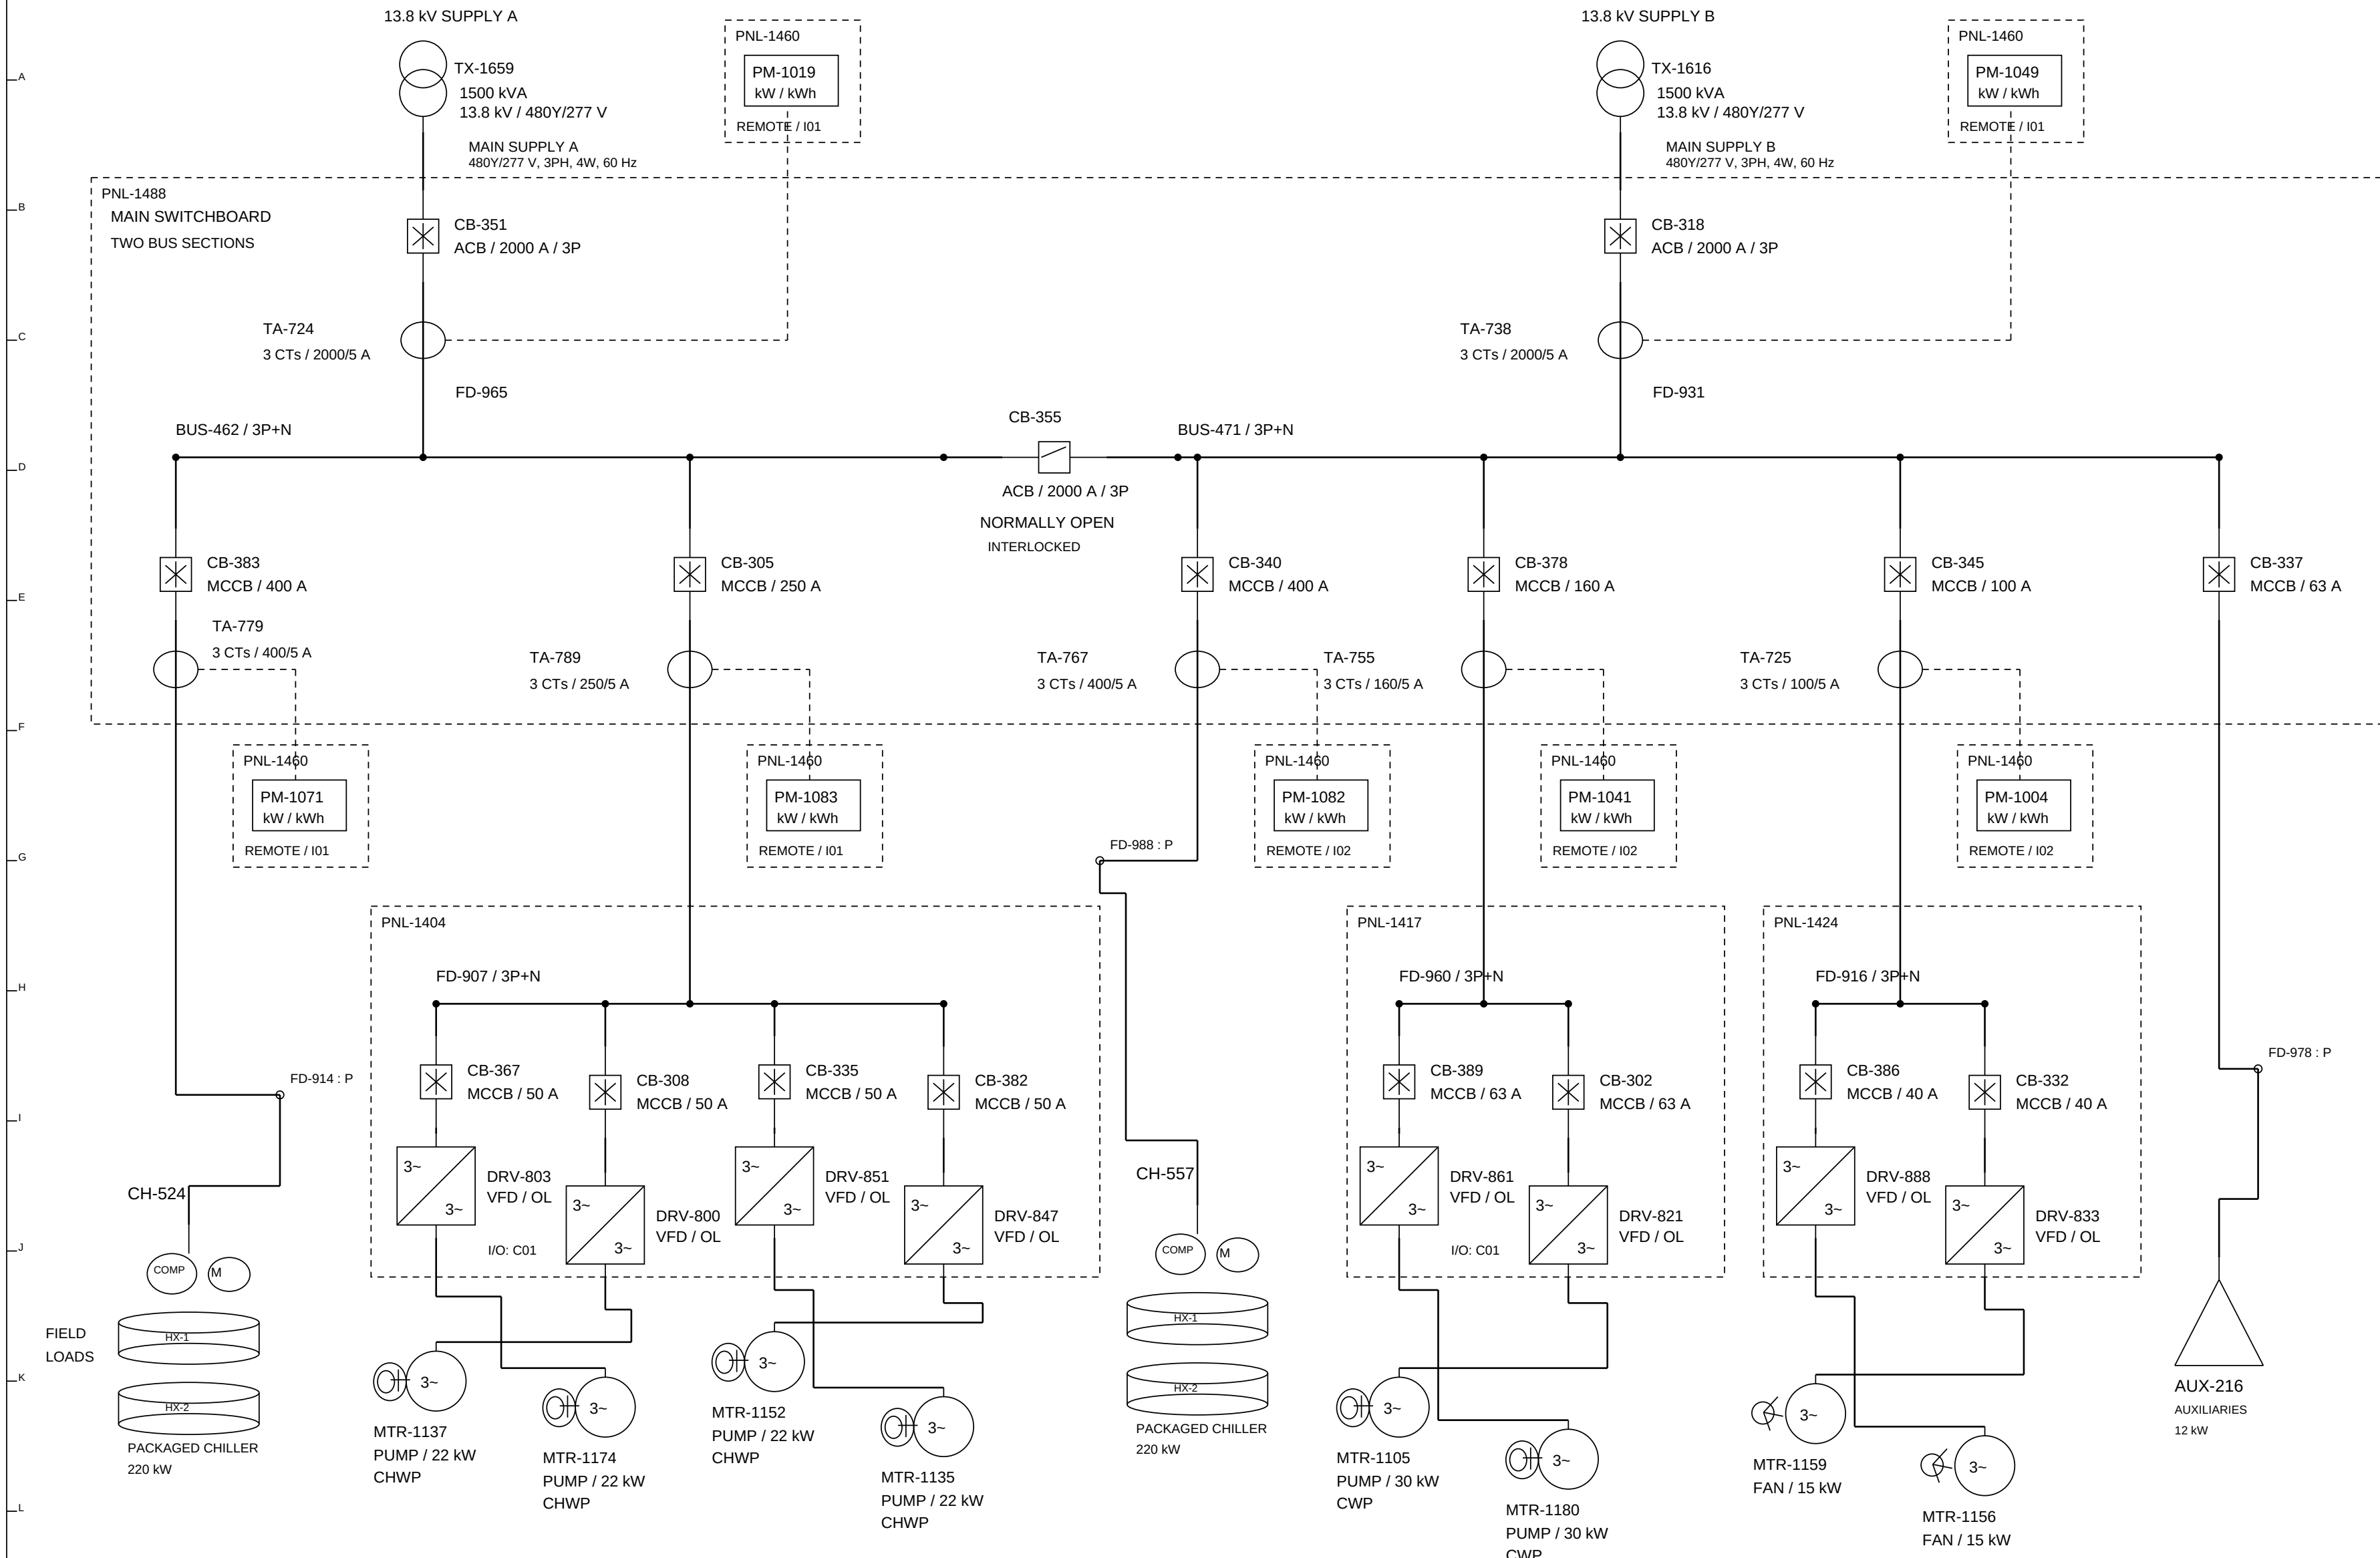

SYMBOLS AND LINE CONVENTIONS

- Transformer / supply
- Circuit breaker; rating shown
- CT set / three phase
- Remote digital meter
- Solid: 3-phase power path
- Dashed: measurement link

PERMITTED SWITCH CONFIGURATIONS

STATE	CB-351	CB-318	CB-355
S0	C	C	O
S1	O	C	O
S2	O	C	C

C = closed O = open
Other MCCBs closed for these states.
Open transition; no source paralleling.

SUPPORTING DRAWINGS

- S01 Consolidated distribution
- I01 Meter terminal circuits / 1
- I02 Meter terminal circuits / 2
- C01 Representative drive controls

GENERAL NOTES

Filled dot: electrical junction.
Crossing without dot: no connection.
Dashed lead: CT-to-meter association.
CHWP: chilled-water pump
CWP: condenser-water pump





DRAWING REGISTER

PLANT LV DISTRIBUTION
S01 | 2026-09-17
A2 LANDSCAPE | NTS
SINGLE-LINE DIAGRAM

S01

METER WIRING / CT SECONDARY AND VOLTAGE-INPUT CIRCUITS

ELECTRICAL SYSTEMS / 480Y/277 V / 60 Hz

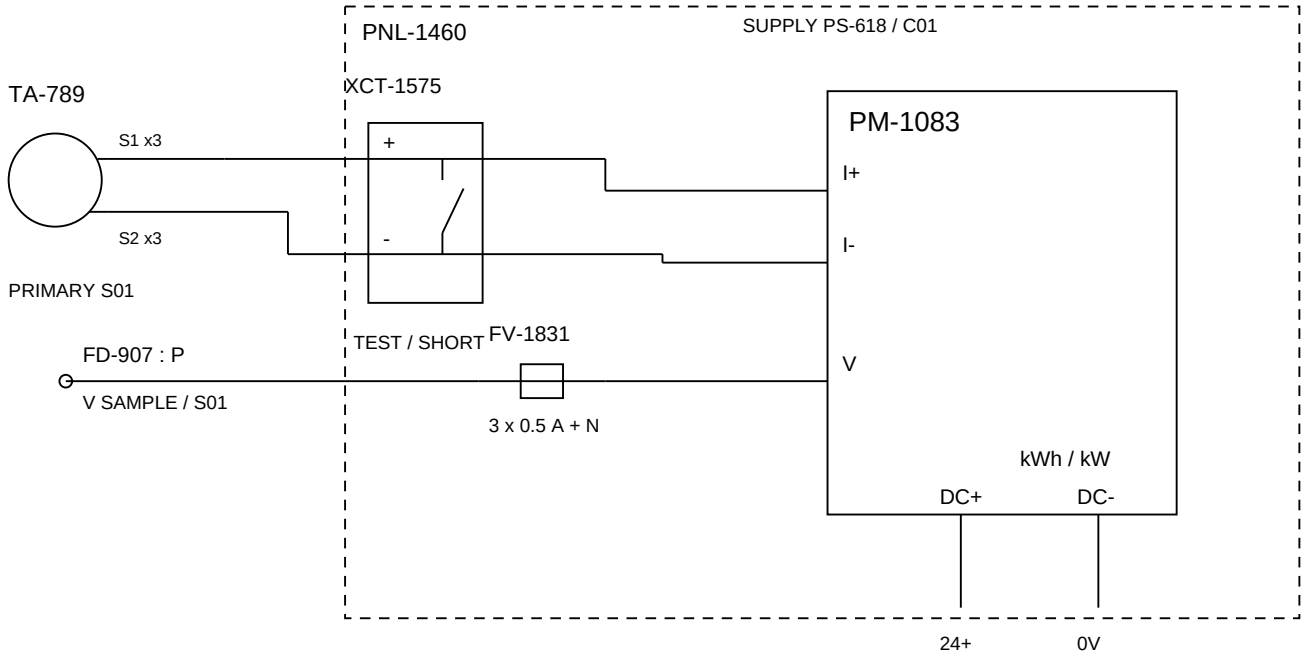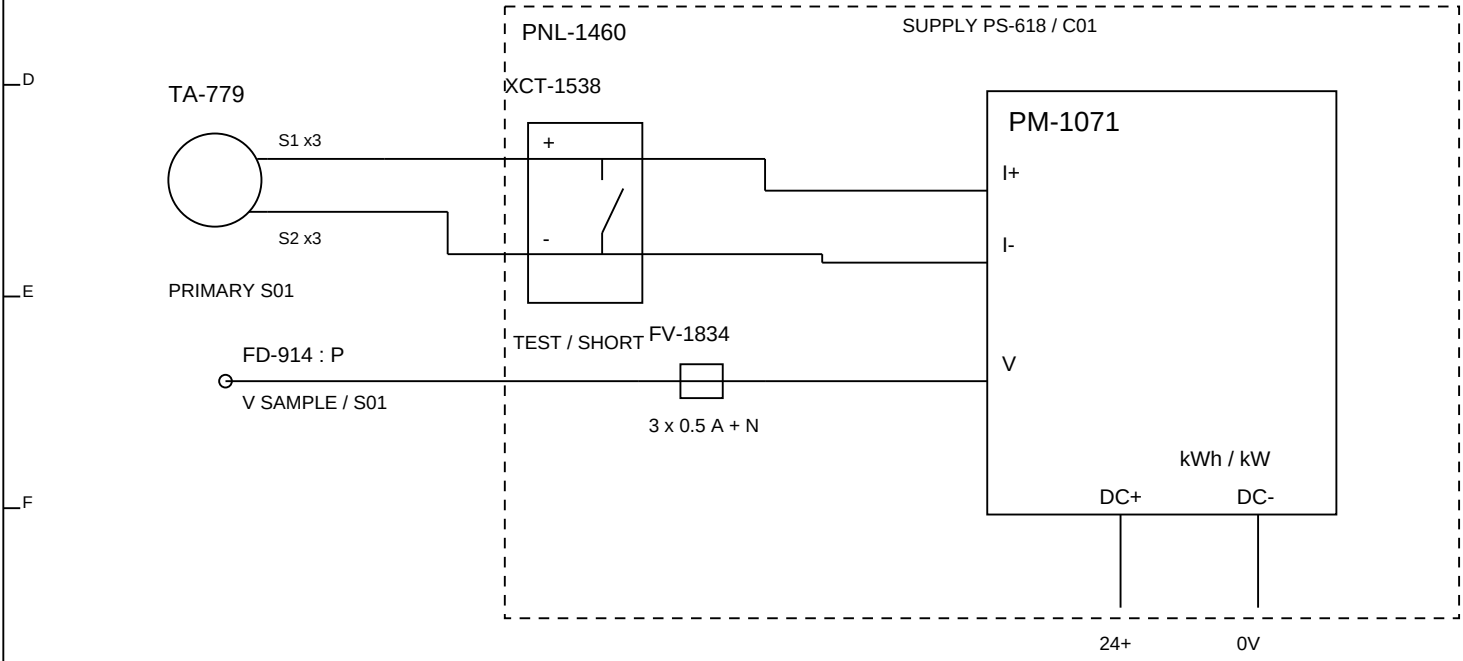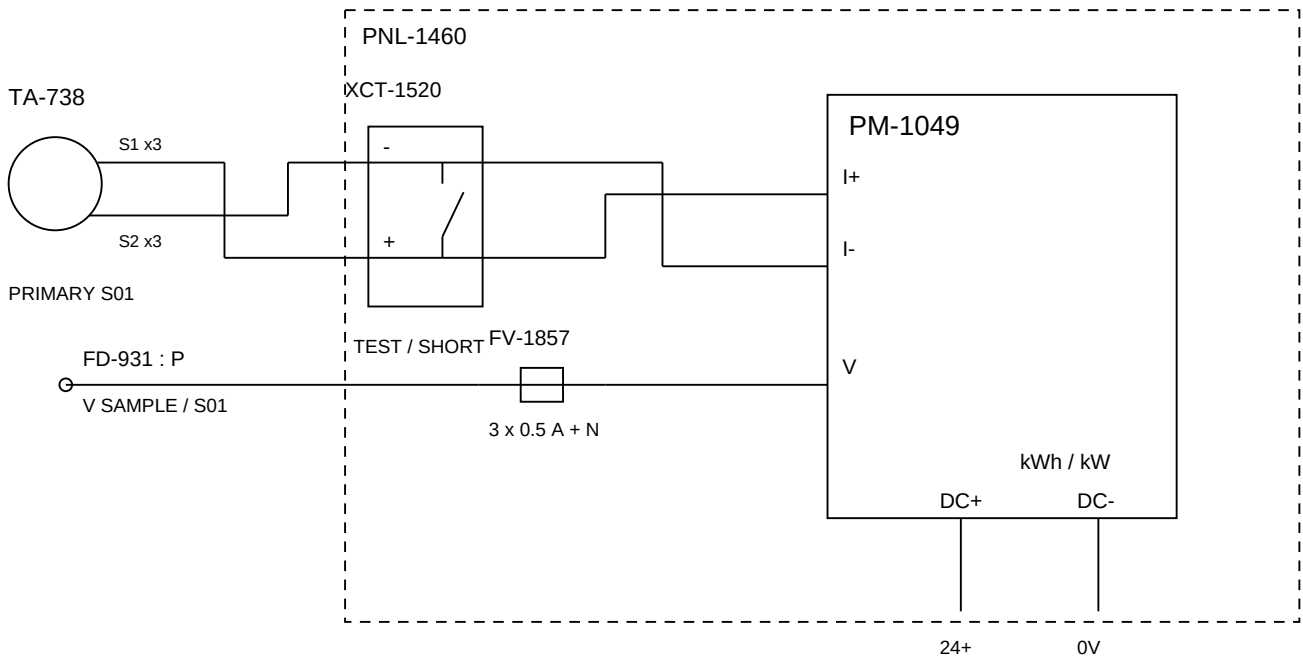
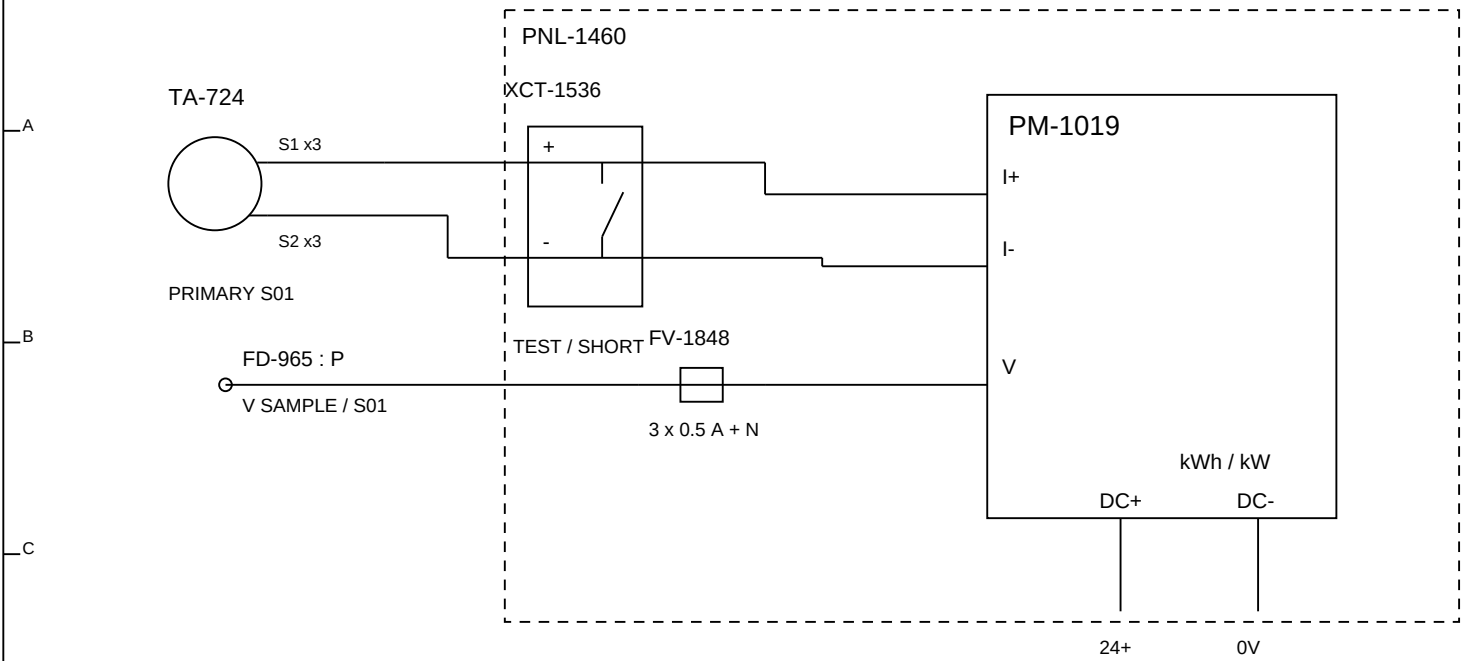


CURRENT: each pair represents 3 isolated phase pairs (L1, L2, L3), S1 to I+ and S2 to I-. Shorting links OPEN in service.
VOLTAGE: 3 fused phase leads + unfused N; 0.5 A phase fuses. DC power: independent 24 V supply on C01. Bundles do not imply shorts.

ELECTRICAL SYSTEMS / PRIMARY DISTRIBUTION: S01

METER WIRING / CT SECONDARY AND VOLTAGE-INPUT CIRCUITS

ELECTRICAL SYSTEMS / 480Y/277 V / 60 Hz

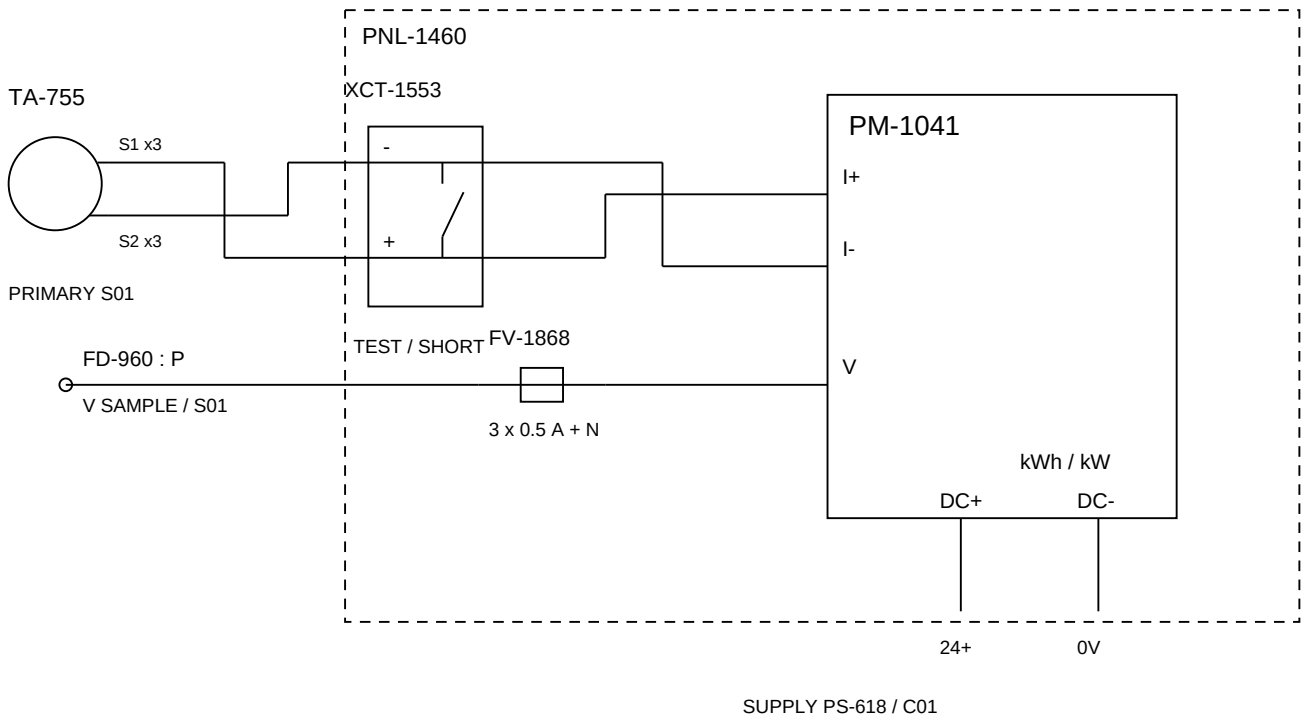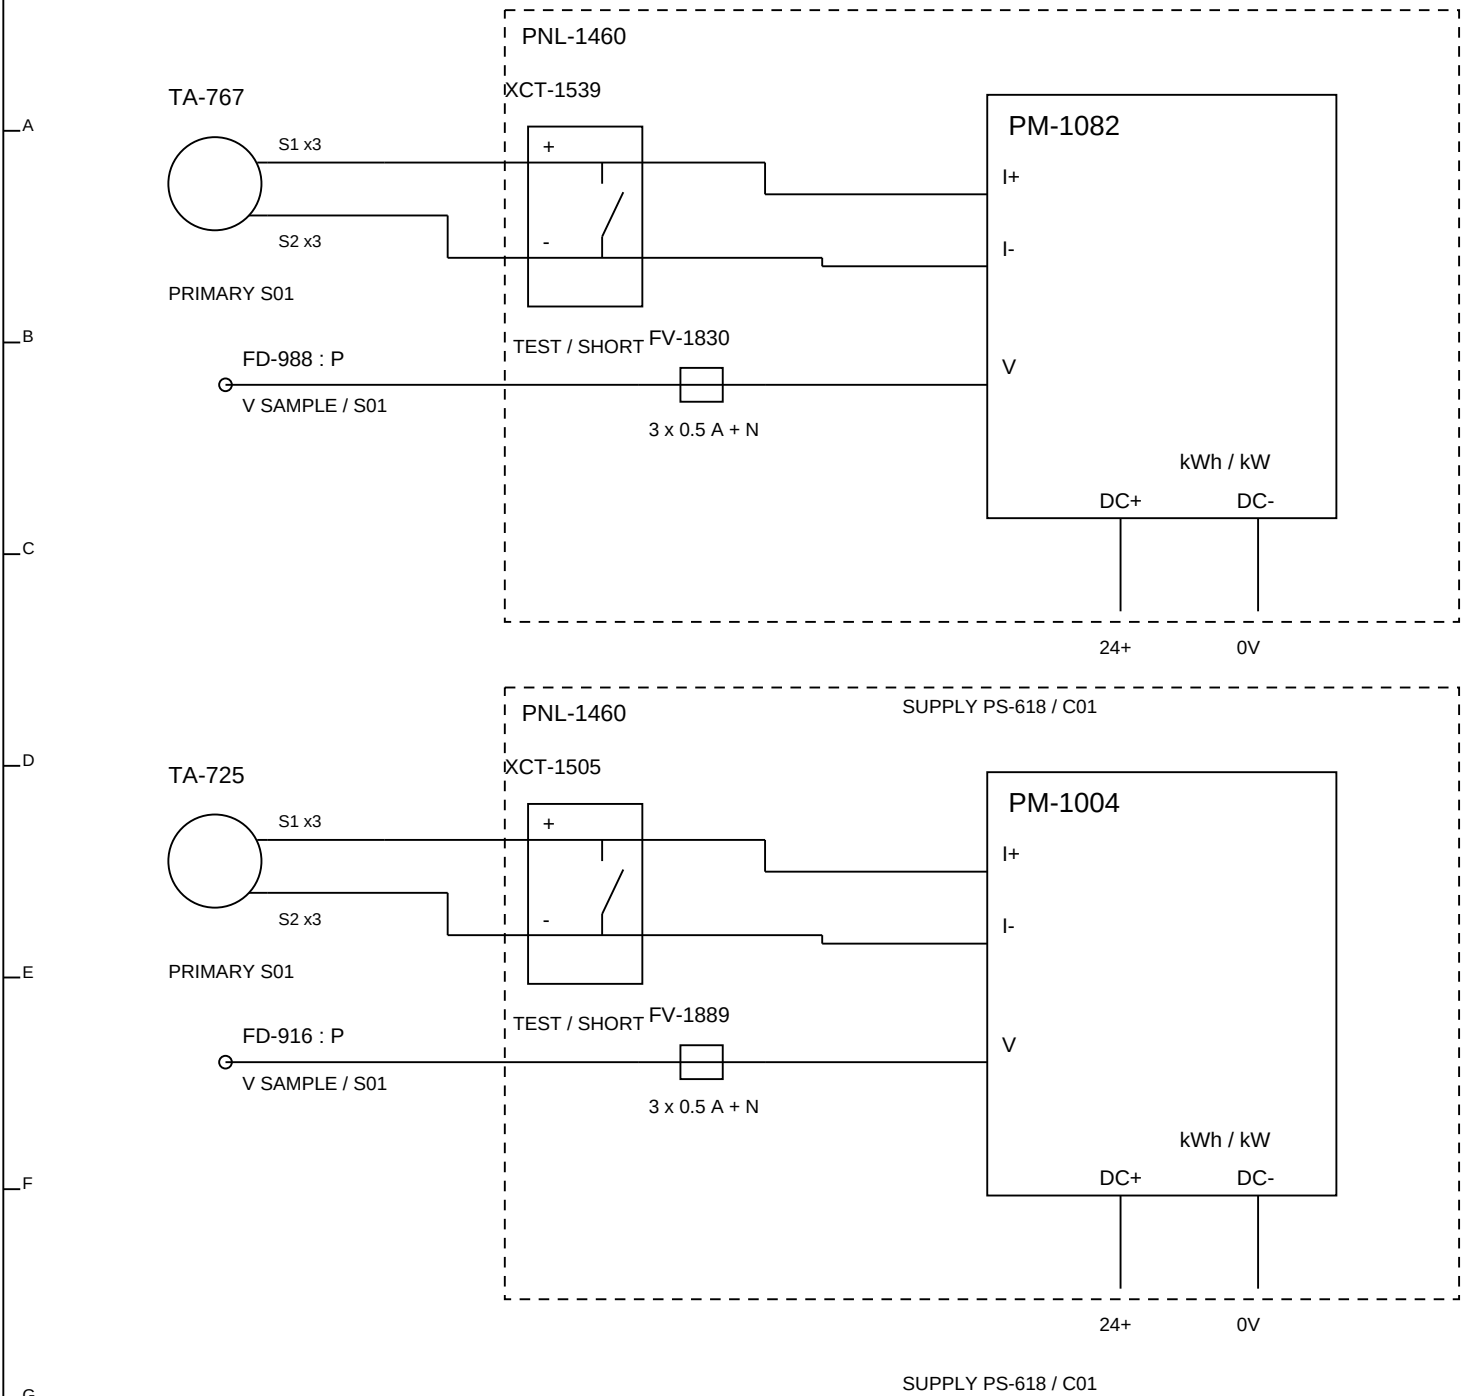

DRAWING CONVENTIONS

- Filled dot = electrical junction. Crossing without dot = no connection.
- CT primary window identifies measurement position, not a series device.
- Solid conductors: type is set by terminal/channel labels.
- Repeated equipment tags are views of the same physical device.
- Power flow and meter coverage depend on the selected configuration.
- Terminal designations are functional.

CURRENT: each pair represents 3 isolated phase pairs (L1, L2, L3), S1 to I+ and S2 to I-. Shorting links OPEN in service.
VOLTAGE: 3 fused phase leads + unfused N; 0.5 A phase fuses. DC power: independent 24 V supply on C01. Bundles do not imply shorts.

ELECTRICAL SYSTEMS / PRIMARY DISTRIBUTION: S01

