


D

C

B

A

GRAPHICAL KEYS FOR STRUCTURAL PLANS

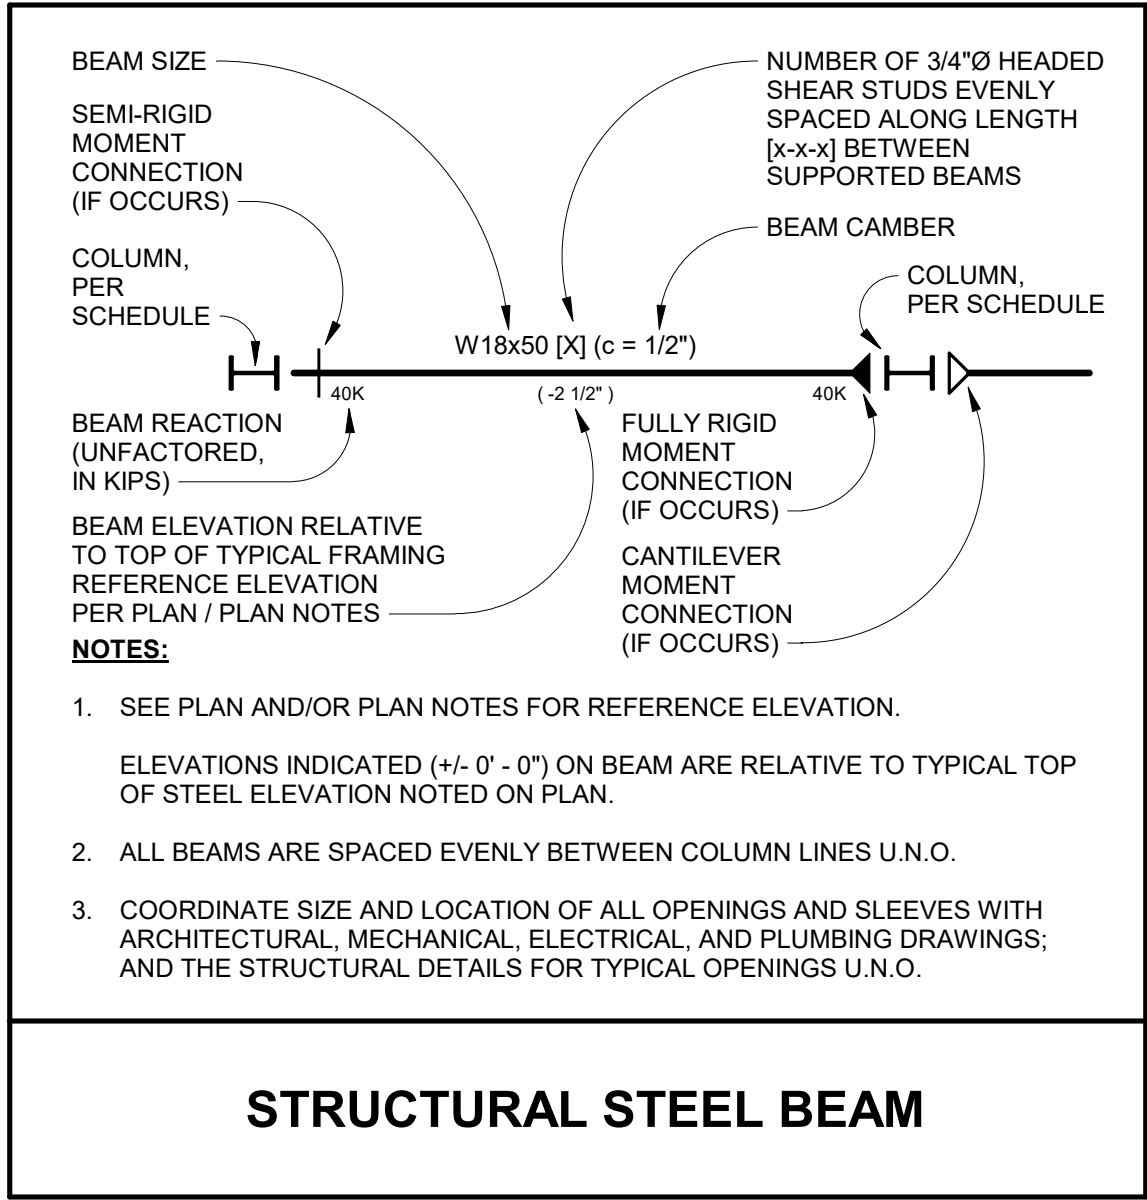

STRUCTURAL SHEET LIST

S000	COVER SHEET
S001	STRUCTURAL DESIGN NOTES
S002	STRUCTURAL DESIGN NOTES
S005	COMPONENT AND CLADDING PLAN
S006	ROOF SNOW DRAFT PLAN
S011	SPECIAL INSPECTION TABLES
S096	P4 LEVEL / FOUNDATION PLAN
S097	P3 LEVEL FRAMING PLAN
S098	P2 LEVEL FRAMING PLAN
S099	P1 LEVEL FRAMING PLAN
S100	LOWER LEVEL FRAMING PLAN
S101	LEVEL 01 FRAMING PLAN
S102	LEVEL 02 FRAMING PLAN
S103	LEVEL 03 FRAMING PLAN
S104	LEVEL 04 FRAMING PLAN
S105	LEVEL 05 FRAMING PLAN
S106	LEVEL 06 FRAMING PLAN
S107	TYPICAL FRAMING PLAN - LEVEL 06-10
S108	LEVEL 11 FRAMING PLAN
S109	LEVEL 12 FRAMING PLAN
S110	PENTHOUSE LEVEL FRAMING PLAN
S111	PENTHOUSE ROOF FRAMING PLAN
S112	MECHANICAL ROOF FRAMING PLAN
S120	PARTIAL PLANS
S201	FRP STRENGTHENING SCHEDULE
S300	TYPICAL CONCRETE DETAILS
S301	TYPICAL CONCRETE DETAILS
S310	TYPICAL STEEL DETAILS
S311	TYPICAL STEEL DETAILS
S312	TYPICAL STEEL DETAILS
S313	TYPICAL STEEL DETAILS
S314	TYPICAL STEEL DETAILS
S400	CONCRETE SECTIONS AND DETAILS
S401	CONCRETE SECTIONS AND DETAILS
S402	CONCRETE SECTIONS AND DETAILS
S500	STEEL SECTIONS AND DETAILS
S501	STEEL SECTIONS AND DETAILS
S502	STEEL SECTIONS AND DETAILS
S503	STEEL SECTIONS AND DETAILS

SYMBOLS	
	STEP IN FOUNDATION / GRADE BEAM
	INDICATES SLAB DEPRESSIONS AND SLOPES IN SLABS
	INDICATES COLUMN / POST / HANGER UP
	INDICATES COLUMN / POST / HANGER DN
	INDICATES COLUMN SLOPE DIRECTION (ABOVE FLOOR)
	INDICATES FLOOR / DECK SPAN DIRECTION
	SPREAD / CONTINUOUS FOOTING MARK, SEE SCHEDULED INFORMATION
	CONC. / WOOD / MASONRY WALL MARK, SEE SCHEDULED INFORMATION
	CONC. COLUMN / POST NUMBER, SEE SCHEDULED INFORMATION
	WOOD / STEEL POST MARK, SEE SCHEDULED INFORMATION
	KEY NOTE, SEE KEY NOTES LIST ON SHEET
	BRACED FRAME LOCATION, SEE ELEVATION


STRUCTURAL ABBREVIATIONS			
ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION
@	AT	MACH	MACHINE
ABV	ABOVE	MANUF	MANUFACTURER
ACI	AMERICAN CONCRETE INSTITUTE	MATL	MATERIAL
ADDL	ADDITIONAL	MAX	MAXIMUM
ADJ	ADJACENT	ME	MECHANICAL ENGINEER
AESS	ARCHITECTURALLY EXPOSED STRUCTURAL STEEL	MECH	MECHANICAL
AFF	ABOVE FINISH FLOOR	MEZZ	MEZZANINE
ASTM	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	MFR	MANUFACTURER
ASIS	AMERICAN INSTITUTE OF STEEL CONSTRUCTION	ML	ONE THOUSANDTH OF AN INCH
ALT	ALTERNATE	MIN	MINIMUM
ALUM	ALUMINUM	MIRR	MIRROR
APPROX	APPROXIMATELY	MISC	MISCELLANEOUS
ARCH	ARCHITECT(URAL)	MTD	MOUNTED
ASCI	AMERICAN SOCIETY FOR TESTING AND MATERIALS	MTL	METAL
AVG	AVERAGE	MULL	MULLION
AWS	AMERICAN WELDING SOCIETY	MVBL	MOVABLE
AS	ANCHOR BOLT	N	NORTH
BD	BOARD	(N)	NEW
BLDG	BUILDING	NA, N/A	NOT AVAILABLE / APPLICABLE
BLKG	BLOCKING	NIC	NOT IN CONTRACT
BM	BEAM	NO	NUMBER / NUMBER OF
BOT	BOTTOM	NOM	NOMINAL
B.O.	BOTTOM OF	NTS	NOT TO SCALE
BRG	BEARING	NVC	NORMAL WEIGHT CONCRETE
B.SMT	BASEMENT	OA	OVERALL
BTW, BTWN	BETWEEN	O.C.	ON CENTER
BW	BOTH WAYS	O.D.	OUTSIDE DIAMETER
C	CHANNEL	O.F.	OUTSIDE FACE
CL	CENTERLINE	OPNG	OPENING
C.O.	CENTER OF	OPP HAND	OPPOSITE HAND
C TO C, C/C	CENTER-TO-CENTER	PAR	PARALLEL
CIP	CAST-IN-PLACE	PART	PARTIAL
CJ	CONTROL JOINT	PAT	PATTERN
CJP	COMPLETE JOINT PENETRATION	PC	PILE CAP OR PRECAST
CLG	CLEAR	PED	PEDESTAL
CLR	CONCRETE MASONRY UNIT	PERF	PERFORATED
CMU	CONCRETE	PERIM	PERIMETER
COL	COLUMN	PERP	PERPENDICULAR
CONC	CONCRETE	PJP	PARTIAL JOINT PENETRATION
CONN	CONNECT, CONNECTION	PL	PLATE
CONSTR	CONSTRUCT, CONSTRUCTION	PLYWD	PLYWOOD
CONSTR JT	CONSTRUCTION JOINT	PREFAB	PREFABRICATED
CONT	CONTINUOUS	PROP	PROPERTY
CRSI	CONCRETE REINFORCING STEEL INSTITUTE	PSF	POUNDS PER SQUARE FOOT
D	DEEP, DEPTH	PSI	POUNDS PER SQUARE INCH
DBL	DOUBLE	PS	POUR STRIP
DEMO	DEMOLISH, DEMOLITION	PSF	POUNDS PER SQUARE FOOT
DEG	DEGREE	PT	PRESSURE TREATED, POST-TENSIONED
DET	DETAIL	PVC	POLYVINYL CHLORIDE
DIA	DIAMETER	QTY	QUANTITY
DIAG	DIAGONAL	R	RADIUS
DIM	DIMENSION	RD	ROOF DRAIN
DIR	DIRECTION	RE	RIGHT END
DN	DOWN	REIN	REINFORCE(D), REINFORCING, REINFORCEMENT
DP	DEEP, DEPTH	REF	REFER (TO), REFERENCE
DTL	DETAIL	REQ / REQD	REQUIRE, REQUIRED
DWG	DRAWING	RH	RIGHT HAND
DWLS	DOWELS	RET	RETURN
E	EAST	REV	REVISE(D), REVISION
EA	EACH	RF	ROUGH OPENING
EE	EACH END	ROT	ROTATE(D)
EF	EACH FACE	RT	RIGHT
EJ	EXPANSION JOINT	S	SOUTH
EL	ELEVATION	SAN	SANITARY
ELEC	ELECTRICAL	SCHED	SCHEDULE(D)
ELEV	ELEVATOR	SDI	STEEL DECK INSTITUTE
ENG, ENGR	ENGINEER	SECT	SECTIONAL
E.O.S.	EDGE OF SLAB	SF	SQUARE FEET
EQ	EQUAL	SHT	SHEET
EQUIP	EQUIPMENT	SIM	SIMILAR
EST	ESTIMATE(D)	SL	SPlice LENGTH
EW	EACH WAY	SLH	SHORT LEG HORIZONTAL
EXIST, (E)	EXISTING	SLV	SHORT LEG VERTICAL
EXP	EXPANSION	SOG	SLAB ON GRADE
EXP BOLT	EXPANSION BOLT	SPEC	SPECIFY, SPECIFICATION(S)
EXT	EXTERIOR	SQ	SQUARE
FAB	FABRICATOR	SS	STAINLESS STEEL
FD	FLOOR DRAIN	SLBB	SHORT LEG BACK-TO-BACK
FF	FINISH FLOOR	SSLH	SHORT SLOTTED HOLES HORIZONTAL
FIN	FINISH	SSLV	SHORT SLOTTED HOLES VERTICAL
FL, FLR	FLOOR	SSTL	STAINLESS STEEL
FDN	FOUNDATION	STD	STANDARD
F.O.	FACE OF	STIFF	STIFFENER
F.O.C.	FACE OF CONCRETE	STL	STEEL
F.O.M.	FACE OF MASONRY	STN	STONE
F.O.S.	FACE OF STUD	STR, STRUCT	STRUCTURE, STRUCTURAL
F.O.W.	FACE OF WALL	SUP	SUPPORT
FT	FOOT, FEET	SURF	SURFACE
FTG	FOOTING	SUSP	SUSPENDED
GA	GAGE, GAUGE	SYM	SYMMETRICAL
GALV	GALVANIZED	TEMP	TEMPORARY
GB	GRADE BEAM	THK	THICK, THICKNESS
GC	GENERAL CONTRACTOR	THRU	THROUGH
GD	GRADE, GROUND	T&B	TOP AND BOTTOM
GEN	GENERAL	T.O.	TOP OF
GR	GRADE	T.O.C.	TOP OF CONCRETE
GYP	GYP SUM	T.O.S.	TOP OF STEEL, TOP OF SLAB
GYP BD	GYP SUM BOARD	T.O.SL	TOP OF SLAB
H	HIGH	T.O.SL	TOP OF STEEL
HD	HEADER	T.O.W.	TOP OF WALL
HDR	HEADER	TYP	TYPICAL
HI	HIGH	UNO	UNLESS NOTED OTHERWISE
HORIZ	HORIZONTAL	VEF	VERTICAL EACH FACE
HP	HIGH POINT	VERT	VERTICAL
HT	HEIGHT	VIF	VERIFY IN FIELD
HVAC	HEATING / VENTILATION / AIR CONDITIONING	W/	WITH
ICBO	INTERNATIONAL CONFERENCE OF BUILDING OFFICIALS	W/O	WITHOUT
ID	INSIDE DIAMETER	W	WEST
IN	INCH	W, WD	WIDE
INCL	INCLUDE(D), INCLUDING	WD	WOOD
INSUL	INSULATION	WDW	WINDOW
INT	INTERIOR	WF	WIDE FLANGE
INV	INVERT	WP	WATER PROOFING
JT	JOINT	WP	WORK POINT
K	KIP (1000 POUNDS)	WT	WEIGHT
L	ANGLE	WWF	WELDED WIRE FABRIC
LB(S)	POUND(S)	YD	YARD
Ld	DEVELOPMENT LENGTH		
Ldh	DEVELOPMENT LENGTH, HOOKED REBAR		
LF	LINEAR FOOT/FEET		
LH	LEFT HAND		
LLB	LONG LEG BACK-TO-BACK		
LLH	LONG LEG HORIZONTAL		
LLV	LONG LEG VERTICAL		
LP	LOW POINT		
LSH	LONG SIDE HORIZONTAL		
LSV	LONG SIDE VERTICAL		
LW	LIGHT WEIGHT		
LWC	LIGHT WEIGHT CONCRETE		

D

C

B

A

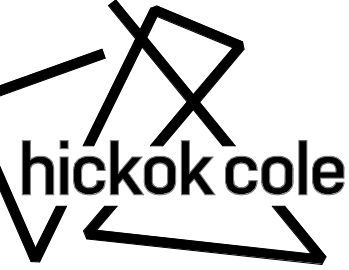

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
1200 K St NW
Washington, DC 20005

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	100% DD
2	05/08/2025	100% DD
3	08/28/2025	100% DD
4	11/21/2025	100% DD
5		100% DD
6		100% DD
7		100% DD
8		100% DD
9		100% DD
10		100% DD
11		100% DD
12		100% DD
13		100% DD
14		100% DD
15		100% DD
16		100% DD
17		100% DD
18		100% DD
19		100% DD
20		100% DD
21		100% DD
22		100% DD
23		100% DD
24		100% DD
25		100% DD
26		100% DD
27		100% DD
28		100% DD
29		100% DD
30		100% DD
31		100% DD
32		100% DD
33		100% DD
34		100% DD
35		100% DD
36		100% DD
37		100% DD
38		100% DD
39		100% DD
40		100% DD
41		100% DD
42		100% DD
43		100% DD
44		100% DD
45		100% DD
46		100% DD
47		100% DD
48		100% DD
49		100% DD
50		100% DD
51		100% DD
52		100% DD
53		100% DD
54		100% DD
55		100% DD
56		100% DD
57		100% DD
58		100% DD
59		100% DD
60		100% DD
61		100% DD
62		100% DD
63		100% DD
64		100% DD
65		100% DD
66		100% DD
67		100% DD
68		100% DD
69		100% DD
70		100% DD
71		100% DD
72		100% DD
73		100% DD
74		100% DD
75		100% DD
76		100% DD
77		100% DD
78		100% DD
79		100% DD
80		100% DD
81		100% DD
82		100% DD
83		100% DD
84		100% DD
85		100% DD
86		100% DD
87		100% DD
88		100% DD
89		100% DD
90		100% DD
91		100% DD
92		100% DD
93		100% DD
94		100% DD
95		100% DD
96		100% DD
97		100% DD
98		100% DD
99		100% DD
100		100% DD

STAMP

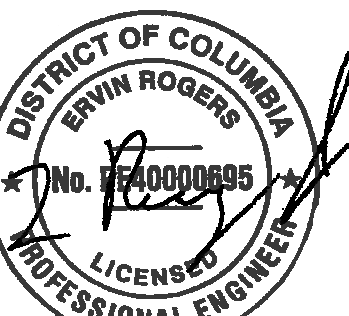

PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated


DRAWING TITLE
COVER SHEET

DRAWING NO.
S000




NOTE: THESE ARE ULTIMATE WIND LOADS



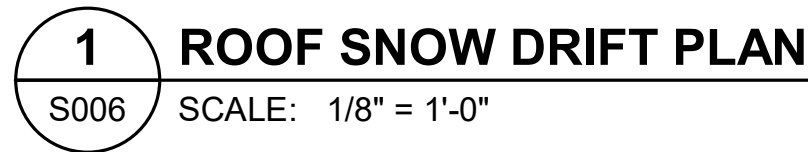

"XX PSF"	MAX SNOW LOAD AGAINST VERTICAL FACE
"XX FT"	HORIZONTAL WIDTH FROM "XX PSF" TO "XX PSF PF"
PSF PF	FLAT ROOF SNOW LOAD (PF = 25 PSF EVERYWHERE)

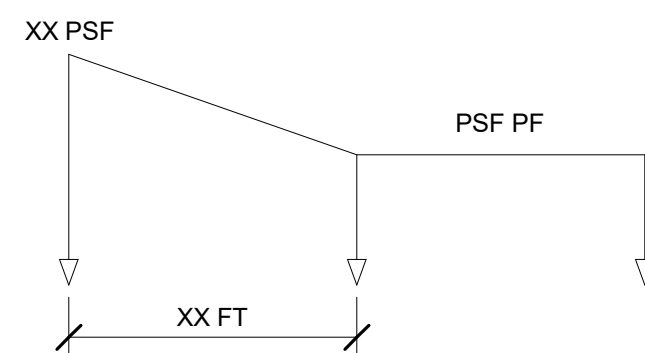


D

C

B

A

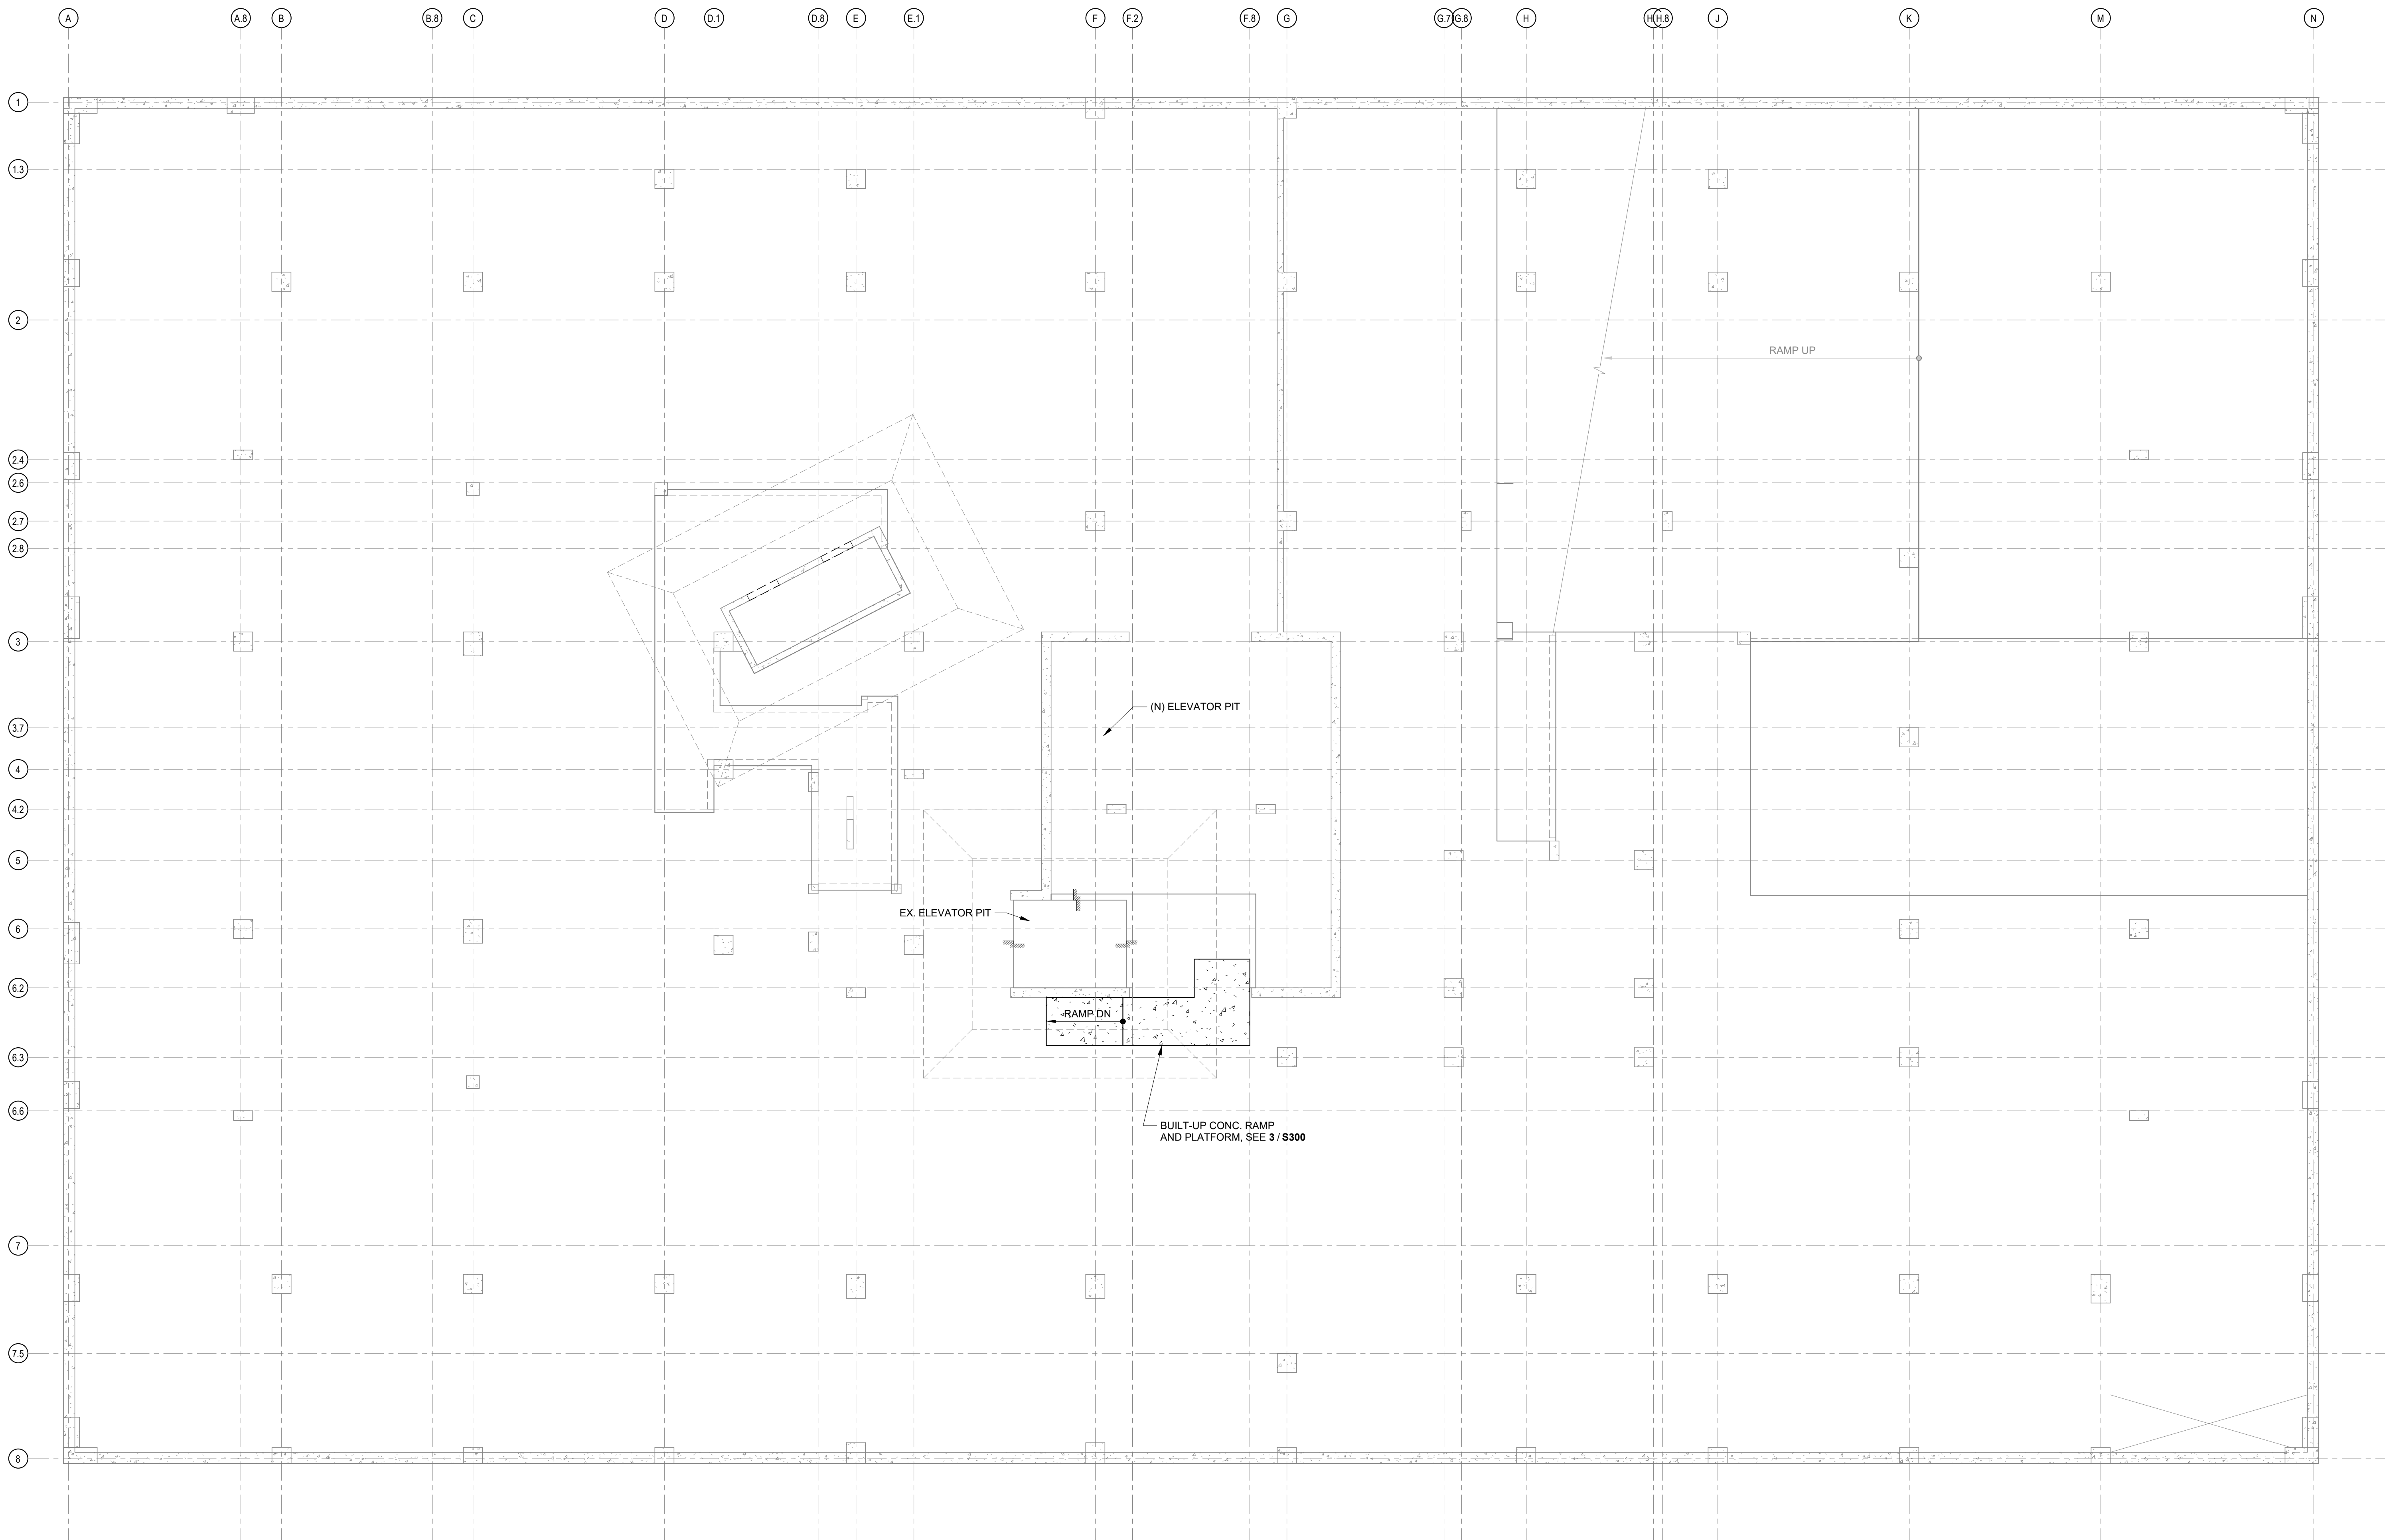


1 P4 LEVEL / FOUNDATION PLAN
S096 SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.
8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB
9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB
10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

D

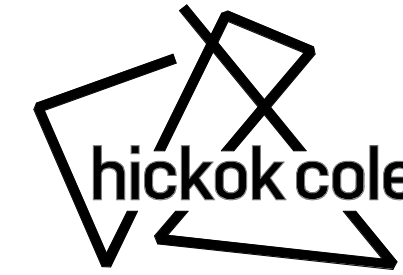

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW

CLIENT NAME


ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	0% PERMIT SET

B

STAMP

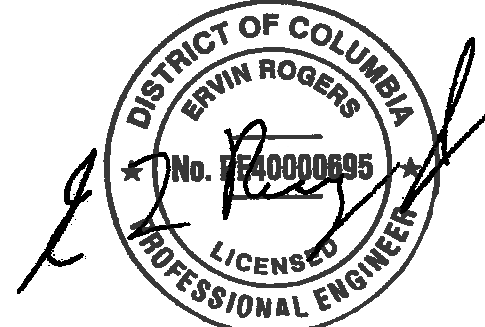

PROJECT NO.
24048

DRAWN BY
Author

A

SCALE
As Indicated

DRAWING TITLE
**P4 LEVEL /
FOUNDATION PLAN**

DRAWING NO.
S096



PLAN NOTES:

-  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP
PLACE ON THE TOP OF SLAB

- DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP
PLACE ON THE BOT OF SLAB

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS




D

C

B

A

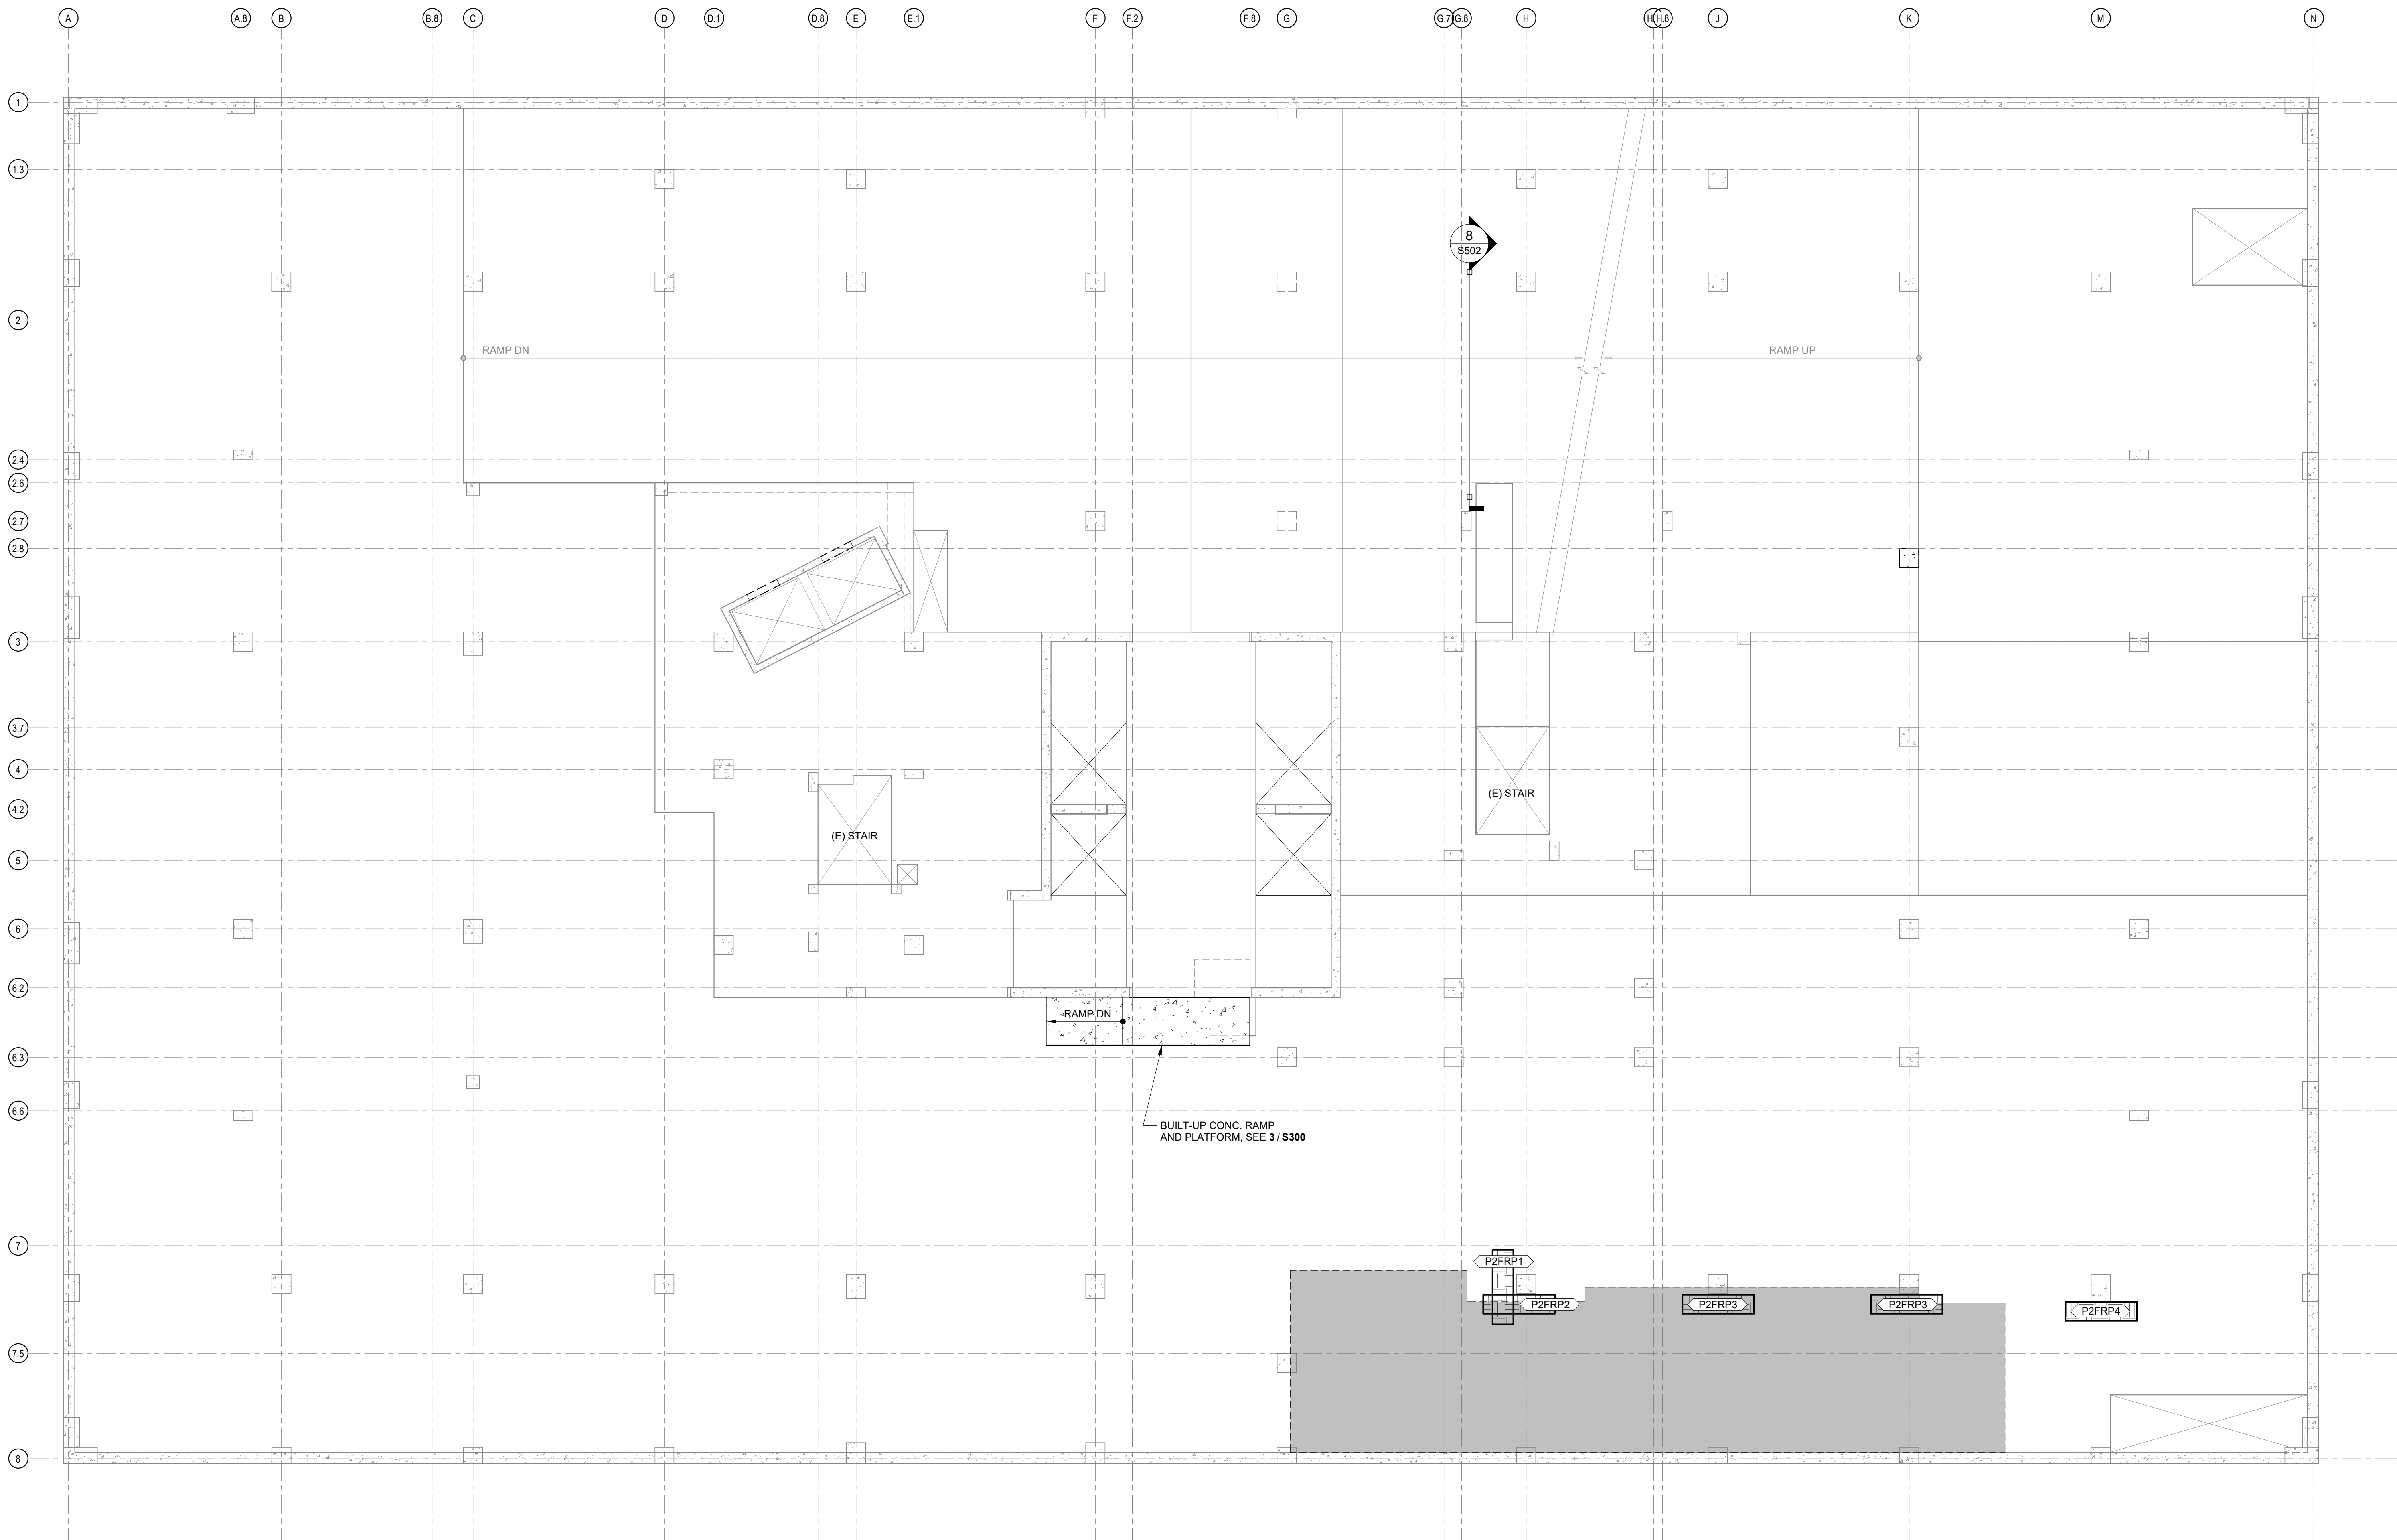

1 P2 LEVEL FRAMING PLAN
S098 SCALE: 1/8" = 1'-0"


PLAN NOTES:

1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.

8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB
9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

D

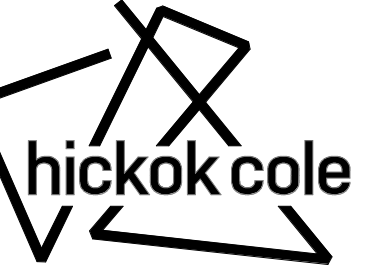

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW

CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	0% PERMIT SET

STAMP



PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
**P2 LEVEL FRAMING
PLAN**


DRAWING NO.
S098

D

C

B

A

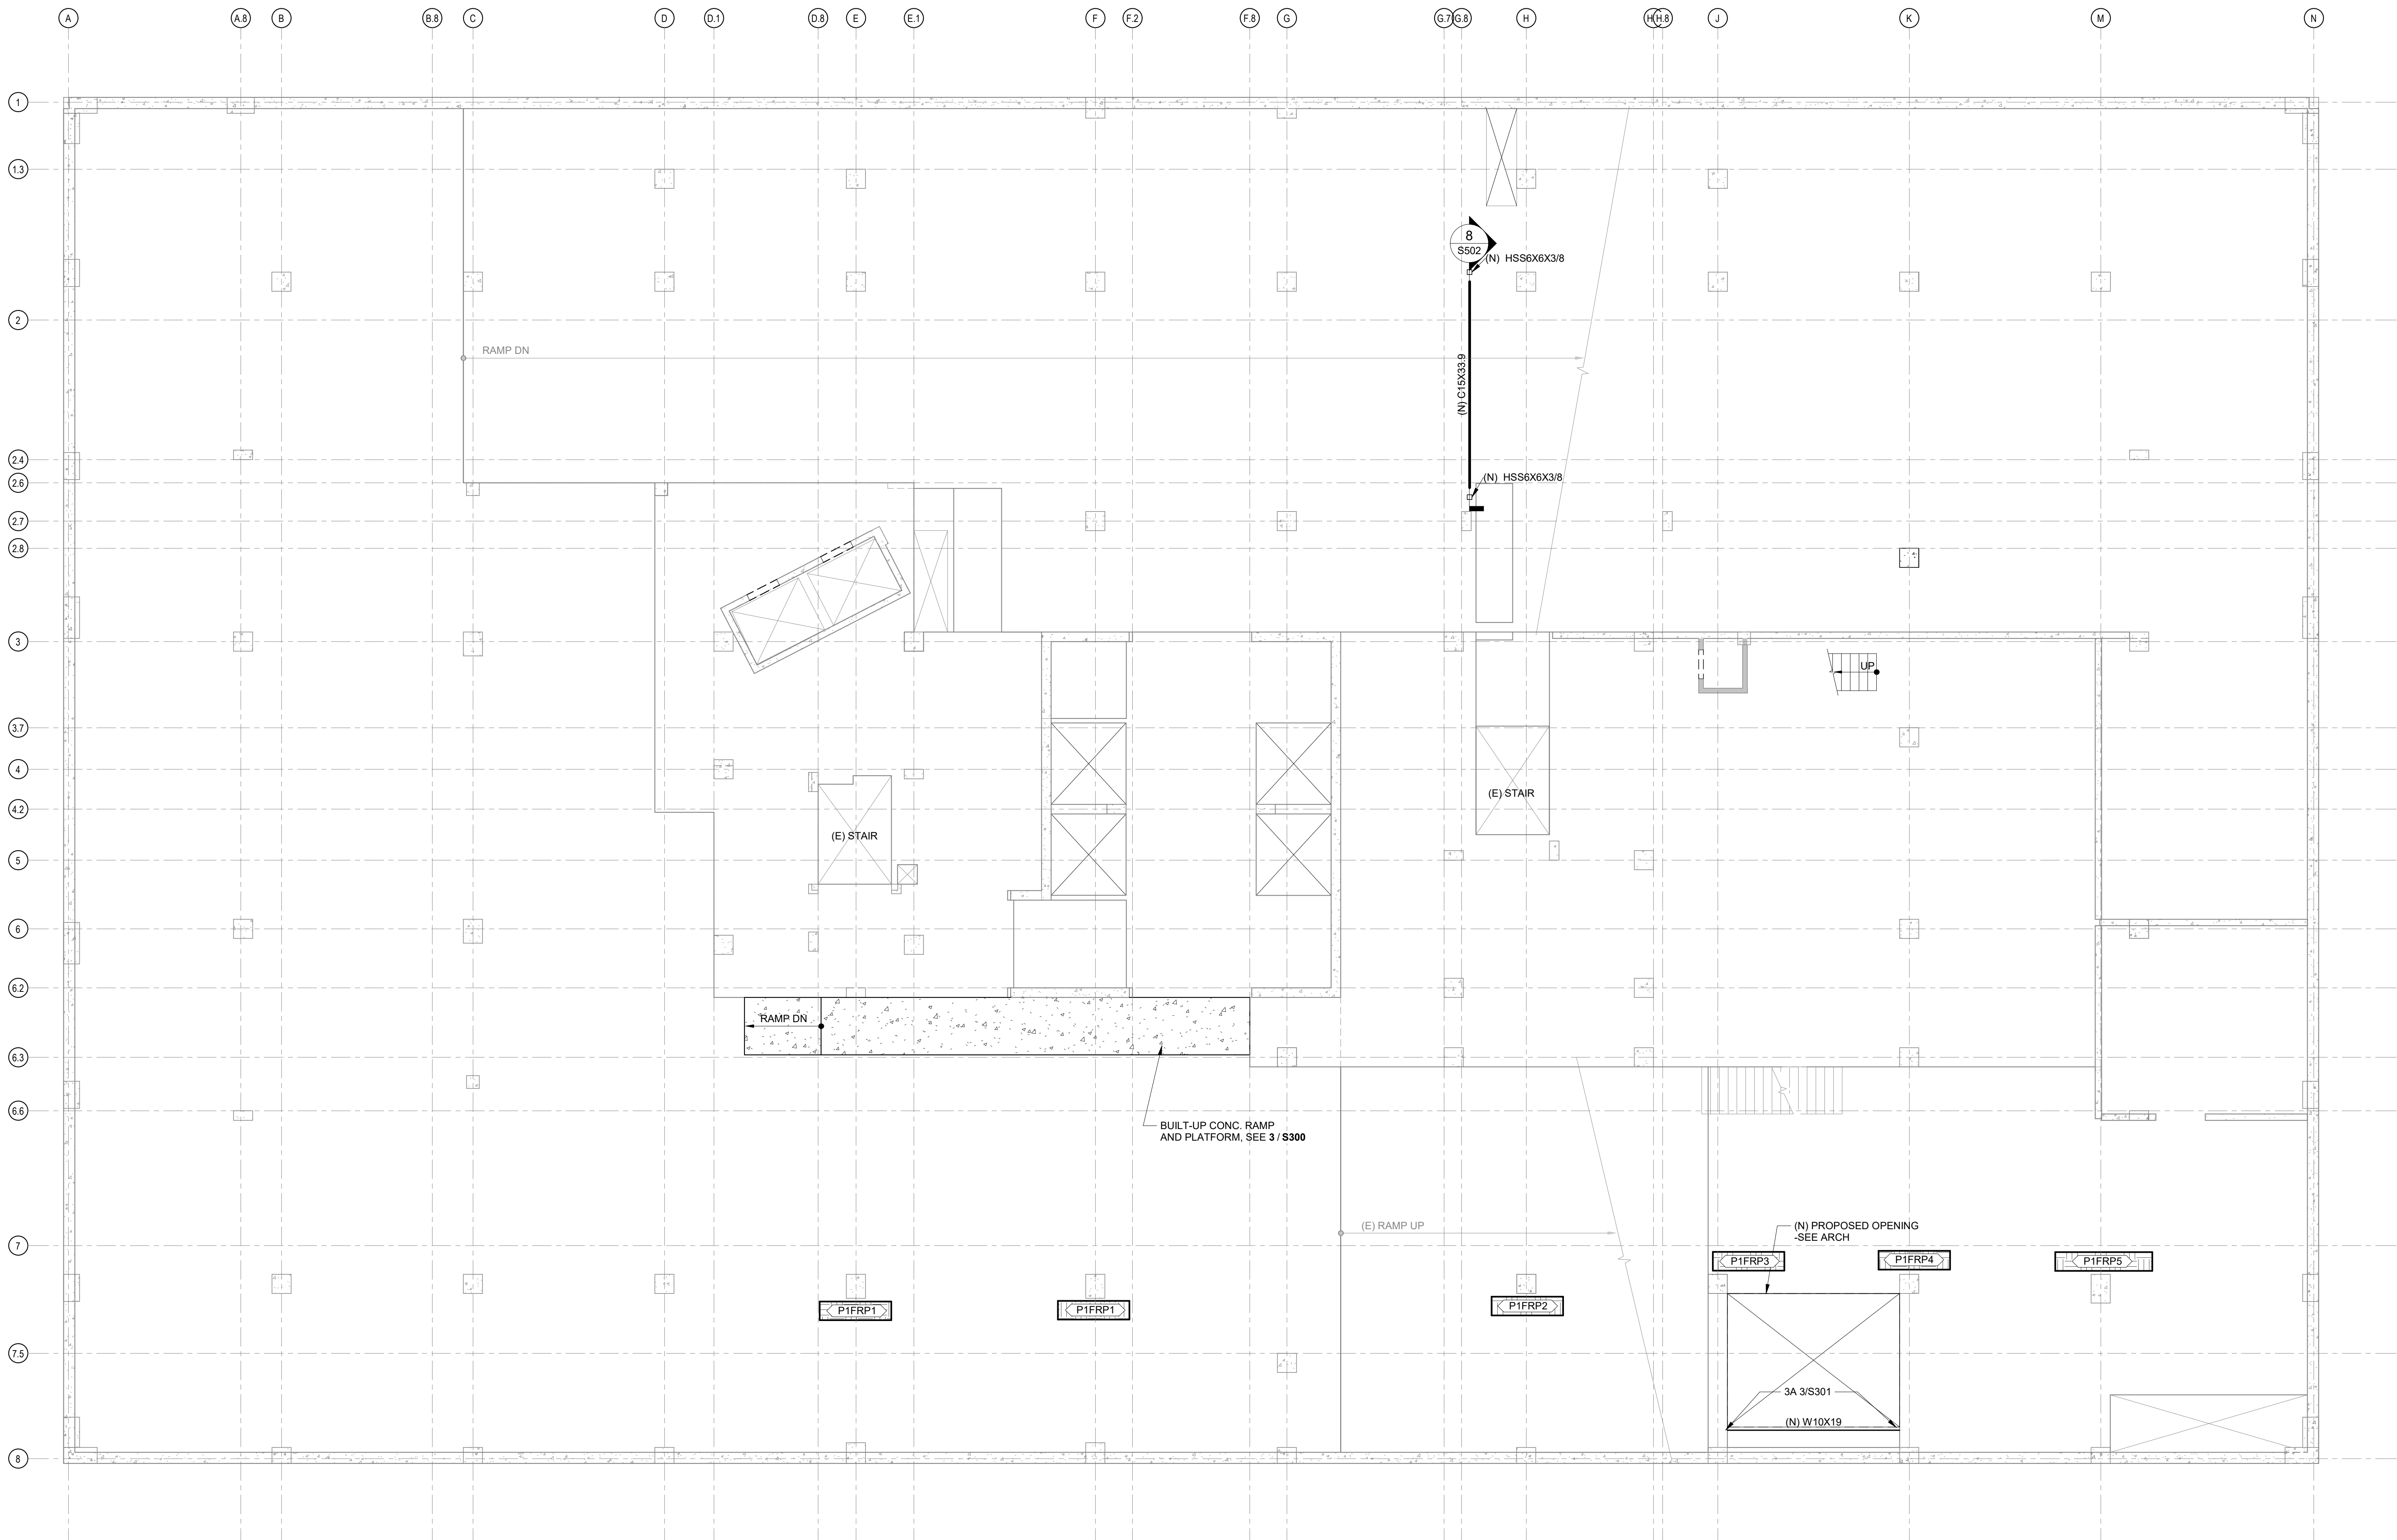

1 P1 LEVEL FRAMING PLAN
S099 SCALE: 1/8" = 1'-0"

PLAN NOTES:


1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.

8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB

9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

D

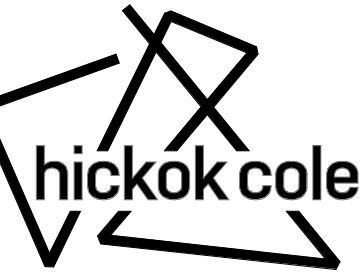

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW

CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% CD
3	08/28/2025	50% CD
4	11/21/2025	0% PERMIT SET

STAMP



PROJECT NO.

24048

DRAWN BY

Author

SCALE

As Indicated

DRAWING TITLE

**P1 LEVEL FRAMING
PLAN**

DRAWING NO.

S099



1 LEVEL 02 FRAMING PLAN
S102 SCALE: 1/8" = 1'-0"





PLAN NOTES:

1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.
8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB
9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
 = 125 PSF @ TENANT STORAGE
 = 150 PSF AT MEP ROOMS





PLAN NOTES:

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

S104



S105 / SCALE: 1/8" = 1'-0"

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS


S105

D

C

B

A

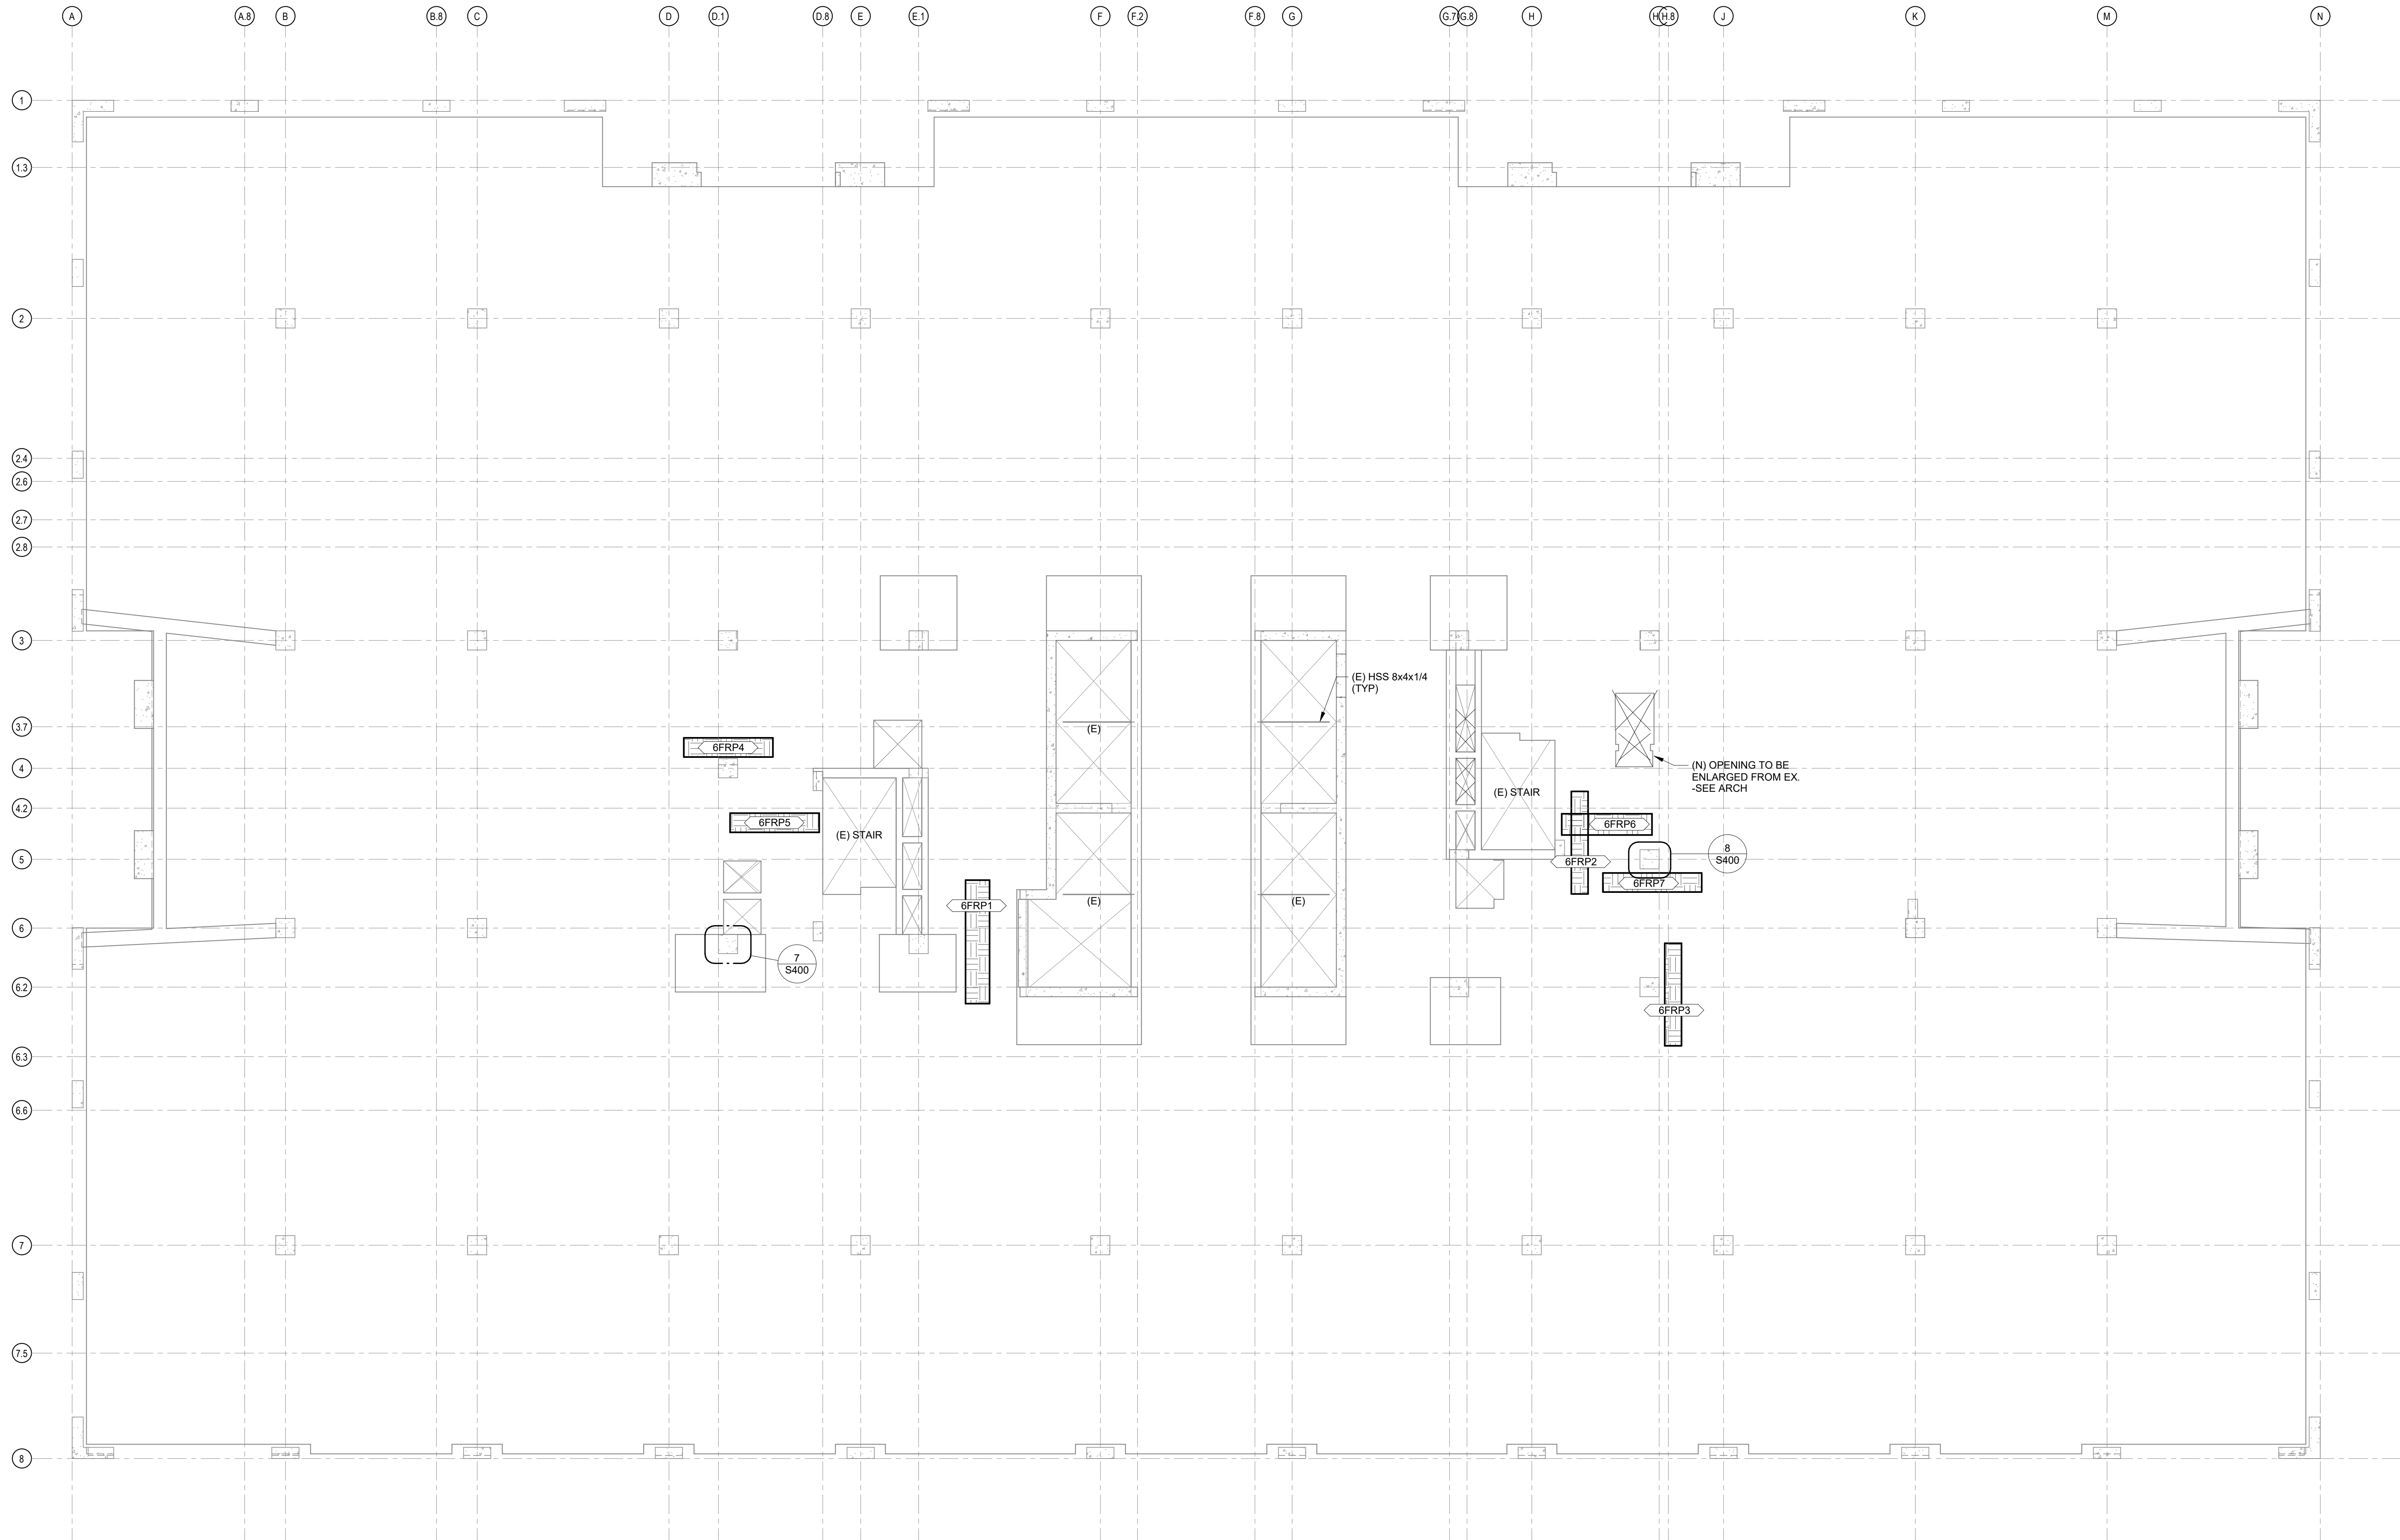


1 LEVEL 06-10 FRAMING PLAN (TYPICAL)
S106 SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.
8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB
9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB
10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

D

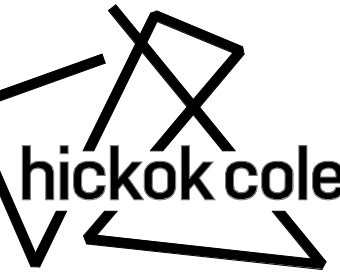

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C


PROJECT NAME
1200 K St NW

CLIENT NAME
1200 K St NW
Washington, DC 20005

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	11/21/2025	COMP/PERMIT SET

STAMP

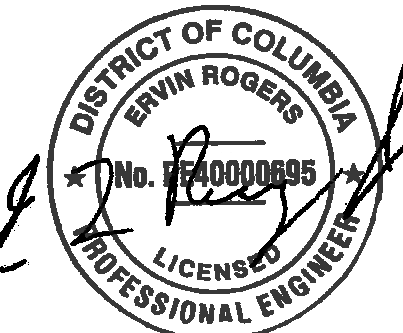

PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
LEVEL 06 FRAMING PLAN

DRAWING NO.
S106



LEVEL 11 FRAMING PLAN

10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS


S108

D

C

B

A

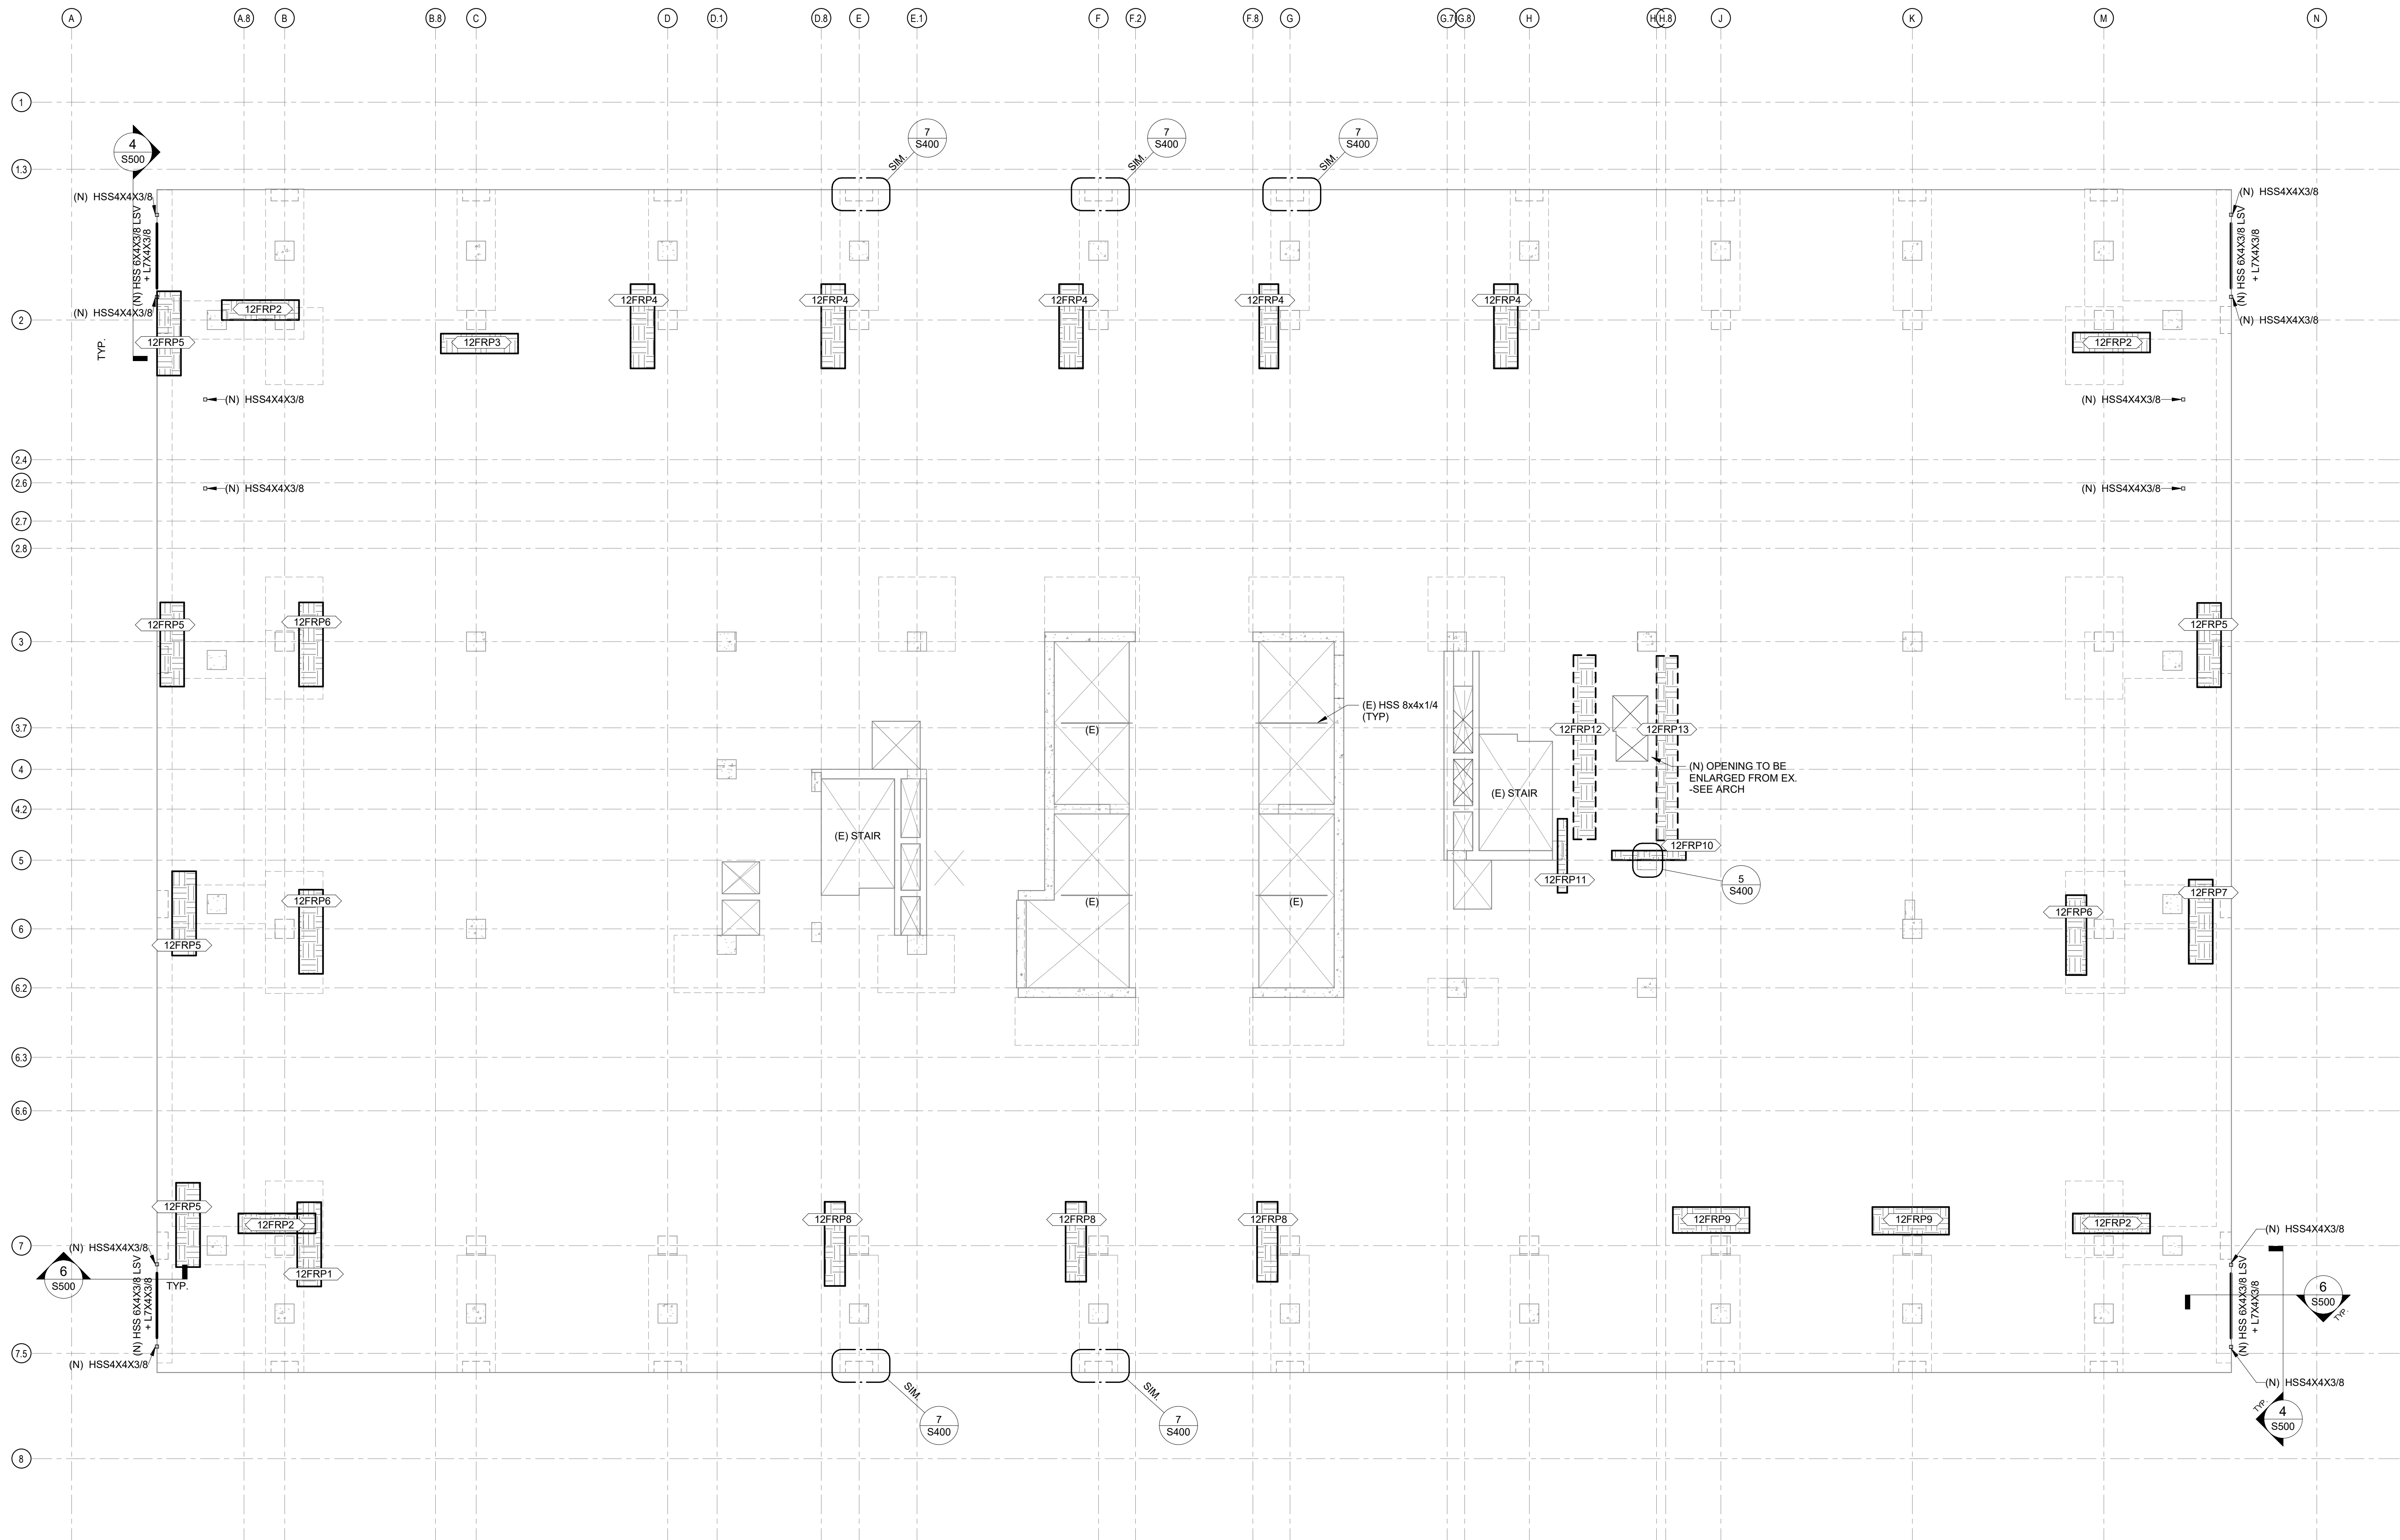


1 LEVEL 12 FRAMING PLAN
S109 SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
2. SEE SHEET S310 THRU S314 FOR TYPICAL STEEL DETAILS.
3. SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
4. SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
5. SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS. SEE STRUCTURAL NOTES.
6. COORDINATE THE LOCATIONS OF NEW POSTS WITH ARCH DRAWINGS.
7. COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.

8.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE TOP OF SLAB
9.  DENOTES THE AREA OF STEEL REQUIRED TO DESIGN FRP PLACE ON THE BOT OF SLAB
10. DESIGN LIVE LOAD = 40 PSF @ RESIDENTIAL UNITS
= 125 PSF @ TENANT STORAGE
= 150 PSF AT MEP ROOMS

D

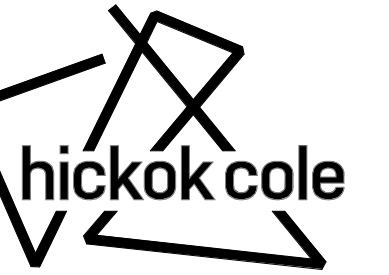

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	CAMP PERMIT SET

STAMP

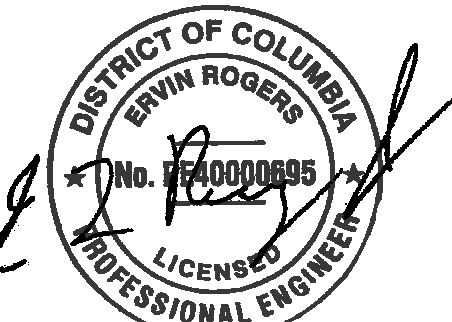

PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
LEVEL 12 FRAMING PLAN

DRAWING NO.
S109

A

D

C

B


A

D

C

B

A

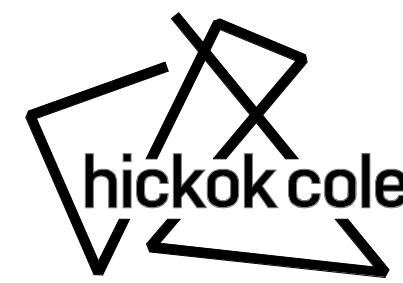

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	CAPPERMIT SET

STAMP

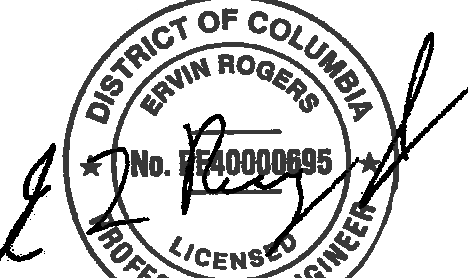

PROJECT NO.

24048

DRAWN BY

Author

SCALE


As Indicated

DRAWING TITLE

**PENTHOUSE ROOF
FRAMING PLAN**

DRAWING NO.

S111

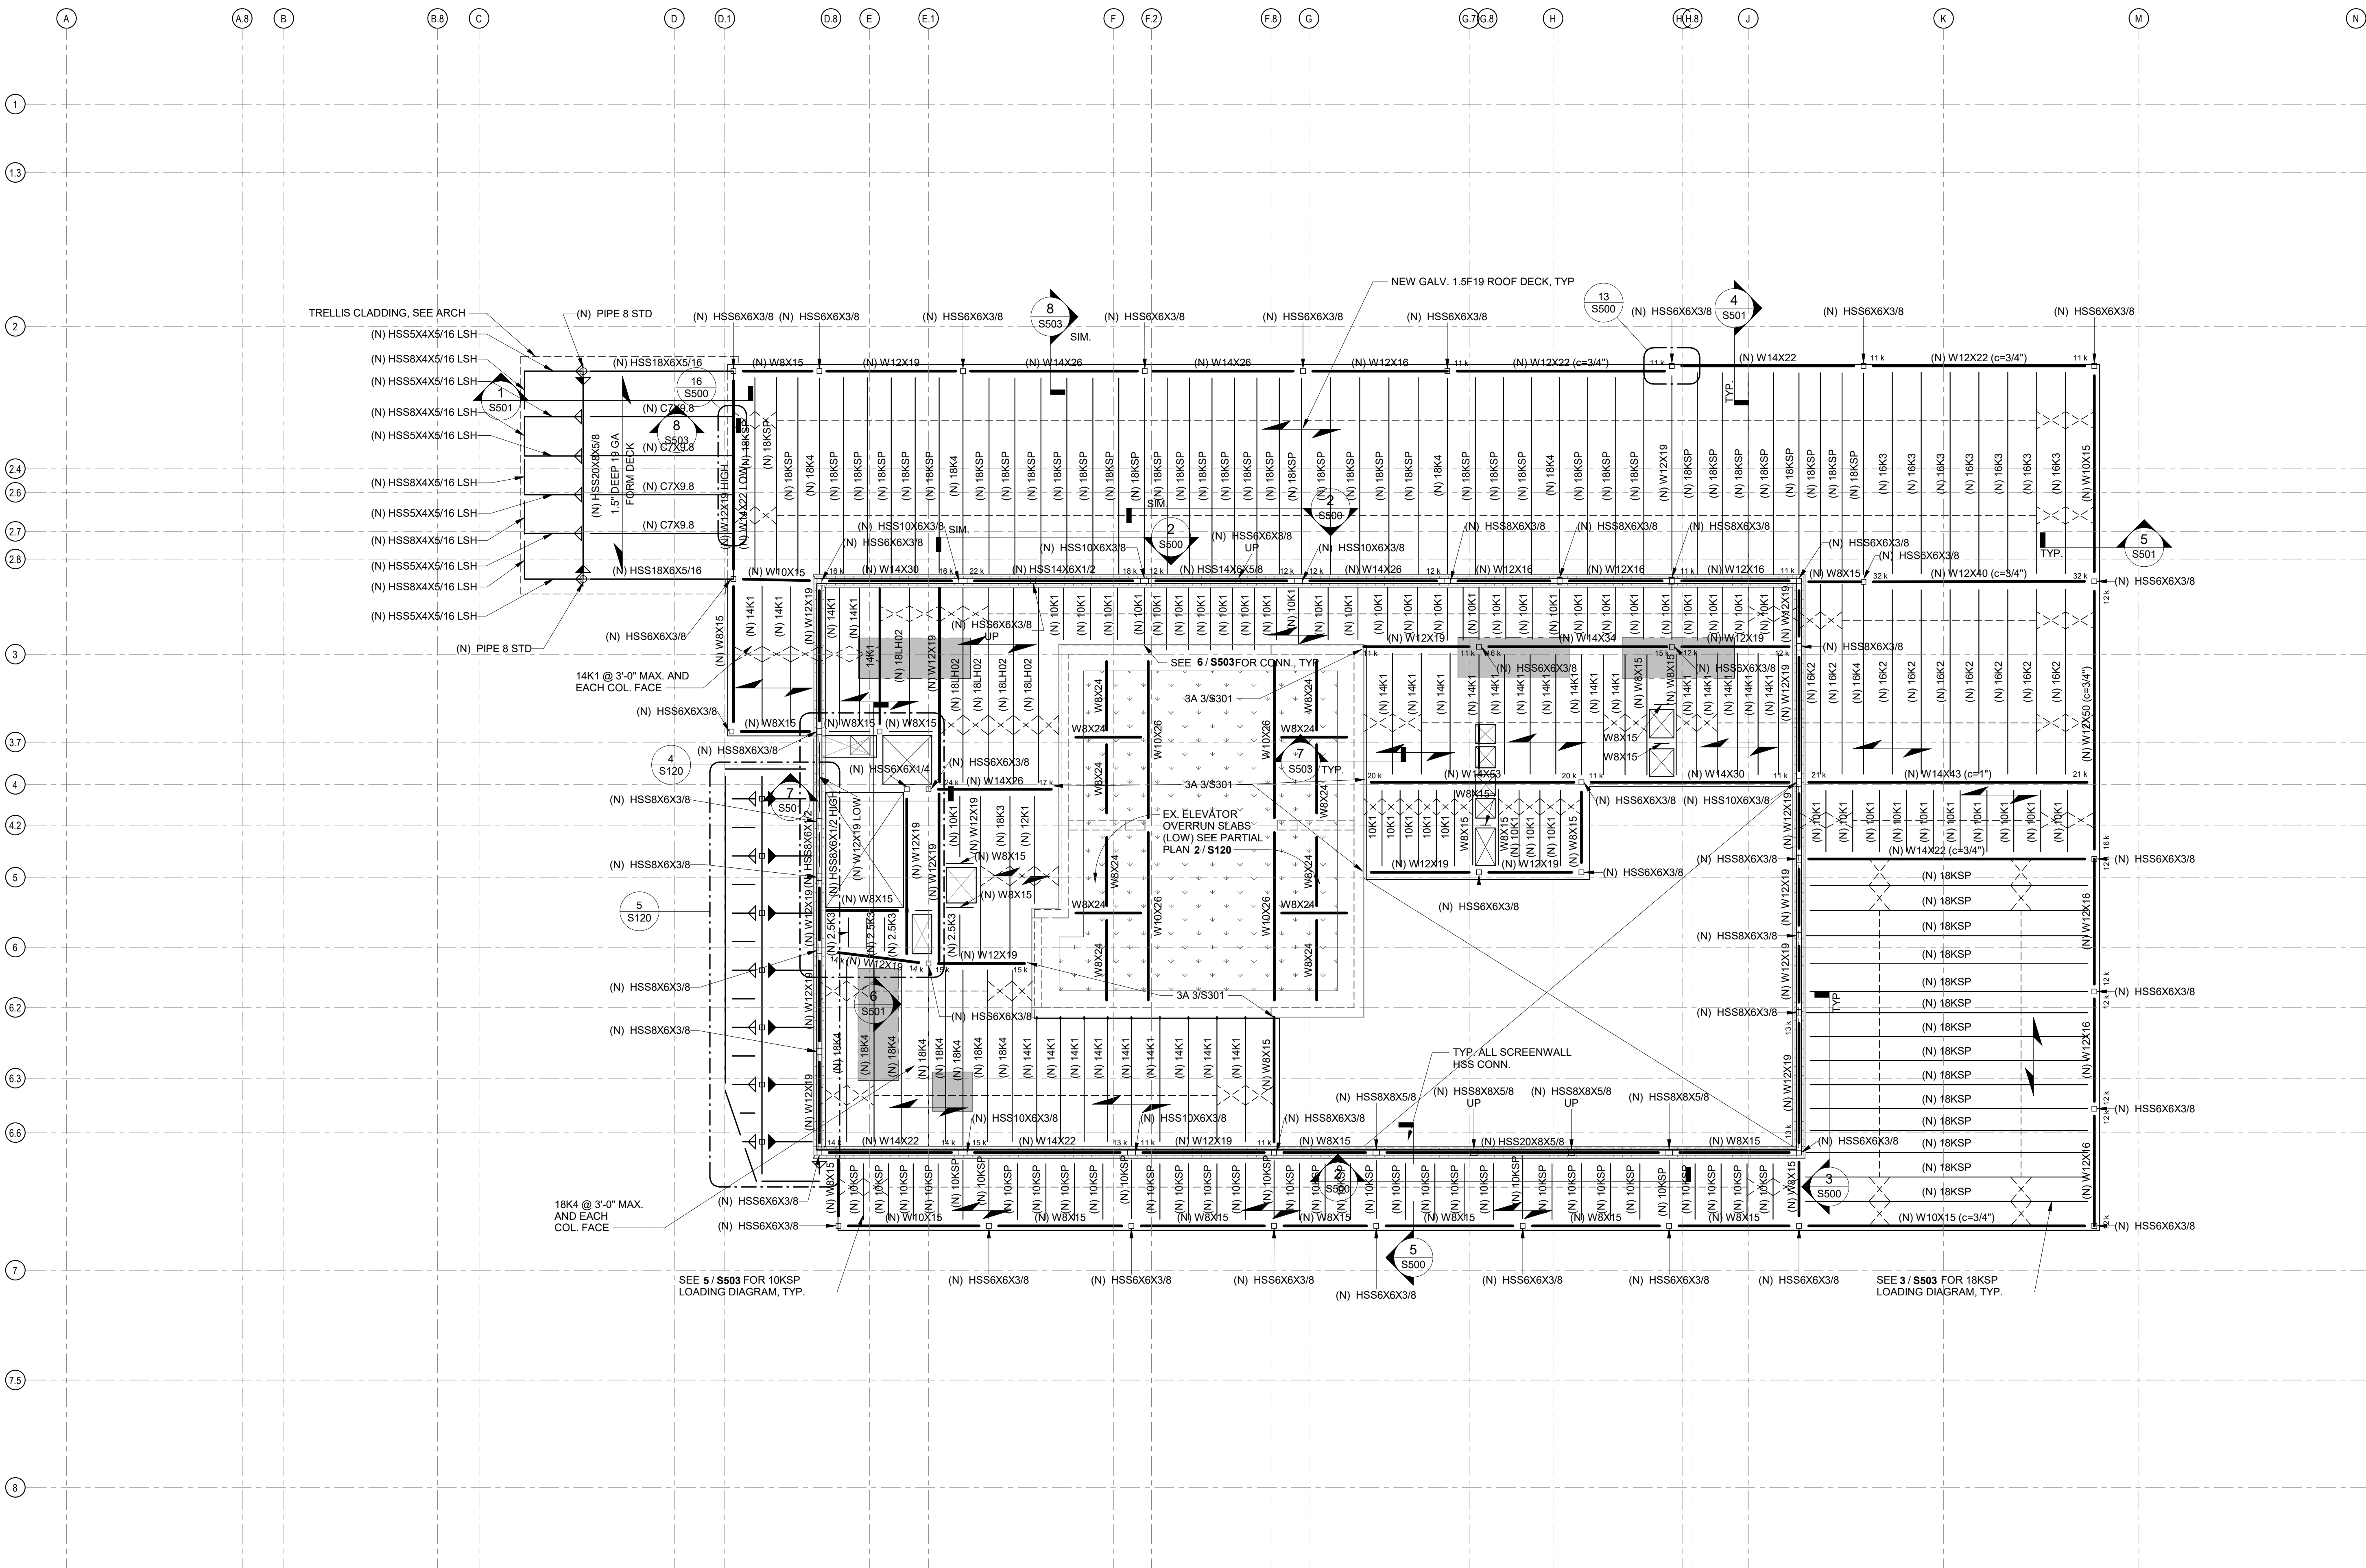

1 PENTHOUSE ROOF FRAMING PLAN
S111 SCALE: 1/8" = 1'-0"

PLAN NOTES:

- SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
- SEE DWG. S300 SERIES FOR TYPICAL STEEL DETAILS.
- SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
- SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
- SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACEMENT OF ANY POST-INSTALLED ANCHORS OR REBAR.
- COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.
- DESIGN LIVE LOAD = 30 PSF @ TRELLISES
= 60 PSF @ GREENROOF AREAS
= 150 PSF AT MEP ROOMS

D

C

B


A

D

C

B

A

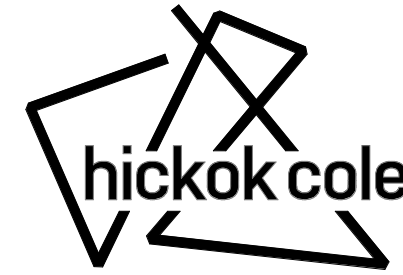

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



PROJECT DETAILS

PROJECT NAME
1200 K St NW

CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	CAMP PERMIT SET

STAMP



PROJECT NO.

24048

DRAWN BY

Author

SCALE


As Indicated

DRAWING TITLE
**MECHANICAL ROOF
FRAMING PLAN**

DRAWING NO.

S112

© 2025 Hickok Cole Architects, Inc.

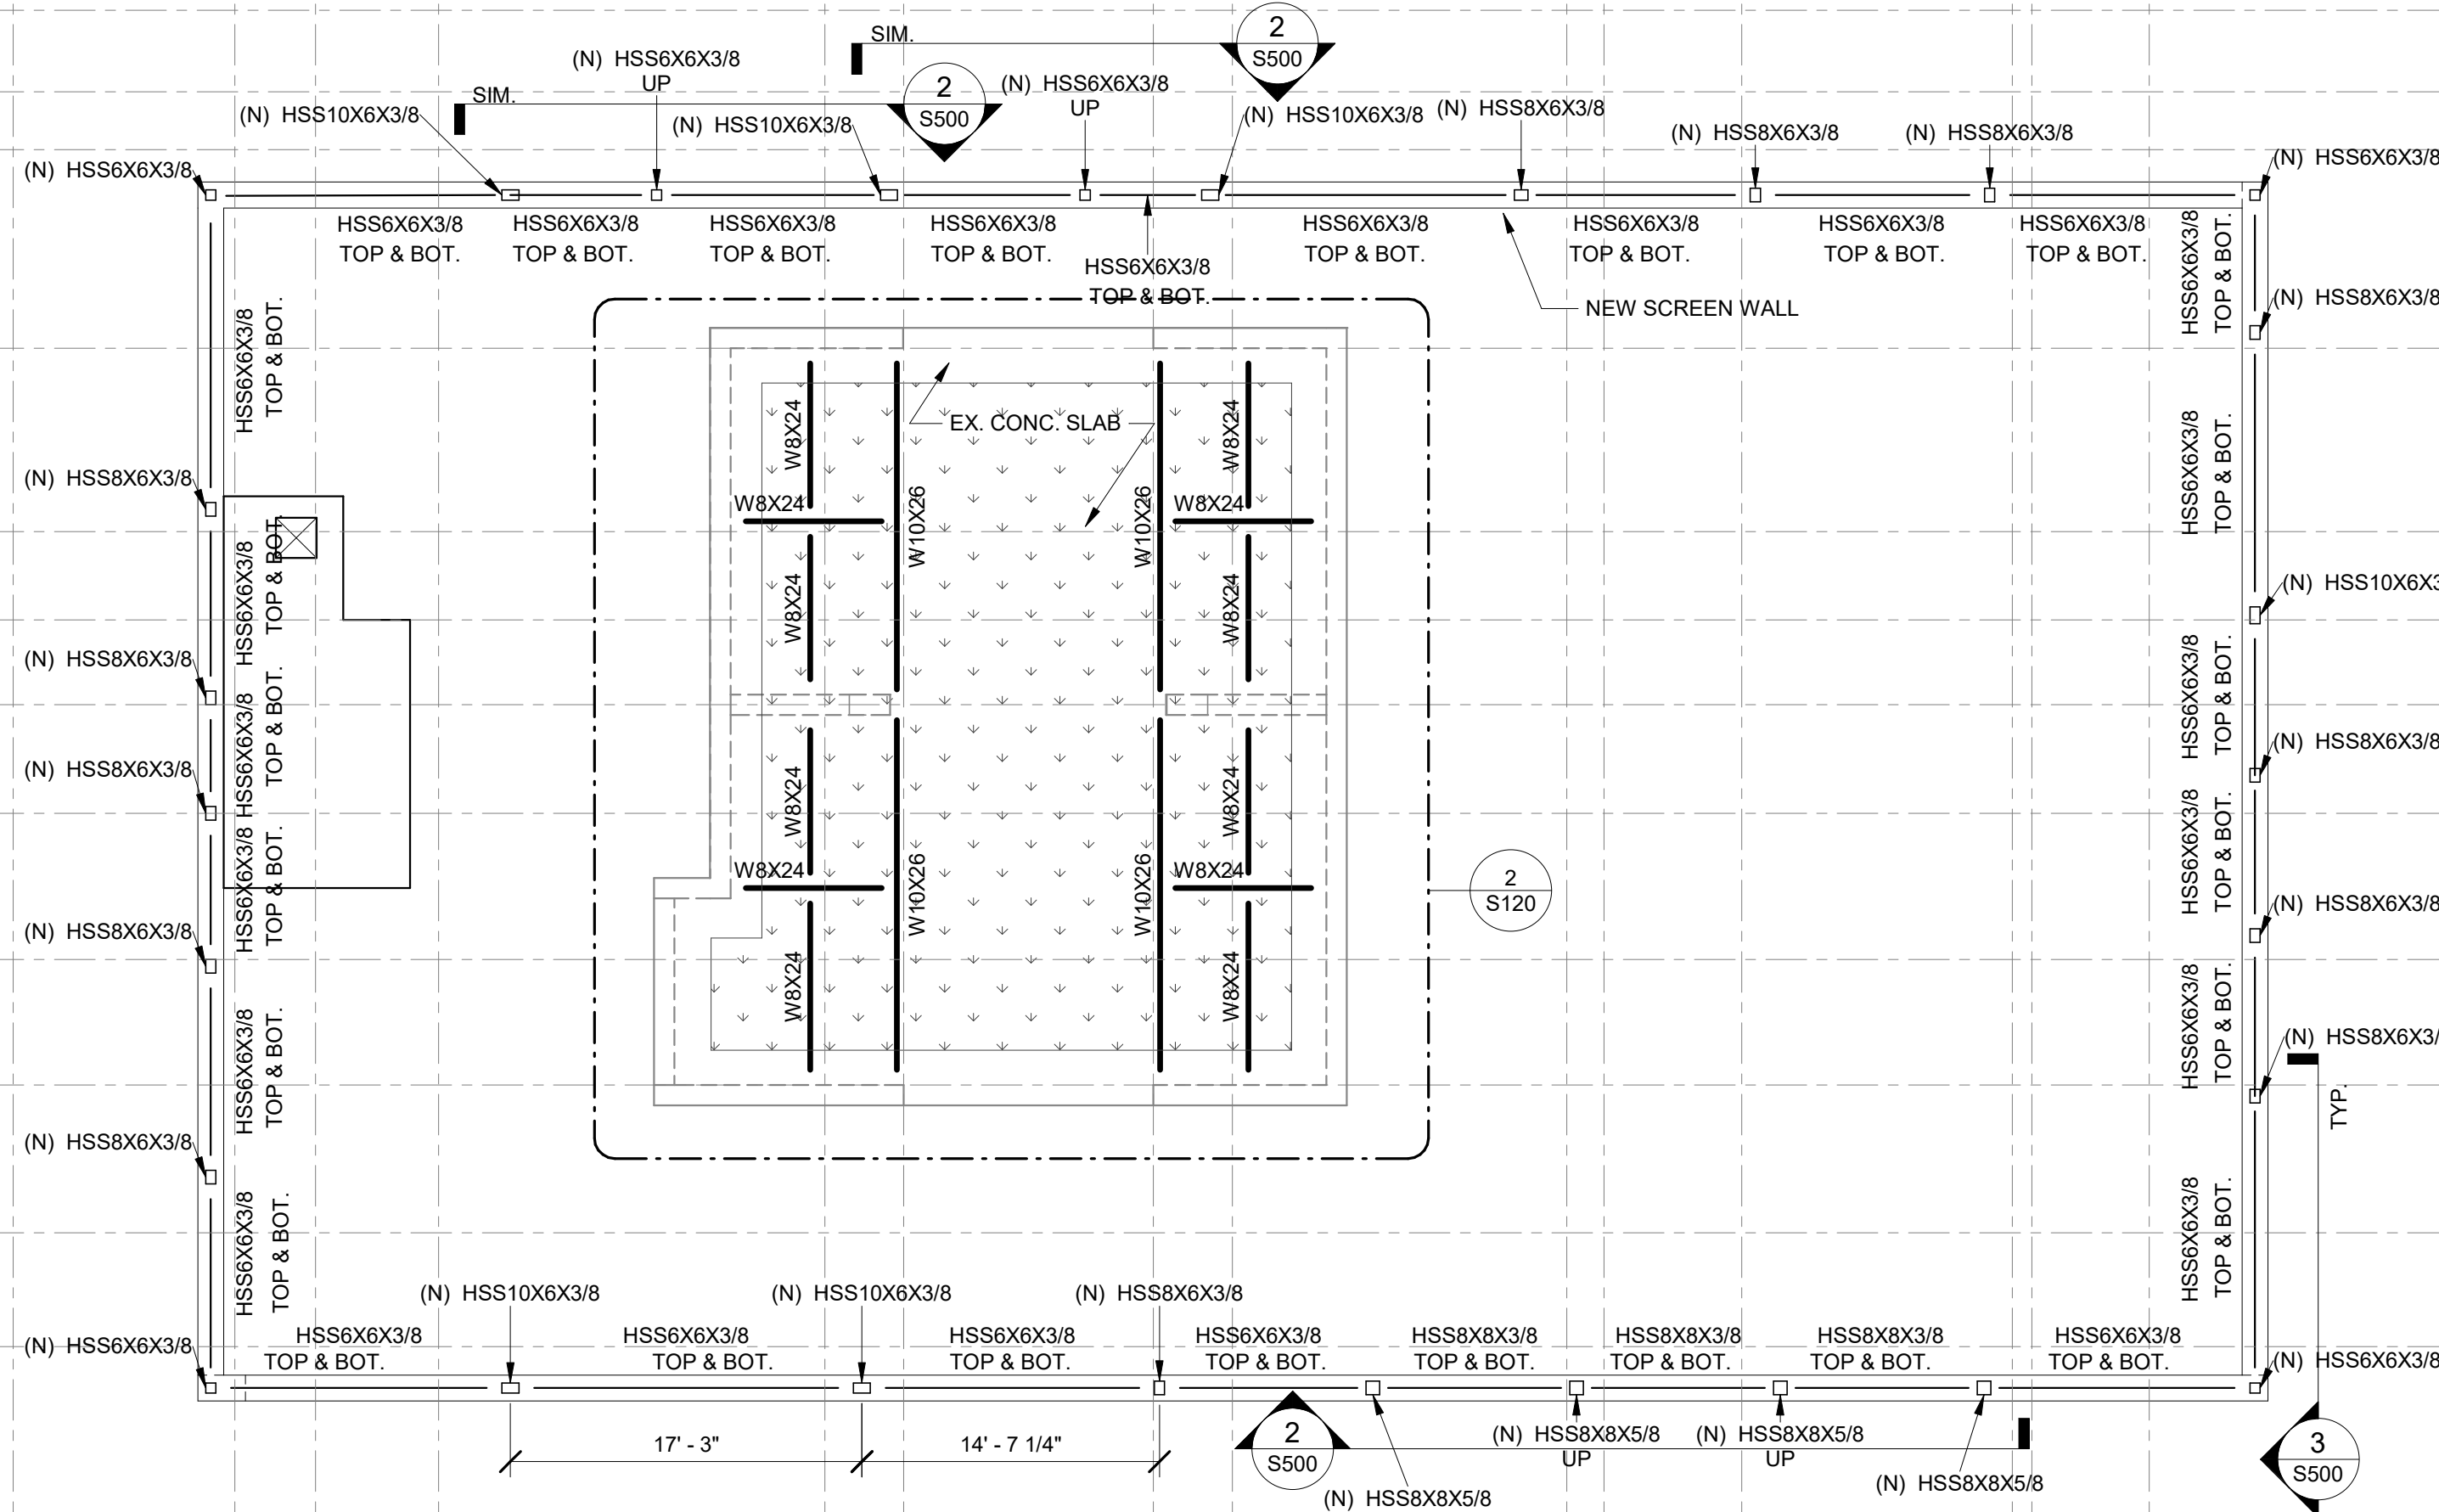

1 SCREEN WALL FRAMING PLAN
S112 SCALE: 1/8" = 1'-0"

PLAN NOTES:





- SEE ARCH DRAWINGS FOR TOP OF SLAB ELEVATION.
- SEE DWG. S300 SERIES FOR TYPICAL STEEL DETAILS.
- SEE DWG. S000 FOR GENERAL NOTES AND GRAPHICAL KEYS.
- SEE DWG S001 THRU S002 FOR STRUCTURAL DESIGN NOTES.
- SUBMIT GPR SCAN OR X-RAY OF EXISTING SLAB AND CONCRETE WALL REINFORCING FOR REVIEW BEFORE PLACMENT OF ANY POST-INSTALLED ANCHORS OR REBAR.
- COORDINATE THE LOCATIONS OF NEW OPENINGS WITH ARCH AND MEP DRAWINGS.
- DESIGN LIVE LOAD = 30 PSF @ TRELLISES
= 60 PSF @ GREENROOF AREAS
= 150 PSF AT MEP ROOMS

D

C

B

A

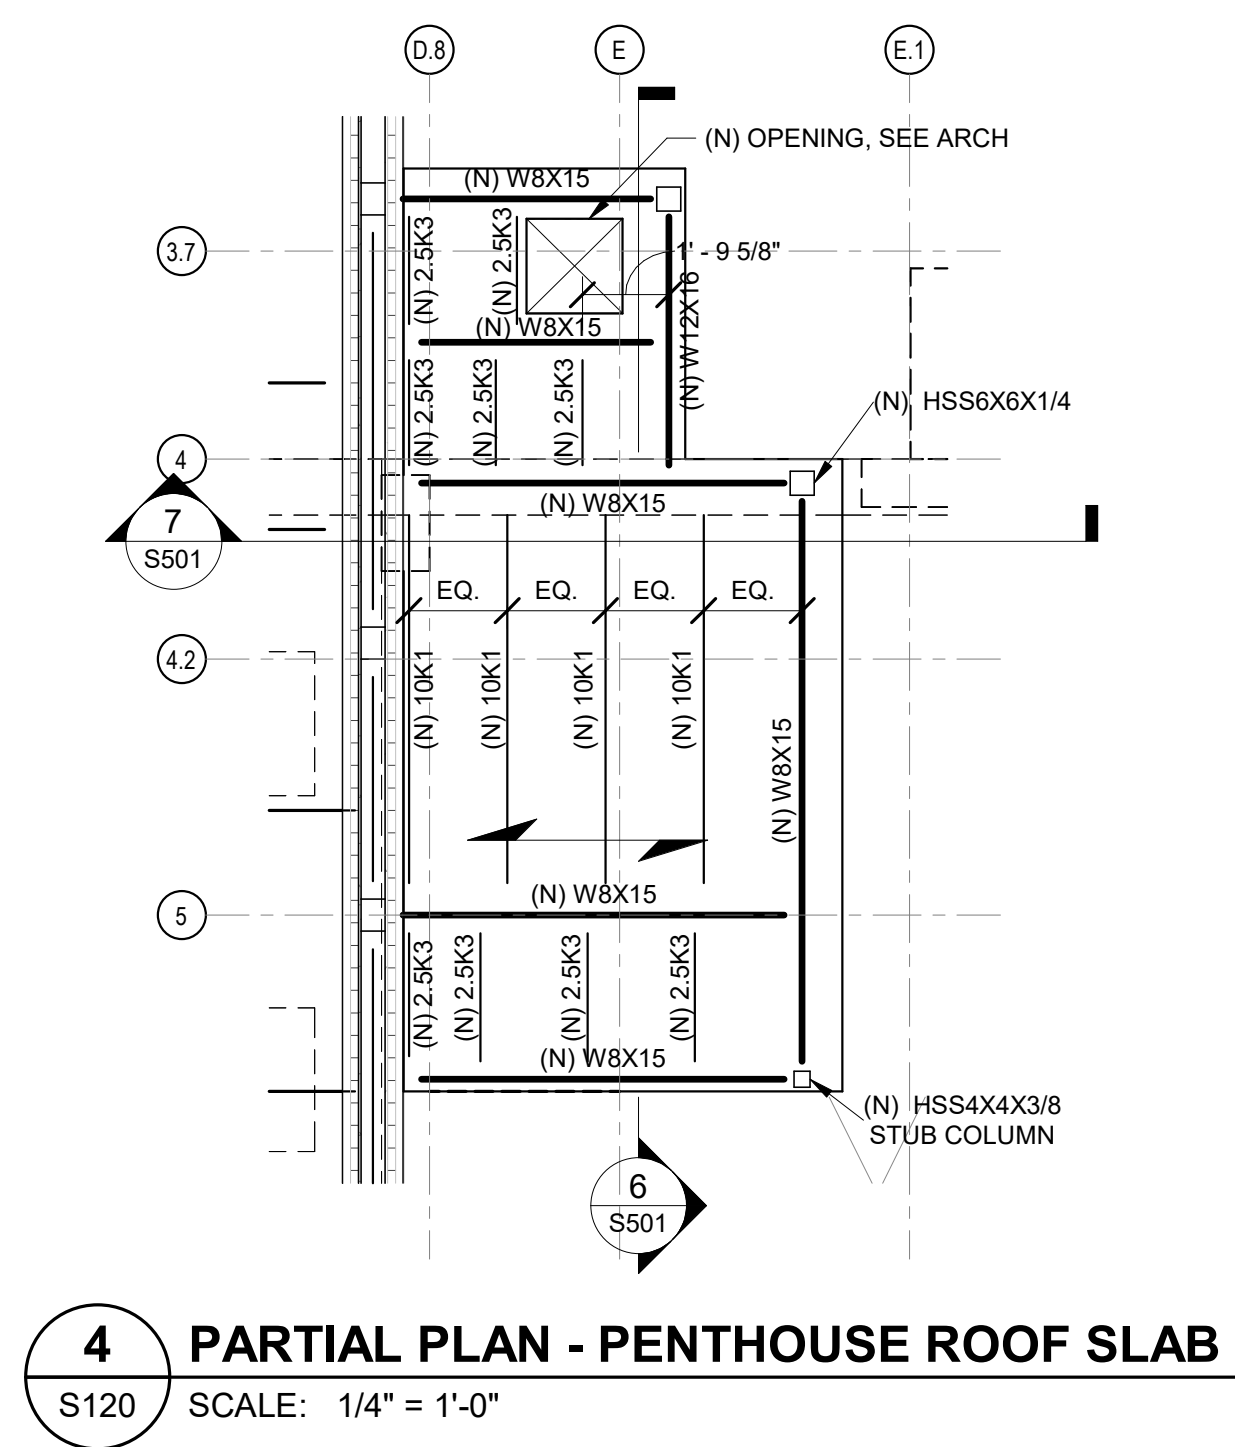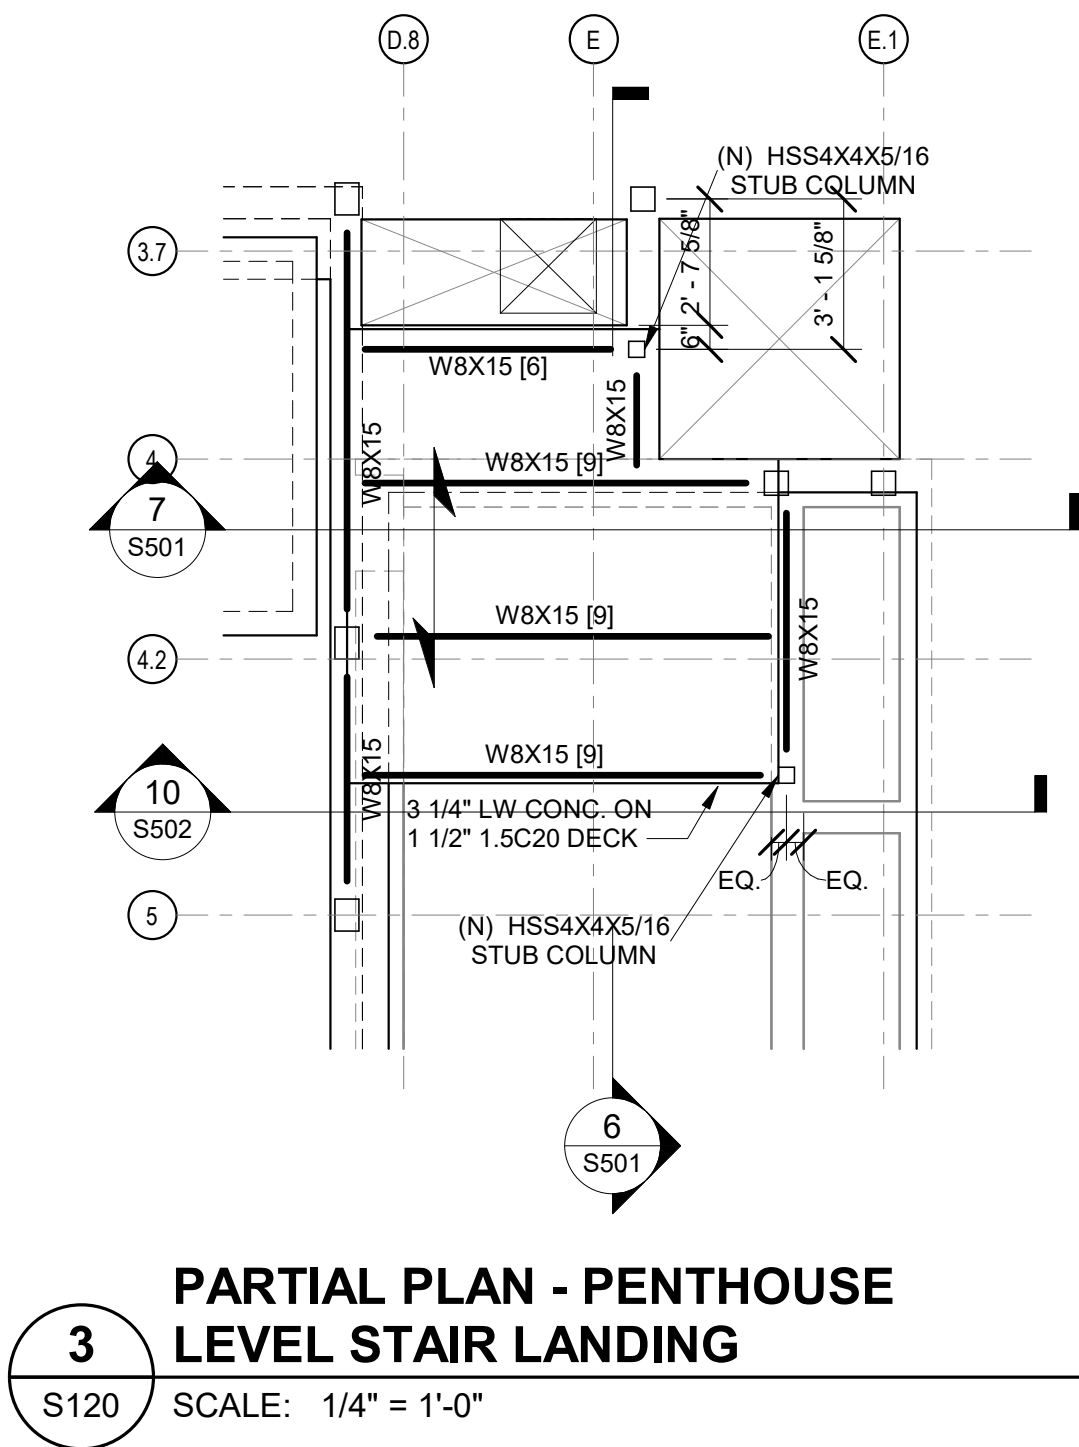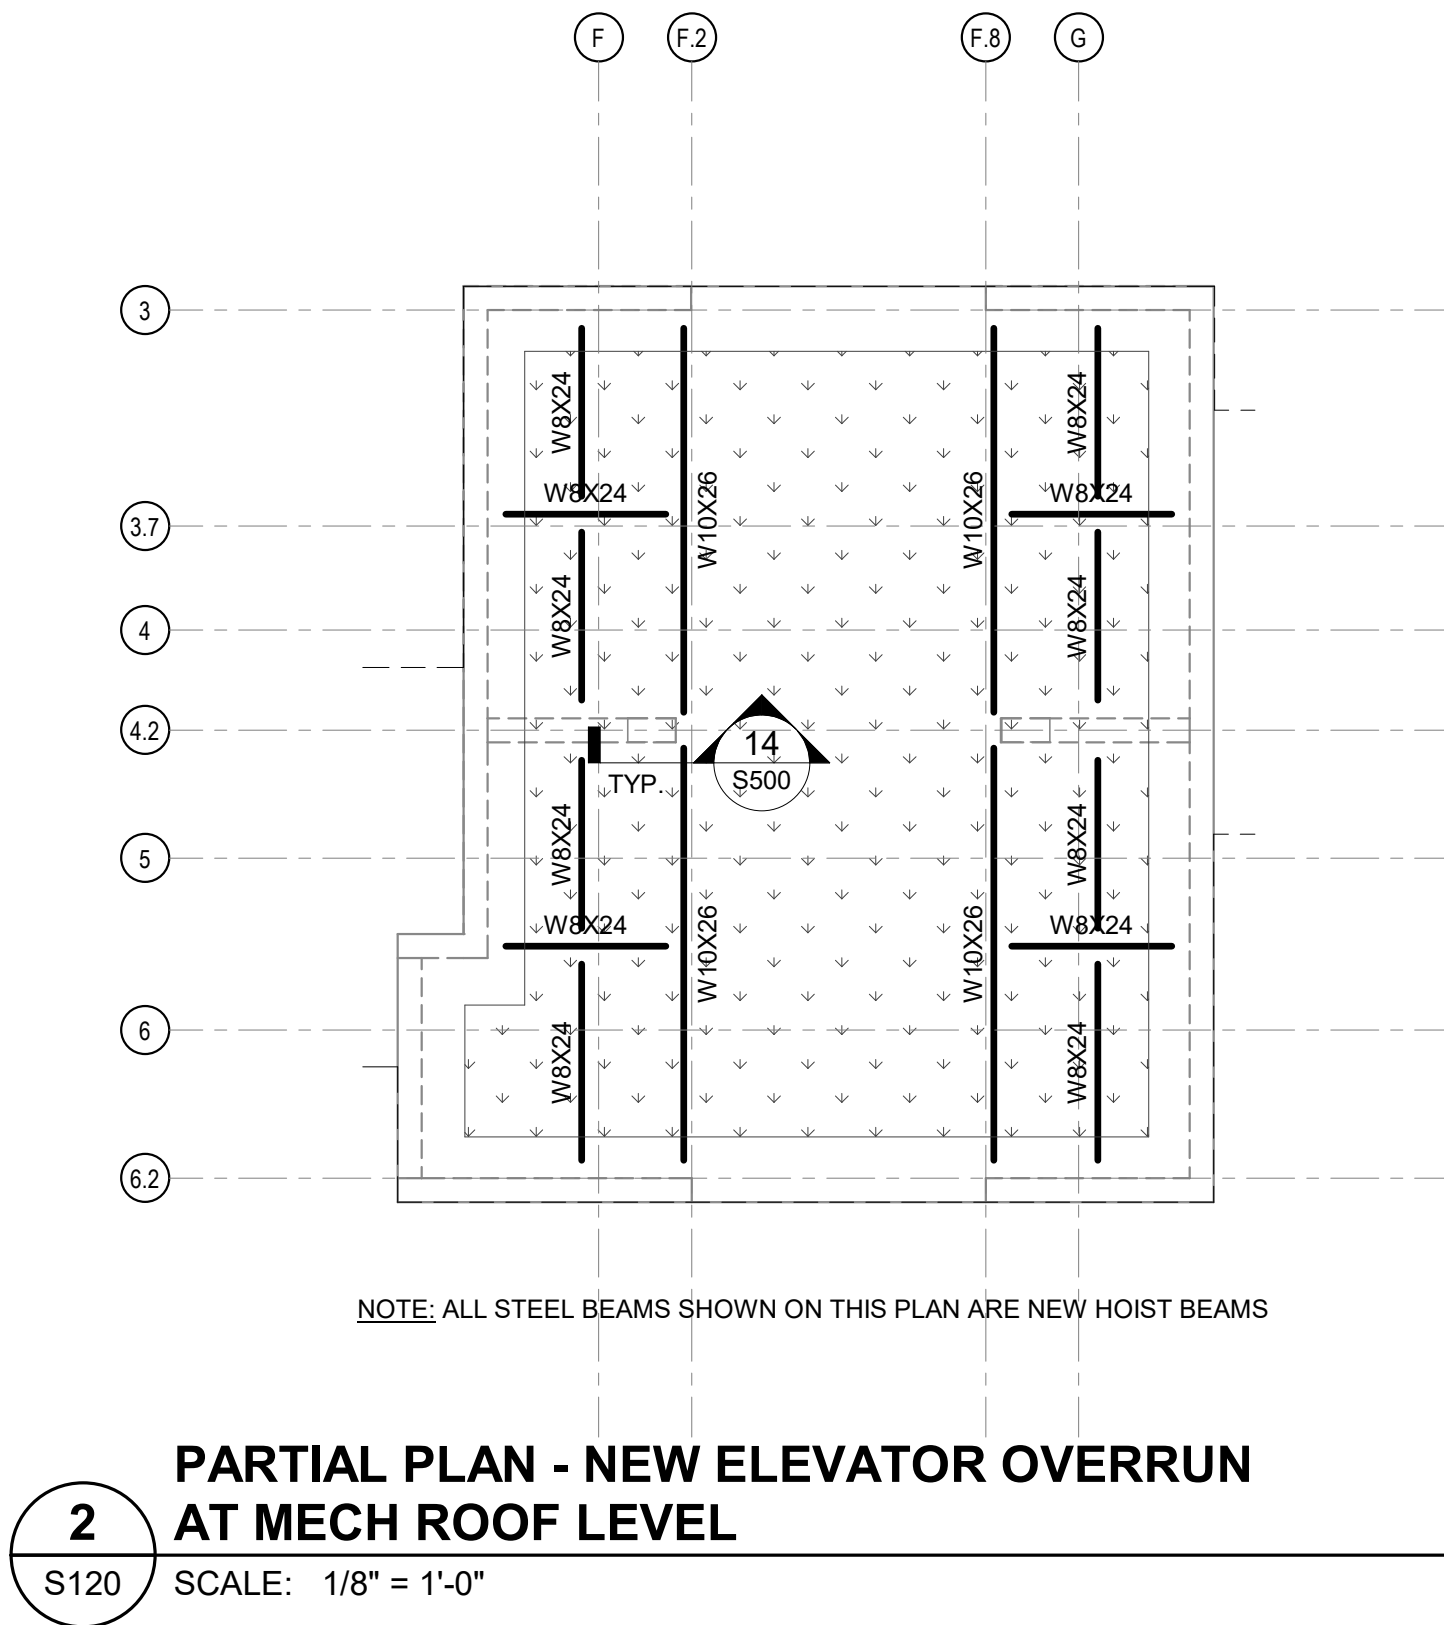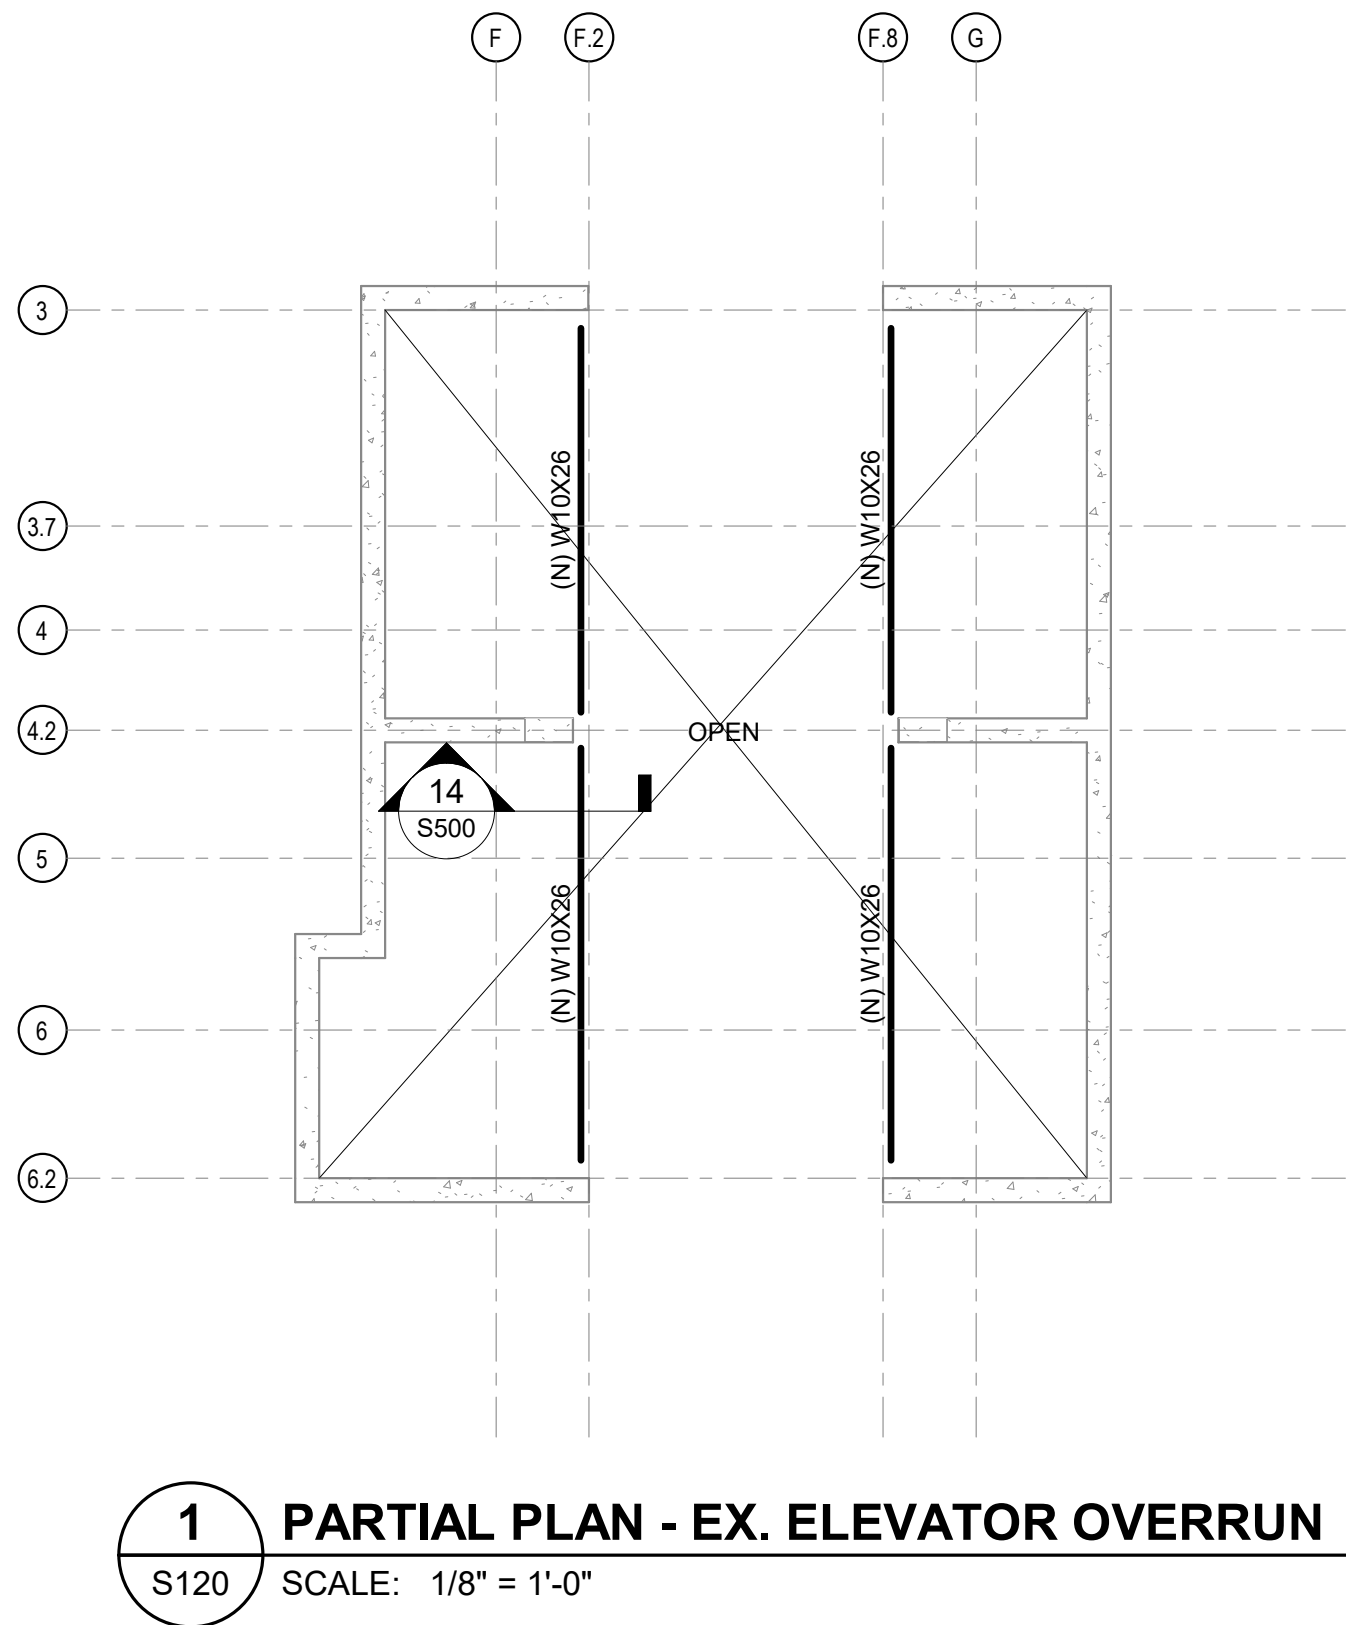


D

C

B

A

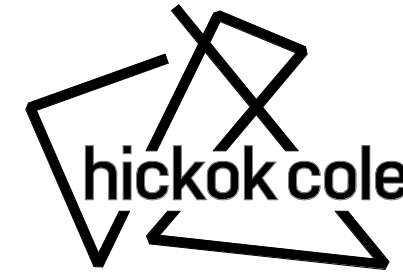

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com


CONSULTANTS
Delon Hampton
ASSOCIATES | CHARTERED
CIVIL | STRUCTURAL | PW/CM

PROJECT DETAILS
PROJECT NAME
1200 K St NW

CLIENT NAME
1200 K St NW
Washington, DC 20005

REVISIONS / NOTES			
#	DATE	DESCRIPTION	
1	03/17/2025	50% Design Development Set	
2	05/08/2025	100% DD	
3	08/28/2025	50% CD	
4	11/21/2025	CAMP PERMIT SET	

STAMP

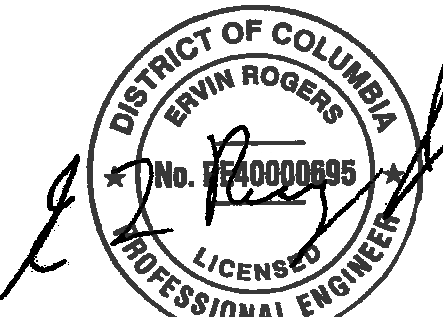

PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
PARTIAL PLANS

DRAWING NO.
S120

D

C


B

A

FRP STRENGTHENING									
FRP Strengthening Mark	Top or Bottom Slab Reinf.	Slab Thickness (in)	Effective Depth "d" (in)	Slab Effective Reinf. Width (in)	Existing Mild Steel Reinf. Area (in2)	Service Dead Load Moment (kip-ft)	Service Live Load Moment (kip-ft)	Service Moment Anticipated During FRP Installation (kip-ft)	Note
P2FRP4	TOP	9"	7 7/8"	10' - 0"	3.7	-58.3 kip-ft	-43.1 kip-ft	-54.1 kip-ft	
P2FRP3	TOP	9"	7 7/8"	10' - 0"	3.1	-66.1 kip-ft	-45.4 kip-ft	-61.5 kip-ft	
P2FRP2	TOP	9"	7 7/8"	10' - 0"	5.3	-116.5 kip-ft	-79.2 kip-ft	-108.6 kip-ft	
P2FRP1	TOP	9"	7 7/8"	11' - 6"	4.8	-99.8 kip-ft	-49.1 kip-ft	-94.8 kip-ft	
P1FRP5	TOP	9"	7 7/8"	10' - 0"	3.7	-64.2 kip-ft	-67.6 kip-ft	-57.5 kip-ft	
P1FRP4	TOP	9"	7 7/8"	11' - 0"	3.4	-57.4 kip-ft	-60.5 kip-ft	-51.3 kip-ft	
P1FRP3	TOP	9"	7 7/8"	11' - 0"	3.4	-38.1 kip-ft	-40.7 kip-ft	-34.1 kip-ft	
P1FRP2	TOP	9"	7 7/8"	11' - 0"	5.7	-105.3 kip-ft	-35.3 kip-ft	-101.9 kip-ft	
P1FRP1	TOP	9"	7 7/8"	11' - 0"	5.7	-109.3 kip-ft	-48.7 kip-ft	-104.5 kip-ft	
LLFRP16	TOP	8"	6 7/8"	8' - 6"	2.5	-43.3 kip-ft	-41.9 kip-ft	-40.5 kip-ft	
LLFRP15	TOP	10"	8 7/8"	10' - 0"	3.7	-59.8 kip-ft	-39.1 kip-ft	-49.9 kip-ft	
LLFRP14	TOP	10"	8 7/8"	10' - 0"	6.2	-111.6 kip-ft	-70.3 kip-ft	-87.7 kip-ft	
LLFRP13	TOP	10"	8 7/8"	18' - 0"	7.4	-136.1 kip-ft	-72.3 kip-ft	-90.2 kip-ft	
LLFRP12	TOP	10"	8 7/8"	11' - 0"	3.4	-61.2 kip-ft	-40.9 kip-ft	-49.5 kip-ft	
LLFRP10	TOP	8"	7"	7' - 0"	1.6	-17.8 kip-ft	-23.5 kip-ft	-15.5 kip-ft	
LLFRP9	TOP	8"	7"	5' - 6"	1.4	-60.2 kip-ft	-63.9 kip-ft	-51.2 kip-ft	
LLFRP8	TOP	8"	7"	5' - 0"	0.6	-6.6 kip-ft	-8.6 kip-ft	-5.8 kip-ft	
LLFRP7	TOP	8"	7"	5' - 0"	1.4	-25.3 kip-ft	-32.8 kip-ft	-19.8 kip-ft	
LLFRP6	TOP	6 1/2"	5 3/8"	6' - 0"	1.4	-8.4 kip-ft	-13.0 kip-ft	-7.0 kip-ft	
LLFRP5	TOP	6 1/2"	5 3/8"	8' - 0"	1.4	-13.5 kip-ft	-20.3 kip-ft	-11.0 kip-ft	
LLFRP4	TOP	6 1/2"	5 3/8"	12' - 0"	3.3	-43.8 kip-ft	-47.0 kip-ft	-39.2 kip-ft	
LLFRP3	TOP	10"	8 7/8"	14' - 0"	4.3	-97.1 kip-ft	-93.4 kip-ft	-88.5 kip-ft	
LLFRP2	TOP	10"	8 7/8"	12' - 6"	7.9	-89.8 kip-ft	-85.0 kip-ft	-82.0 kip-ft	
LLFRP1	TOP	10"	8 7/8"	8' - 0"	2.5	-97.6 kip-ft	-54.5 kip-ft	-83.5 kip-ft	
13FRP35	BOTTOM	9"	7 7/8"	10' - 0"	6.2	109.4 kip-ft	58.0 kip-ft	68.5 kip-ft	
13FRP34	BOTTOM	9"	7 7/8"	8' - 0"	5.3	75.9 kip-ft	68.5 kip-ft	59.2 kip-ft	
13FRP33	BOTTOM	9"	7 7/8"	10' - 0"	5.3	102.3 kip-ft	98.2 kip-ft	68.9 kip-ft	
13FRP32	BOTTOM	9"	7 7/8"	10' - 0"	7.9	111.0 kip-ft	103.6 kip-ft	71.6 kip-ft	
13FRP31	BOTTOM	9"	7 7/8"	15' - 0"	5.3	116.2 kip-ft	119.6 kip-ft	72.5 kip-ft	
13FRP30	BOTTOM	9"	7 7/8"	10' - 0"	6.2	122.2 kip-ft	81.0 kip-ft	65.3 kip-ft	
13FRP29	BOTTOM	9"	7 7/8"	10' - 0"	5.7	115.0 kip-ft	74.9 kip-ft	80.6 kip-ft	
13FRP28	BOTTOM	9"	7 7/8"	14' - 0"	7.0	118.4 kip-ft	83.6 kip-ft	82.9 kip-ft	
13FRP27	BOTTOM	9"	7 7/8"	23' - 0"	7.1	161.9 kip-ft	93.9 kip-ft	92.7 kip-ft	
13FRP26	BOTTOM	9"	7 7/8"	10' - 0"	4.3	113.1 kip-ft	54.1 kip-ft	54.9 kip-ft	
13FRP25	BOTTOM	9"	7 7/8"	18' - 0"	4.7	99.1 kip-ft	47.4 kip-ft	48.6 kip-ft	
13FRP24	BOTTOM	9"	7 7/8"	10' - 0"	4.3	91.3 kip-ft	37.5 kip-ft	54.5 kip-ft	
13FRP23	BOTTOM	9"	7 7/8"	18' - 0"	7.9	148.2 kip-ft	117.6 kip-ft	50.6 kip-ft	
13FRP22	BOTTOM	9"	7 7/8"	18' - 6"	5.7	147.4 kip-ft	76.1 kip-ft	74.9 kip-ft	
13FRP21	BOTTOM	9"	7 7/8"	10' - 0"	4.3	80.6 kip-ft	46.3 kip-ft	57.8 kip-ft	
13FRP20	BOTTOM	9"	7 7/8"	18' - 0"	4.7	80.1 kip-ft	39.6 kip-ft	50.9 kip-ft	
13FRP19	BOTTOM	9"	7 7/8"	10' - 0"	4.3	88.3 kip-ft	41.4 kip-ft	57.6 kip-ft	
13FRP18	TOP	9"	7 7/8"	20' - 0"	6.2	-93.4 kip-ft	-47.5 kip-ft	-53.5 kip-ft	
13FRP17	TOP	9"	7 7/8"	5' - 0"	0.6	-15.5 kip-ft	-23.6 kip-ft	-4.7 kip-ft	
13FRP16	TOP	6 1/2"	5 1/2"	12' - 0"	1.9	-16.8 kip-ft	-24.0 kip-ft	-13.1 kip-ft	
13FRP15	TOP	16 1/2"	15 3/8"	13' - 0"	3.7	-150.8 kip-ft	-105.3 kip-ft	-101.3 kip-ft	
13FRP14	TOP	9"	7 7/8"	3' - 6"	0.8	-31.8 kip-ft	-29.2 kip-ft	-21.0 kip-ft	
13FRP13	TOP	9"	7 7/8"	8' - 0"	1.2	-55.1 kip-ft	-22.9 kip-ft	-26.3 kip-ft	
13FRP12	TOP	9"	7 7/8"	8' - 0"	1.6	-93.2 kip-ft	-66.5 kip-ft	-71.5 kip-ft	
13FRP11	TOP	16 1/2"	15 3/8"	10' - 0"	14.2	-452.0 kip-ft	-340.0 kip-ft	-293.3 kip-ft	
13FRP10	TOP	16 1/2"	15 3/8"	10' - 0"	15.5	-522.8 kip-ft	-301.0 kip-ft	-301.8 kip-ft	
13FRP9	TOP	9"	93 3/4"	10' - 0"	9.6	-345.4 kip-ft	-283.8 kip-ft	-256.7 kip-ft	
13FRP8	TOP	9"	93 3/4"	5' - 8"	7.2	-120.1 kip-ft	-99.6 kip-ft	-81.2 kip-ft	
13FRP7	TOP	9"	93 3/4"	10' - 0"	9.6	-396.0 kip-ft	-269.3 kip-ft	-281.2 kip-ft	
13FRP6	TOP	9"	7 13/16"	8' - 4"	9.6	-151.4 kip-ft	-110.7 kip-ft	-104.5 kip-ft	
13FRP5	TOP	18 1/2"	17 5/16"	10' - 0"	16.8	-668.4 kip-ft	-433.9 kip-ft	-450.2 kip-ft	
13FRP4	TOP	9"	21 13/16"	10' - 6"	9.6	-665.2 kip-ft	-466.0 kip-ft	-457.0 kip-ft	Slab is 9" Thick w/ 16 1/2" Tapered Drop Panel
13FRP3	TOP	16 1/2"	15 3/8"	10' - 0"	15.5	-603.0 kip-ft	-306.0 kip-ft	-388.0 kip-ft	
13FRP2	TOP	16 1/2"	15 3/8"	10' - 0"	15.5	-590.2 kip-ft	-328.4 kip-ft	-386.2 kip-ft	
13FRP1	TOP	16 1/2"	15 3/8"	10' - 0"	15.5	-547.2 kip-ft	-336.4 kip-ft	-357.7 kip-ft	
12FRP13	BOTTOM	8"	6 7/8"	6' - 0"	1.2	14.0 kip-ft	16.0 kip-ft	27.0 kip-ft	
12FRP12	BOTTOM	8"	6 7/8"	3' - 0"	1.9	6.0 kip-ft	8.0 kip-ft	12.0 kip-ft	
12FRP11	TOP	8"	6 7/8"	3' - 0"	0.5	-11.0 kip-ft	-15.0 kip-ft	-25.0 kip-ft	
12FRP10	TOP	8"	6 7/8"	20' - 0"	3.5	-75.0 kip-ft	-75.0 kip-ft	-136.0 kip-ft	
12FRP9	TOP	8"	6 7/8"	9' - 0"	1.6	-90.0 kip-ft	-40.0 kip-ft	-120.0 kip-ft	
12FRP8	TOP	8"	6 7/8"	12' - 0"	3.1	-222.0 kip-ft	-84.0 kip-ft	-305.0 kip-ft	
12FRP7	TOP	22"	20 1/2"	2' - 0"	2.9	-112.0 kip-ft	-28.0 kip-ft	-146.0 kip-ft	
12FRP6	TOP	14"	12 1/2"	4' - 0"	4.8	-200.0 kip-ft	-70.0 kip-ft	-270.0 kip-ft	
12FRP5	TOP	22"	20 1/2"	2' - 0"	3.3	-112.0 kip-ft	-28.0 kip-ft	-146.0 kip-ft	
12FRP4	TOP	8"	6 7/8"	12' - 0"	4.8	-230.0 kip-ft	-90.0 kip-ft	-311.0 kip-ft	
12FRP3	TOP	8"	6 7/8"	9' - 0"	1.6	-90.0 kip-ft	-36.0 kip-ft	-123.0 kip-ft	
12FRP2	TOP	14"	12 1/2"	4' - 0"	4.5	-99.0 kip-ft	-63.0 kip-ft	-140.0 kip-ft	
12FRP1	TOP	8"	6 7/8"	9' - 0"	2.0	-200.0 kip-ft	-70.0 kip-ft	-270.0 kip-ft	
11FRP11	BOTTOM	8"	6 7/8"	3' - 6"	0.5	15.0 kip-ft	20.0 kip-ft	31.0 kip-ft	
11FRP10	BOTTOM	8"	6 7/8"	9' - 0"	1.2	26.0 kip-ft	24.0 kip-ft	34.0 kip-ft	
11FRP9	BOTTOM	8"	6 7/8"	23' - 0"	2.8	68.0 kip-ft	30.0 kip-ft	94.0 kip-ft	
11FRP8	TOP	8"	6 7/8"	6' - 0"	2.5	-24.0 kip-ft	-12.0 kip-ft	-33.0 kip-ft	
11FRP7	TOP	8"	6 7/8"	7' - 0"	1.9	-33.0 kip-ft	-14.0 kip-ft	-46.0 kip-ft	
11FRP6	TOP	8"	6 7/8"	11' - 0"	3.5	-252.0 kip-ft	-82.0 kip-ft	-325.0 kip-ft	
11FRP5	TOP	8"	6 7/8"	6' - 0"	1.3	-45.0 kip-ft	-22.0 kip-ft	-65.0 kip-ft	
11FRP4	TOP	8"	6 7/8"	8' - 0"	1.5	-32.0 kip-ft	-28.0 kip-ft	-54.0 kip-ft	
11FRP3	TOP	8"	6 7/8"	14' - 0"	2.1	-215.0 kip-ft	-101.0 kip-ft	-296.0 kip-ft	
11FRP2	TOP	14"	12 1/2"	4' - 0"	10.3	-230.0 kip-ft	-100.0 kip-ft	-310.0 kip-ft	
11FRP1	TOP	8"	6 7/8"	10' - 0"	3.5	-270.0 kip-ft	-100.0 kip-ft	-365.0 kip-ft	
6FRP8	TOP	9"	10 3/16"	6' - 0"	1.2	-265.4 kip-ft	-137.4 kip-ft	-243.3 kip-ft	Slab is 9" Thick w/ 16 1/2" Tapered Drop Panel
6FRP7	TOP	9"	7 7/8"	10' - 0"	4.4	-58.3 kip-ft	-65.4 kip-ft	-50.5 kip-ft	
6FRP6	TOP	9"	7 7/8"	7' - 0"	1.2	-22.4 kip-ft	-25.0 kip-ft	-18.9 kip-ft	
6FRP5	TOP	9"	7 7/8"	7' - 0"	0.8	-7.0 kip-ft	-8.2 kip-ft	-5.9 kip-ft	
6FRP4	TOP	9"	7 7/8"	8' - 0"	4.2	-42.8 kip-ft	-51.0 kip-ft	-37.3 kip-ft	
6FRP3	TOP	9"	10 5/8"	9' - 0"	5.0	-183.3 kip-ft	-94.7 kip-ft	-163.7 kip-ft	Slab is 9" Thick w/ 16 1/2" Tapered Drop Panel
6FRP2	TOP	9"	7 7/8"	6' - 0"	1.2	-15.1 kip-ft	-19.0 kip-ft	-11.1 kip-ft	
6FRP1	TOP	9"	7 7/8"	5' - 6"	0.6	-21.4 kip-ft	-10.0 kip-ft	-19.1 kip-ft	
2FRP6	TOP	22"	20 3/4"	2' - 0"	2.4	-271.0 kip-ft	-62.1 kip-ft	-267.9 kip-ft	
2FRP5	TOP	8"	6 7/8"	10' - 0"	4.4	-56.7 kip-ft	-65.4 kip-ft	-51.8 kip-ft	
2FRP4	TOP	8"	6 7/8"	6' - 0"	1.9	-19.9 kip-ft	-23.5 kip-ft	-15.6 kip-ft	
2FRP3	TOP	8"	6 7/8"	7' - 0"	1.2	-22.2 kip-ft	-25.7 kip-ft	-19.7 kip-ft	
2FRP2	TOP	8"	6 7/8"	7' - 0"	0.8	-6.4 kip-ft	-6.9 kip-ft	-5.6 kip-ft	
2FRP1	TOP	8"	6 7/8"	8' - 0"	4.2	-36.1 kip-ft	-44.1 kip-ft	-32.7 kip-ft	
1FRP2	TOP	8"	6 7/8"	11' - 0"	2.2	-40.0 kip-ft	-25.4 kip-ft	-37.4 kip-ft	
1FRP1	TOP	8"	6 7/8"	20' - 0"	7.8	-79.4 kip-ft	-69.6 kip-ft	-71.6 kip-ft	

SLAB THICKNESS TO BE VERIFIED IN FIELD

D

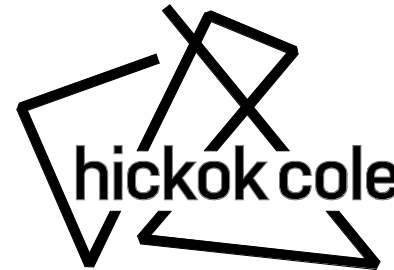

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set

STAMP

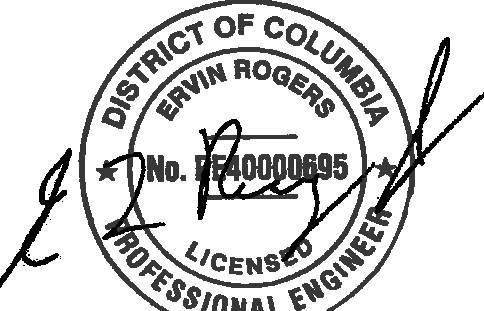

PROJECT NO.

24048

DRAWN BY

Author

SCALE


DRAWING TITLE

**FRP
STRENGTHENING
SCHEDULE**


DRAWING NO.

S201


D

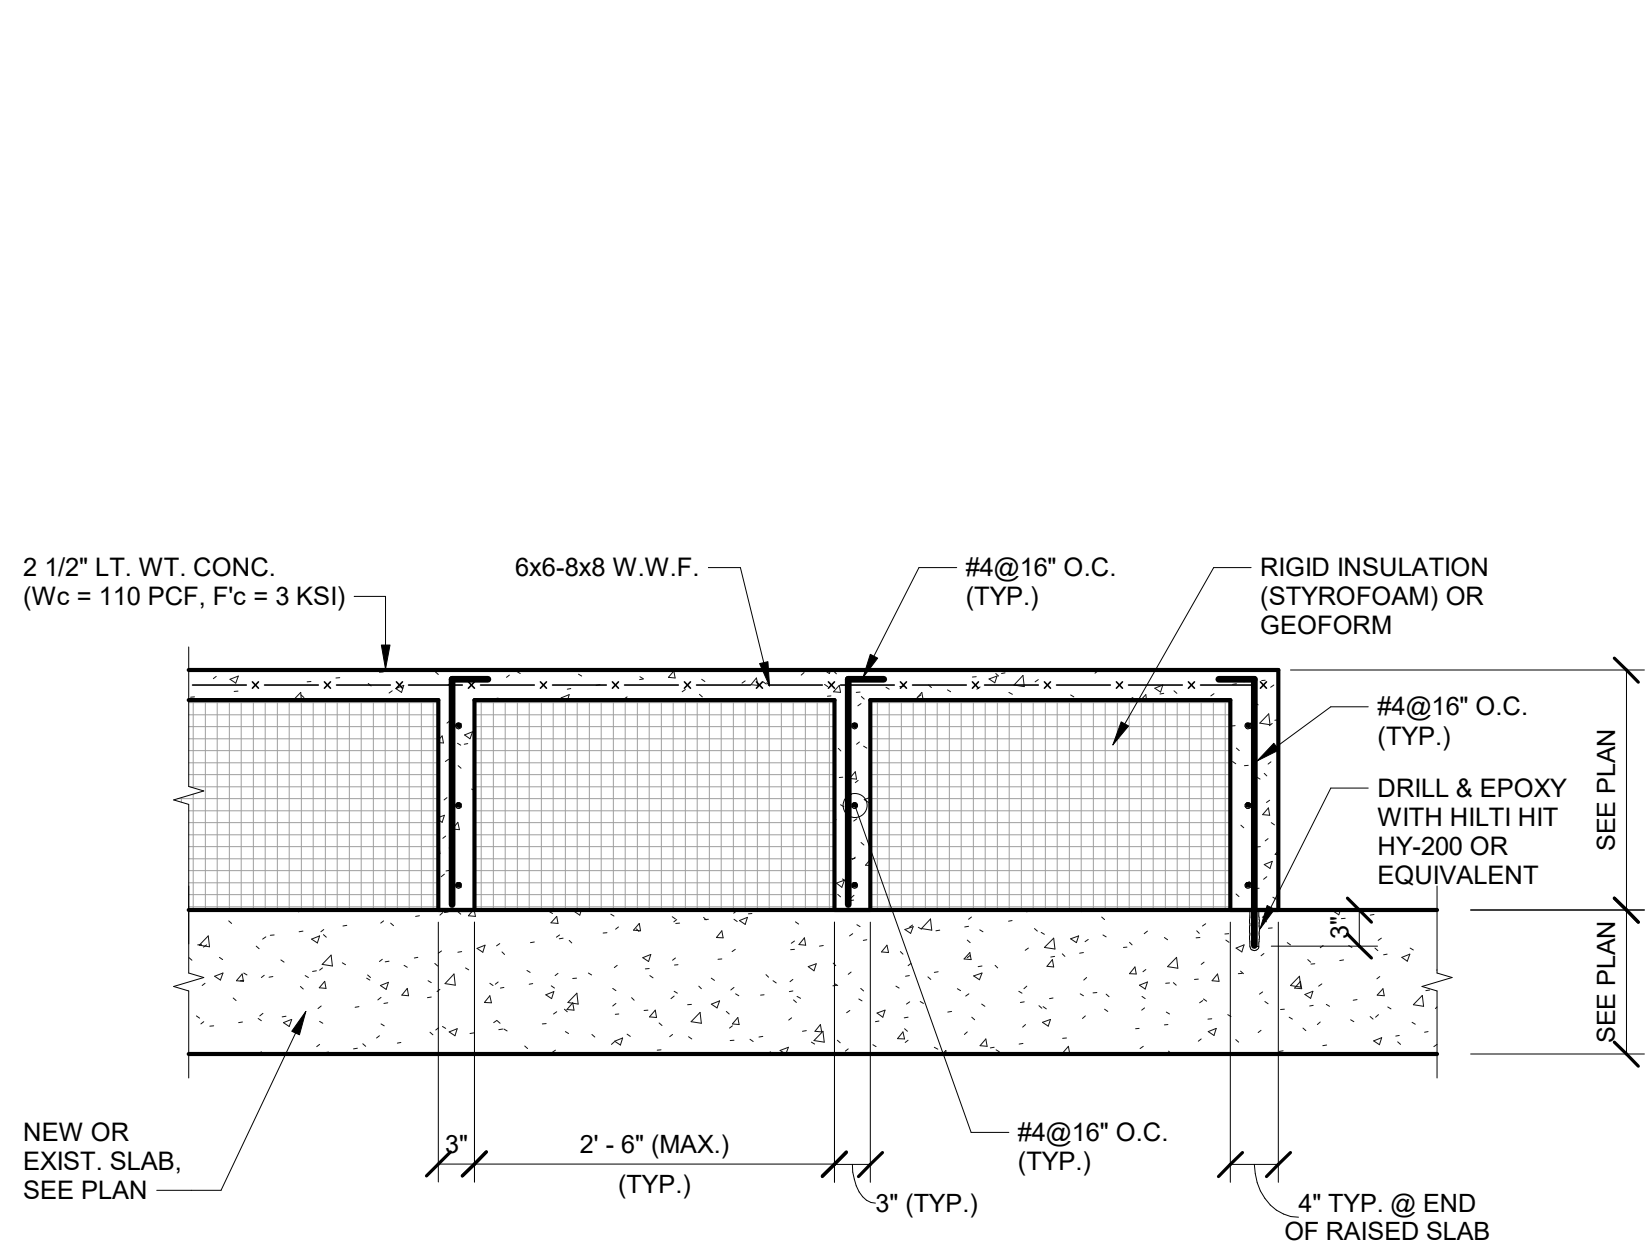

TYPICAL RAISED SLAB OPTION I

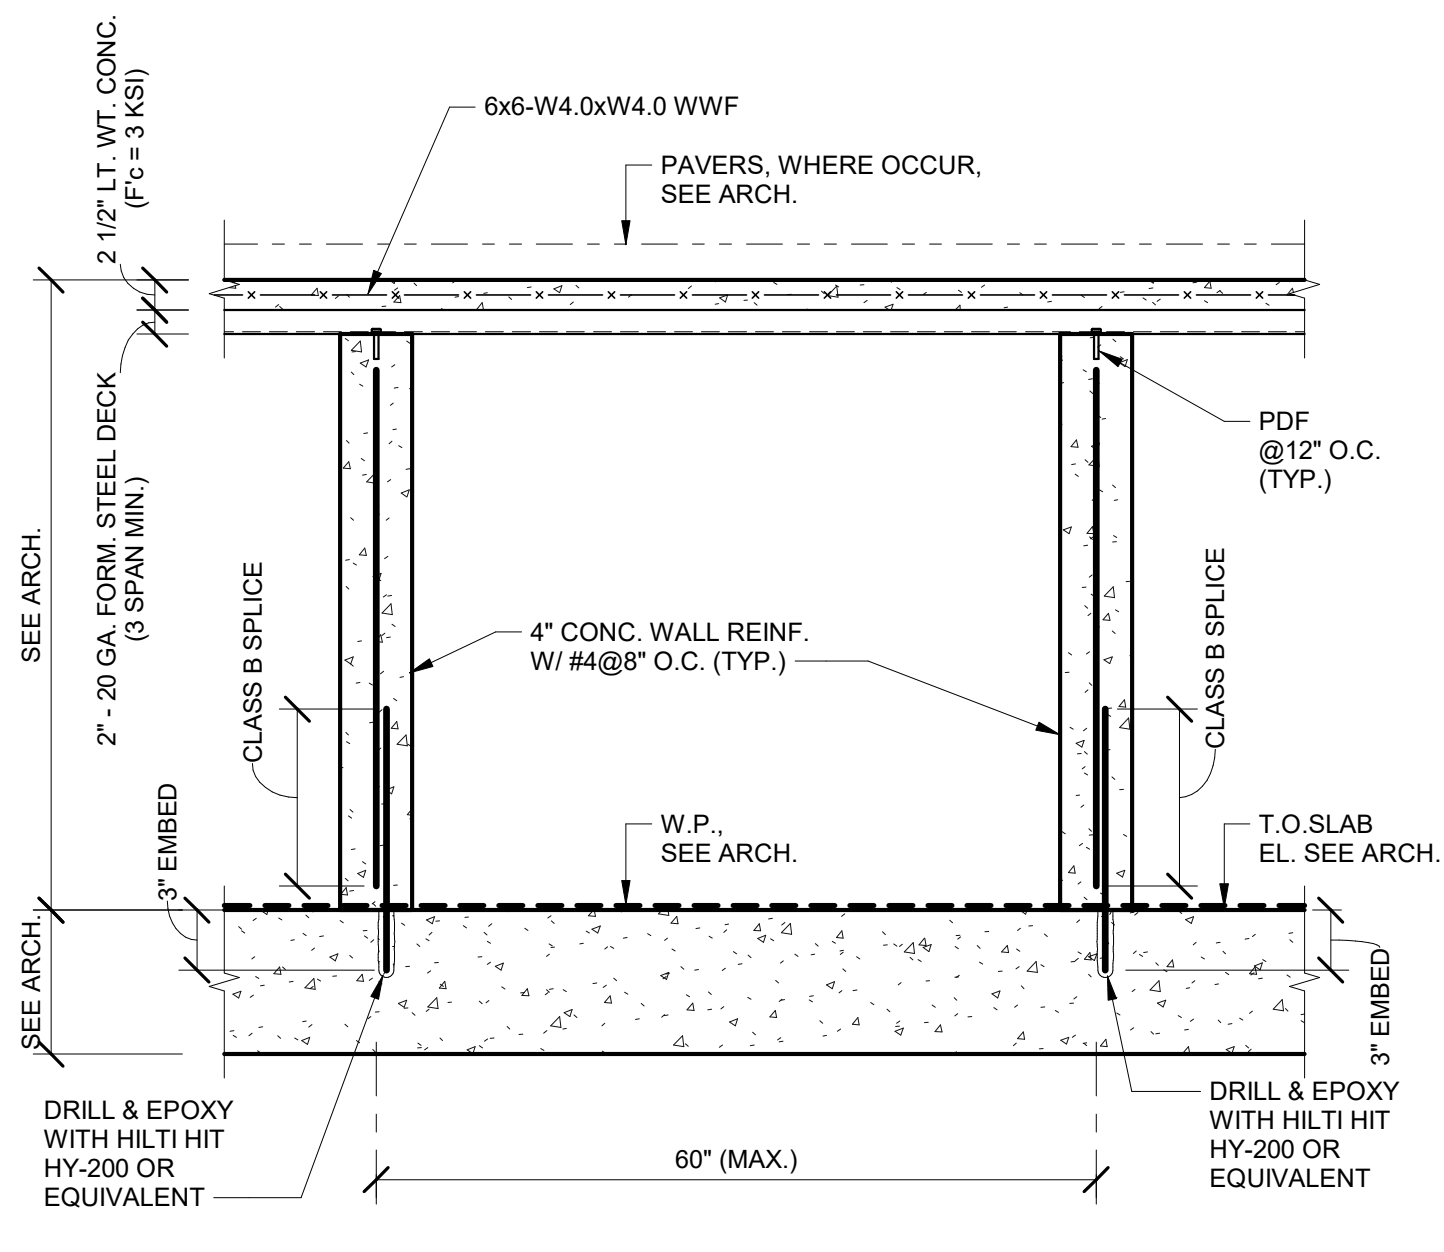

TYPICAL RAISED SLAB OPTION II

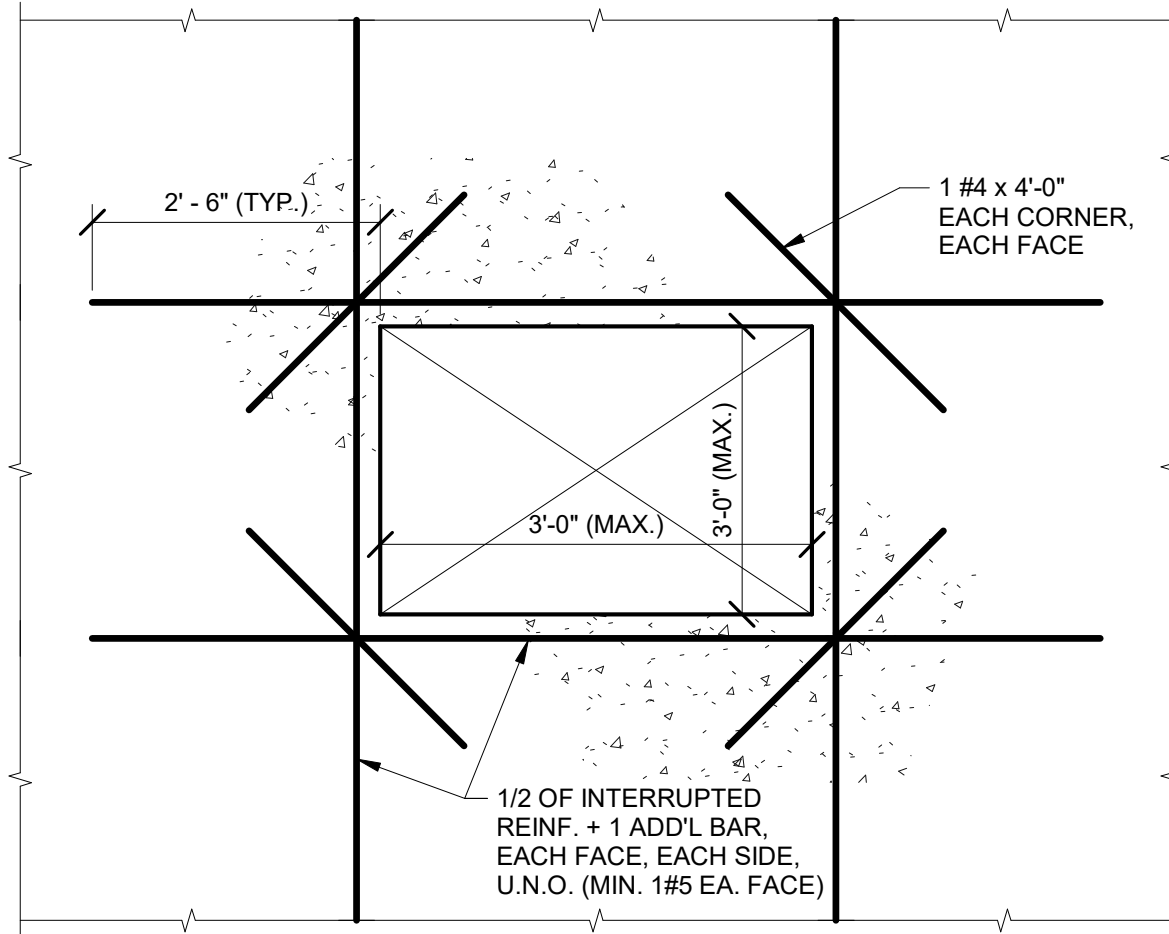


1 TYPICAL RAISED SLAB

S300 SCALE: 3/4" = 1'-0"


2 OPENING AT CONCRETE WALL

S300 SCALE: 3/4" = 1'-0"

C

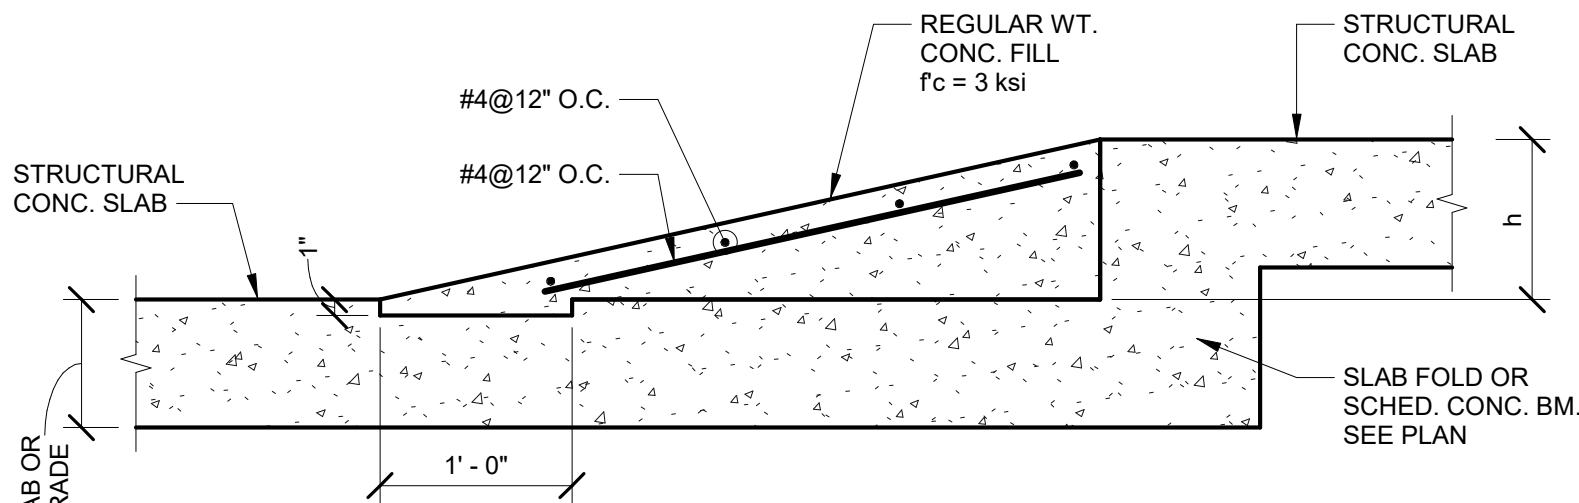


AT HEIGHT DIFFERENCE 'h' < 1'-0"

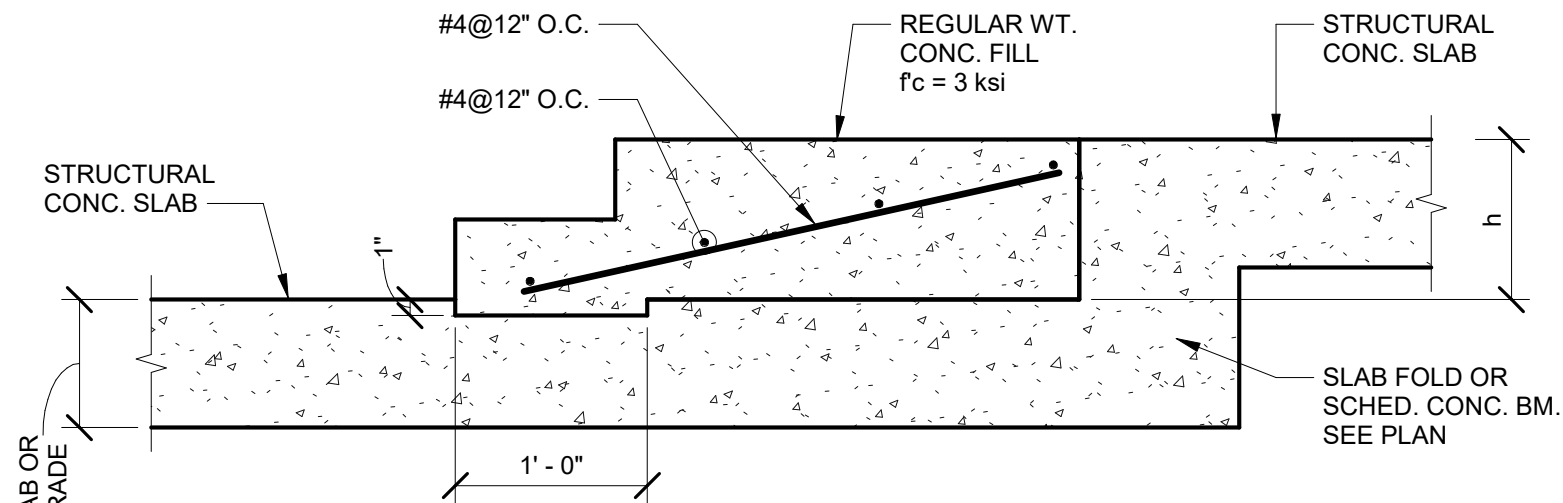


AT HEIGHT DIFFERENCE 'h' < 1'-0"


B

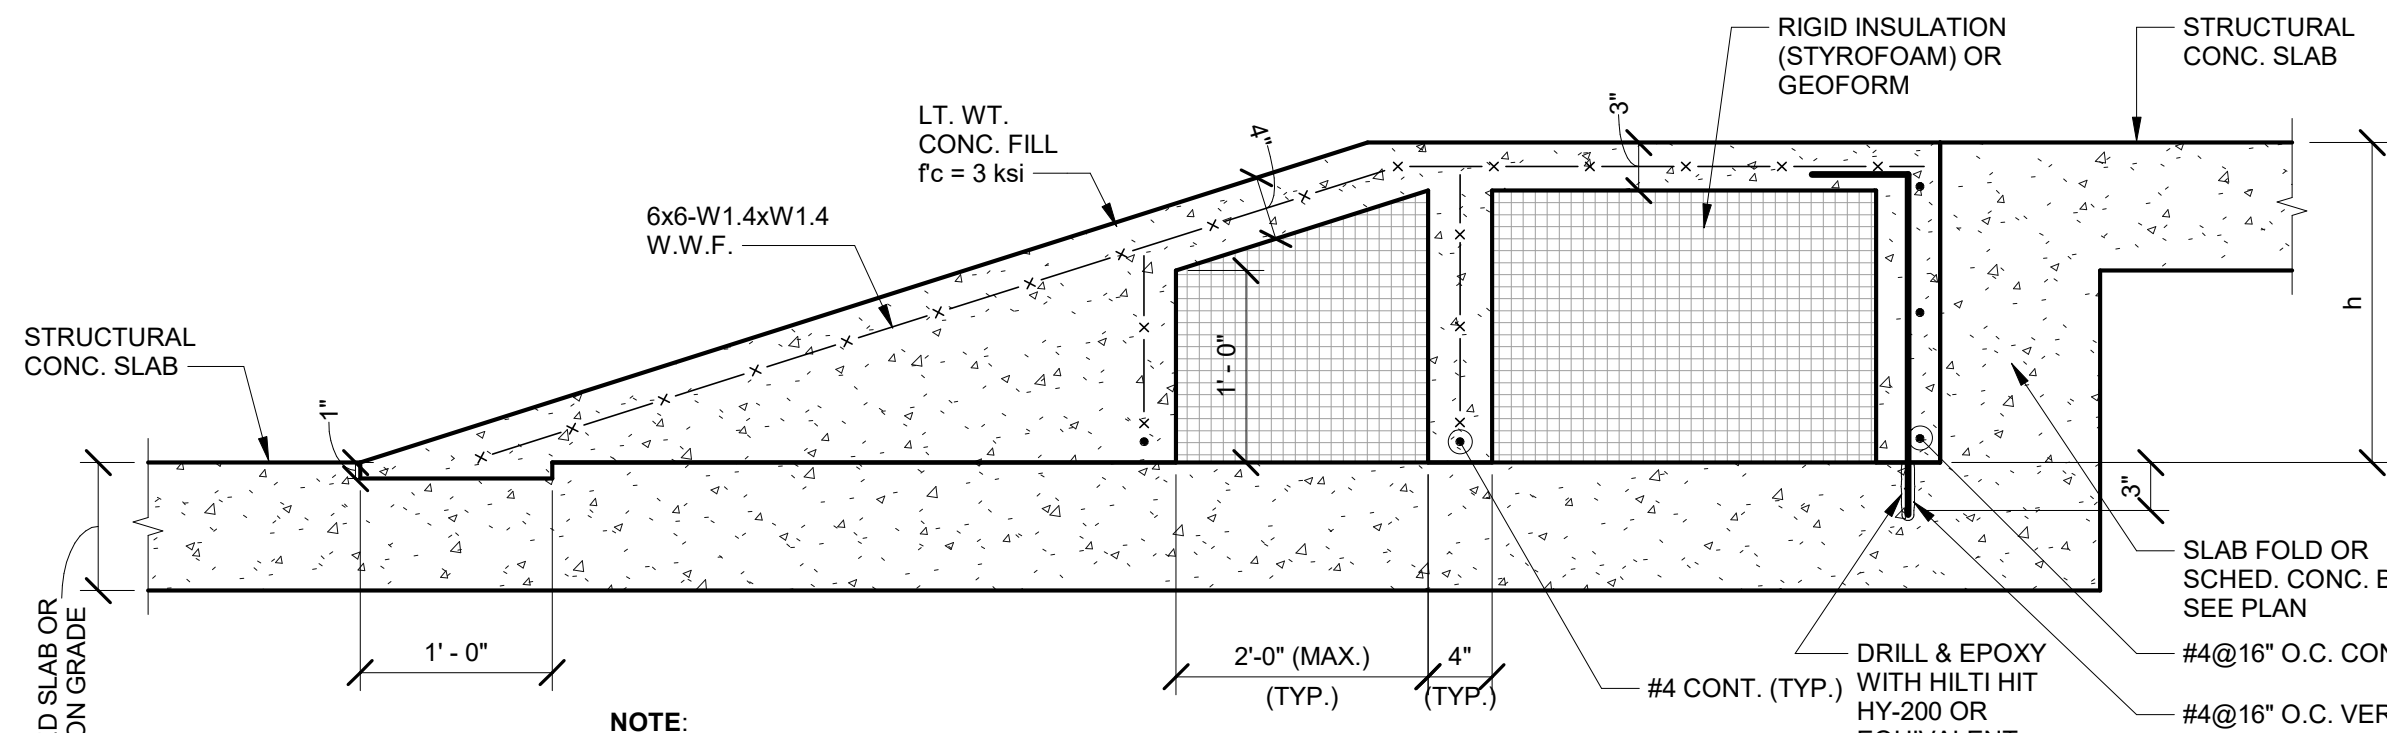

AT HEIGHT DIFFERENCE 'h' ≥ 1'-0"

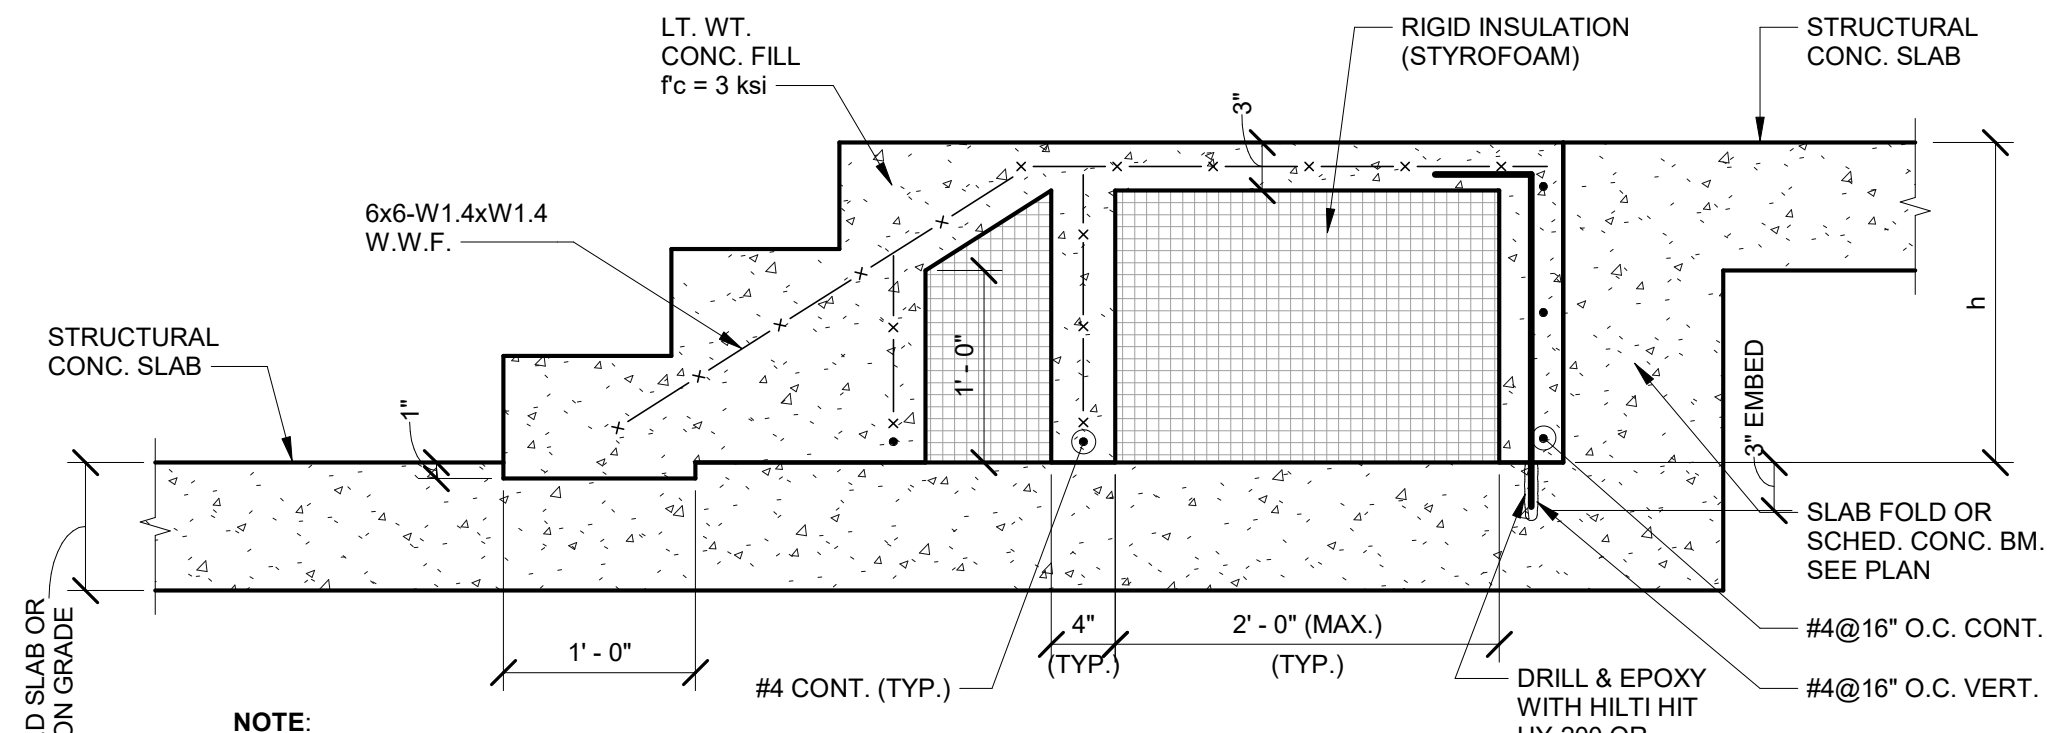

AT HEIGHT DIFFERENCE 'h' ≥ 1'-0"

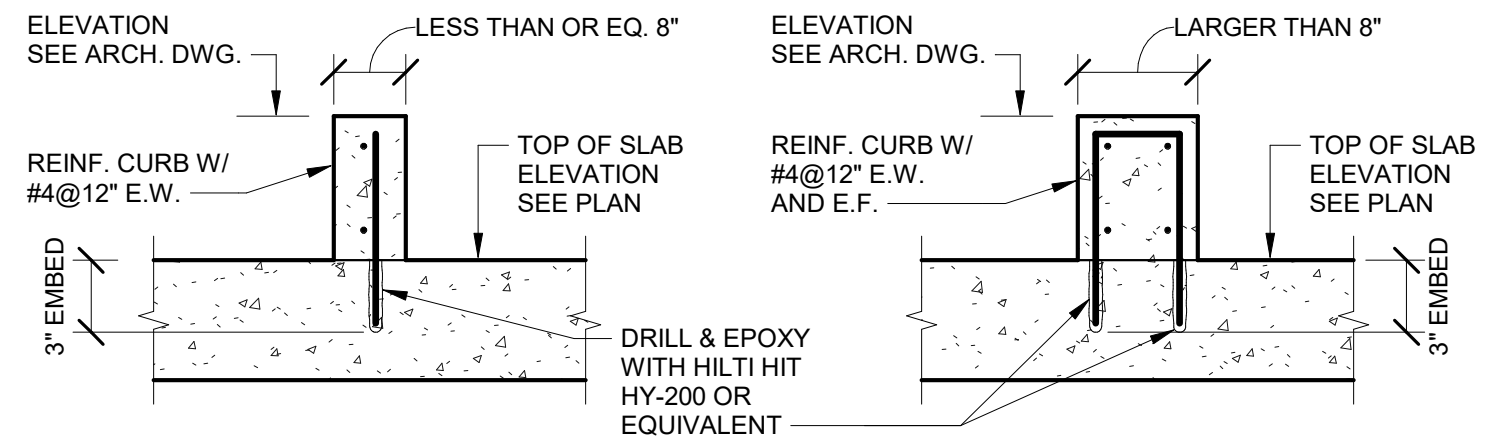

3 DETAIL - TYPICAL BUILT-UP RAMP

S300 SCALE: 1" = 1'-0"


4 DETAIL - TYPICAL BUILT-UP STAIR

S300 SCALE: 1" = 1'-0"

5 TYPICAL CURB REINFORCING


S300 SCALE: 3/4" = 1'-0"

A

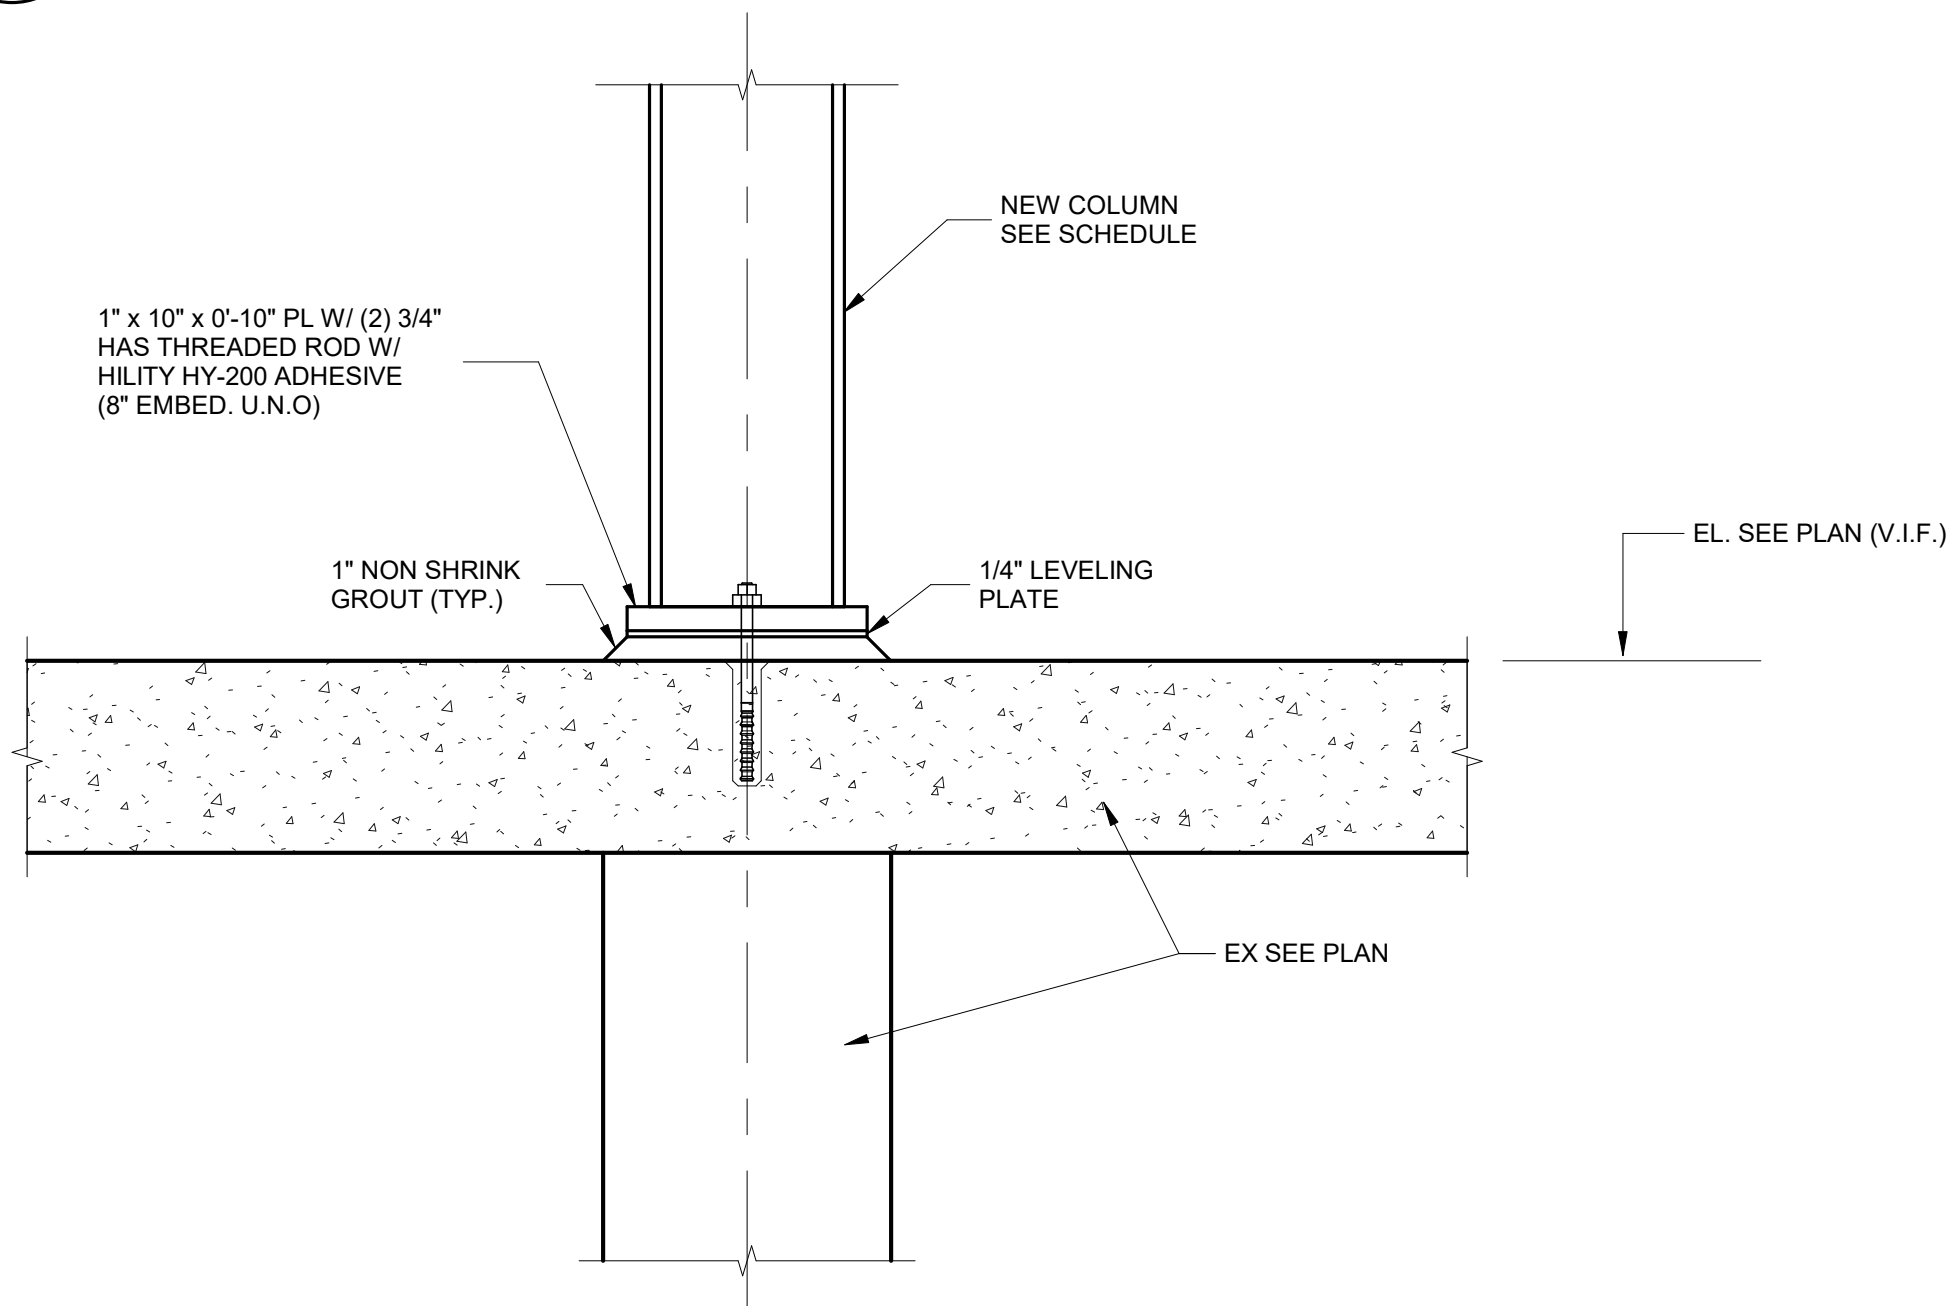



7B-2 - TYPICAL CONNECTION TO EX COLUMN TO COLUMN

S300 SCALE: 1 1/2" = 1'-0"

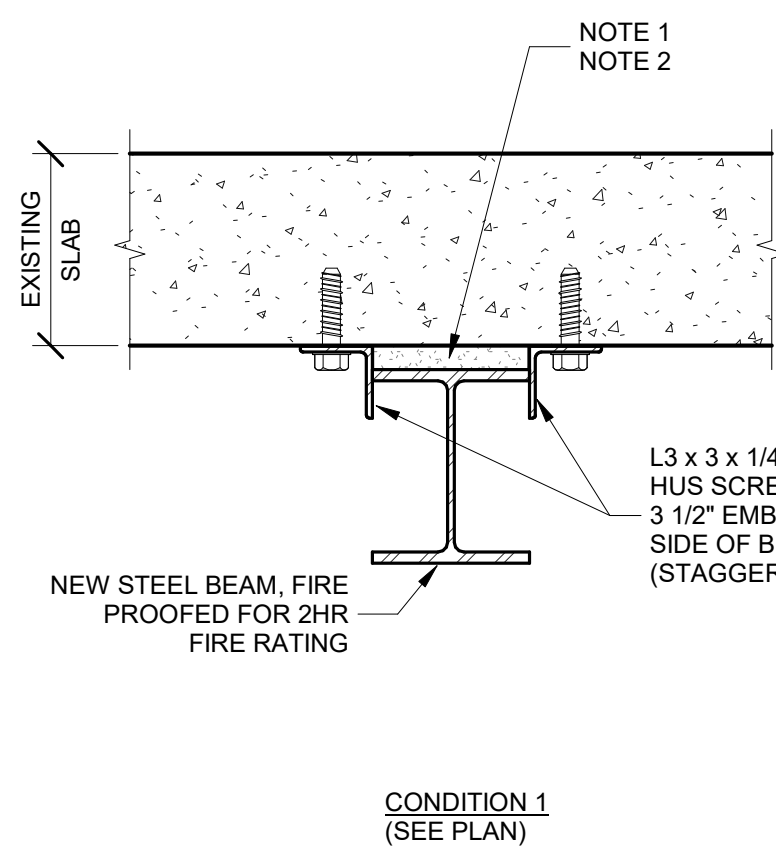


7D-1 - TYPICAL NEW STEEL BEAM UNDER EX SLAB

S300 SCALE: 1 1/2" = 1'-0"

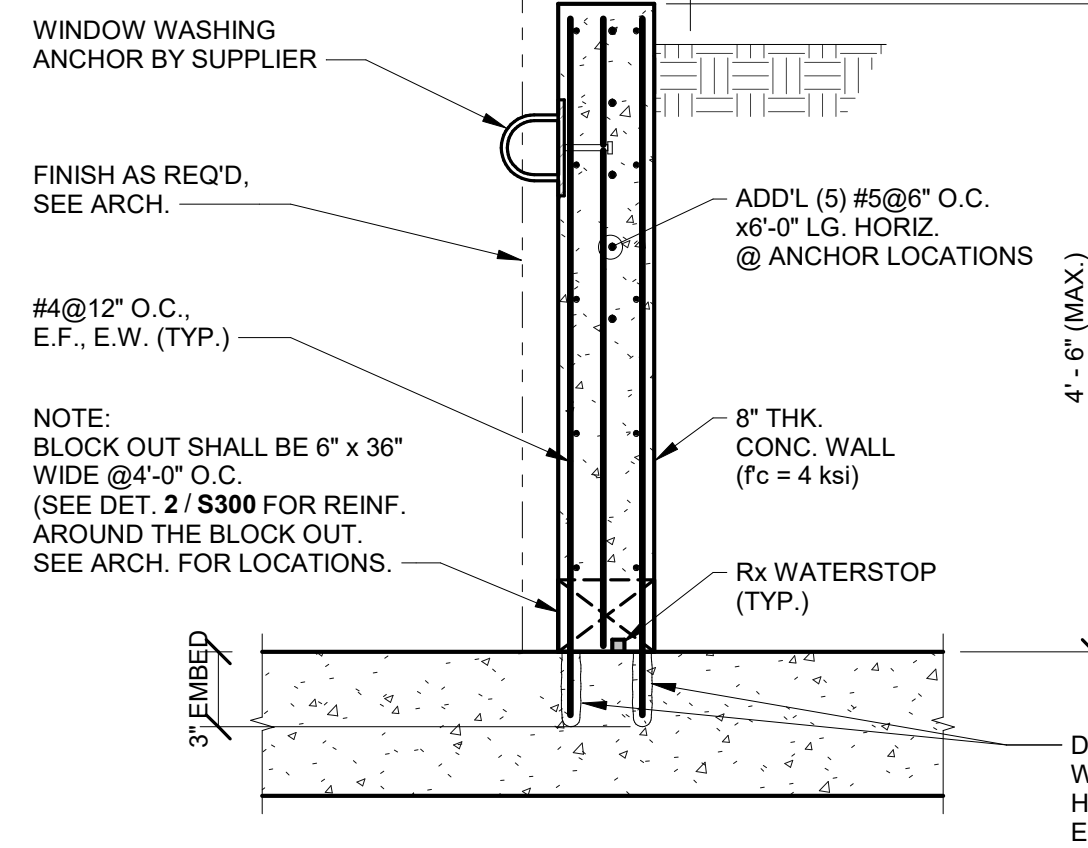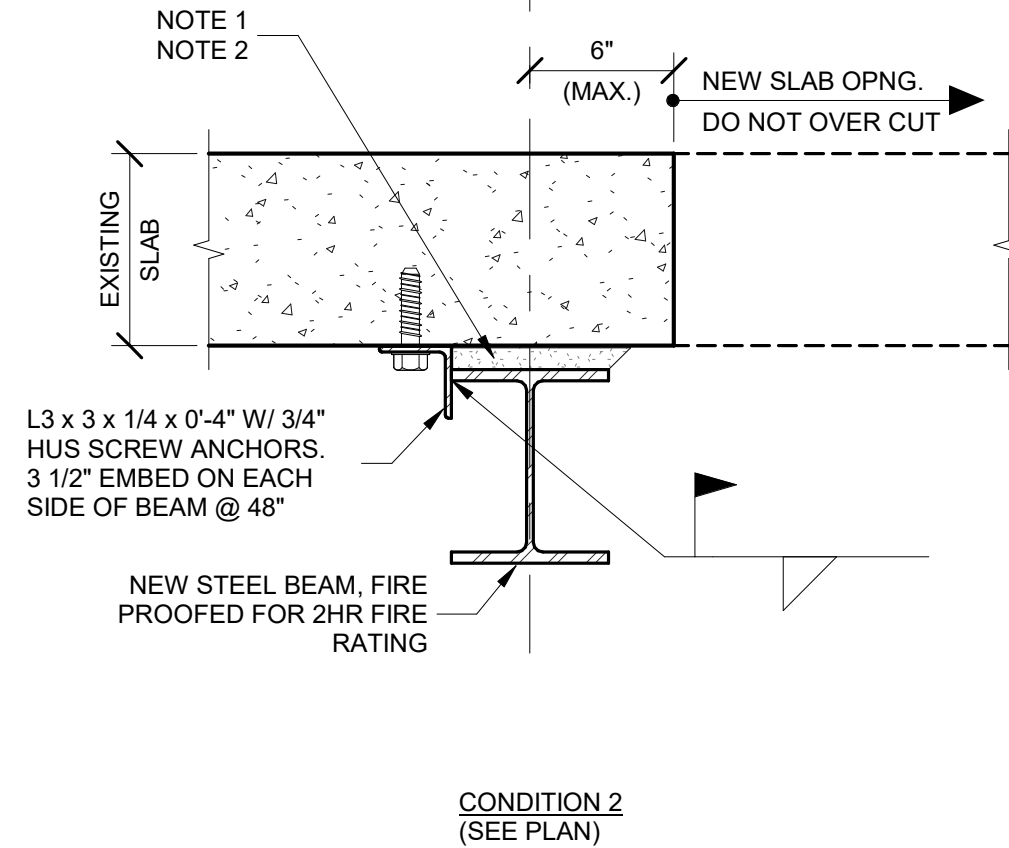

AT RAILINGS & FALL PROTECTION ANCHORS

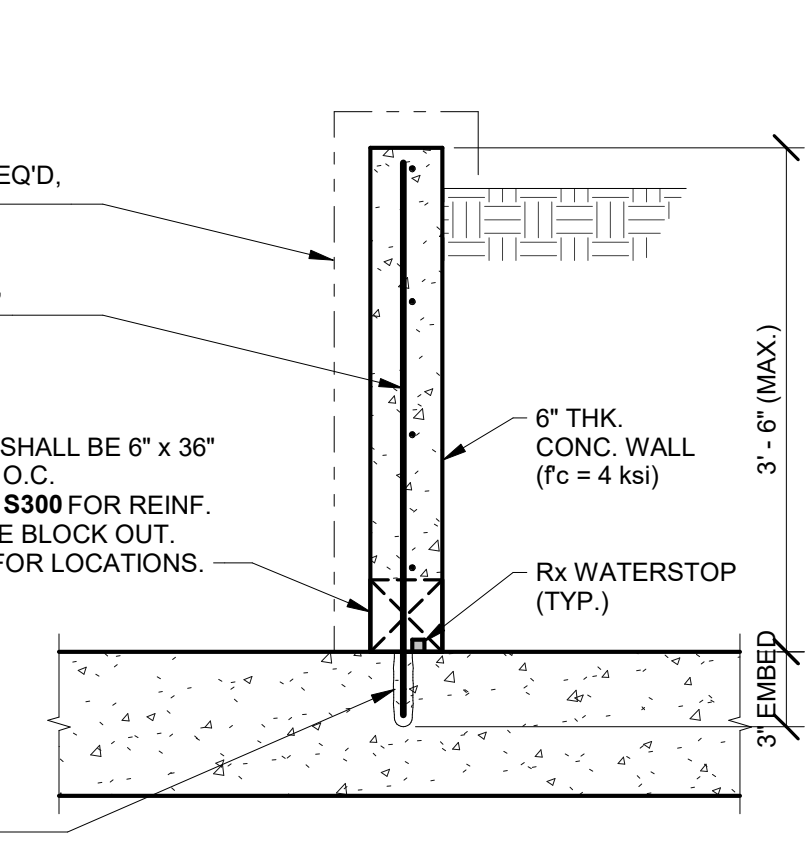


AT ALL OTHER LOCATIONS

8 TYPICAL PLANTER WALLS

S300 SCALE: 3/4" = 1'-0"

D

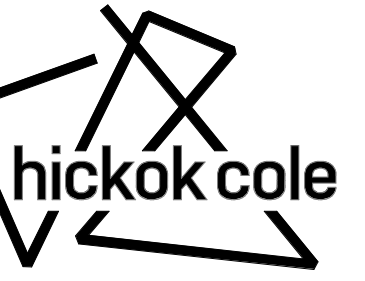

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	150% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	150% CD
4	11/12/2025	CAMP PERMIT SET

STAMP

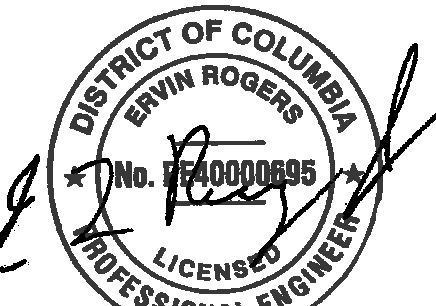

PROJECT NO.
24048


DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
TYPICAL CONCRETE DETAILS

DRAWING NO.

S300

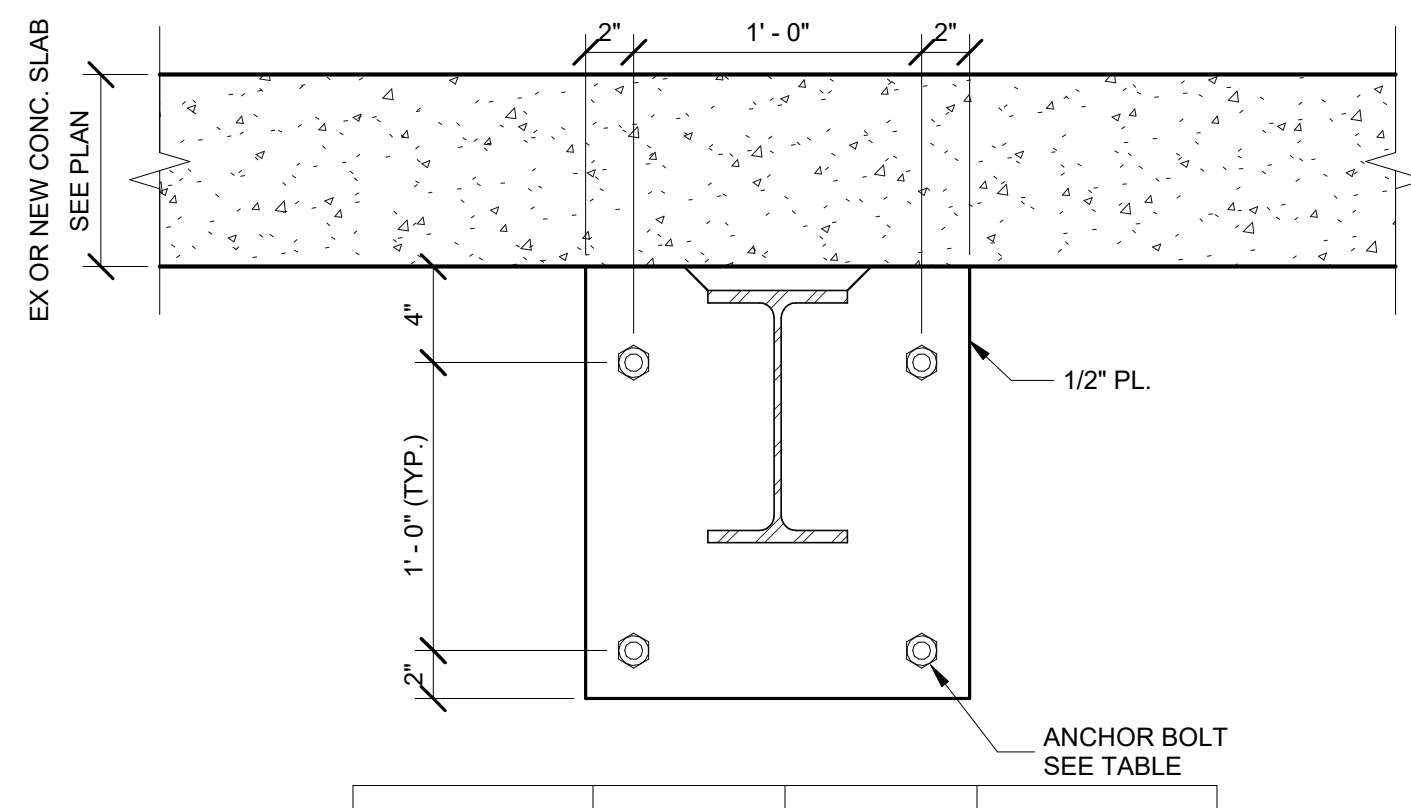

ANCHOR B
SEE TABLE

		SEE TABLE		
	NO. OF ANCHOR BOLTS	EFFECTIVE EMBEDMENT	MAX. CAPACITY	DETAIL TYPE
3/4" HUS EZ- SORET ANCHOR	4	5.69"	32 KIPS	3A/S301
	6	5.69"	50 KIPS	3B/S301
	8	5.69"	70 KIPS	3C/S301
	10	5.69"	80 KIPS	3D/S301
3/4" HAS THREADED ROD W/ HLT HY-200 ADHESIVE	4	8"	26 KIPS	3E/S301
	6	8"	40 KIPS	3F/S301
	8	8"	55 KIPS	3G/S301

TYPICAL CONNECTION TO EX WALL

S301 SCALE: 1 1/2" = 1'-0"

NOTES FOR DEVELOPMENT LENGTHS / TENSION LAP SPlice LENGTHS

- 1) TYPES OF LAP SPLICES ARE DEFINED AS:
 - CLASS A:
 - APPLICABLE WHEN REINFORCING PROVIDED IS AT LEAST TWICE THAT REQUIRED BY ANALYSIS AND NO MORE THAN ONE HALF IS SPLICED AT SAME LAP LENGTH
 - CLASS B:
 - WHERE CLASS A IS NOT APPLICABLE
- 2) TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12 INCHES OF CONCRETE CAST BELOW THE BARS.
- 3) CASE 1 & 2 ARE DEFINED AS:
 - CASE 1:
 - CLEAR COVER AT LEAST $1 d_b$
 - CLEAR SPACING OF BARS NOT LESS THAN $1 d_b$ (CENTER-TO-CENTER SPACING AT LEAST $2 d_b$)
 - STIRRUPS OR TIES THROUGH THE SPLICE / DEVELOPMENT LENGTH WHICH ARE NOT LESS THAN THE CODE MINIMUM
 - OR
 - CLEAR COVER AT LEAST $1 d_b$
 - CLEAR SPACING OF BARS OR WIRES BEING DEVELOPED / LAP SPLICED AT LEAST $2 d_b$ (CENTER-TO-CENTER SPACING AT LEAST $3 d_b$)
- CASE 2:
 - ALL OTHER CASES
- 4) SPLICE / DEVELOPMENT LENGTHS OF BARS IN TENSION LISTED IN TABLES SHALL BE MULTIPLIED PER THE TABLE BELOW WITH THE MODIFICATION FACTORS FOR EACH APPLICABLE CONDITION:

CONDITION	MODIFICATION FACTOR	REMARKS
LIGHT-WEIGHT CONCRETE	1.3	
EPOXY-COATED REBARS	1.5	1.3 MAX FOR TOP BARS
	1.2	
Fy # 60 ksi	Fy/60	
BUNDLED BARS	1.2	SEE NOTES
	1.33	

- 5) IF BARS OF DIFFERENT SIZES ARE LAP SPLICED IN TENSION, THE SPLICE LENGTH SHALL BE THE GREATER OF DEVELOPMENT LENGTH / CLASS A SPLICE OF THE LARGER BAR AND SPLICE LENGTH OF THE SMALLER BAR.
- 6) FOR NON-CONTACT SPLICES, CENTER-TO-CENTER SPACING OF BARS SHALL NOT EXCEED ONE-FIFTH OF THE REQUIRED SPLICE LENGTH AND SHALL NOT EXCEED 6".
- 7) BUNDLED BARS:
 - MAXIMUM NUMBER OF BUNDLED BARS IS (4).
 - INDIVIDUAL BAR SPLICES WITHIN A BUNDLE SHALL NOT OVERLAP
 - ENTIRE BUNDLES SHALL NOT BE LAP SPLICED
 - COMPUTATION OF SPLICE LENGTH SHALL BE BASED ON d_b OF EQUIVALENT AREA OF BUNDLED BARS
 - BUNDLED BARS SHALL BE ENCLOSED BY TRANSVERSE REIN. (H BARS MIN. IF IN COMPRESSION)
 - BARS LARGER THAN #11 SHALL NOT BE BUNDLED IN BEAMS.

S301 SCALE: 3/8" = 1'-0"

S301


A

B


C

D


9 TYPICAL HOIST BEAM (19'-0" SPAN)
S310 SCALE: 3/4" = 1'-0"

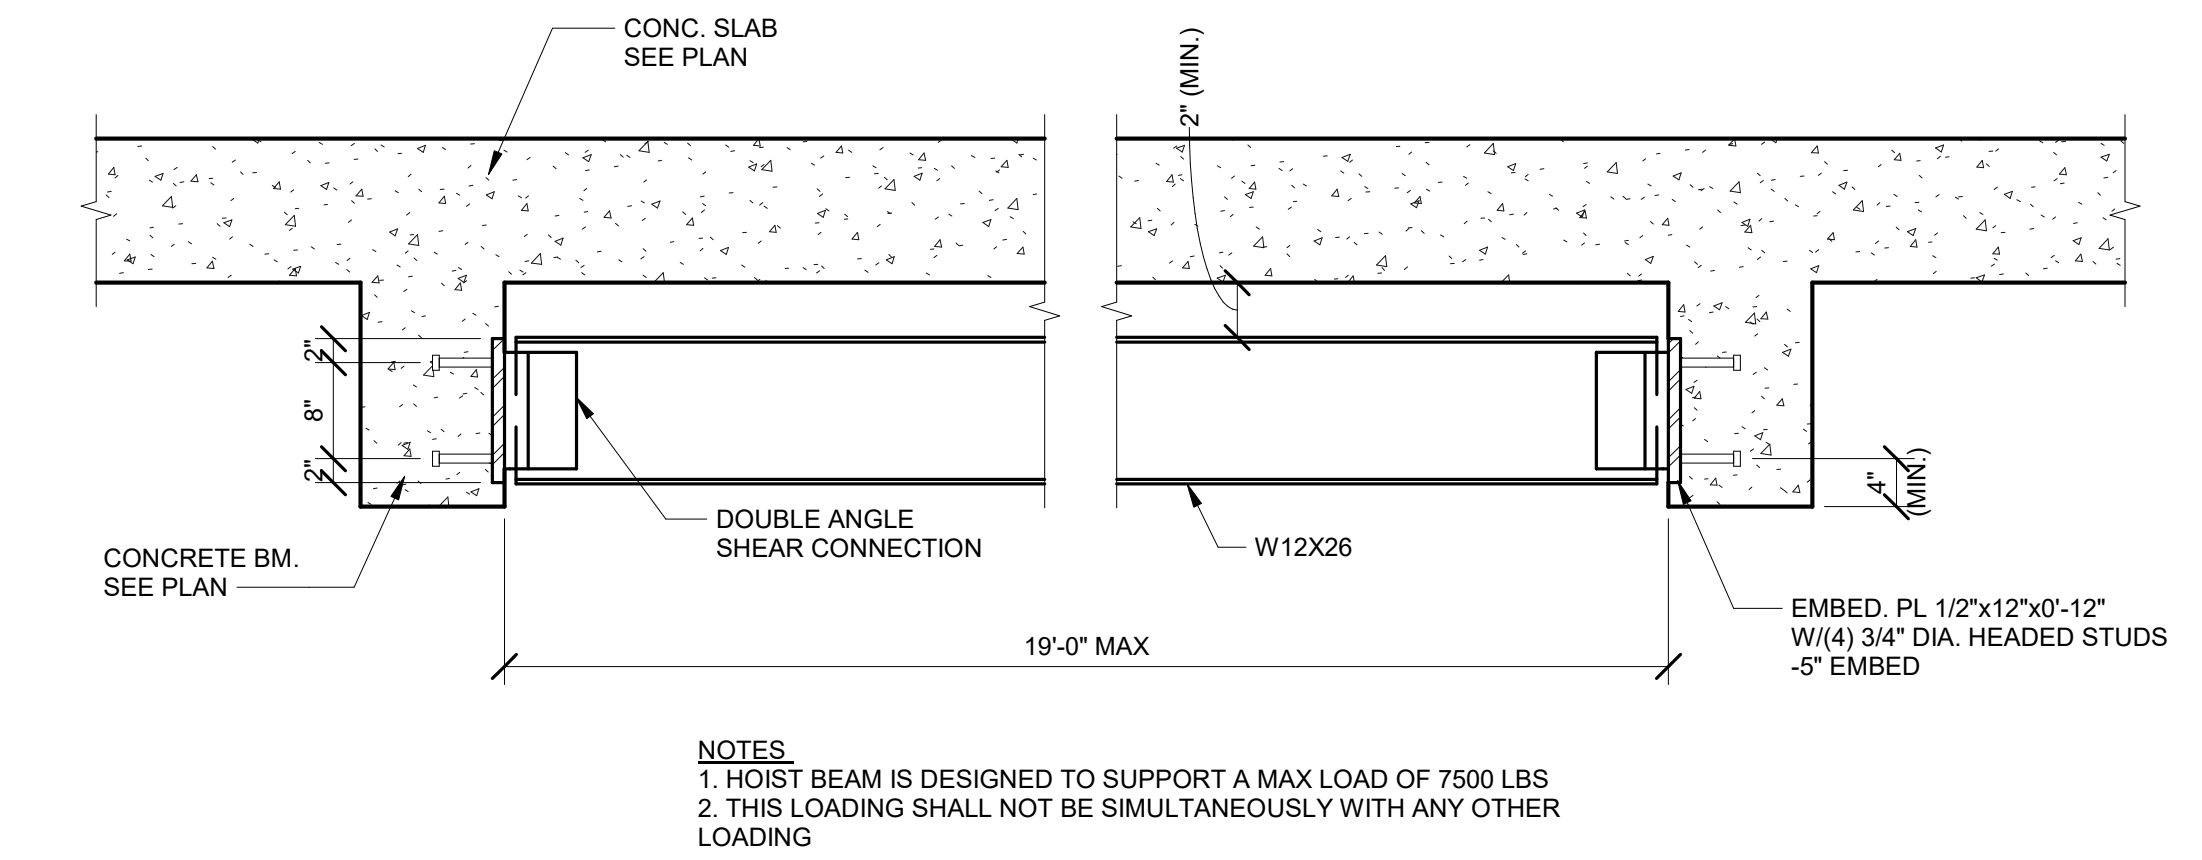


8 ELEVATOR RAIL SUPPORT - TOP CONNECTION ADJACENT TO BEAM
S310 SCALE: 3/4" = 1'-0"

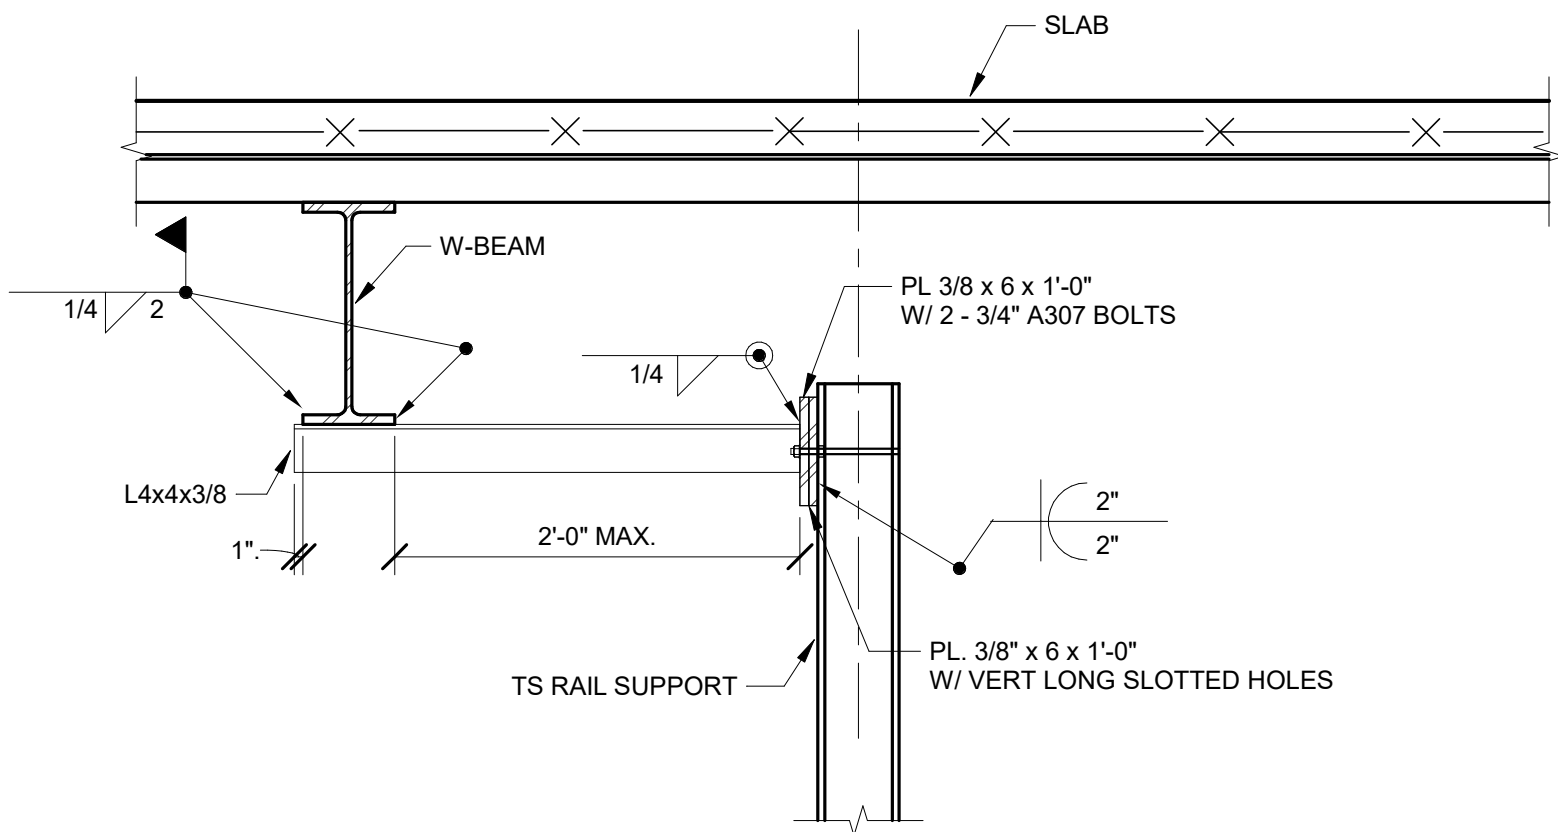


4 TYPICAL HOIST BEAM (11'-0" SPAN)
S310 SCALE: 3/4" = 1'-0"

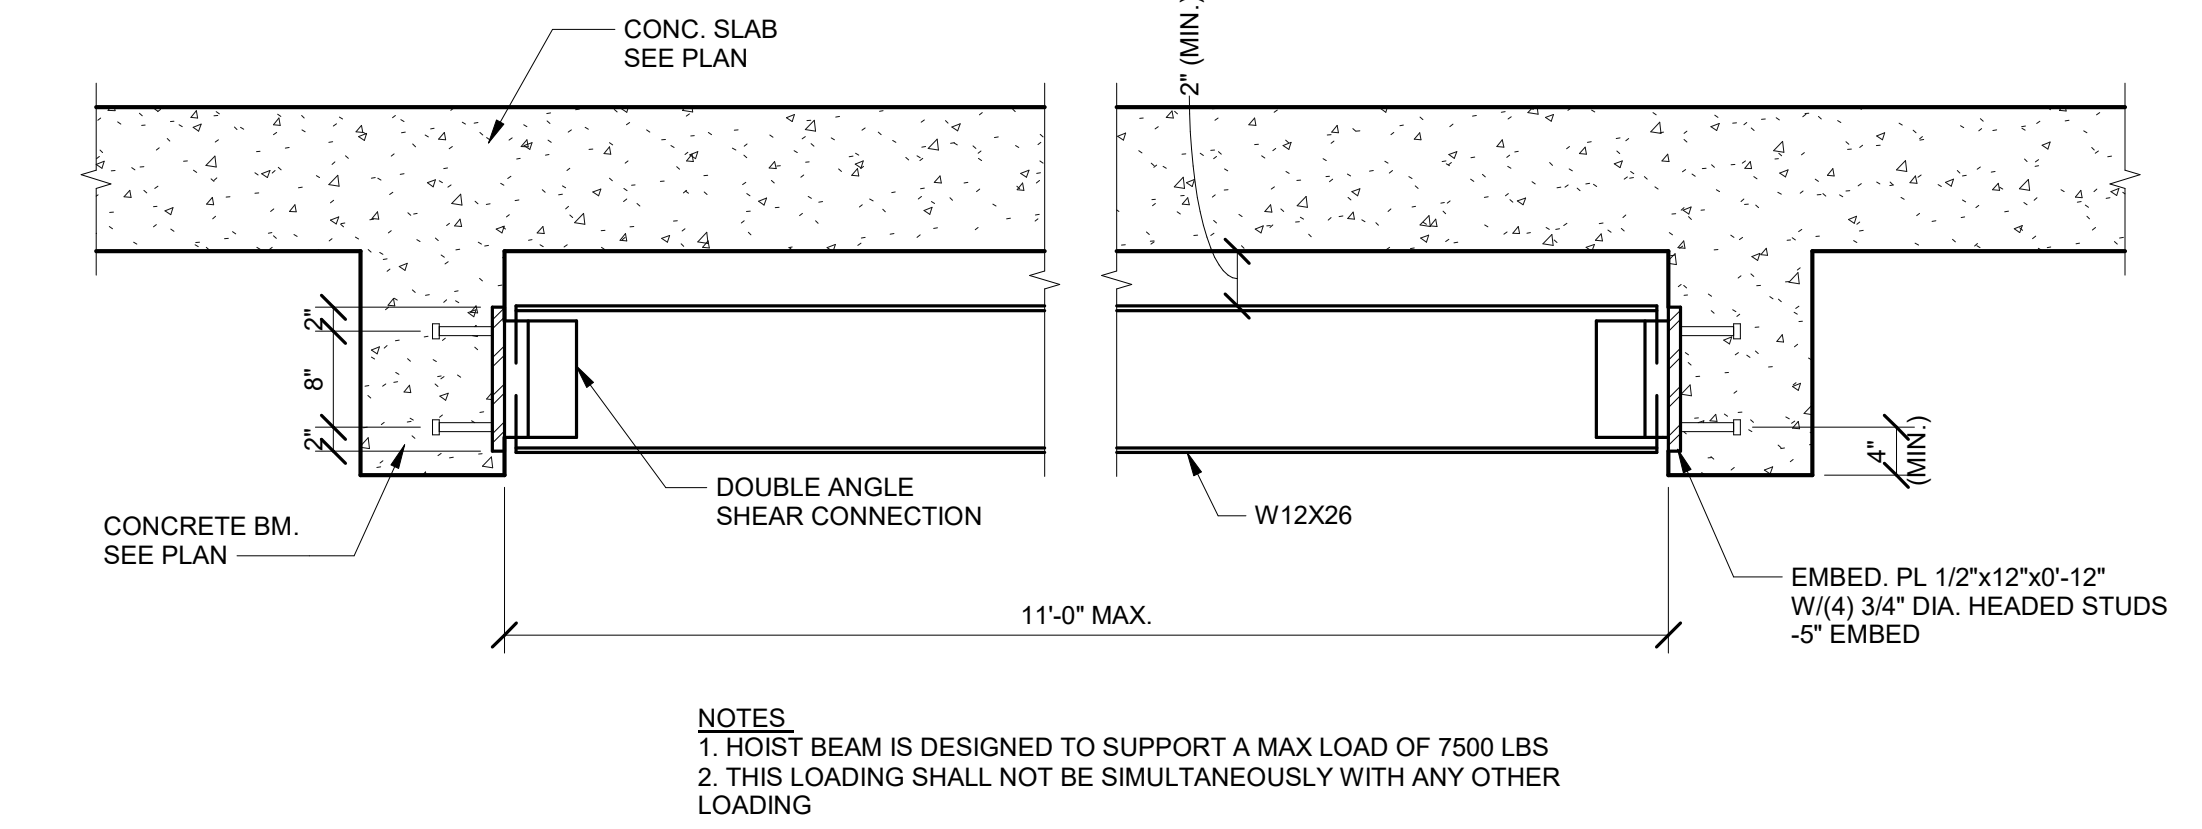


10 TYPICAL ELEVATOR BEAM SPACING REQUIREMENT
S310 SCALE: 1/2" = 1'-0"

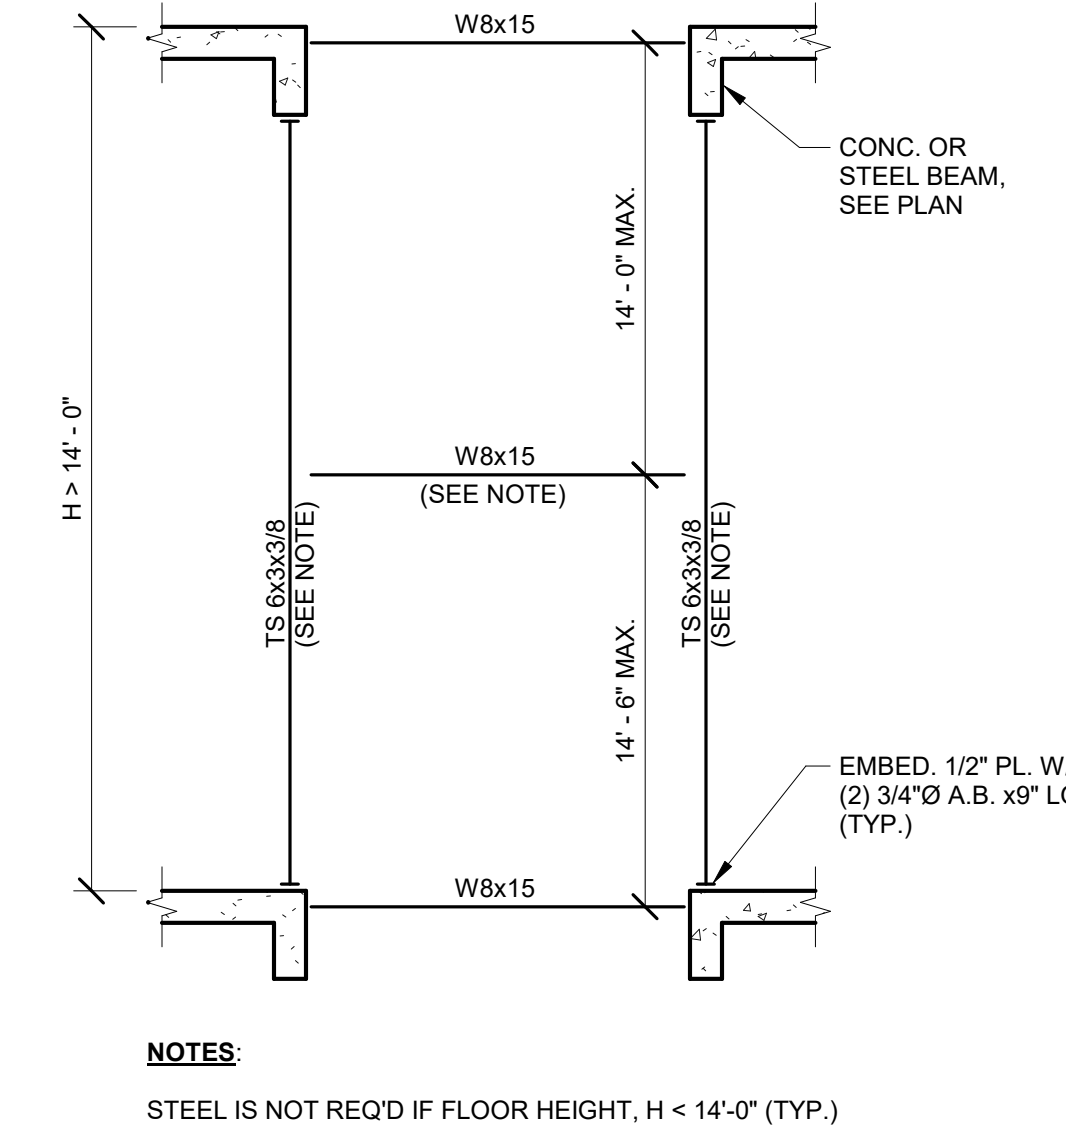


5 SILL AT ELEVATOR DOOR STEEL FRAMED DOOR
S310 SCALE: 1 1/2" = 1'-0"

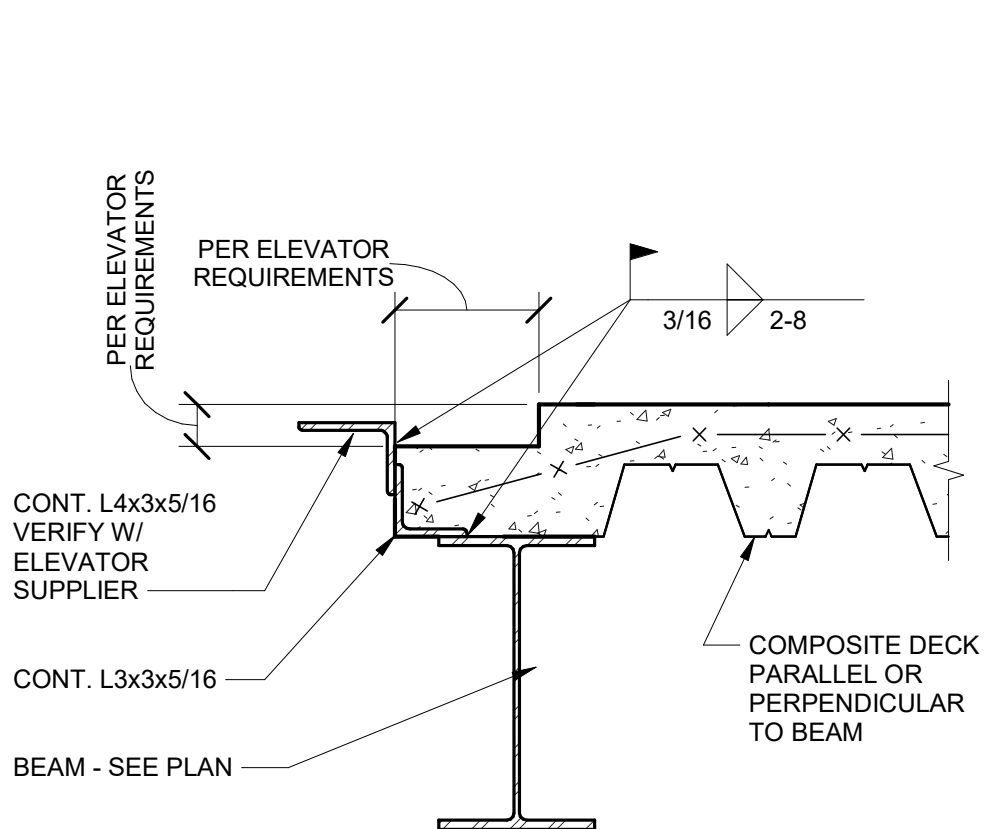


2 FOLDING PARTITION SUPPORT
S310 SCALE: 1" = 1'-0"

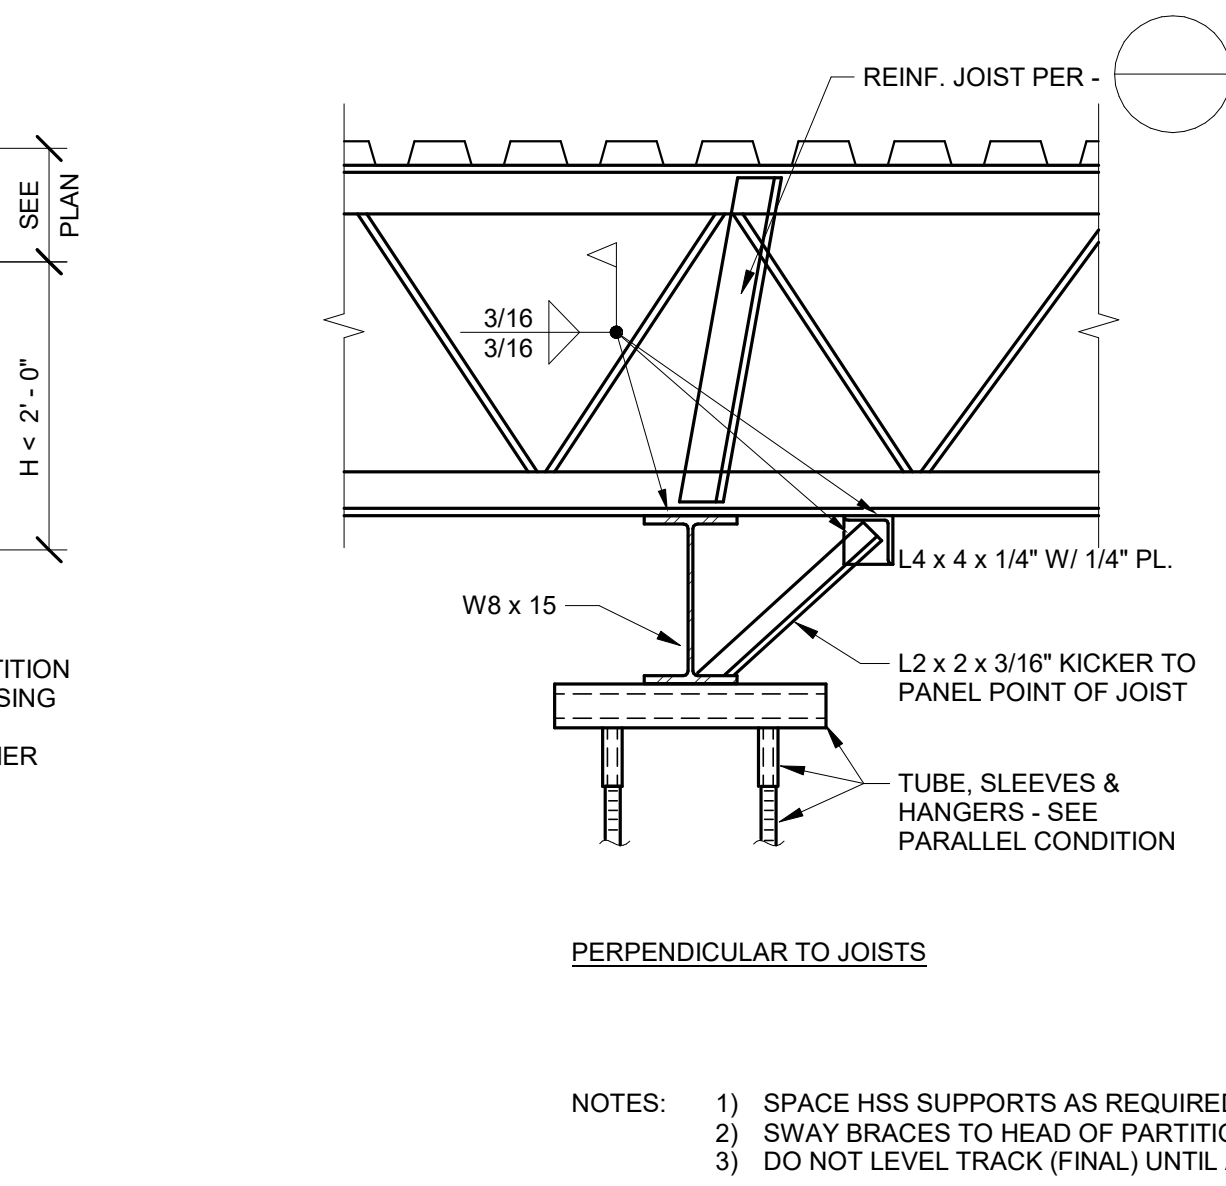


11 ELEVATOR SEPERATION BEAM AT CONCRETE FLOOR SLAB
S310 SCALE: 1 1/2" = 1'-0"

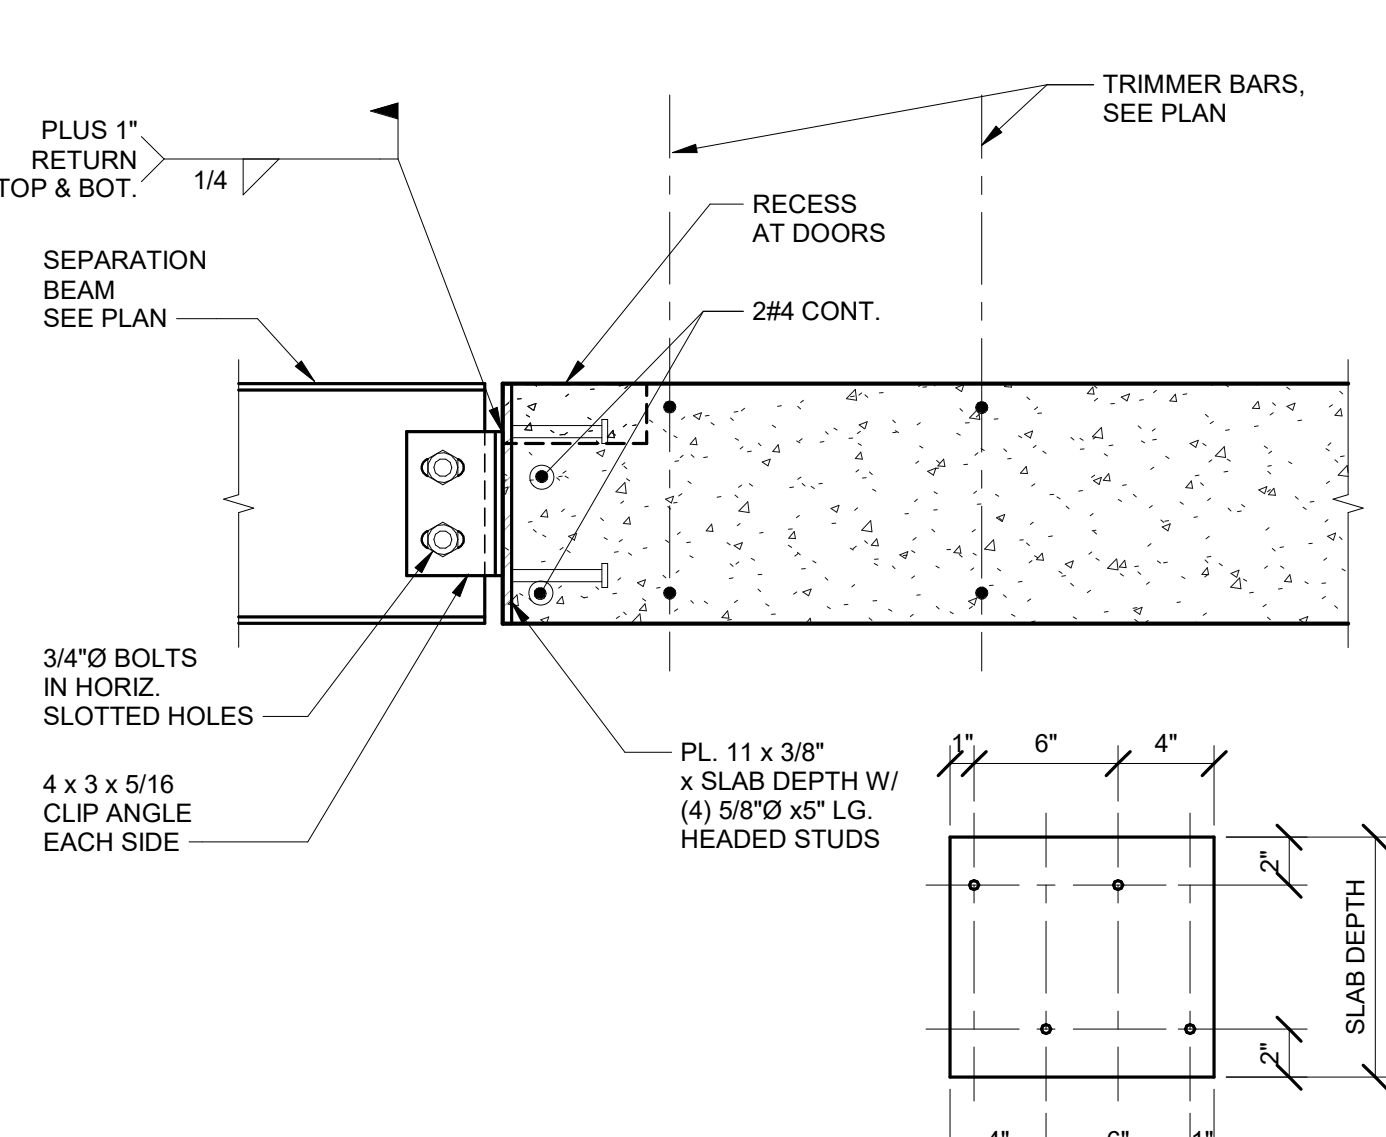


6 ELEVATOR RAIL SUPPORT - TOP CONNECTION NOT ADJACENT TO BEAM
S310 SCALE: 1 1/2" = 1'-0"

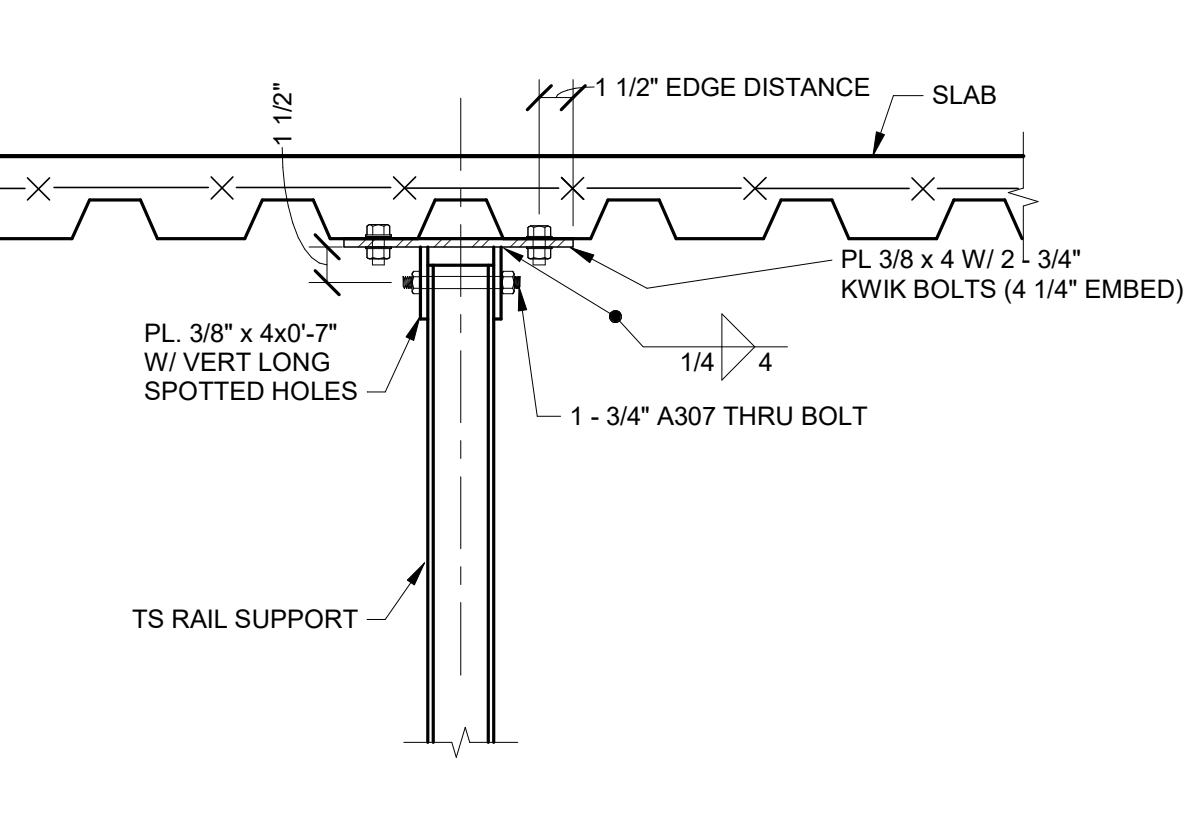


3 COOLING TOWER SUPPORTS
S310 SCALE: 3/4" = 1'-0"

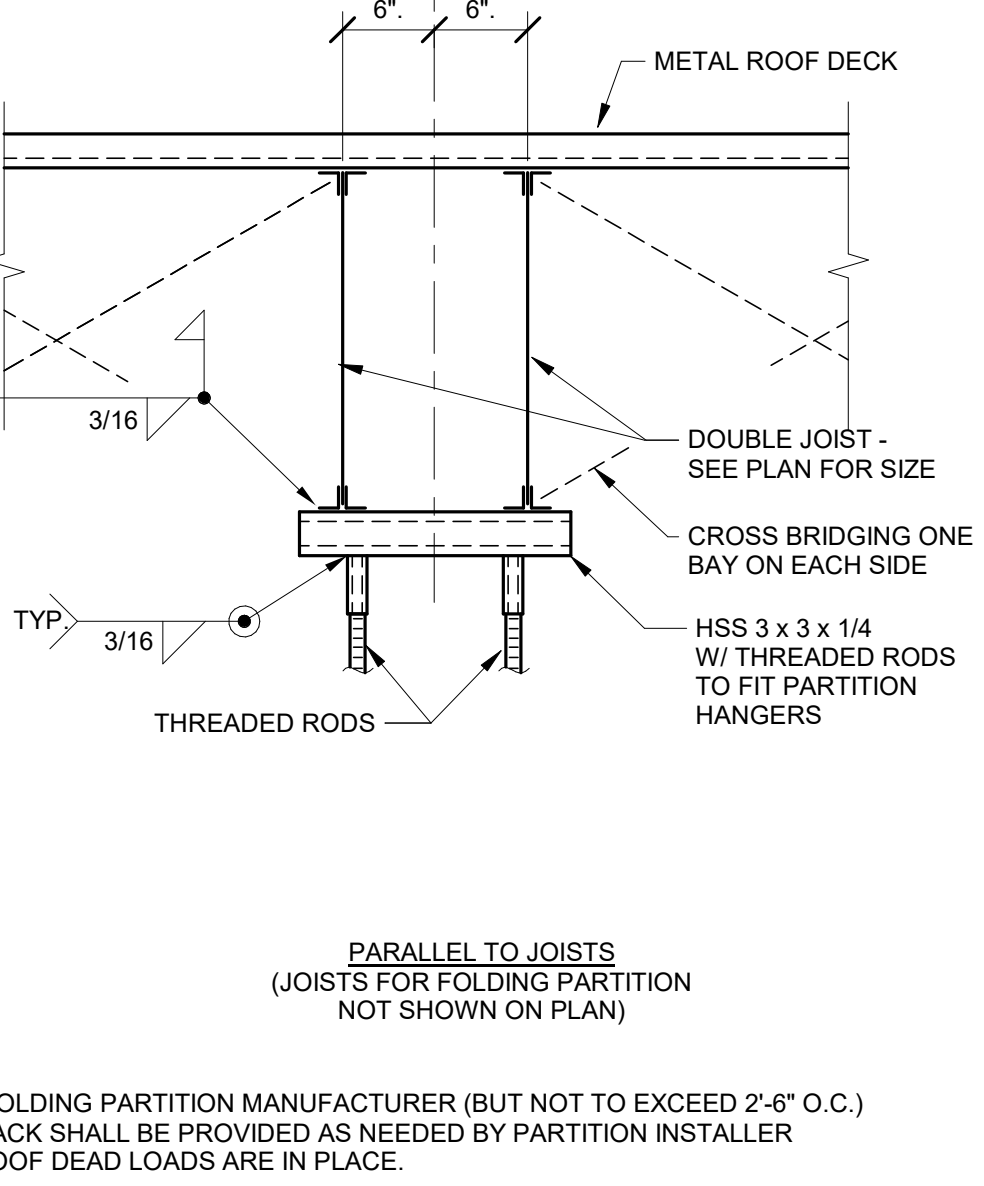


12 ELEVATOR SEPERATION BEAM AT CONCRETE FLOOR SLAB CORNER
S310 SCALE: 1 1/2" = 1'-0"

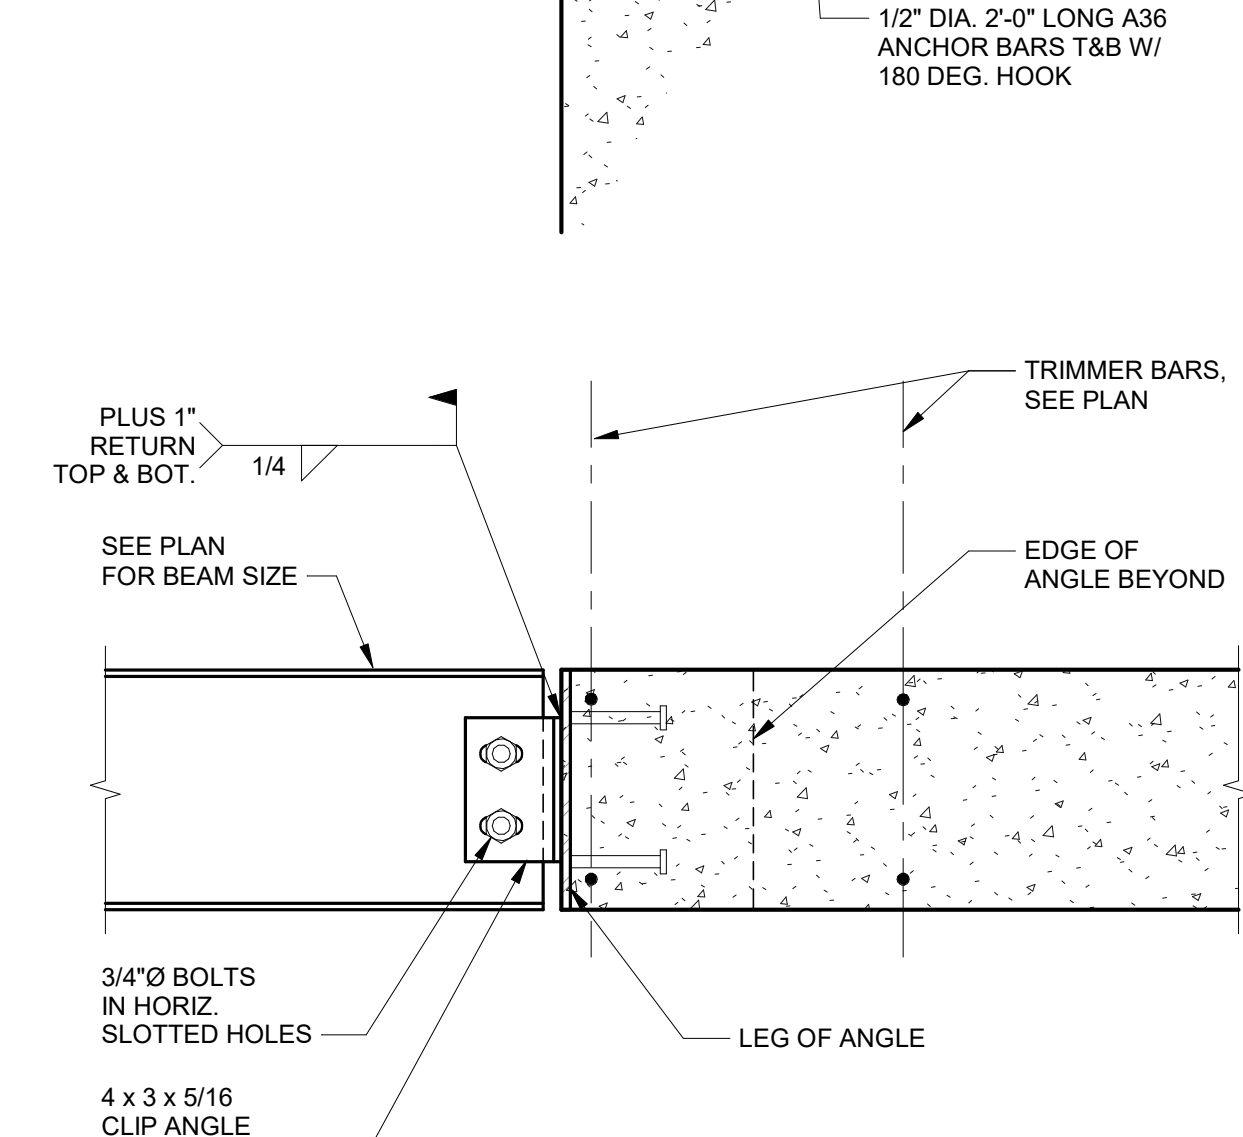

7 ELEVATOR SEPERATION BEAM AT CONCRETE WALL OR BEAM
S310 SCALE: 1 1/2" = 1'-0"

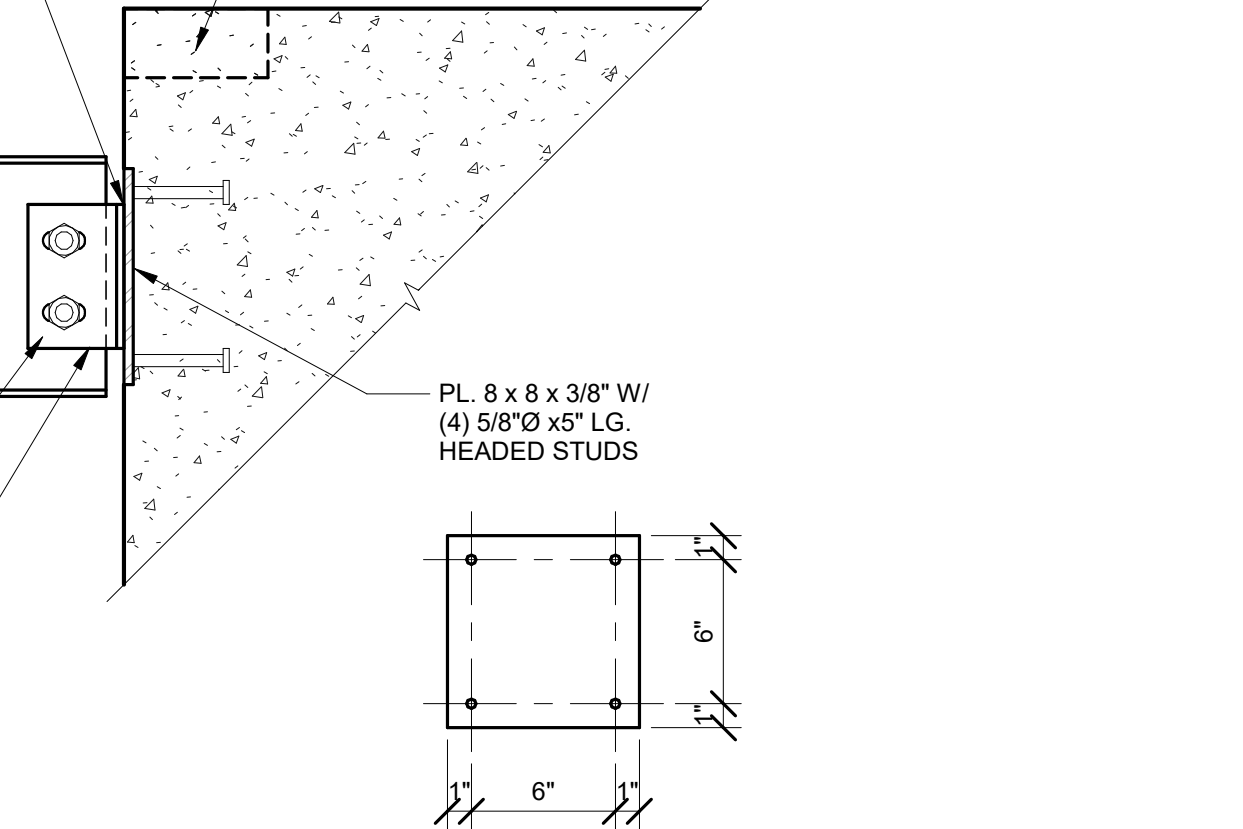

1 TYPICAL OPERABLE PARTITION
S310 SCALE: 3/4" = 1'-0"

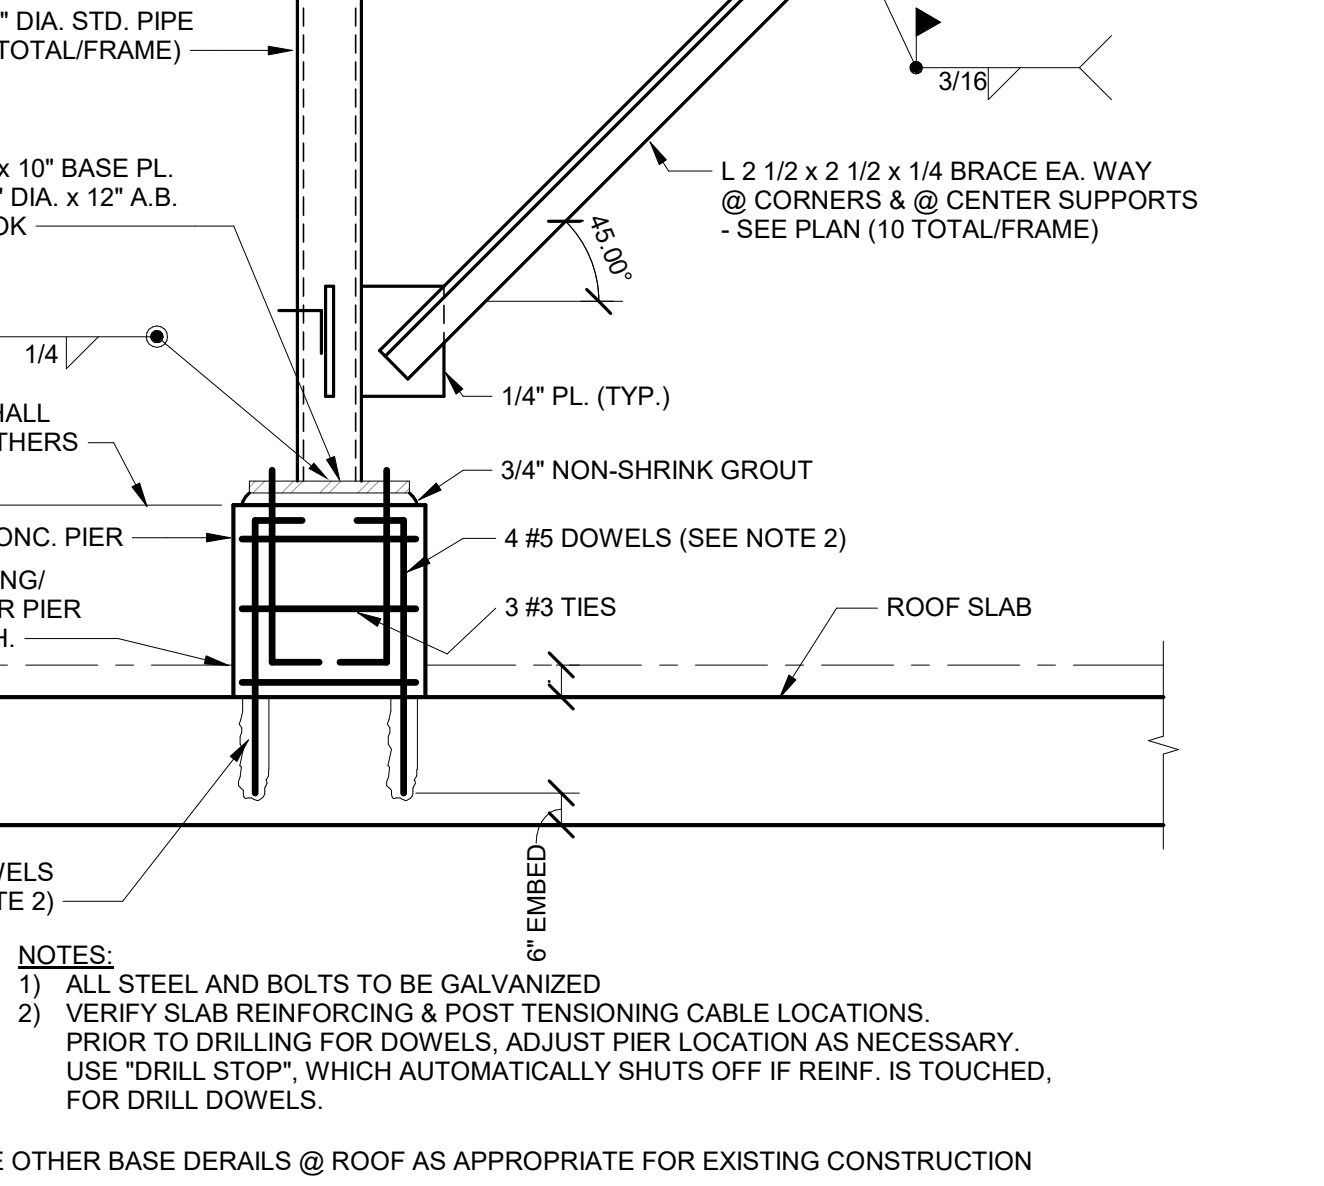

11/21/2025 4:04:11 PM

A

B


C

D


MINIMUM FILLET WELD SCHEDULE	
THICKNESS OF THICKER PART JOINED (INCHES)	MINIMUM SIZE OF FILLET WELD (INCHES)
TO 1/4 INCLUSIVE	1/8
OVER 1/4 TO 1/2	3/16
OVER 1/2 TO 3/4	1/4
OVER 3/4	5/16

NOTE: THIS SCHEDULE CONTROLS FOR ALL FILLET WELDS UNLESS OTHERWISE NOTED OR DETAILED

12 MINIMUM FILLET WELD SCHEDULE
S311 SCALE: 3/16" = 1'-0"

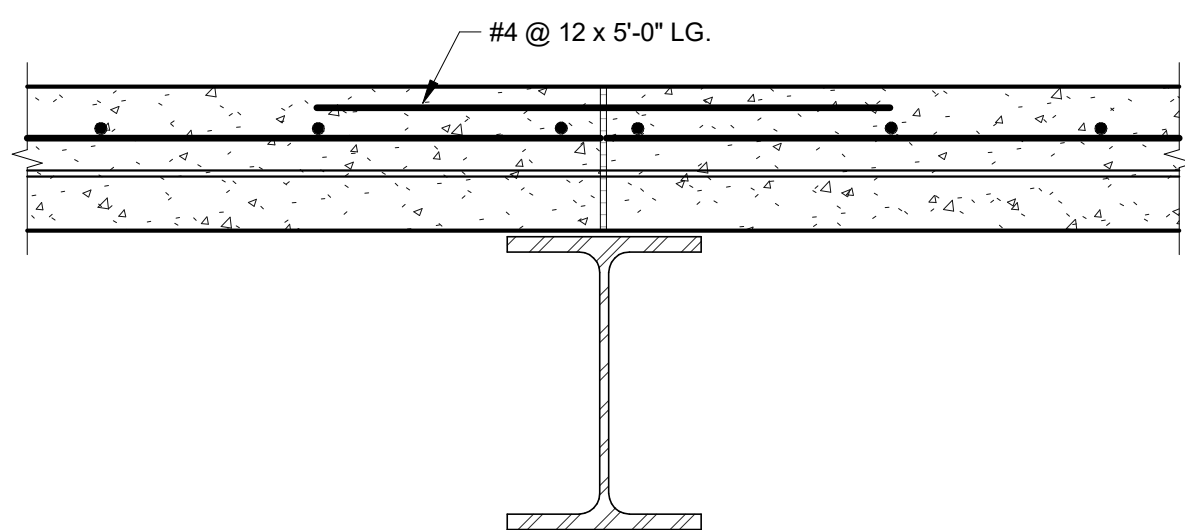


13 TYPICAL CONSTRUCTION JOINT
S311 SCALE: 1 1/2" = 1'-0"

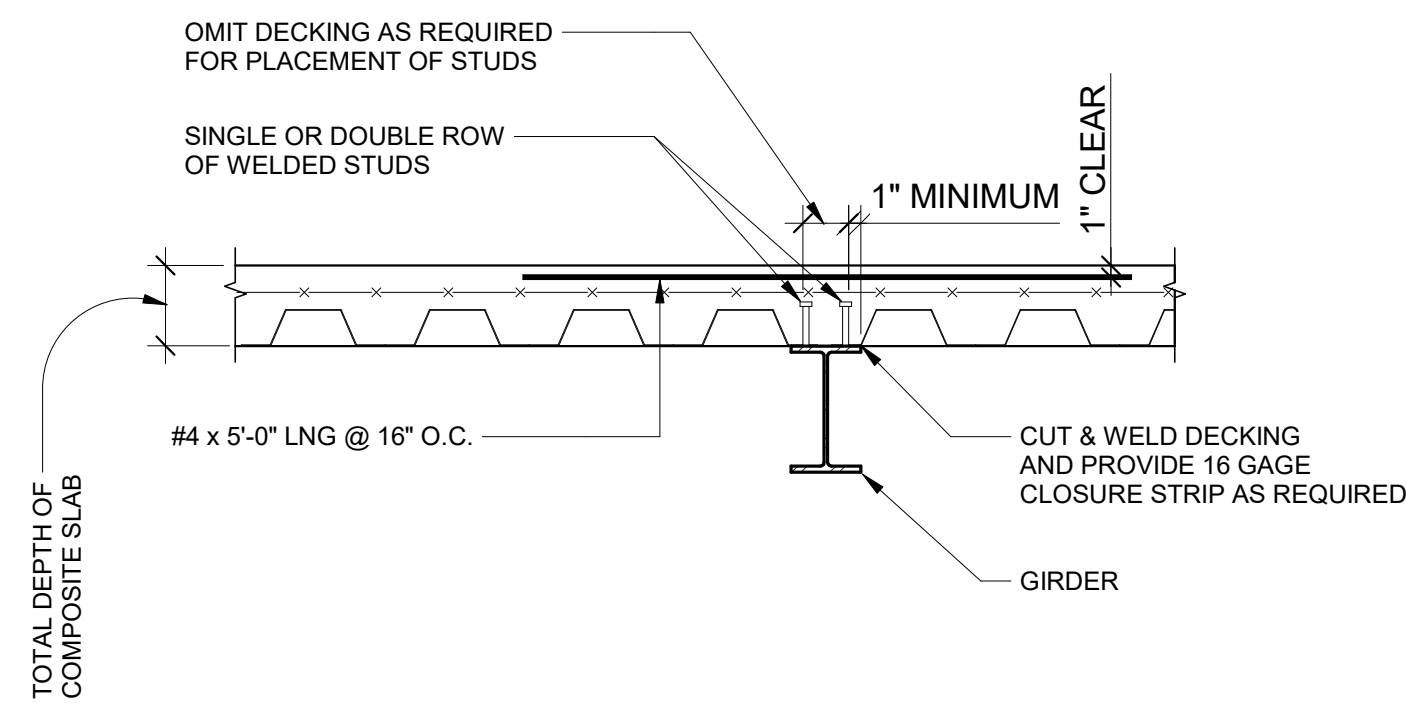


NOTE: 1) PROVIDE SUPPORT CHAIRS TO POSITION #4 TOP BARS.
COMPOSITE STEEL DECK/PARALLEL TO BEAM
S311 SCALE: 3/4" = 1'-0"


9 MOMENT CONNECTION DETAIL - BEAM AND GIRDER
S311 SCALE: 1 1/2" = 1'-0"

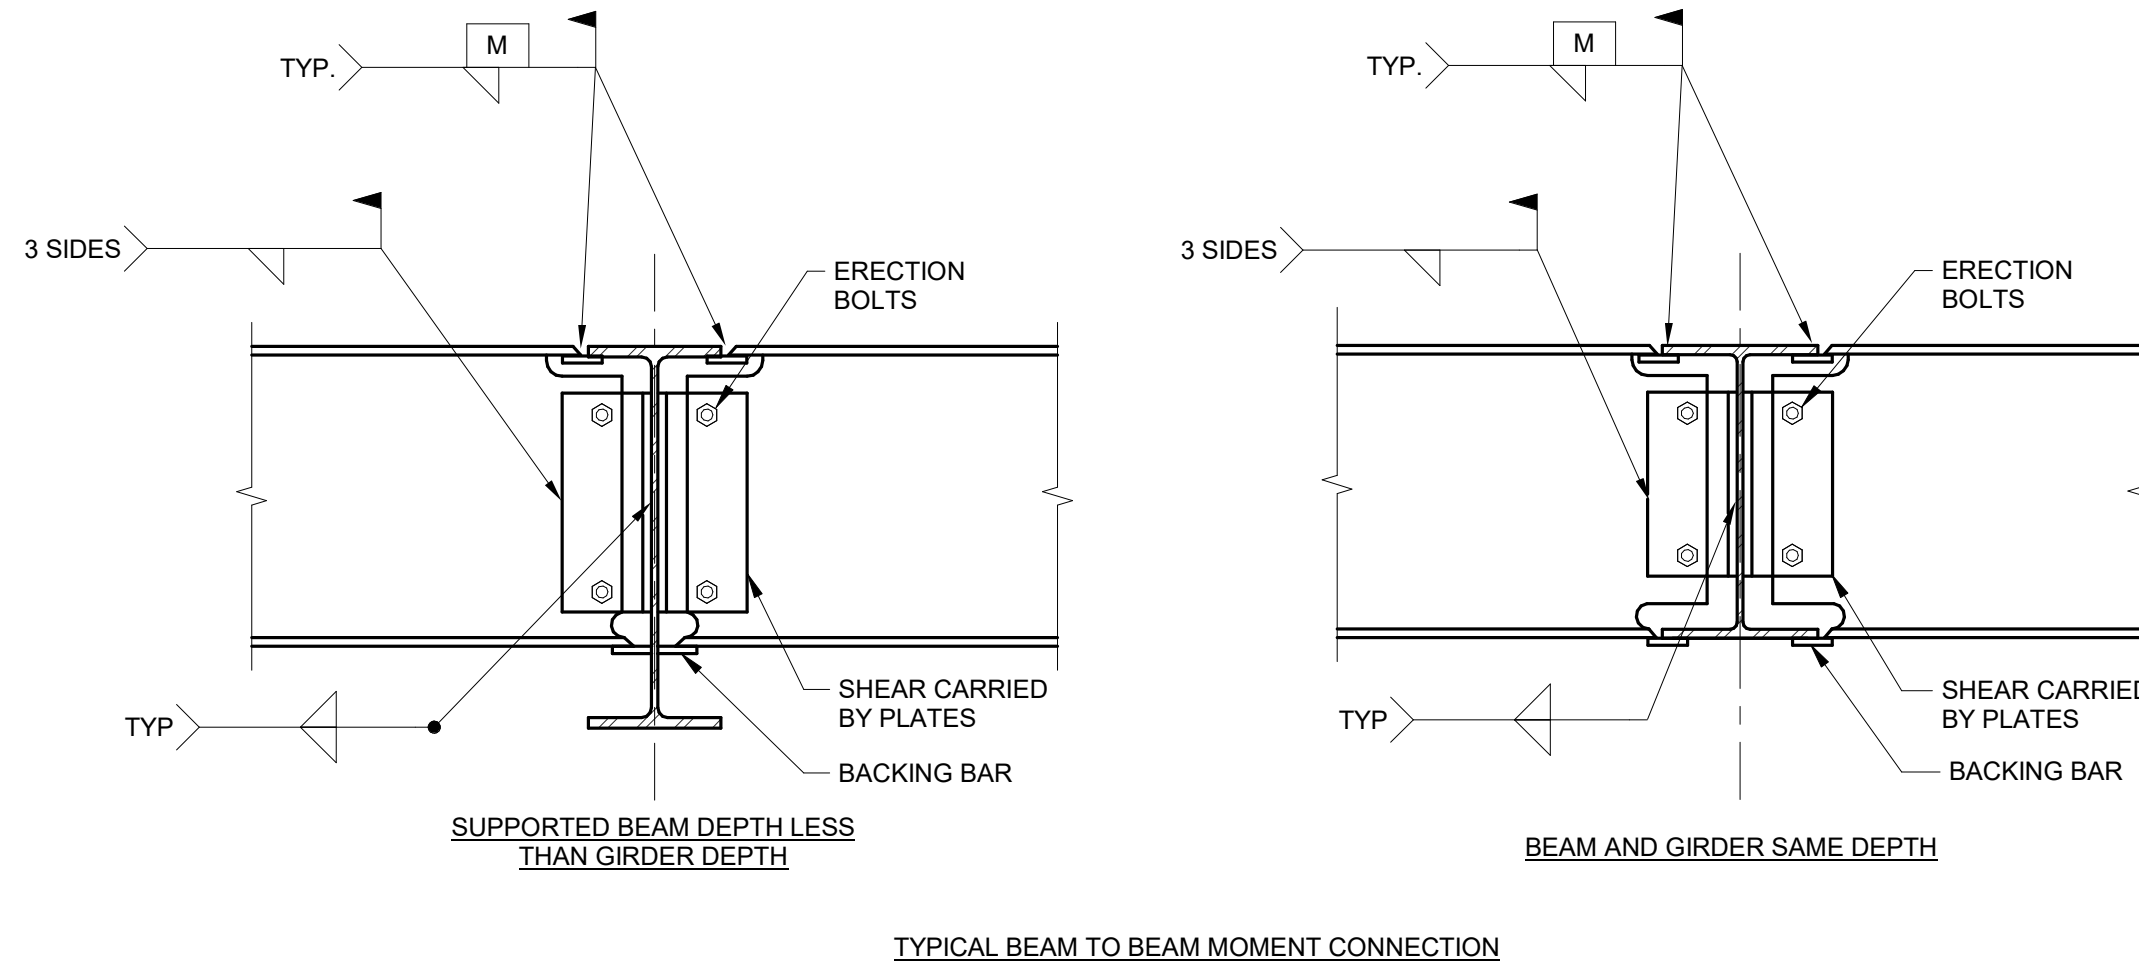


14 TYPICAL FRAMED BEAM CONNECTIONS
S311 SCALE: 1 1/2" = 1'-0"

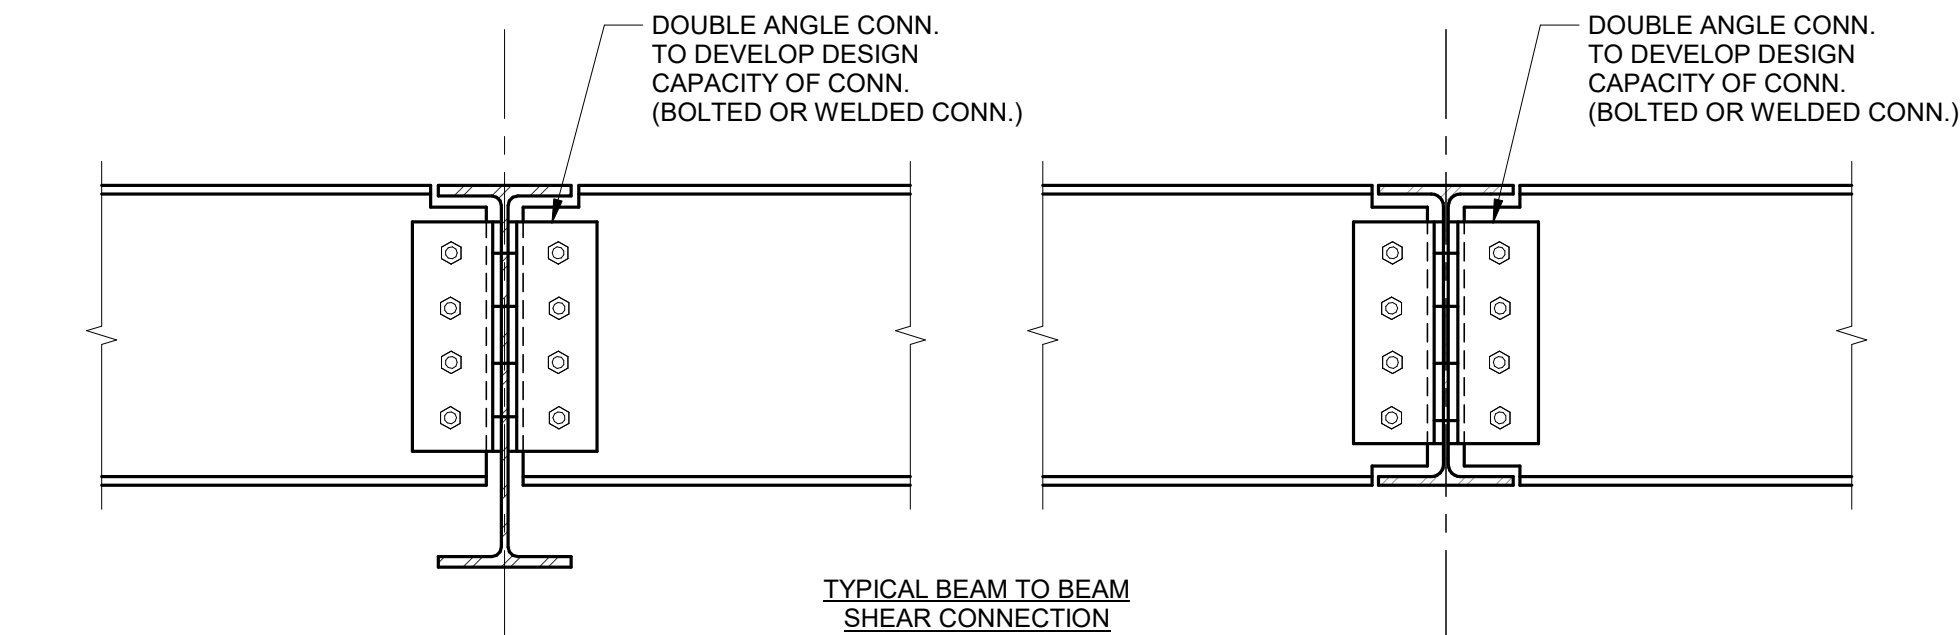


6 TYP. BEAM TO TUBE COL. CONNECTION
S311 SCALE: 3/4" = 1'-0"

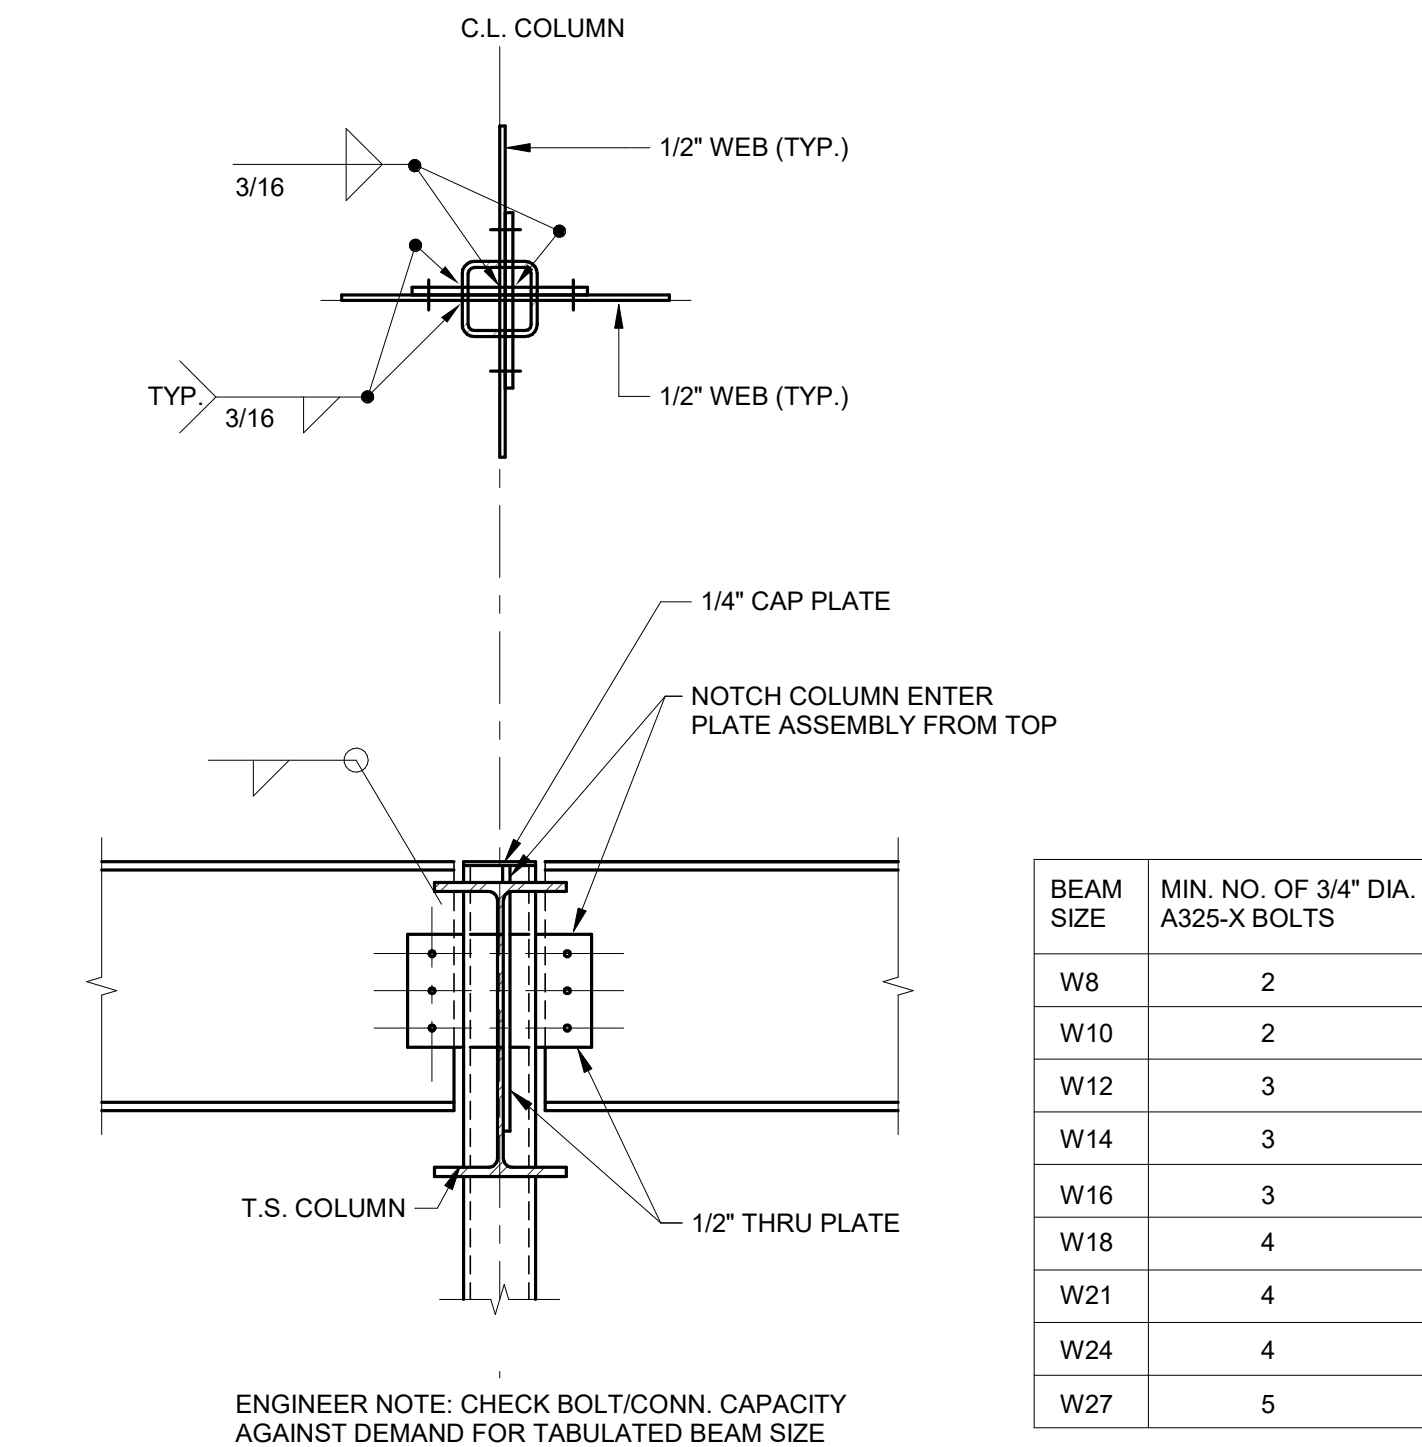


7 CANTILEVERED BEAM OVER COLUMN CONNECTION
S311 SCALE: 1" = 1'-0"

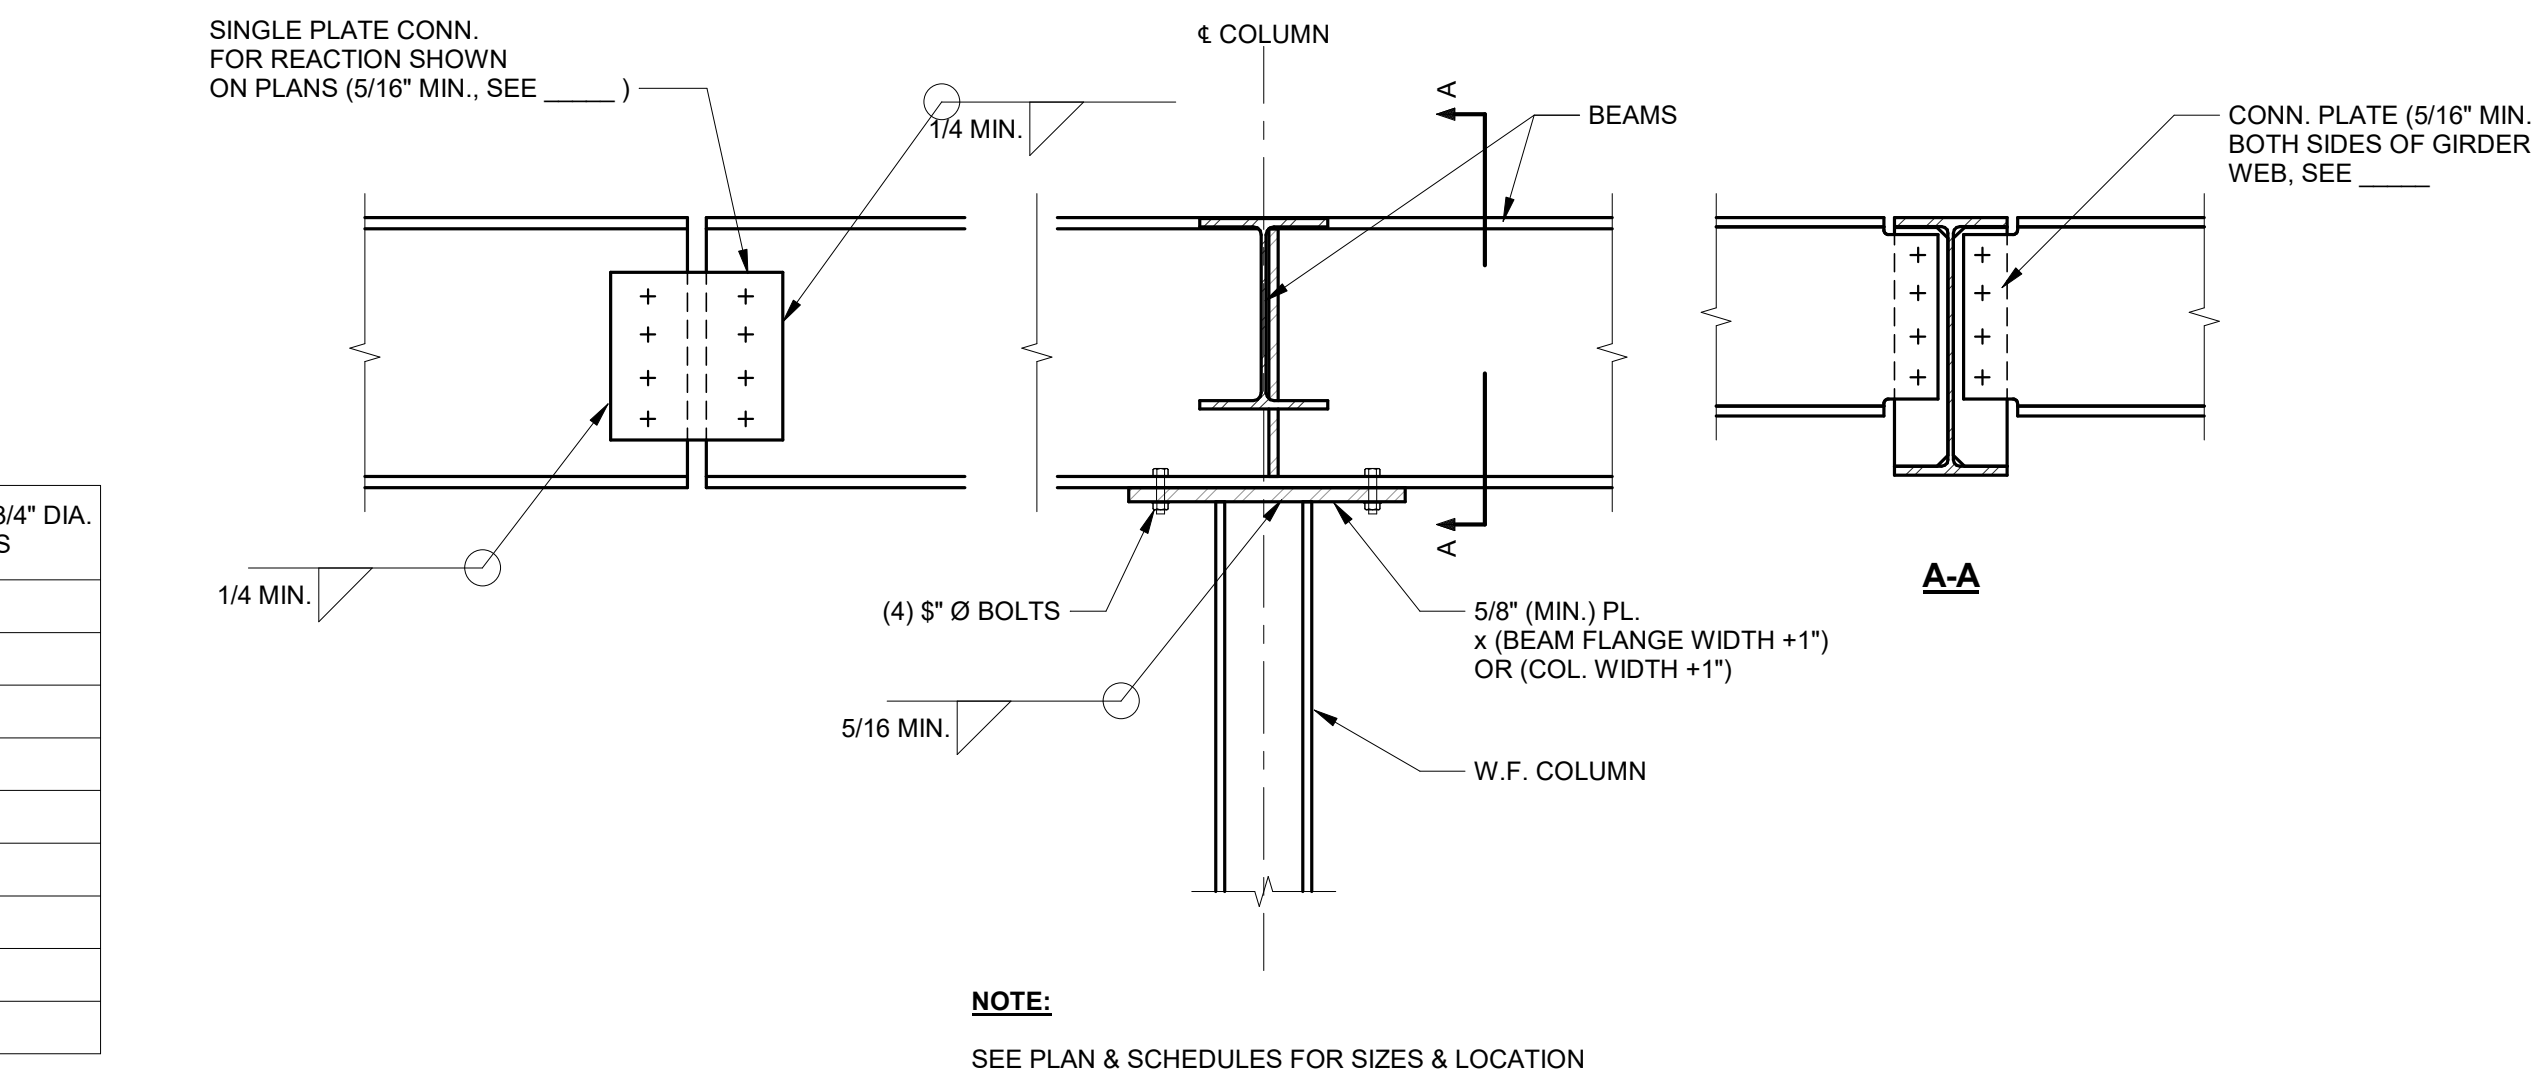


8 SKEWED BEAM TO COLUMN CONNECTION
S311 SCALE: 1/4" = 1'-0"

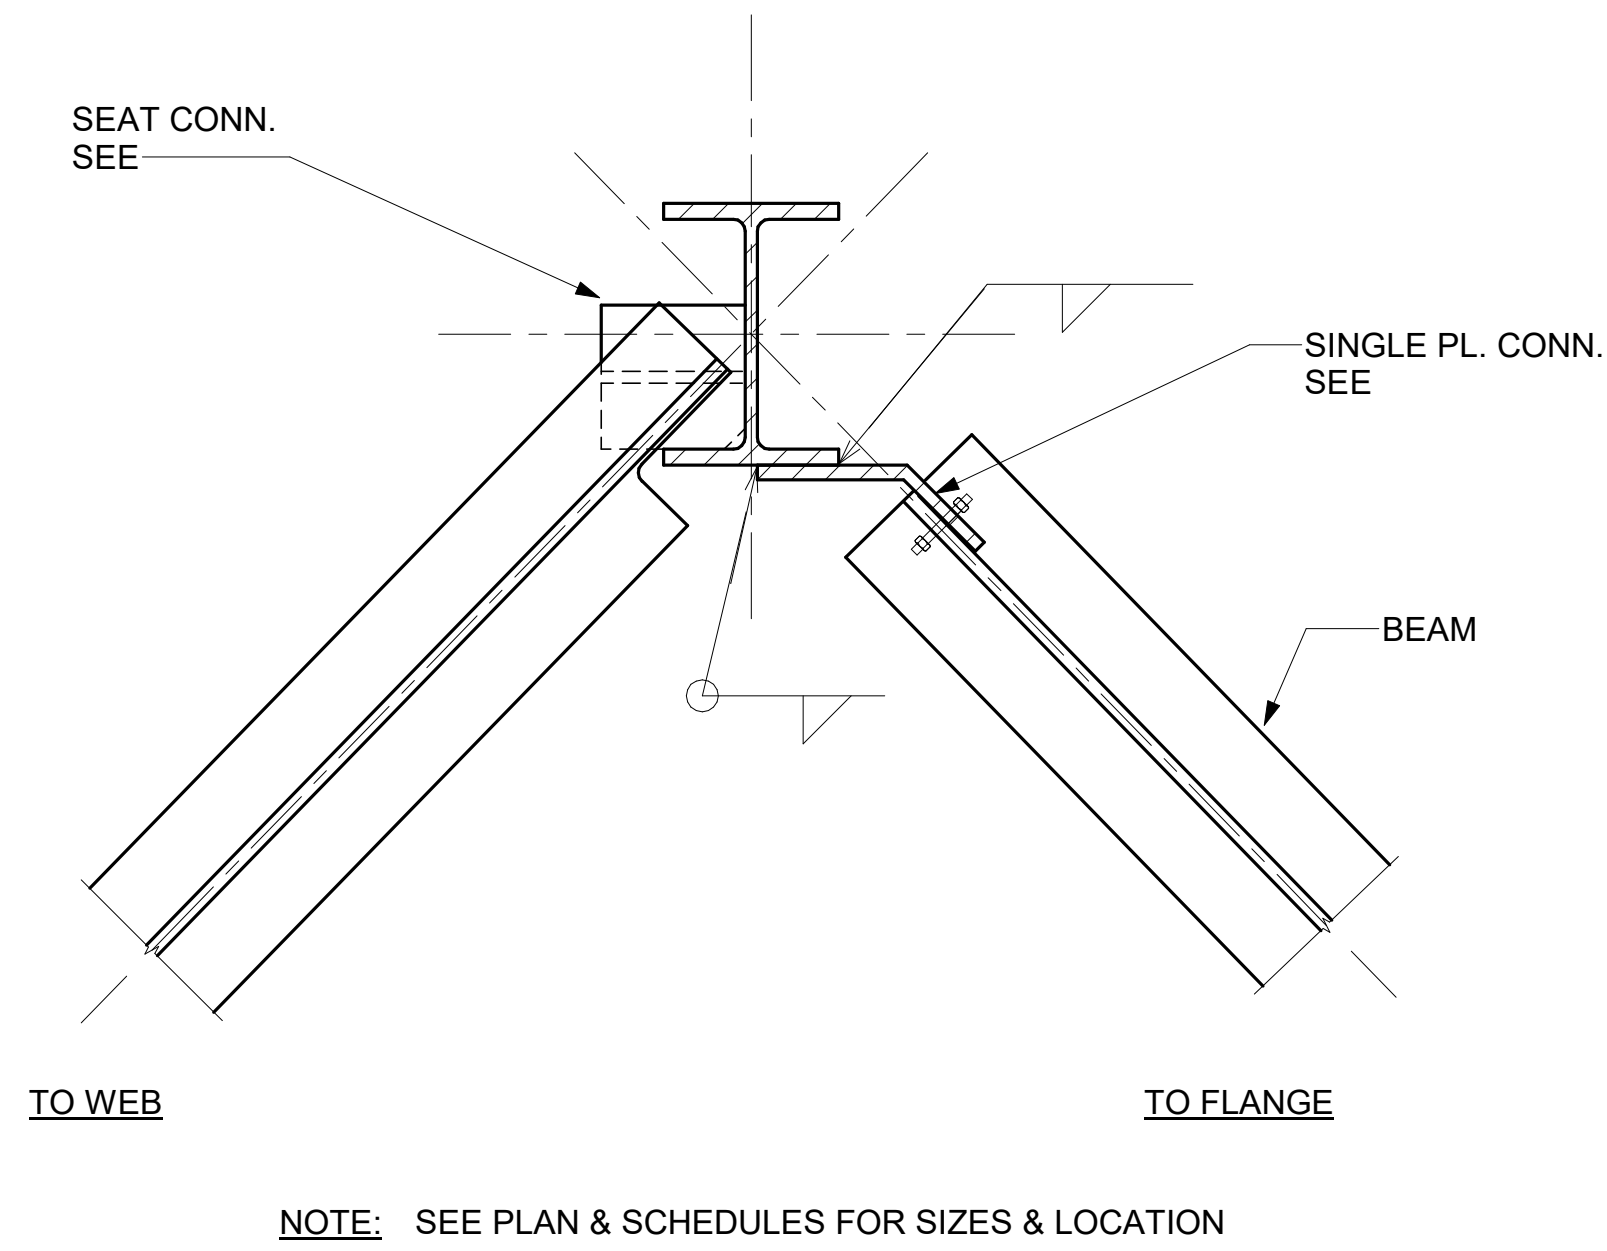


10 COLUMN TO TRANSFER GIRDER CONNECTION
S311 SCALE: 3/4" = 1'-0"

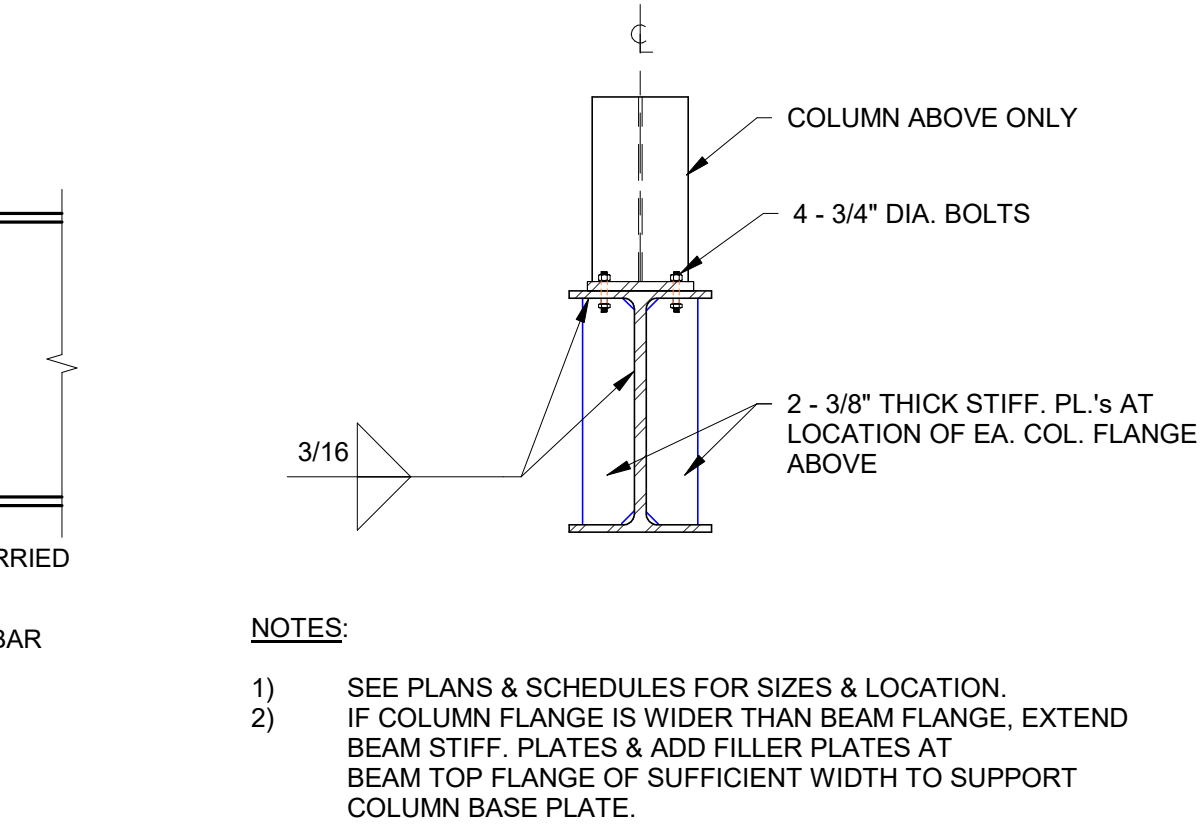


11 BEAM BEARING DETAIL ON CONCRETE WALL
S311 SCALE: 3/4" = 1'-0"

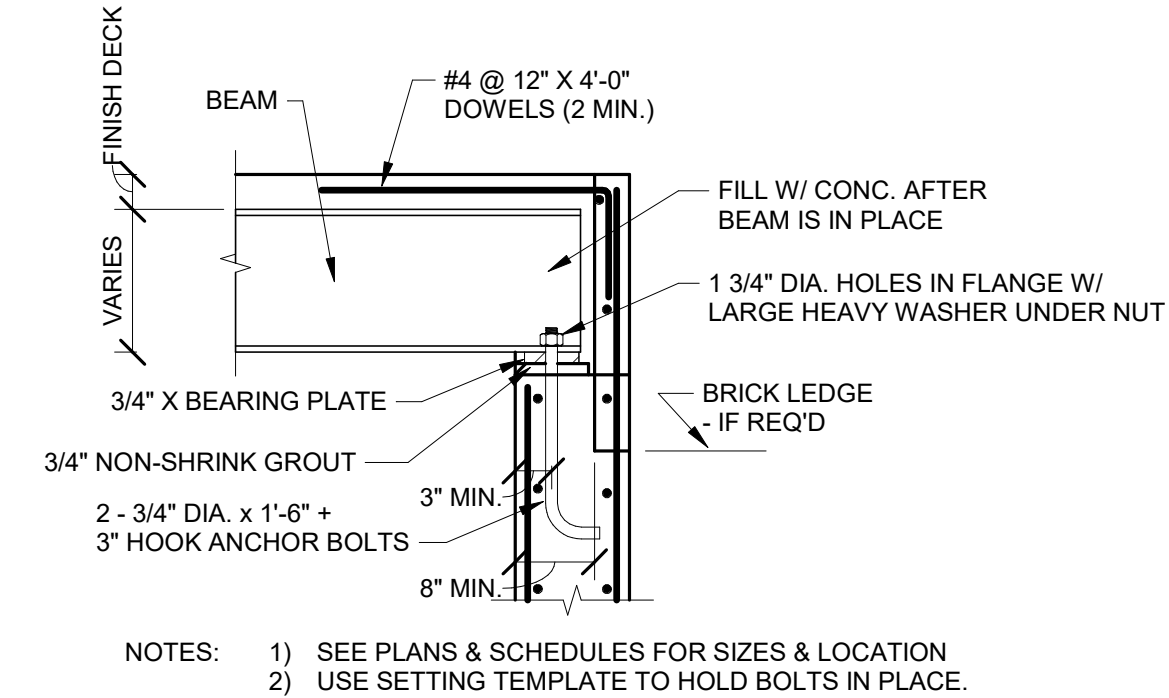


4 BEAM OVER COLUMN CONNECTION
S311 SCALE: 3/4" = 1'-0"

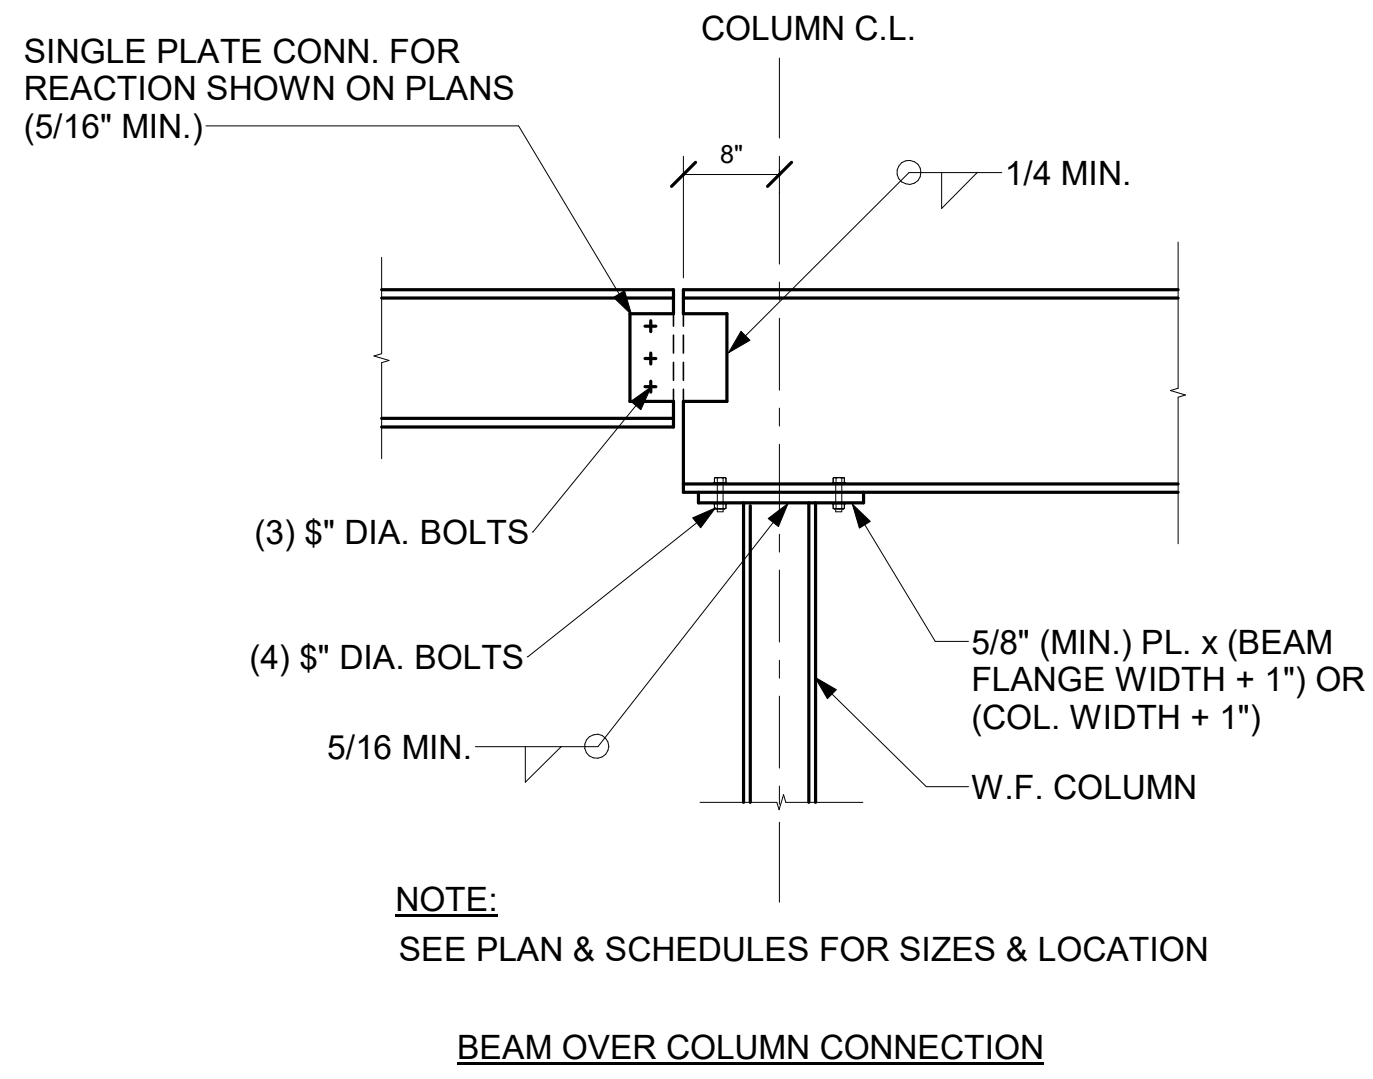


3 BEAM OVER COLUMN CONNECTION
S311 SCALE: 3/4" = 1'-0"

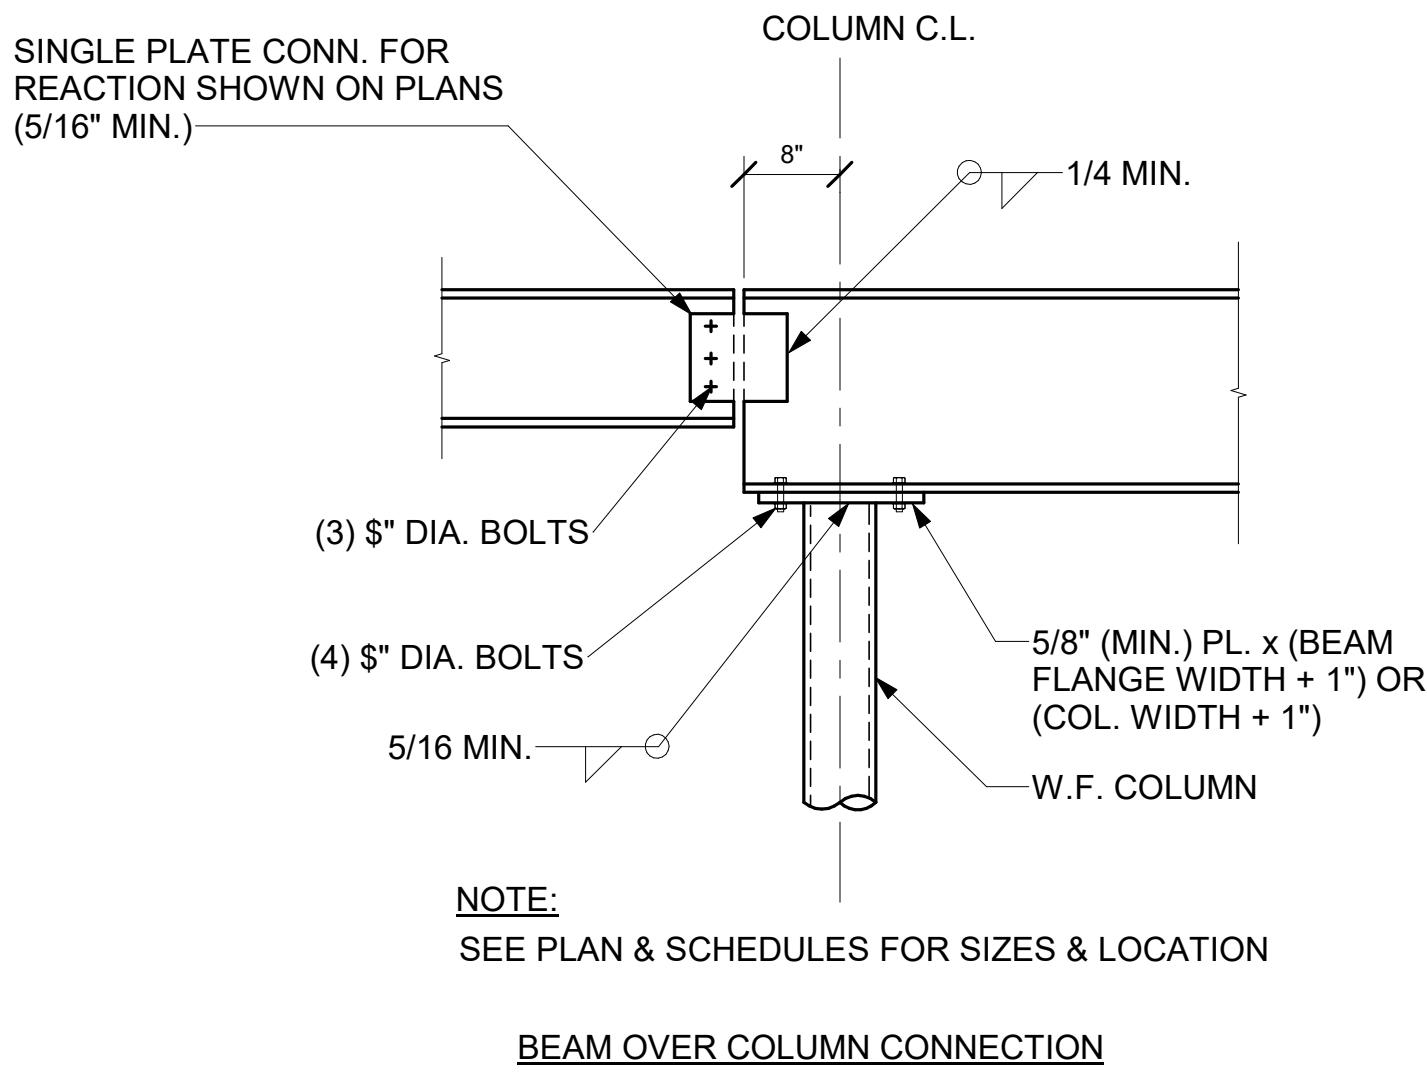

2 BEAM ON COLUMN CONNECTION
S311 SCALE: 3/4" = 1'-0"

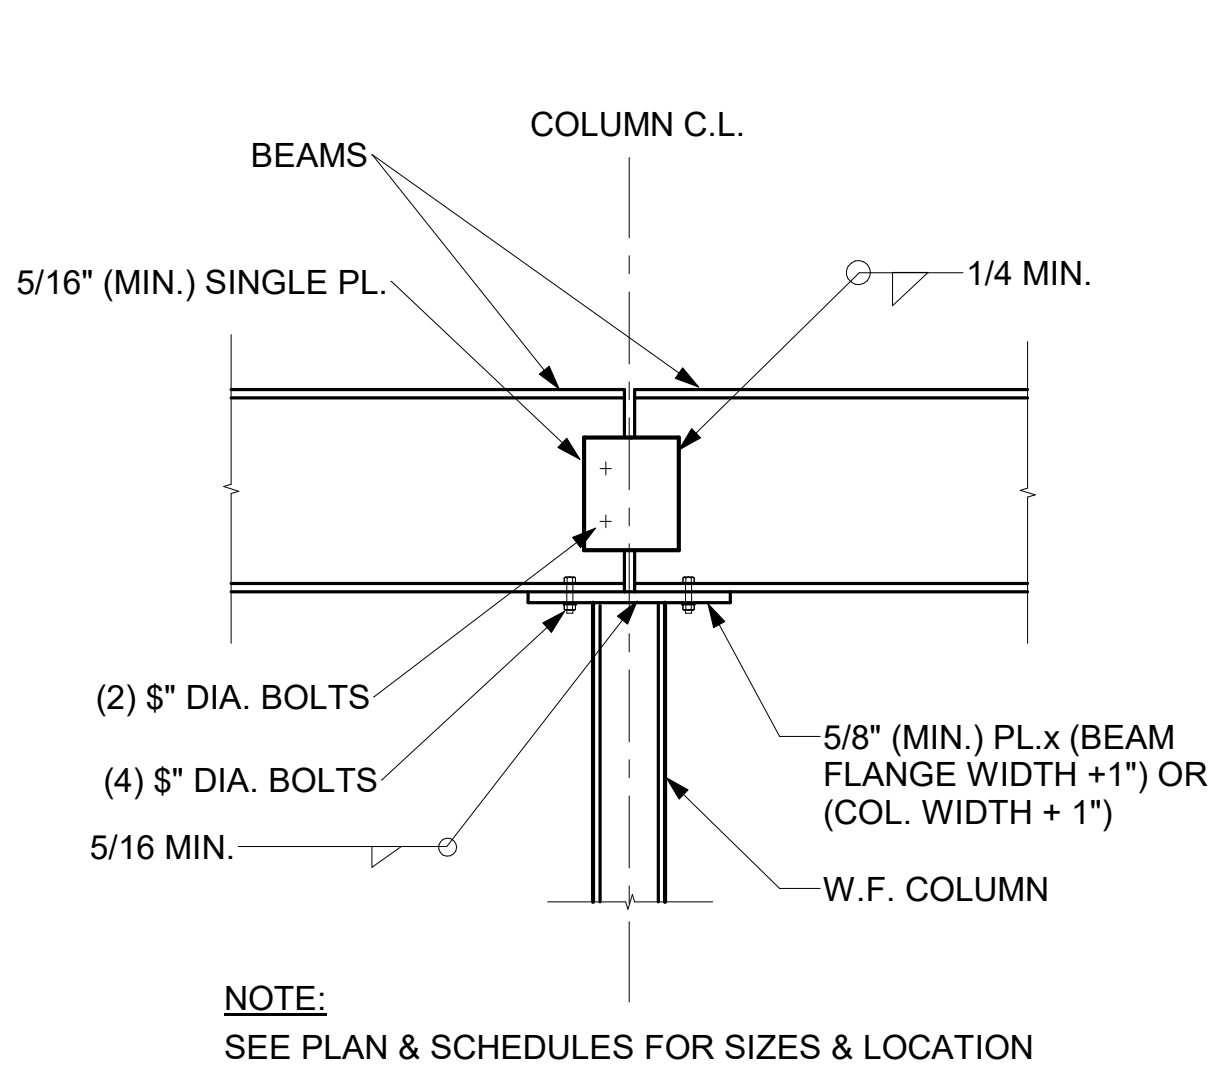

1 BEAM ON COLUMN CONNECTION
S311 SCALE: 3/4" = 1'-0"

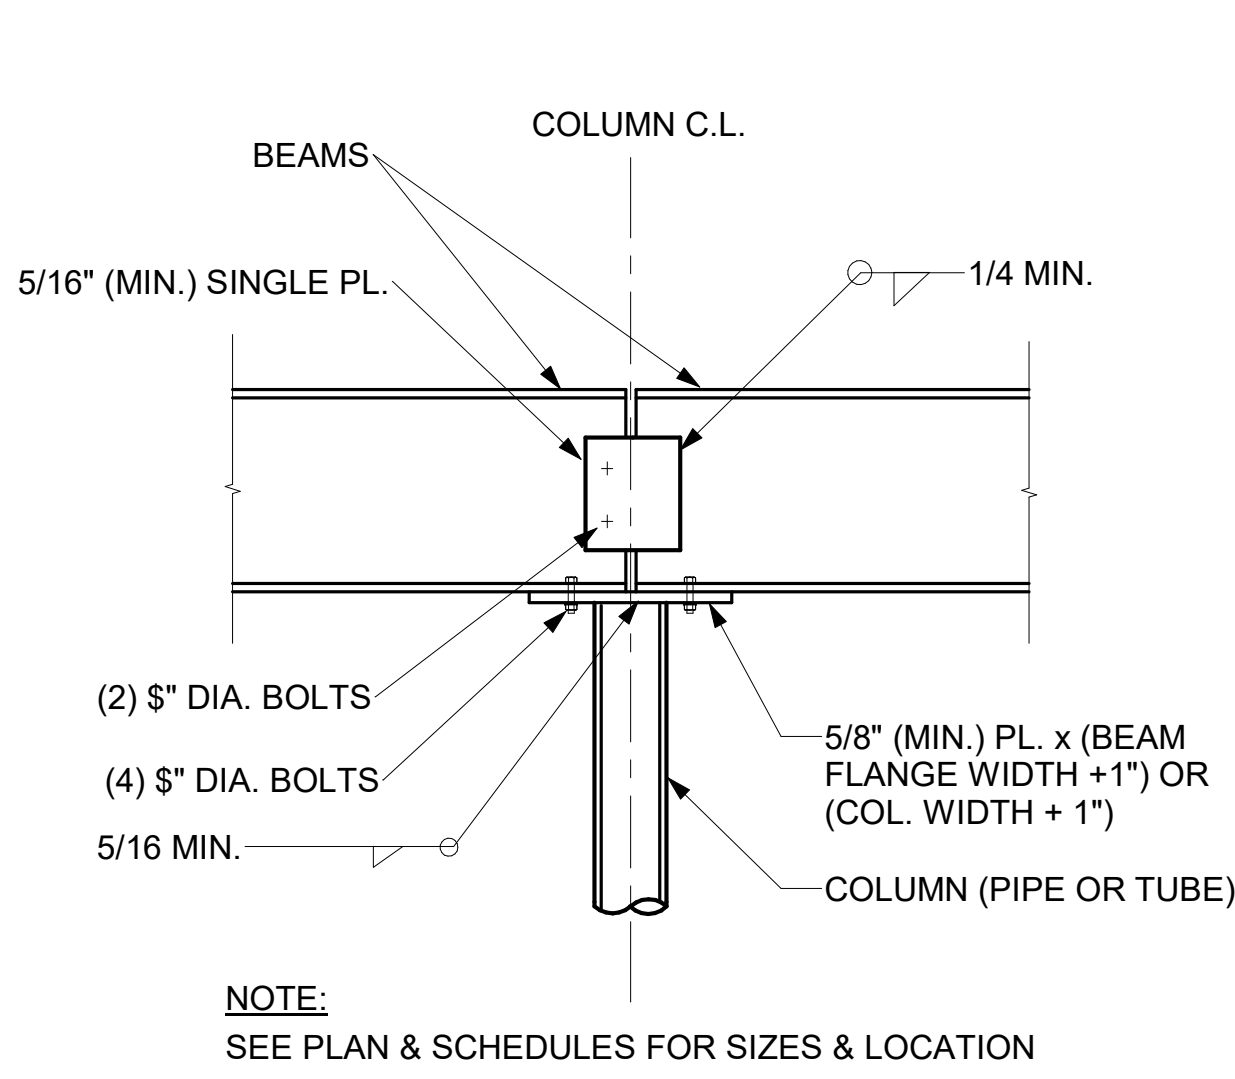

© 2025 Hickok Cole Architects, Inc.


S311

SCALE
As Indicated

DRAWING TITLE
TYPICAL STEEL DETAILS

DRAWN BY
Author

PROJECT NO.
24048

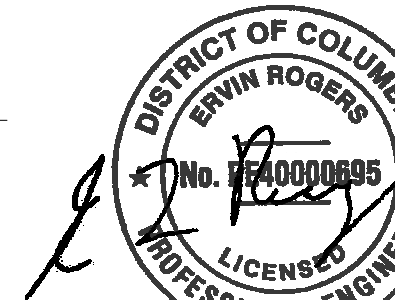

REVISIONS / NOTES	
#	DESCRIPTION
1	03/17/2025 50% Design Development Set
2	05/08/2025 100% DD
3	08/28/2025 100% CD
4	11/21/2025 100% PERMIT SET

ADDRESS
1200 K St NW
Washington, DC 20005

CLIENT NAME

PROJECT NAME
1200 K St NW


PROJECT DETAILS





CONSULTANTS

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com




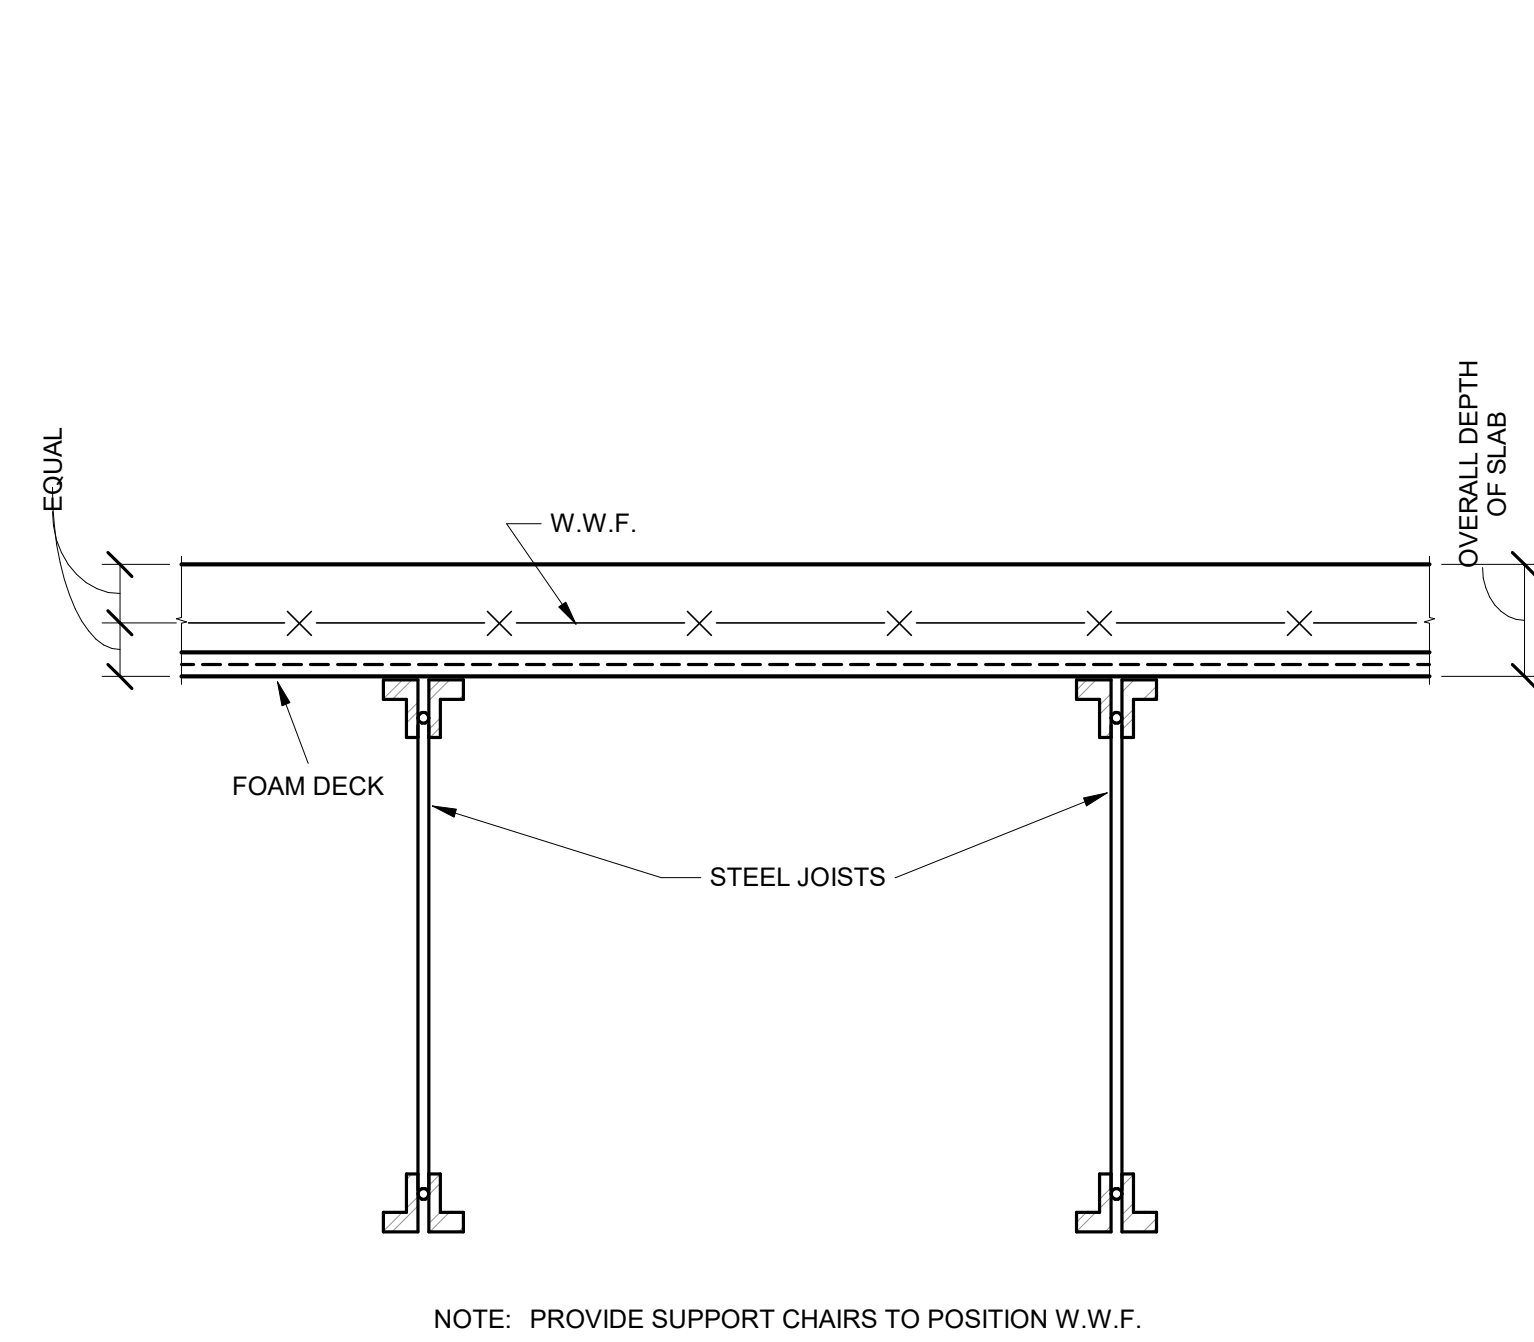


3 CONCRETE SLAB ON PERMANENT STEEL
FORM
S313 SCALE: 1/4" = 1'-0" OVERHANG

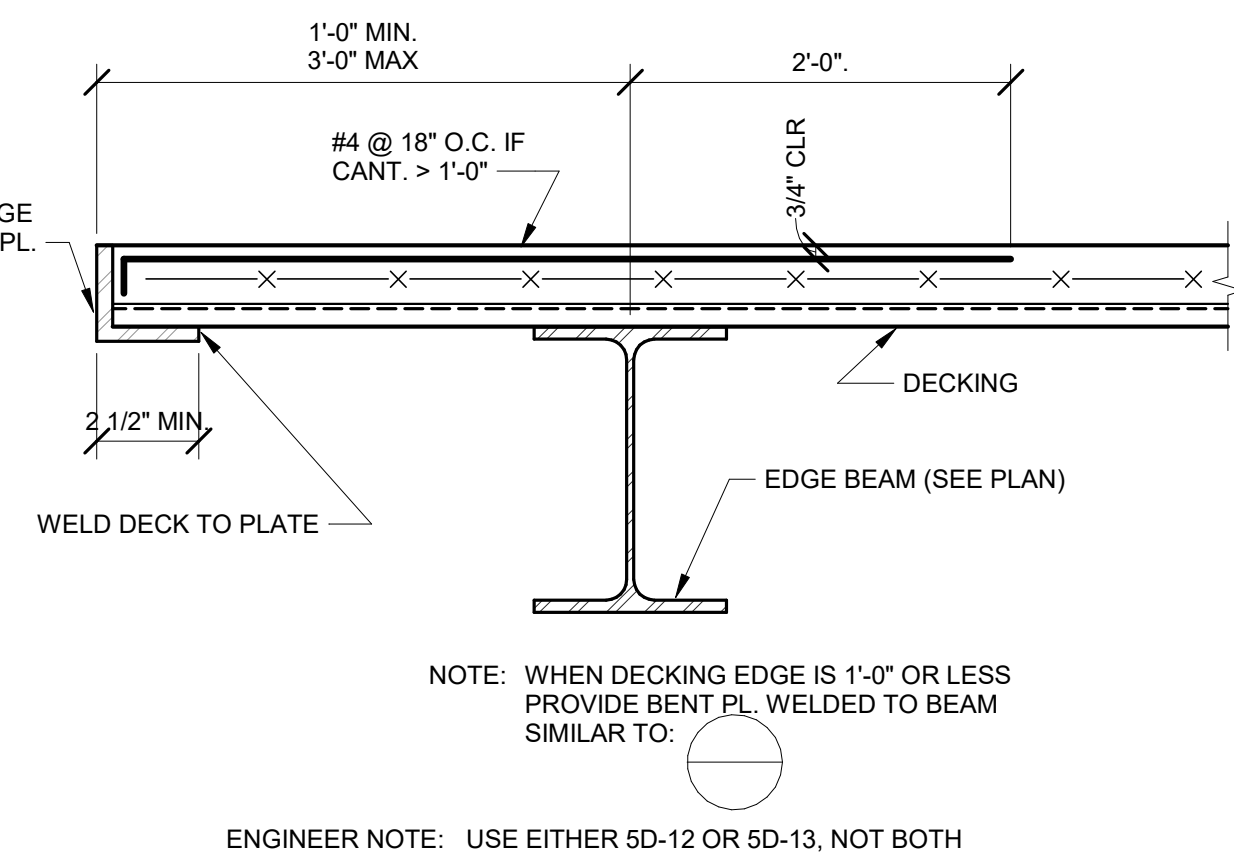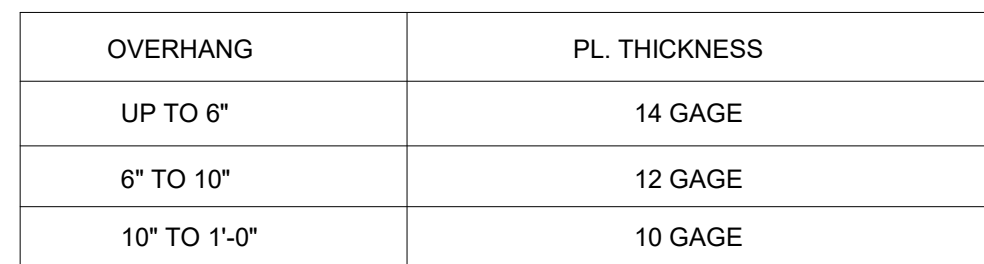




6 DECKING EDGE
S313 SCALE: 1 1/2" = 1'-0"

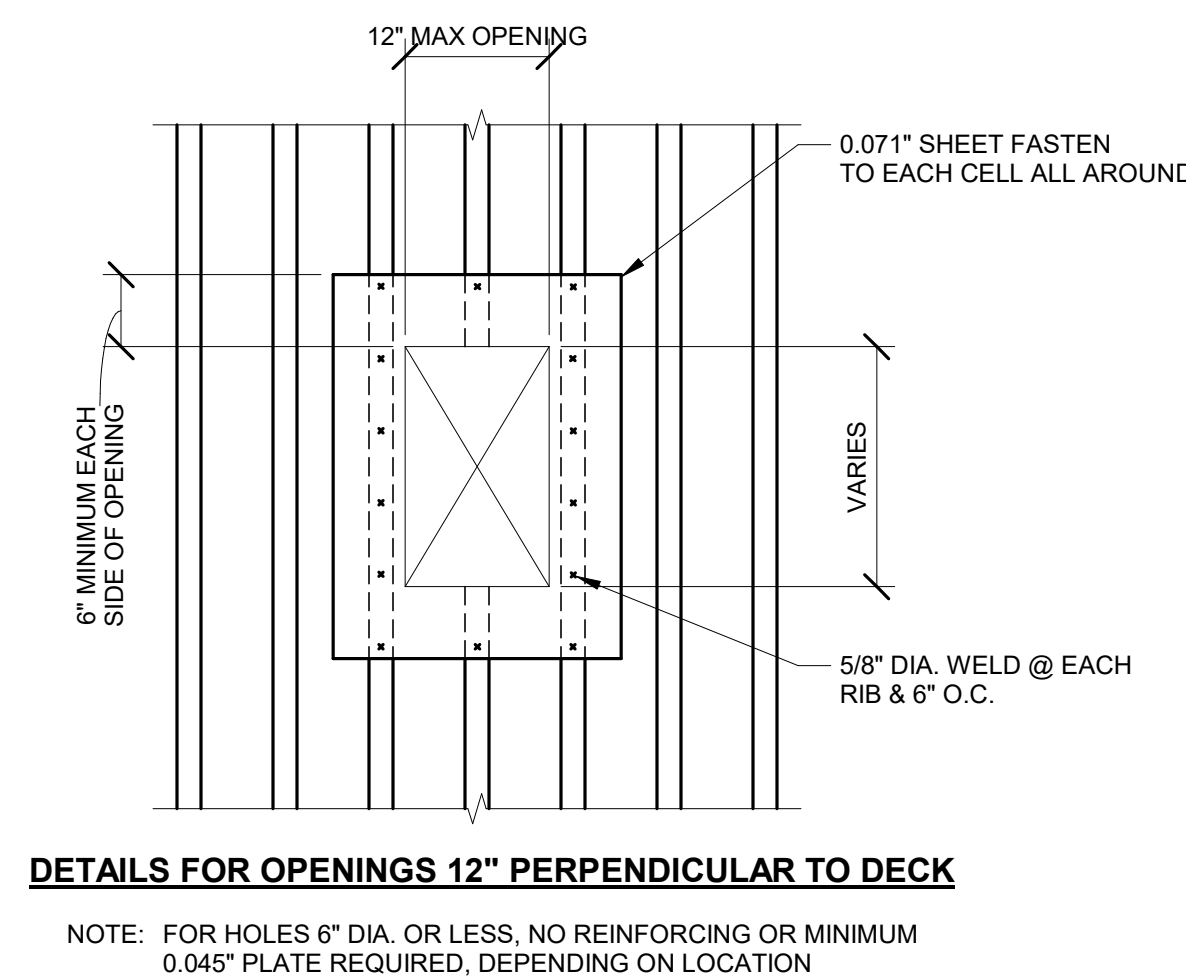

11 SUPPORT OF FLOOR DECK AT COLUMN

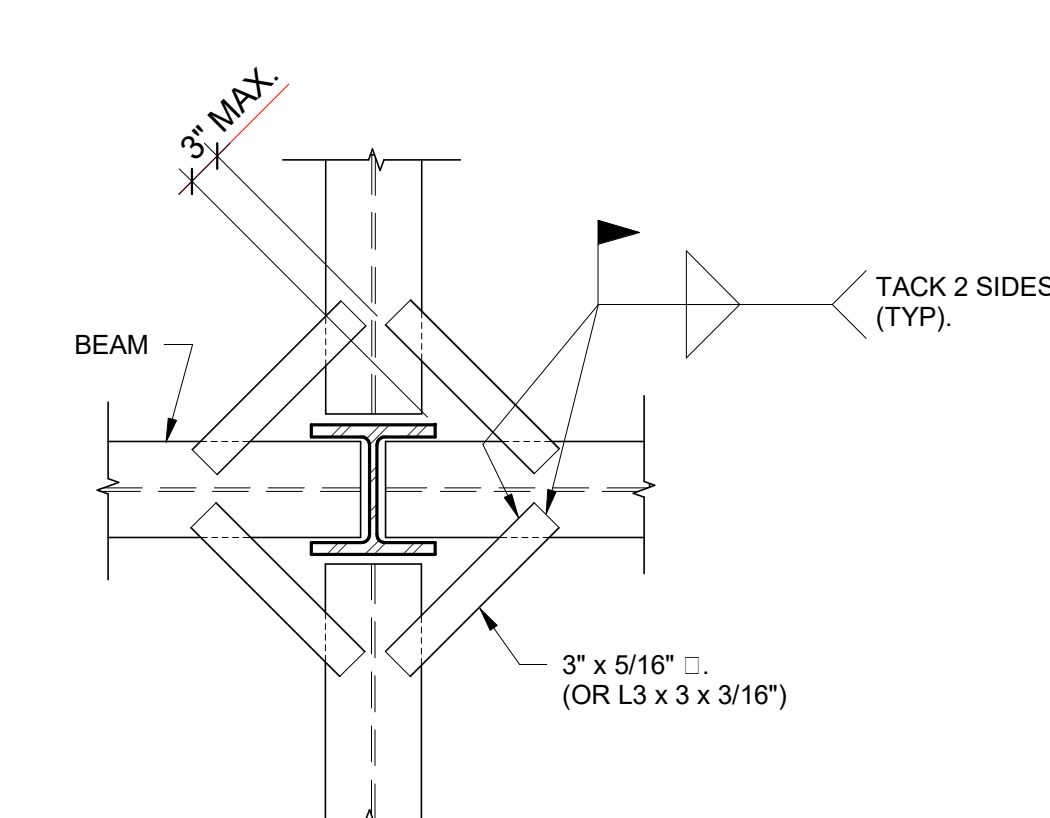

D

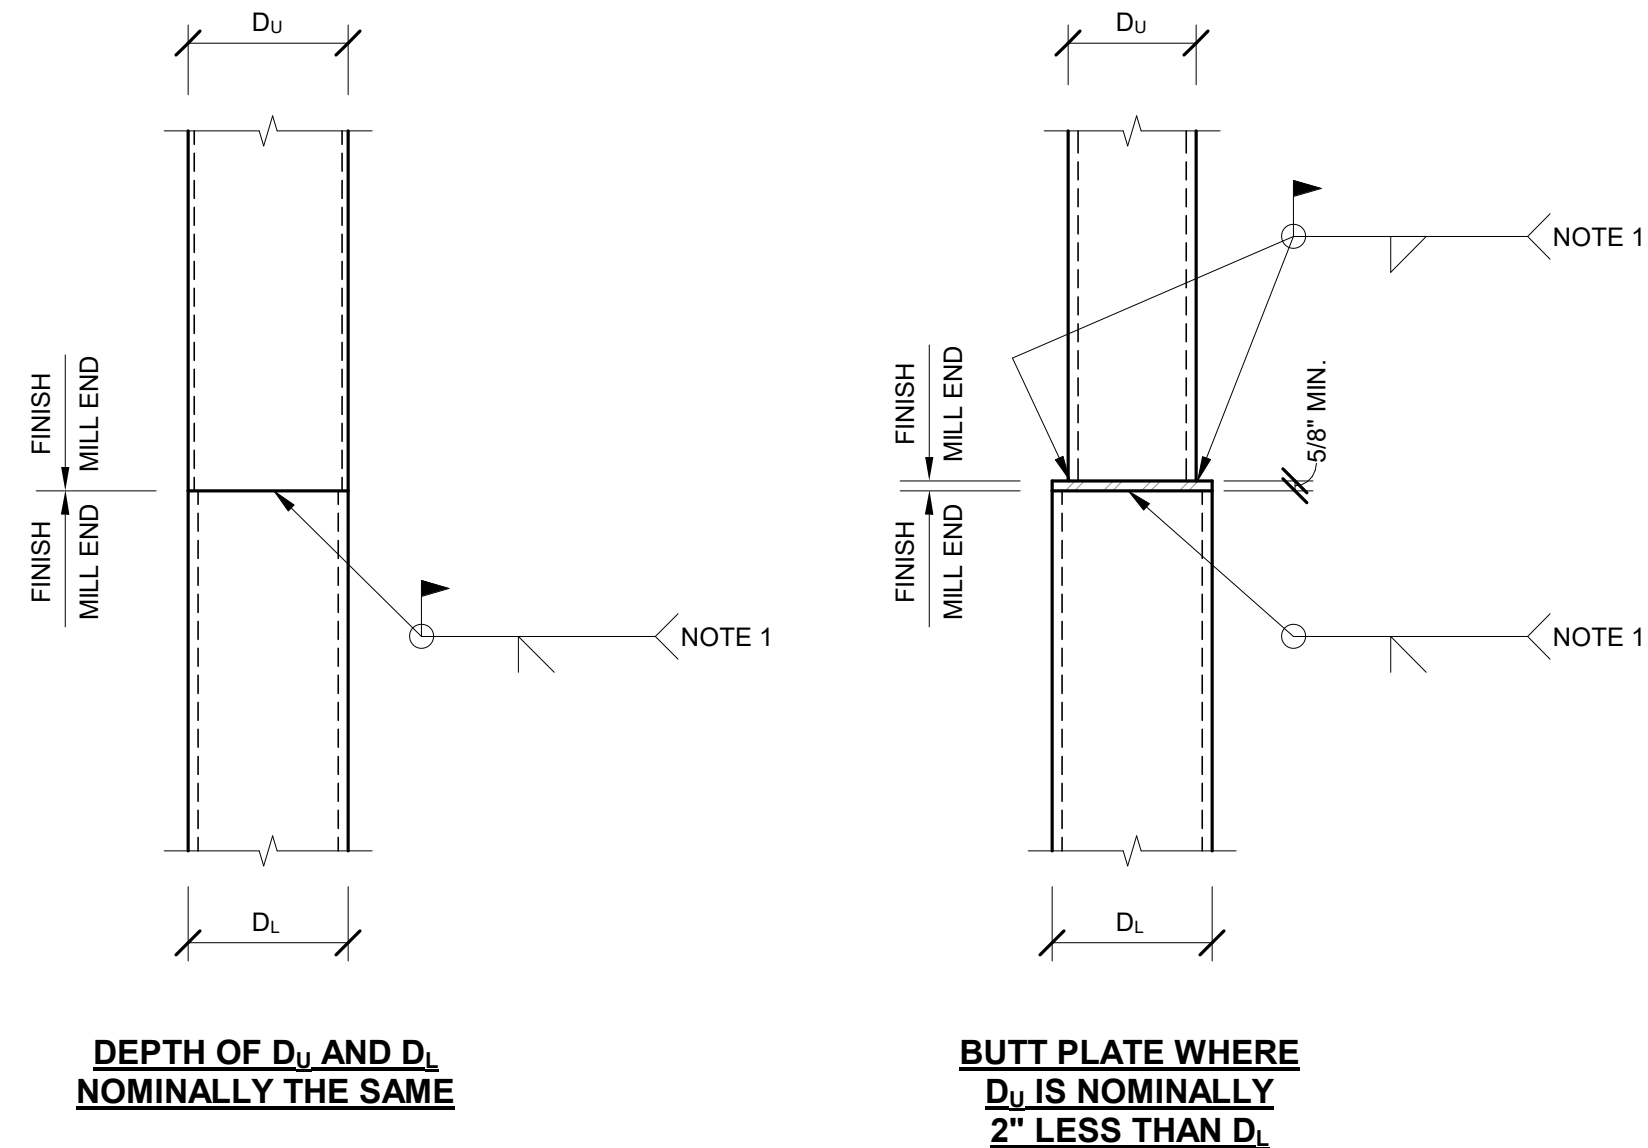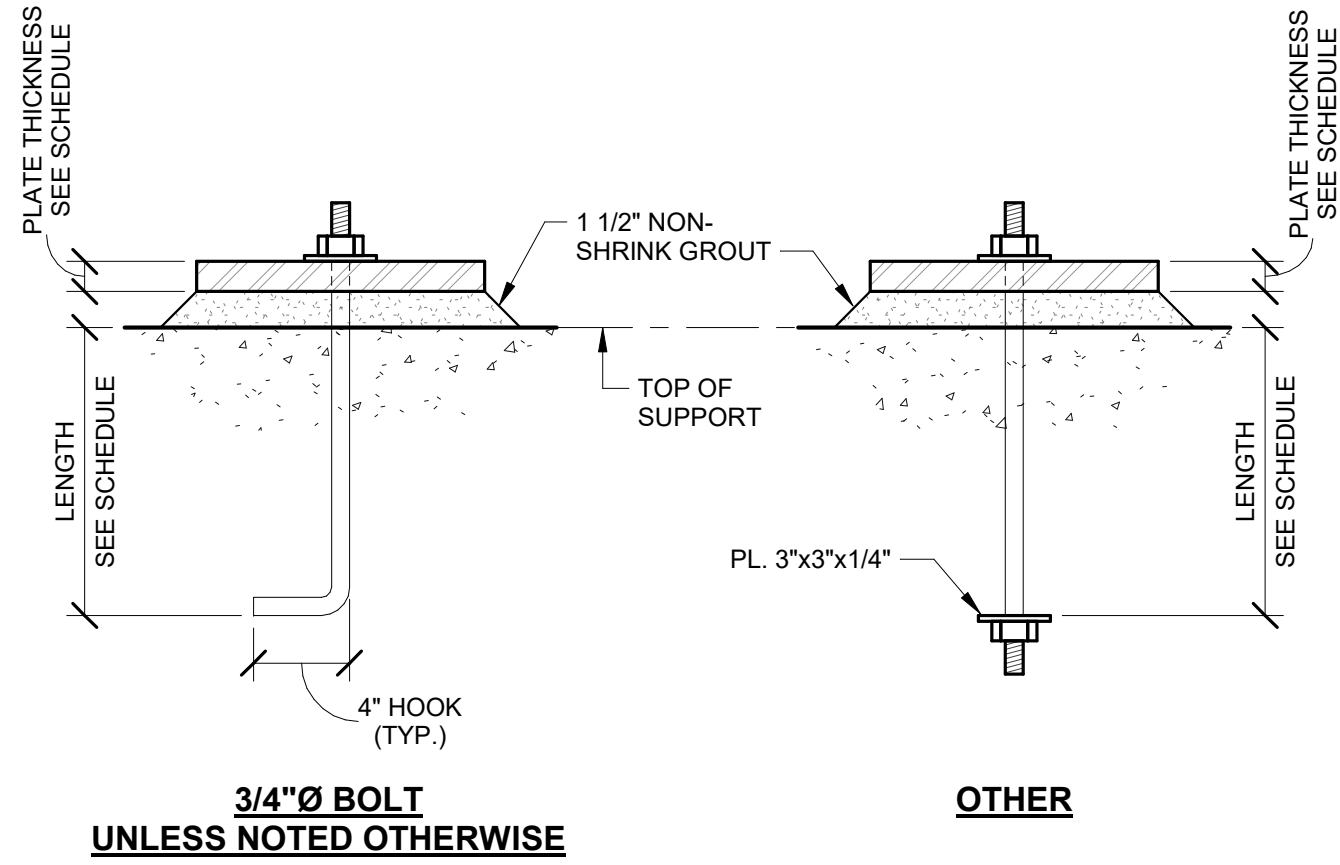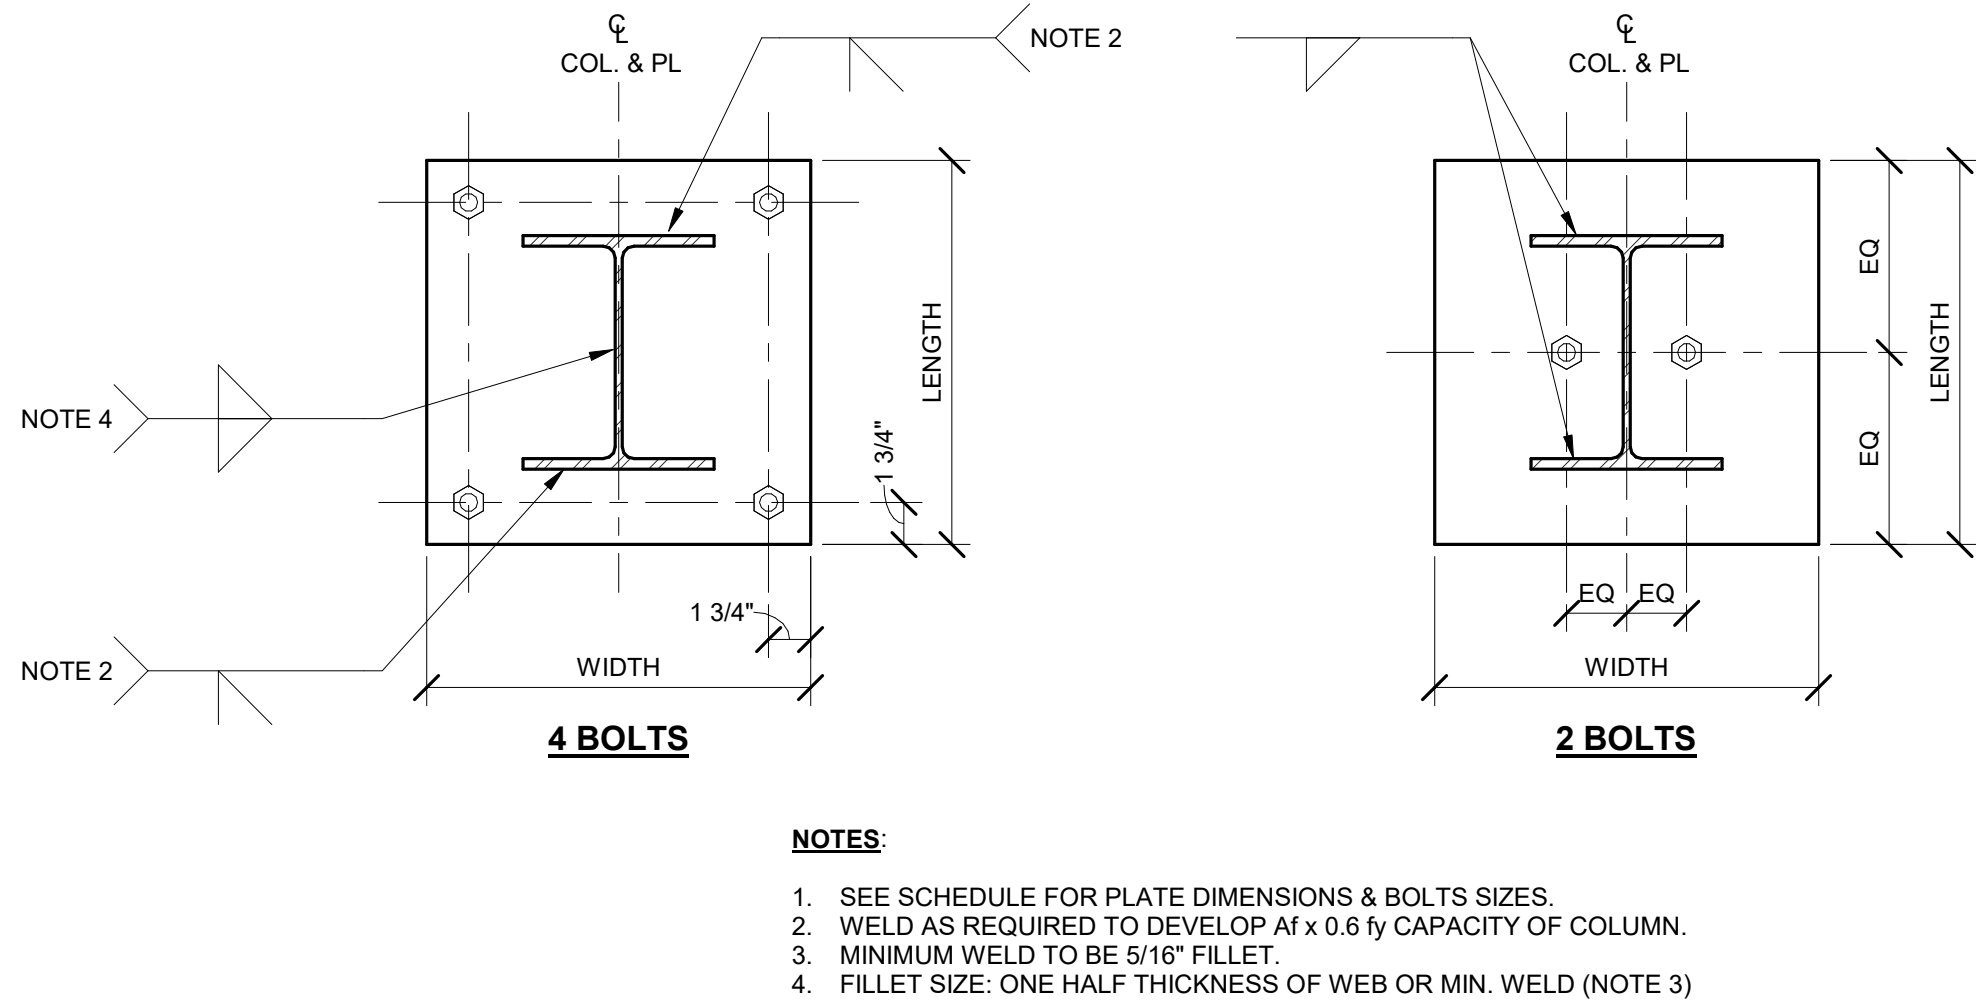


1 W COLUMN BASE PLT.
S314 SCALE: 1 1/2" = 1'-0"

2 BASE PLATE SETTING DETAIL
S314 SCALE: 1 1/2" = 1'-0"

3 WELDED TUBE STEEL COLUMN SPLICE
S314 SCALE: 1" = 1'-0"

COLUMN BASE PLATE SCHEDULE							
MARK	BASE PLATE SIZE			ANCHOR BOLT			REMARKS
	WIDTH	LENGTH	THICKNESS	NO.	SIZE	*LENGTH	

* LENGTH INDICATED IS MINIMUM EMBEDMENT.

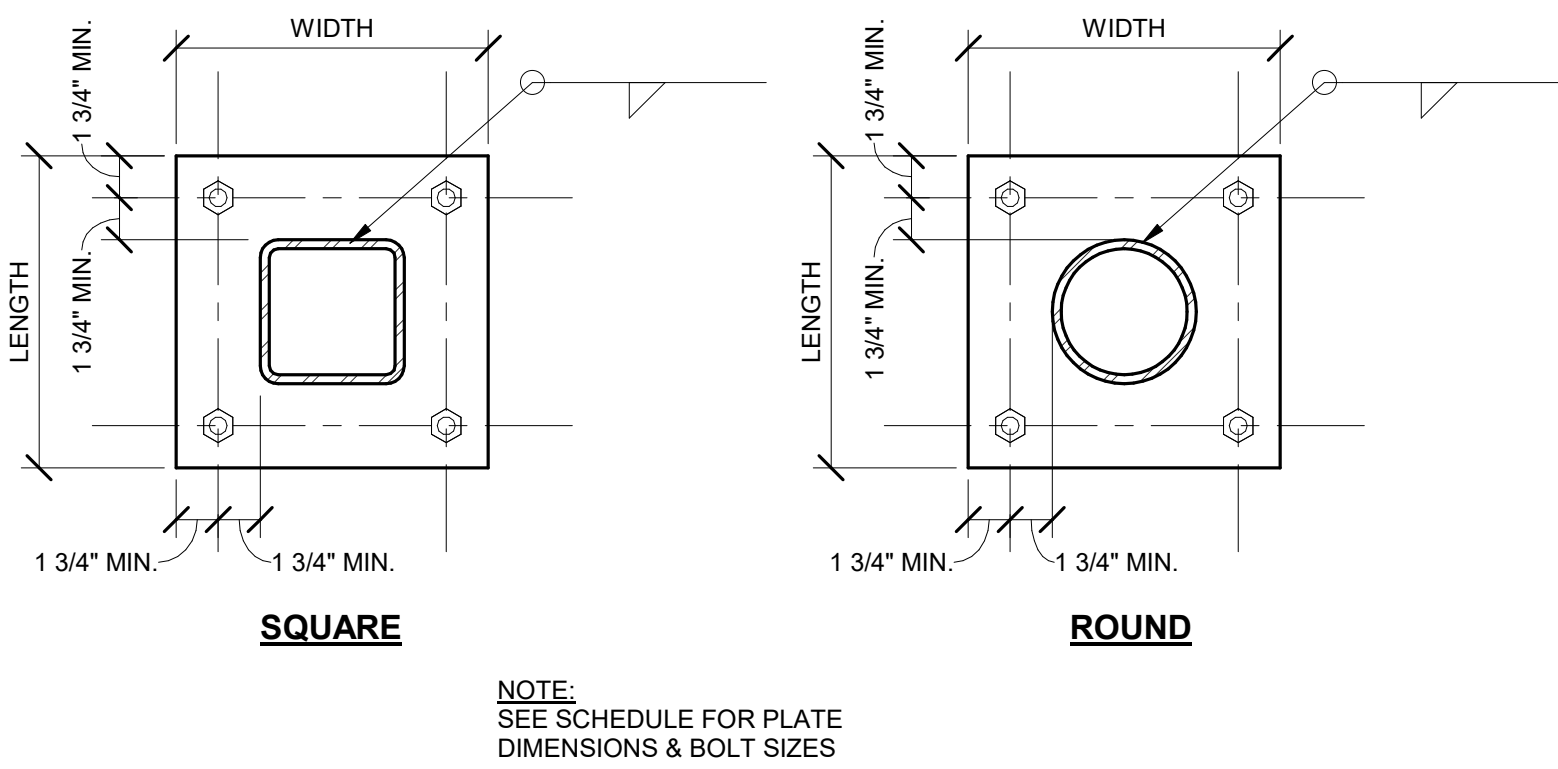

4 COLUMN BASE PL. SCHEDULE
S314 SCALE: 1" = 1'-0"


5 TUBE STEEL COLUMN BASE PLATE
S314 SCALE: 1 1/2" = 1'-0"

C

B

A

D

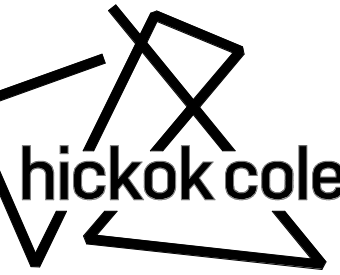

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS

Delon Hampton
ASSOCIATES | CHARTERED
CIVIL | STRUCTURAL | PM/CM

C

PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
1200 K St NW
Washington, DC 20005

B

REVISIONS / NOTES	
#	DESCRIPTION
1	50% Design Development Set
2	100% DD
3	50% CD
4	50% CD
5	50% CD
6	50% CD
7	50% CD
8	50% CD
9	50% CD
10	50% CD
11	50% CD
12	50% CD
13	50% CD
14	50% CD
15	50% CD
16	50% CD
17	50% CD
18	50% CD
19	50% CD
20	50% CD
21	50% CD
22	50% CD
23	50% CD
24	50% CD
25	50% CD
26	50% CD
27	50% CD
28	50% CD
29	50% CD
30	50% CD
31	50% CD
32	50% CD
33	50% CD
34	50% CD
35	50% CD
36	50% CD
37	50% CD
38	50% CD
39	50% CD
40	50% CD
41	50% CD
42	50% CD
43	50% CD
44	50% CD
45	50% CD
46	50% CD
47	50% CD
48	50% CD
49	50% CD
50	50% CD
51	50% CD
52	50% CD
53	50% CD
54	50% CD
55	50% CD
56	50% CD
57	50% CD
58	50% CD
59	50% CD
60	50% CD
61	50% CD
62	50% CD
63	50% CD
64	50% CD
65	50% CD
66	50% CD
67	50% CD
68	50% CD
69	50% CD
70	50% CD
71	50% CD
72	50% CD
73	50% CD
74	50% CD
75	50% CD
76	50% CD
77	50% CD
78	50% CD
79	50% CD
80	50% CD
81	50% CD
82	50% CD
83	50% CD
84	50% CD
85	50% CD
86	50% CD
87	50% CD
88	50% CD
89	50% CD
90	50% CD
91	50% CD
92	50% CD
93	50% CD
94	50% CD
95	50% CD
96	50% CD
97	50% CD
98	50% CD
99	50% CD
100	50% CD

STAMP

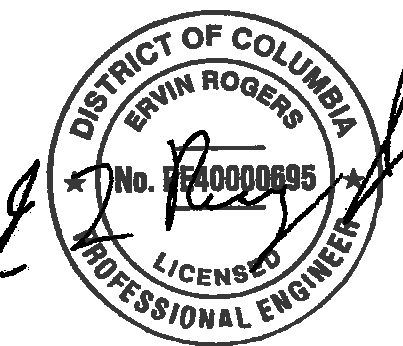

PROJECT NO.
24048

DRAWN BY
Author

SCALE
As indicated

DRAWING TITLE
TYPICAL STEEL DETAILS

DRAWING NO.
S314


A

B


C

D


9 CONC CURB DETAIL
S400 SCALE: 1" = 1'-0"

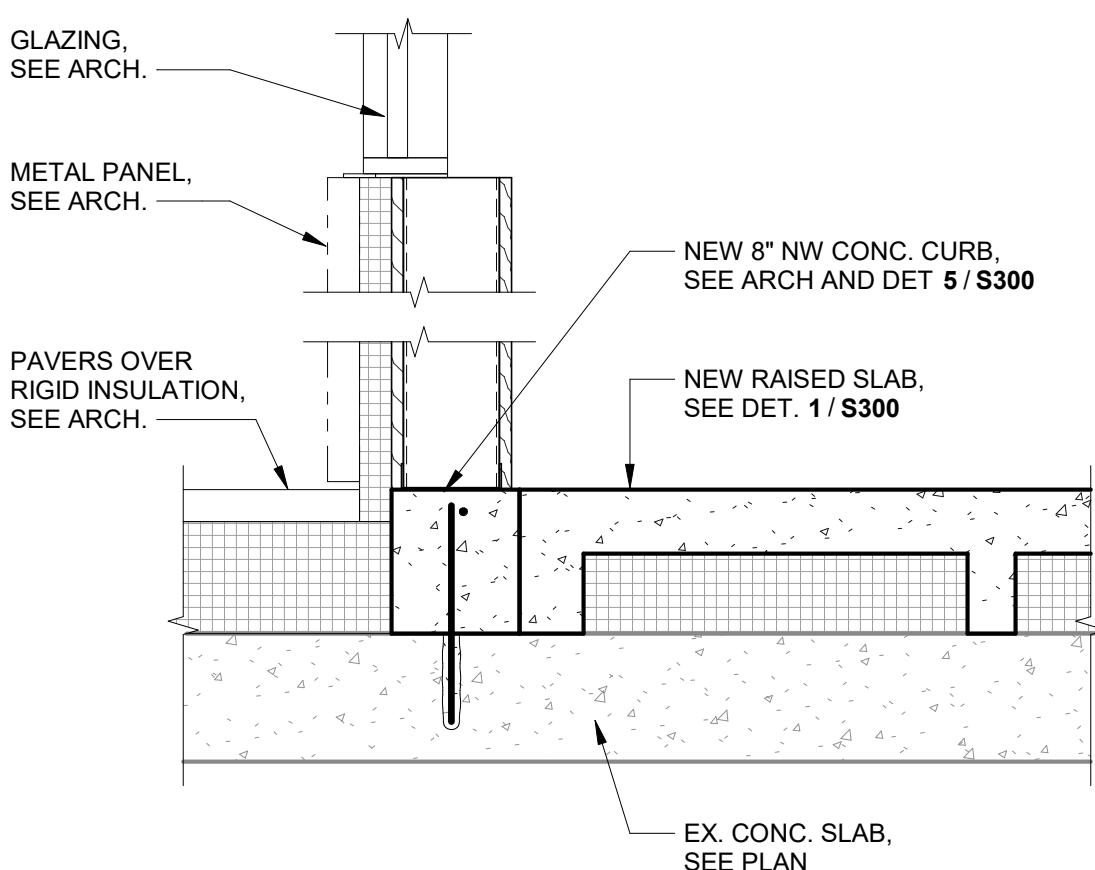


1 RAISED SLAB AT POOL
S400 SCALE: 3/4" = 1'-0"

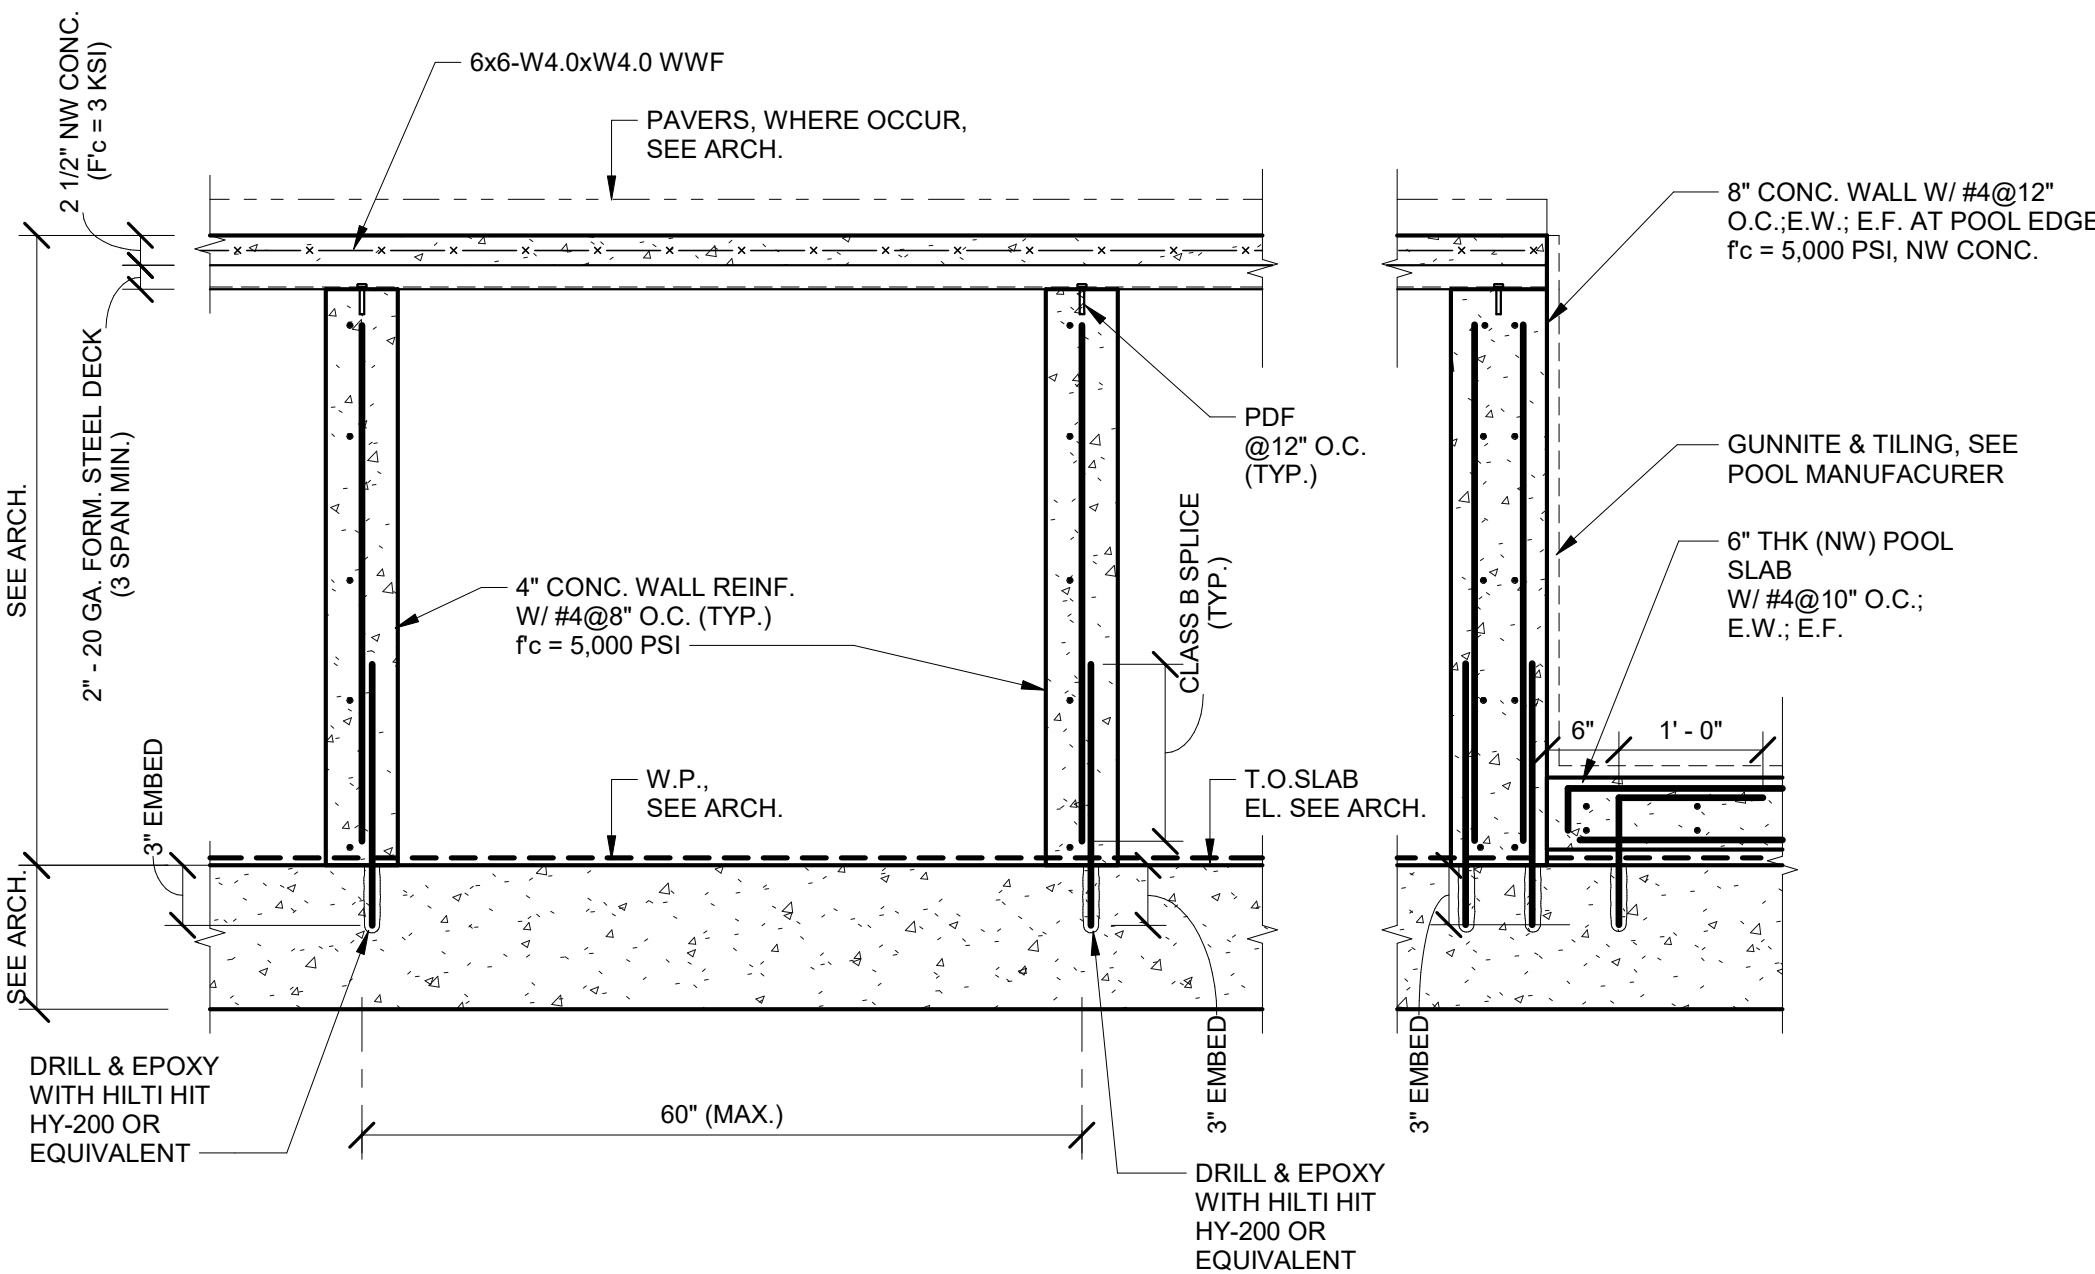


5 COLUMN PUNCHING STRENGTHING - OPTION 3
S400 SCALE: 3/4" = 1'-0"

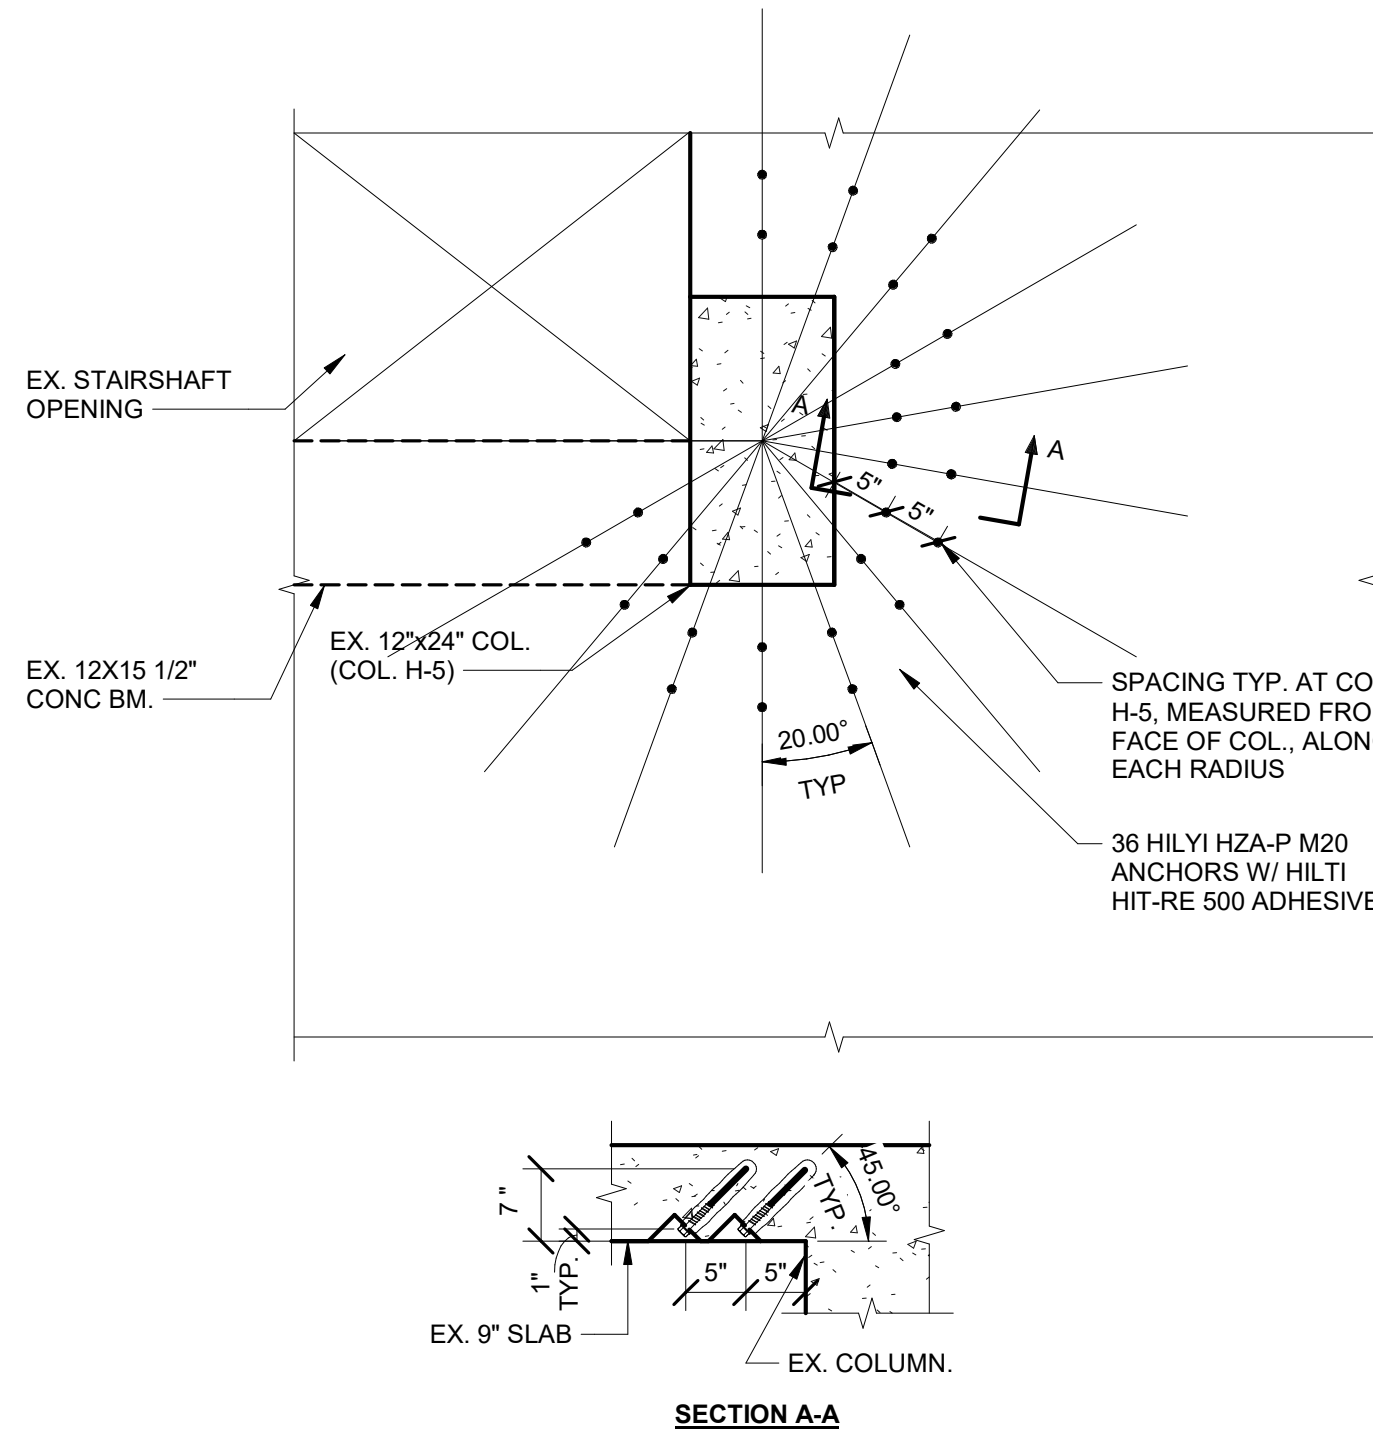


6 SECTION AT L1 DOORWAY
S400 SCALE: 1" = 1'-0"

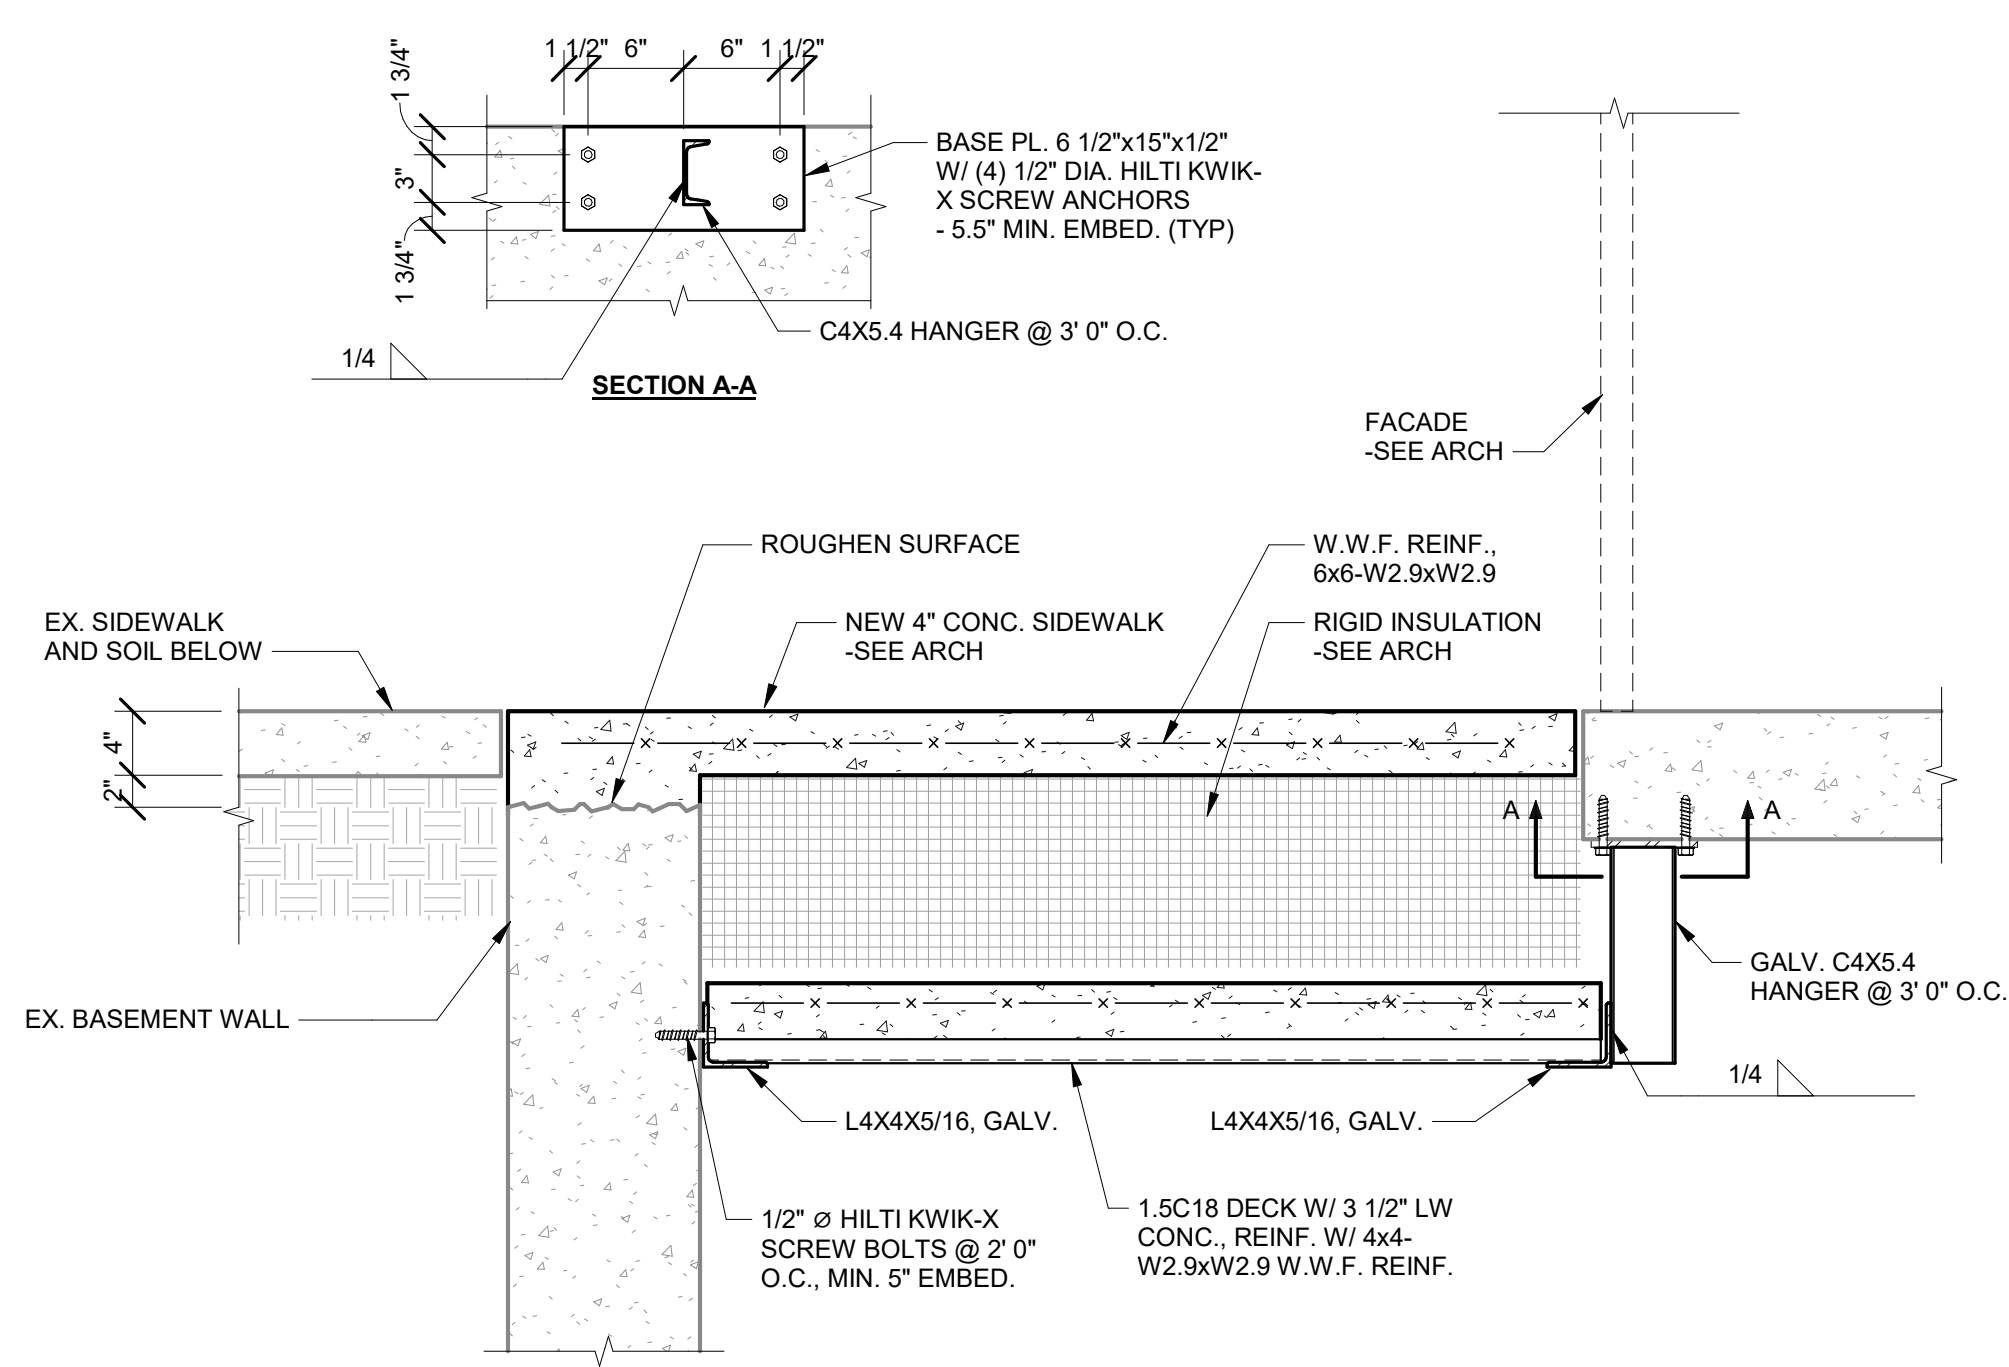


2 EXTERIOR COLUMN DROP CAP
S400 SCALE: 3/4" = 1'-0"

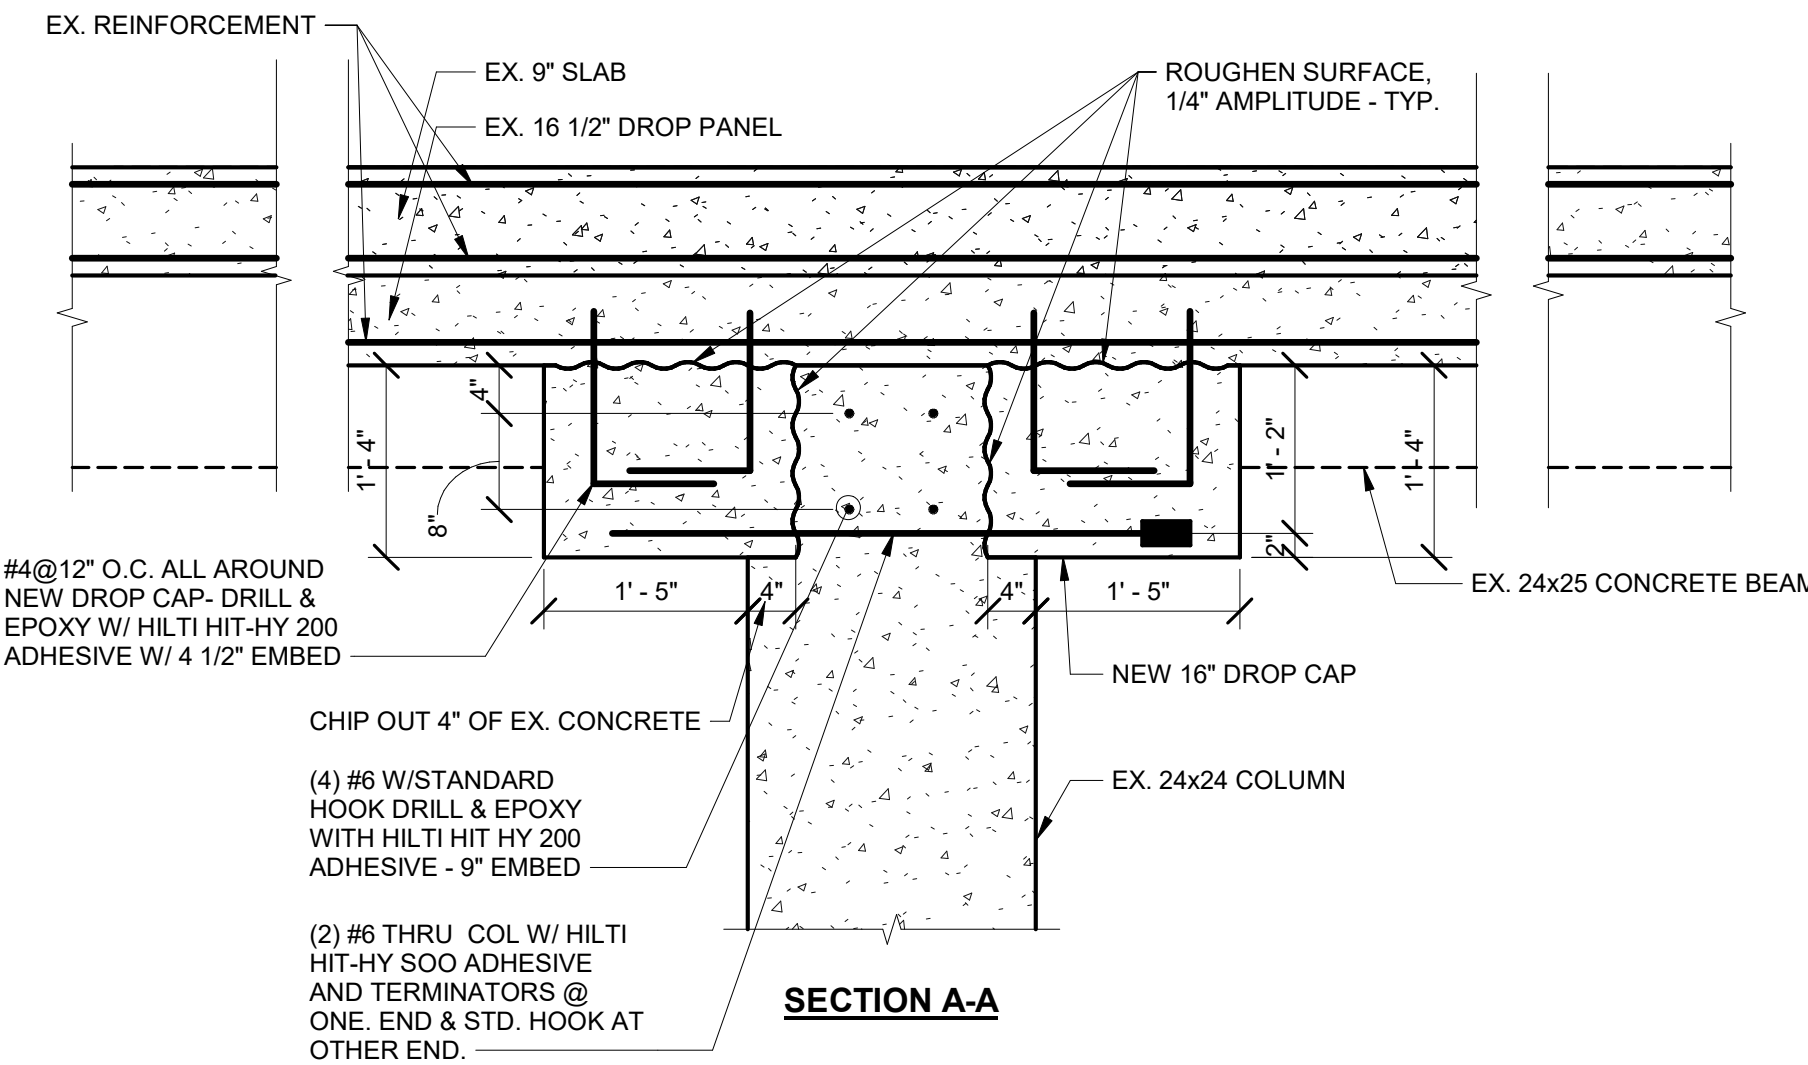


7 COLUMN PUNCHING STRENGTHING - OPTION 4
S400 SCALE: 3/4" = 1'-0"

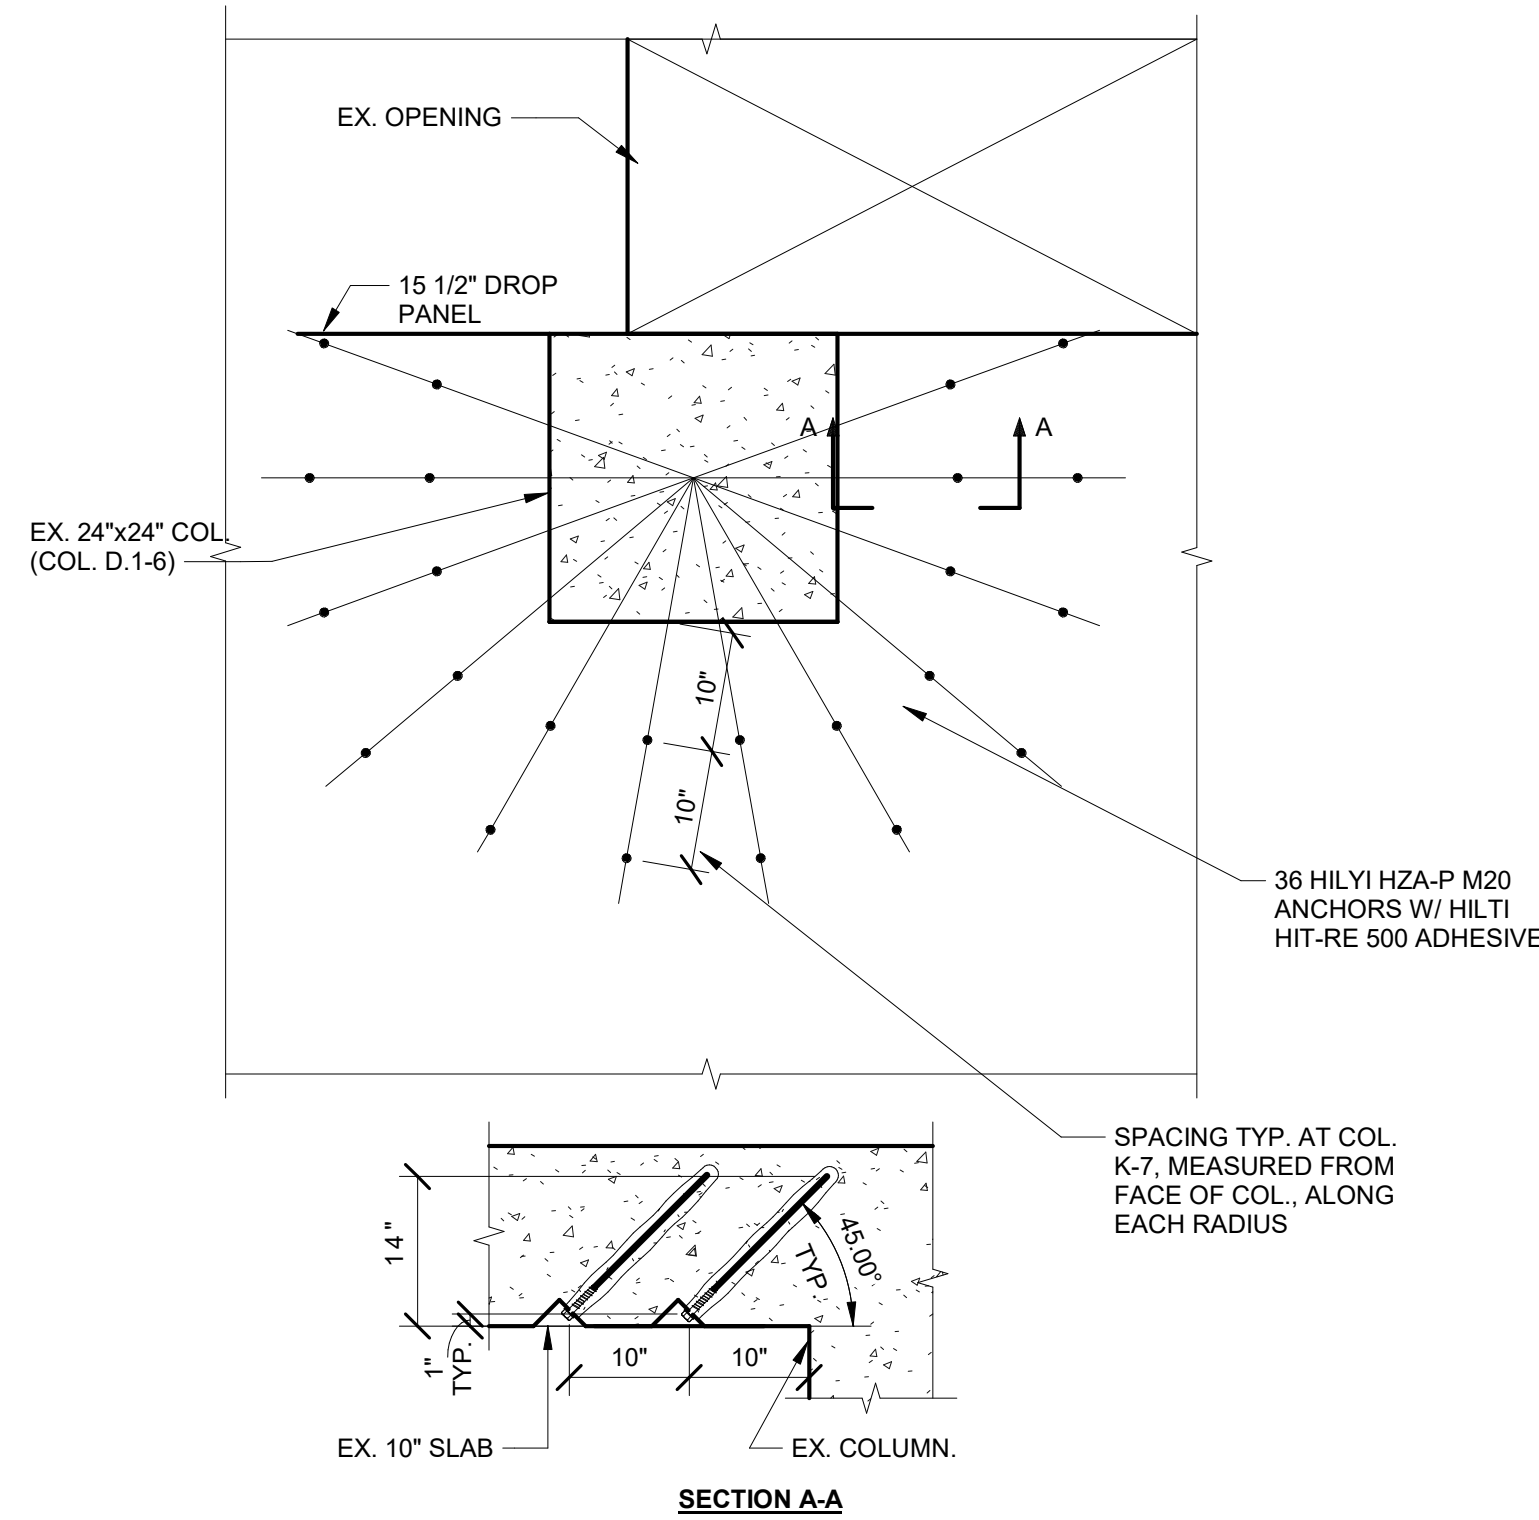


3 COLUMN PUNCHING STRENGTHING - OPTION 1
S400 SCALE: 3/4" = 1'-0"

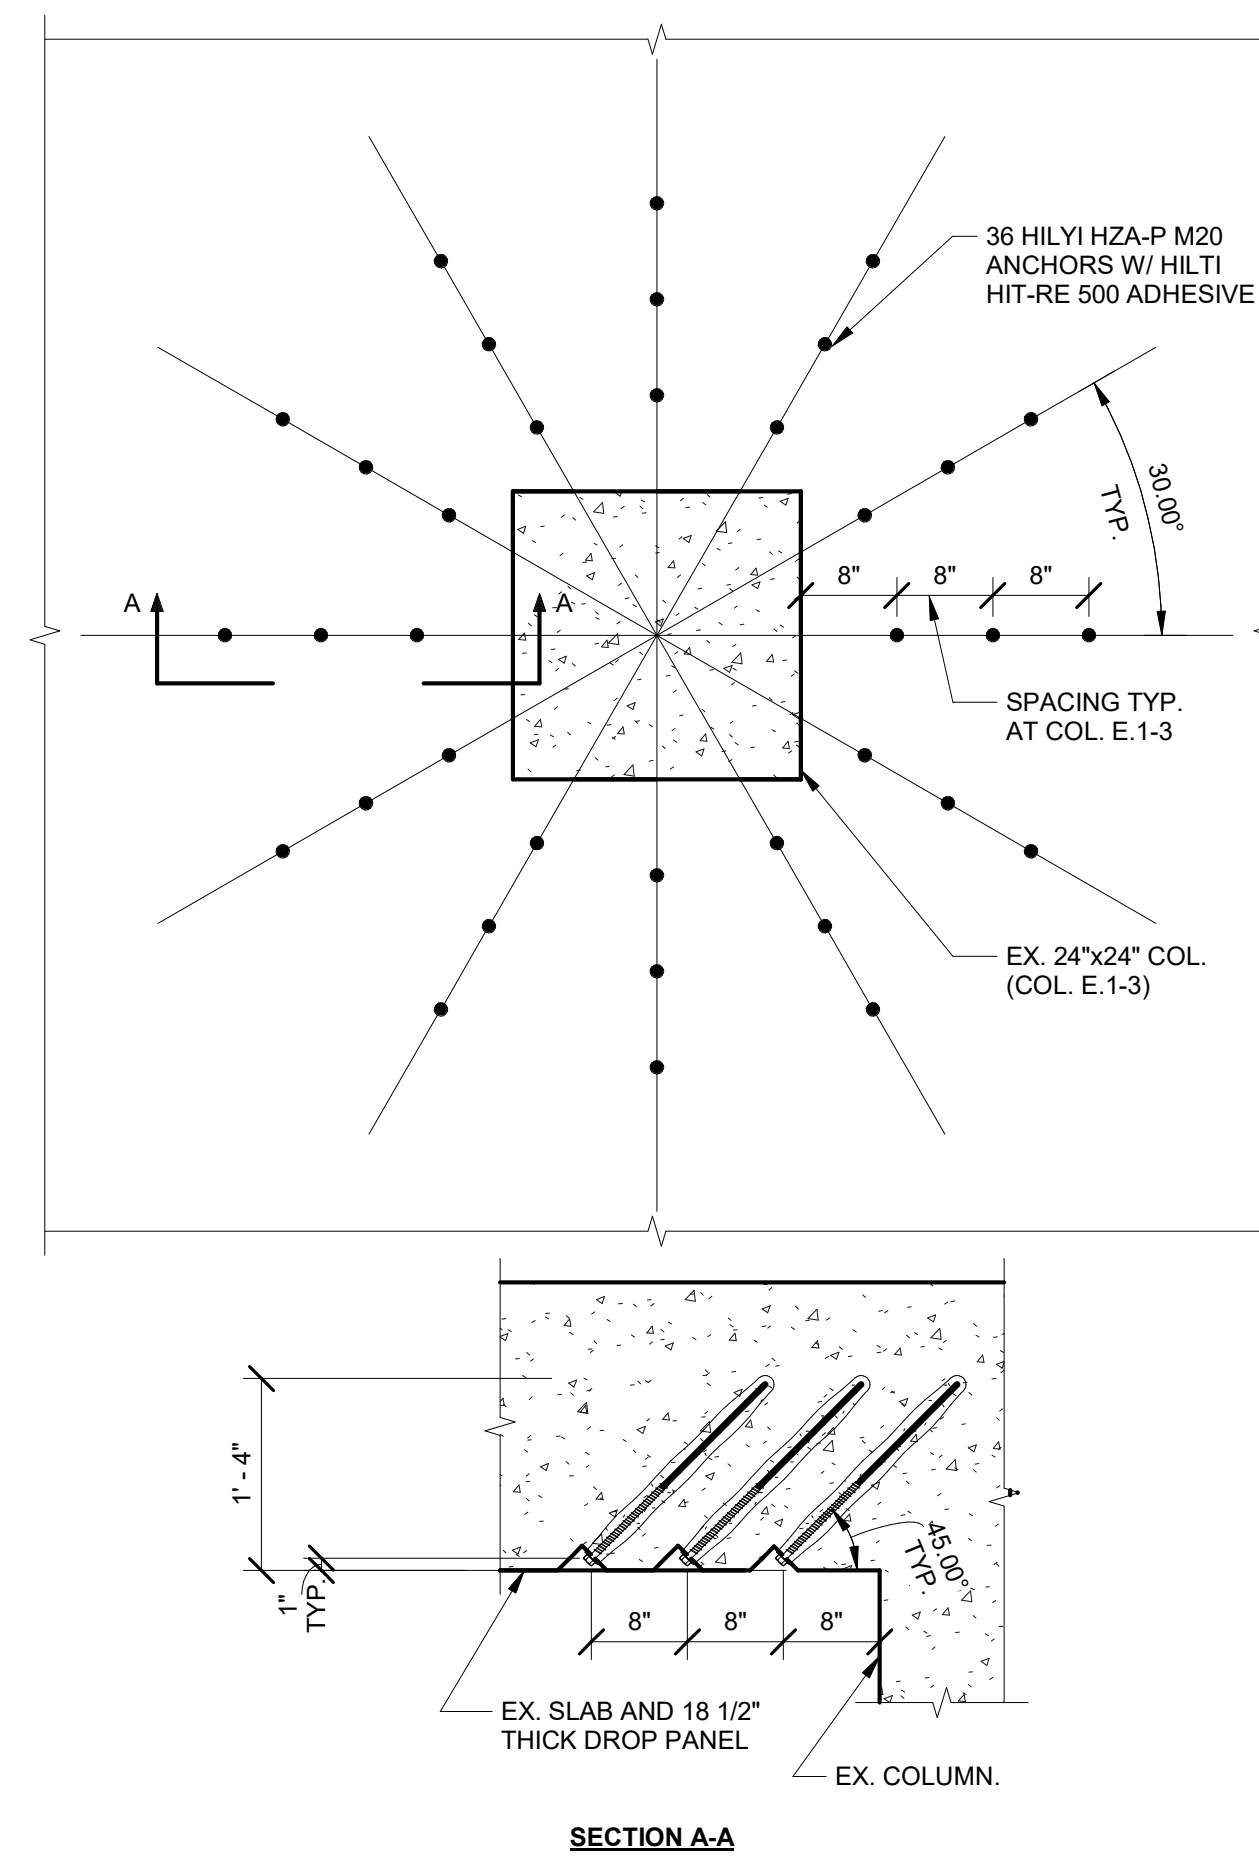


8 COLUMN PUNCHING STRENGTHING - OPTION 5
S400 SCALE: 3/4" = 1'-0"

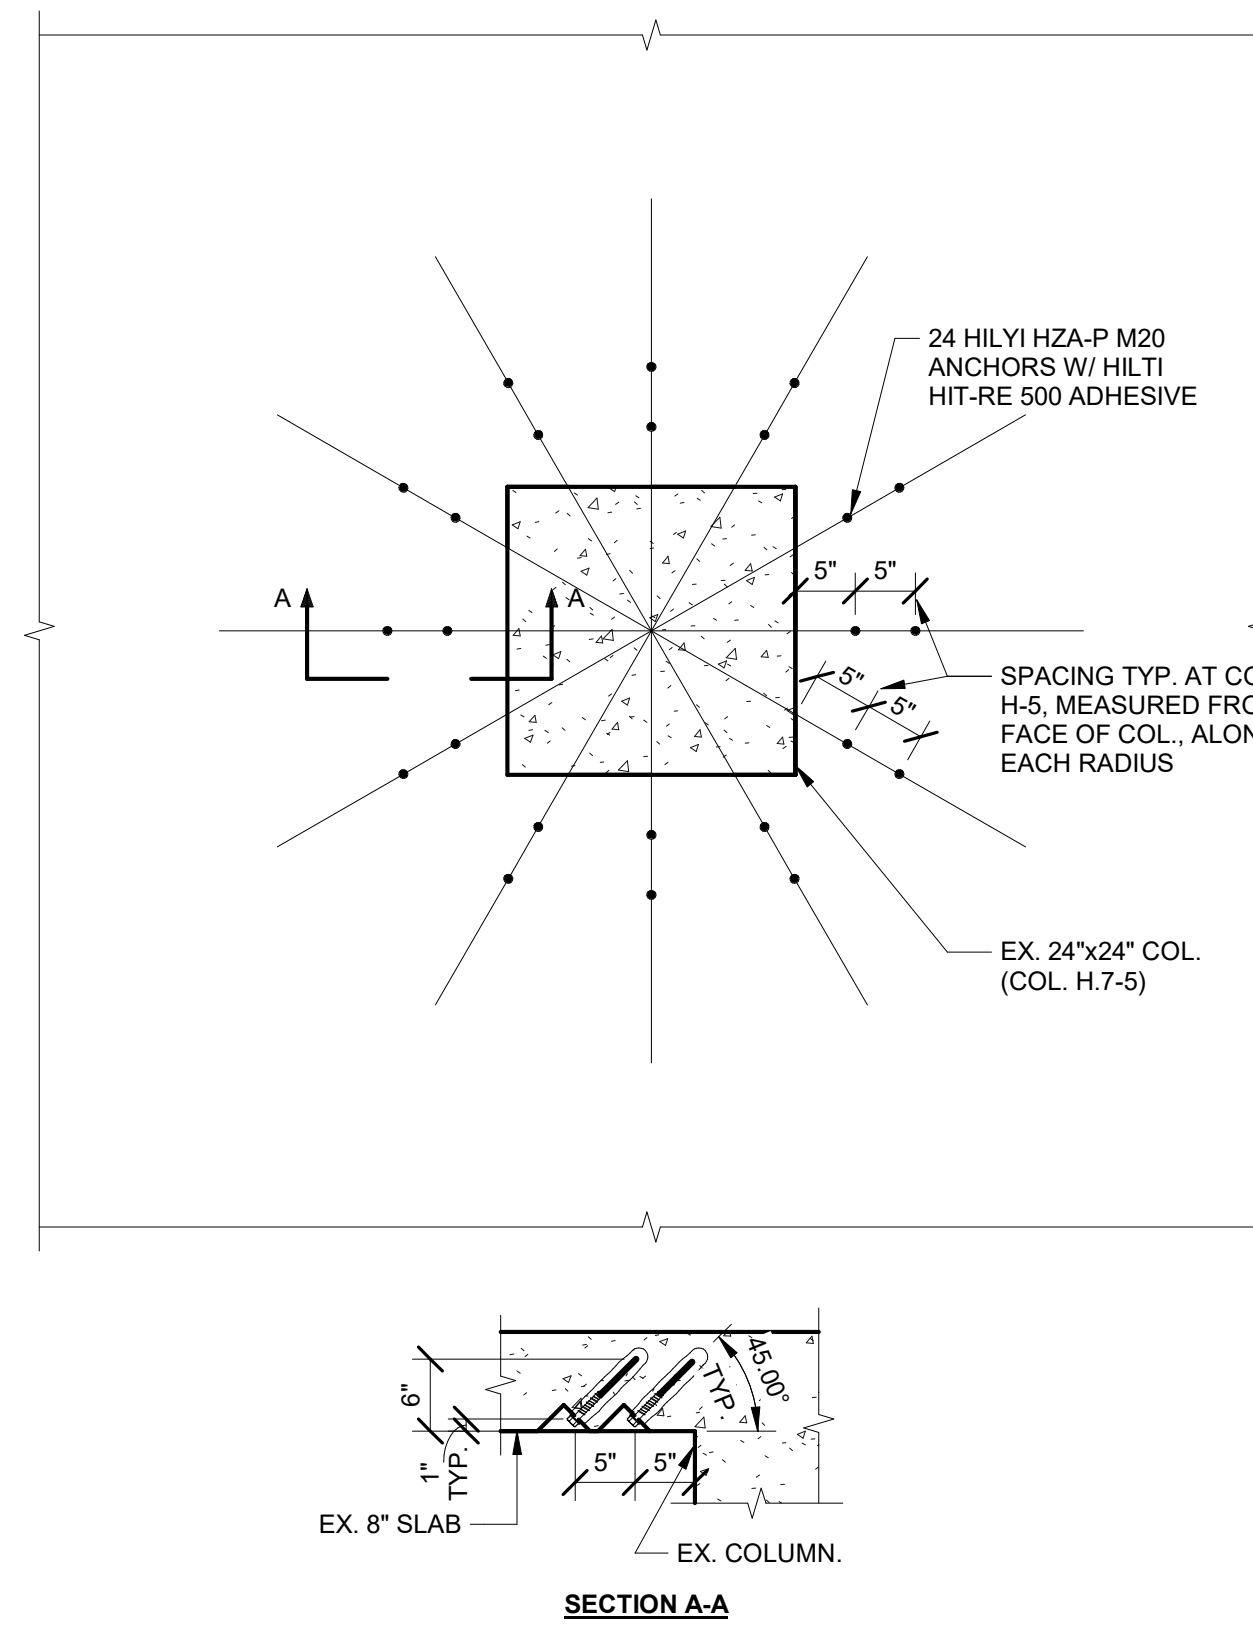

4 COLUMN PUNCHING STRENGTHING - OPTION 2
S400 SCALE: 3/4" = 1'-0"

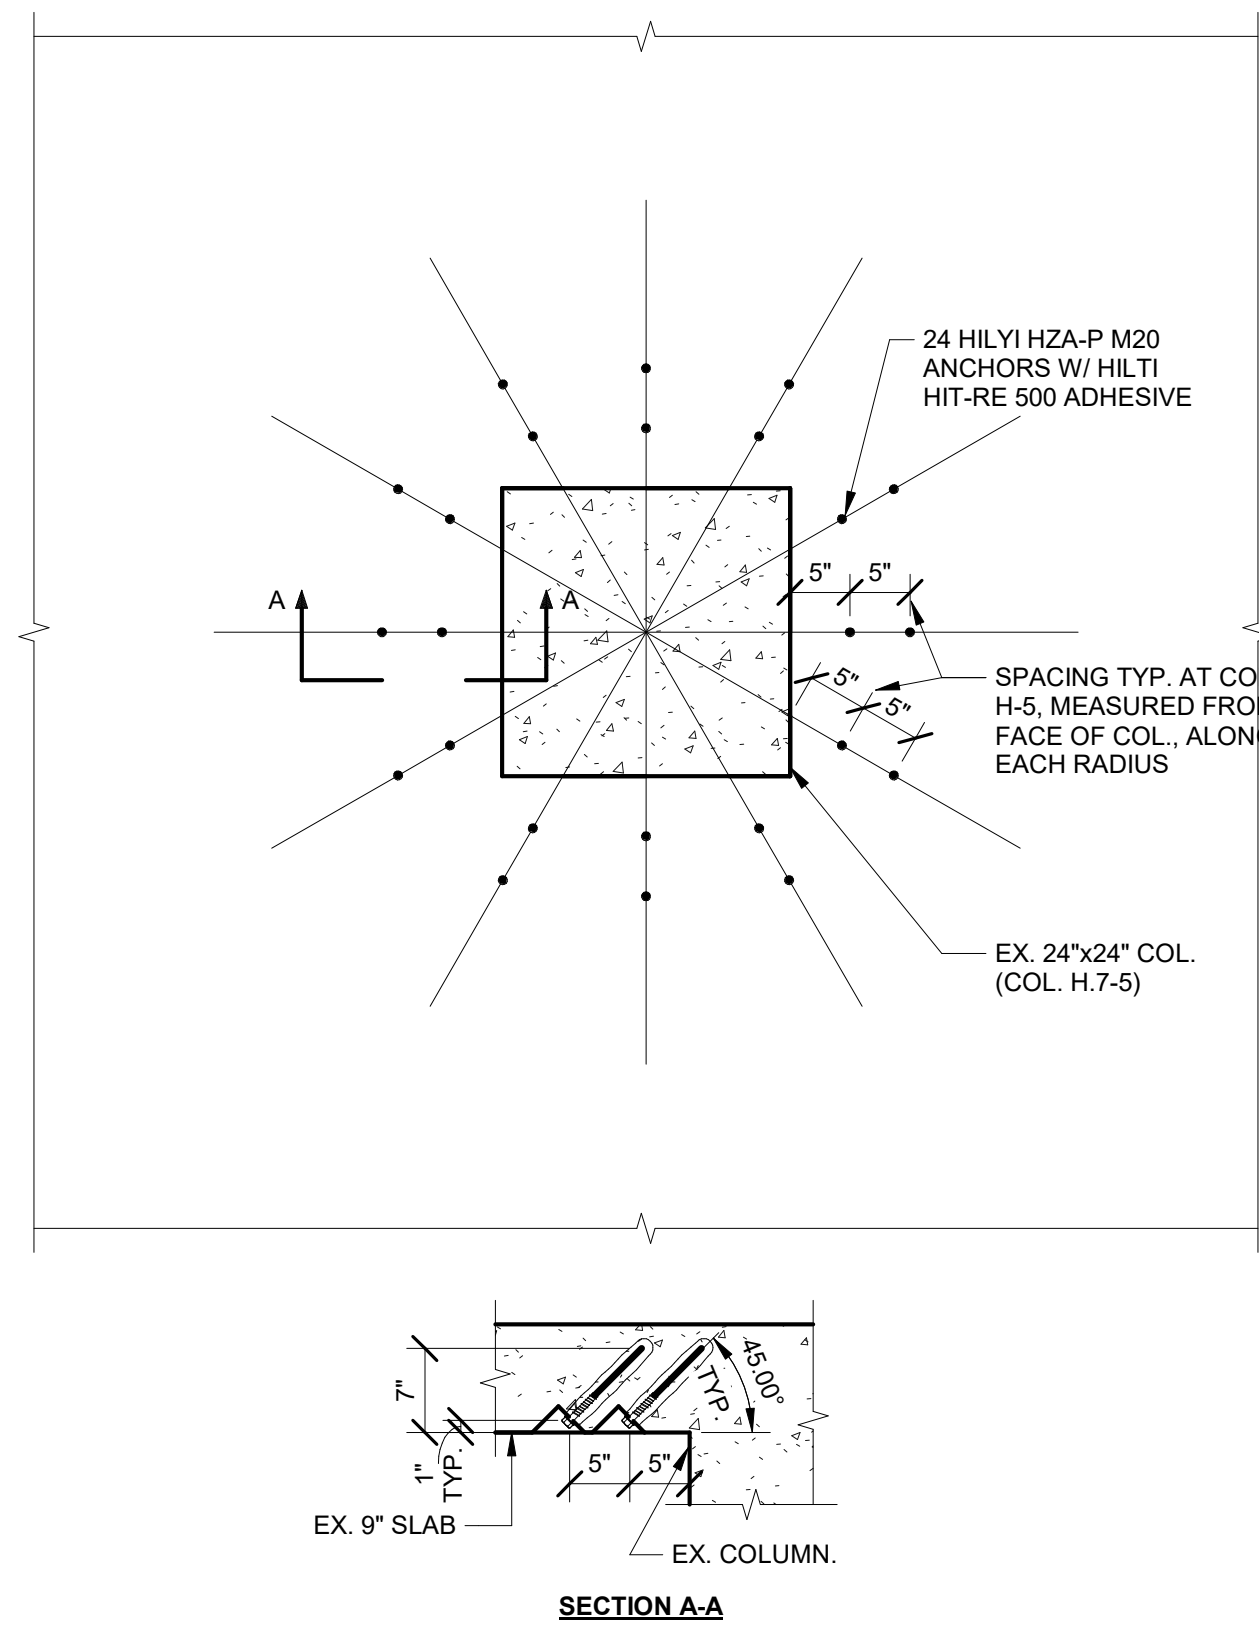

10 INTERIOR COLUMN DROP CAP
S400 SCALE: 3/4" = 1'-0"

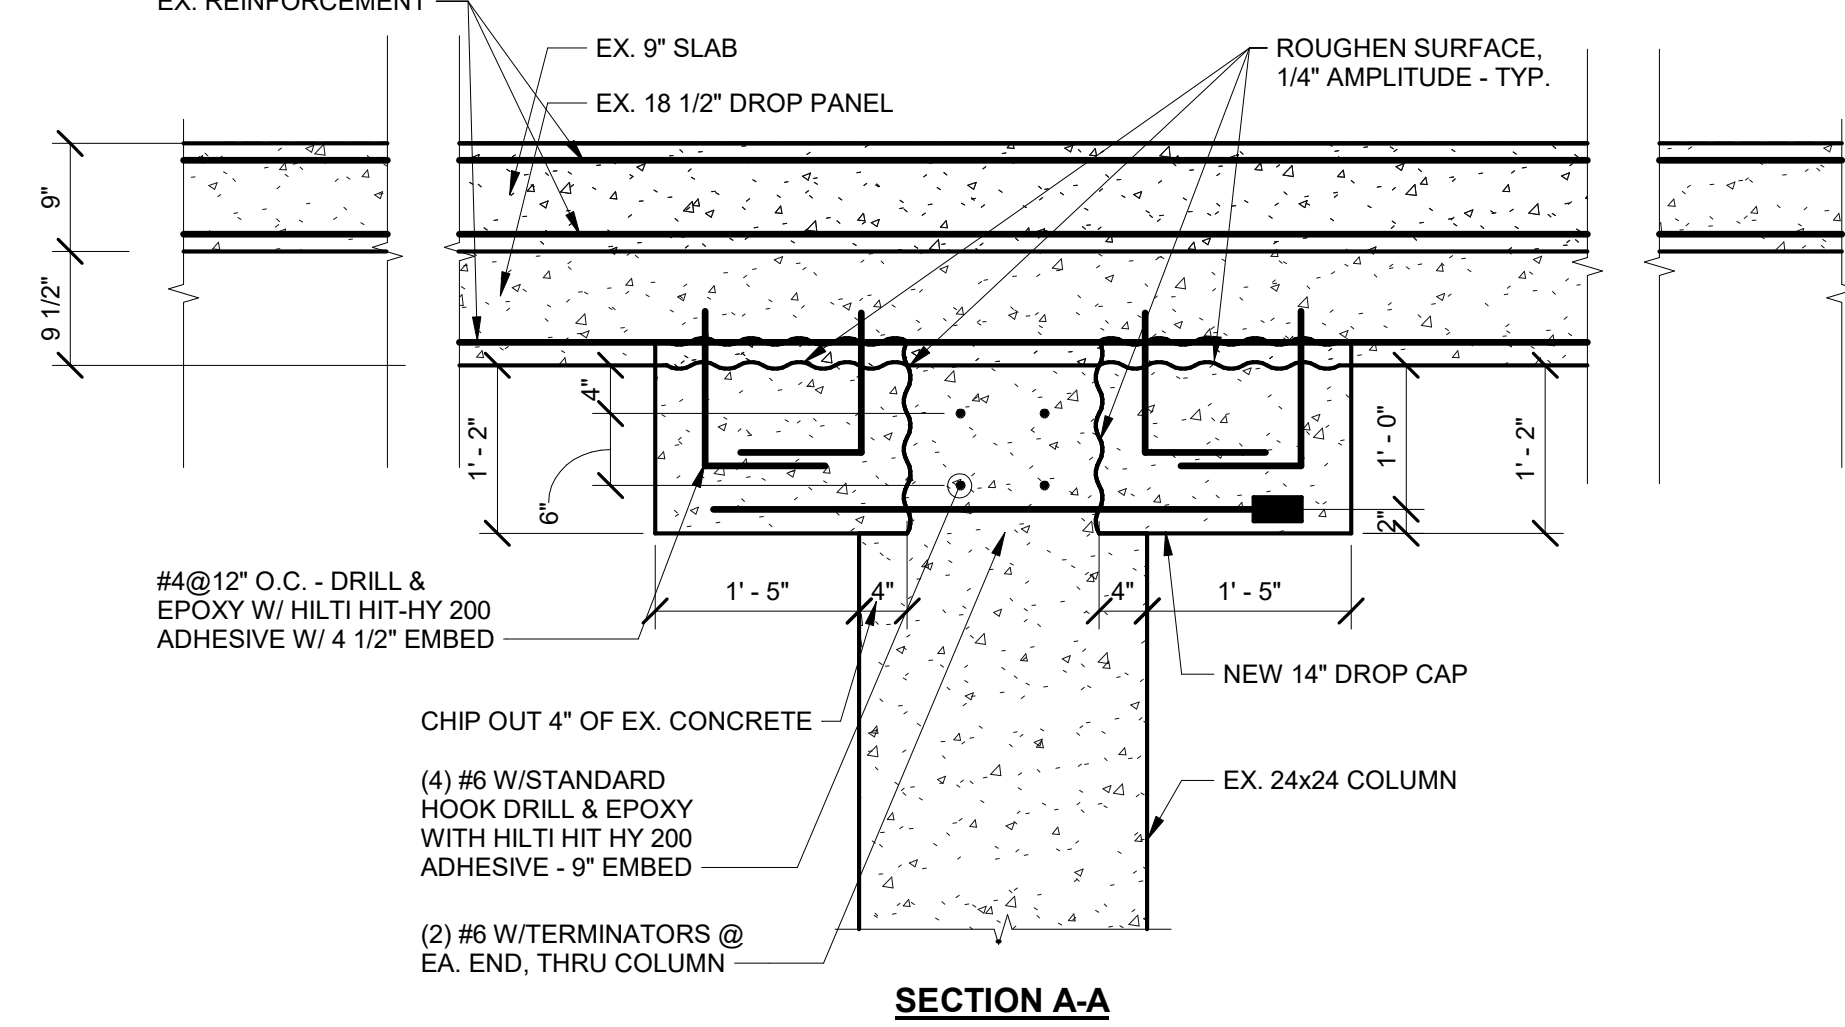


PROJECT NO.
24048

DRAWN BY
Author

SCALE
As Indicated

DRAWING TITLE
**CONCRETE
SECTIONS AND
DETAILS**

DRAWING NO.
S400

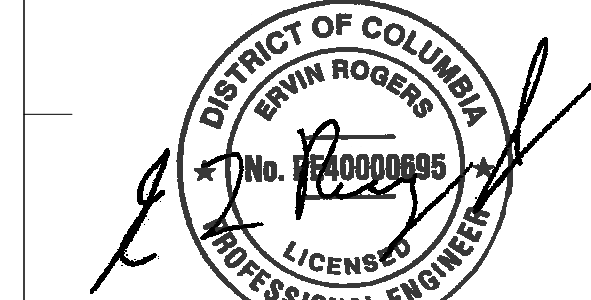

REVISIONS / NOTES		
#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% CD
3	08/28/2025	150% CD
4	11/21/2025	CAPPERMIT SET

ADDRESS
**1200 K St NW
Washington, DC 20005**

CLIENT NAME

PROJECT NAME
1200 K St NW

PROJECT DETAILS




CONSULTANTS

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com




D

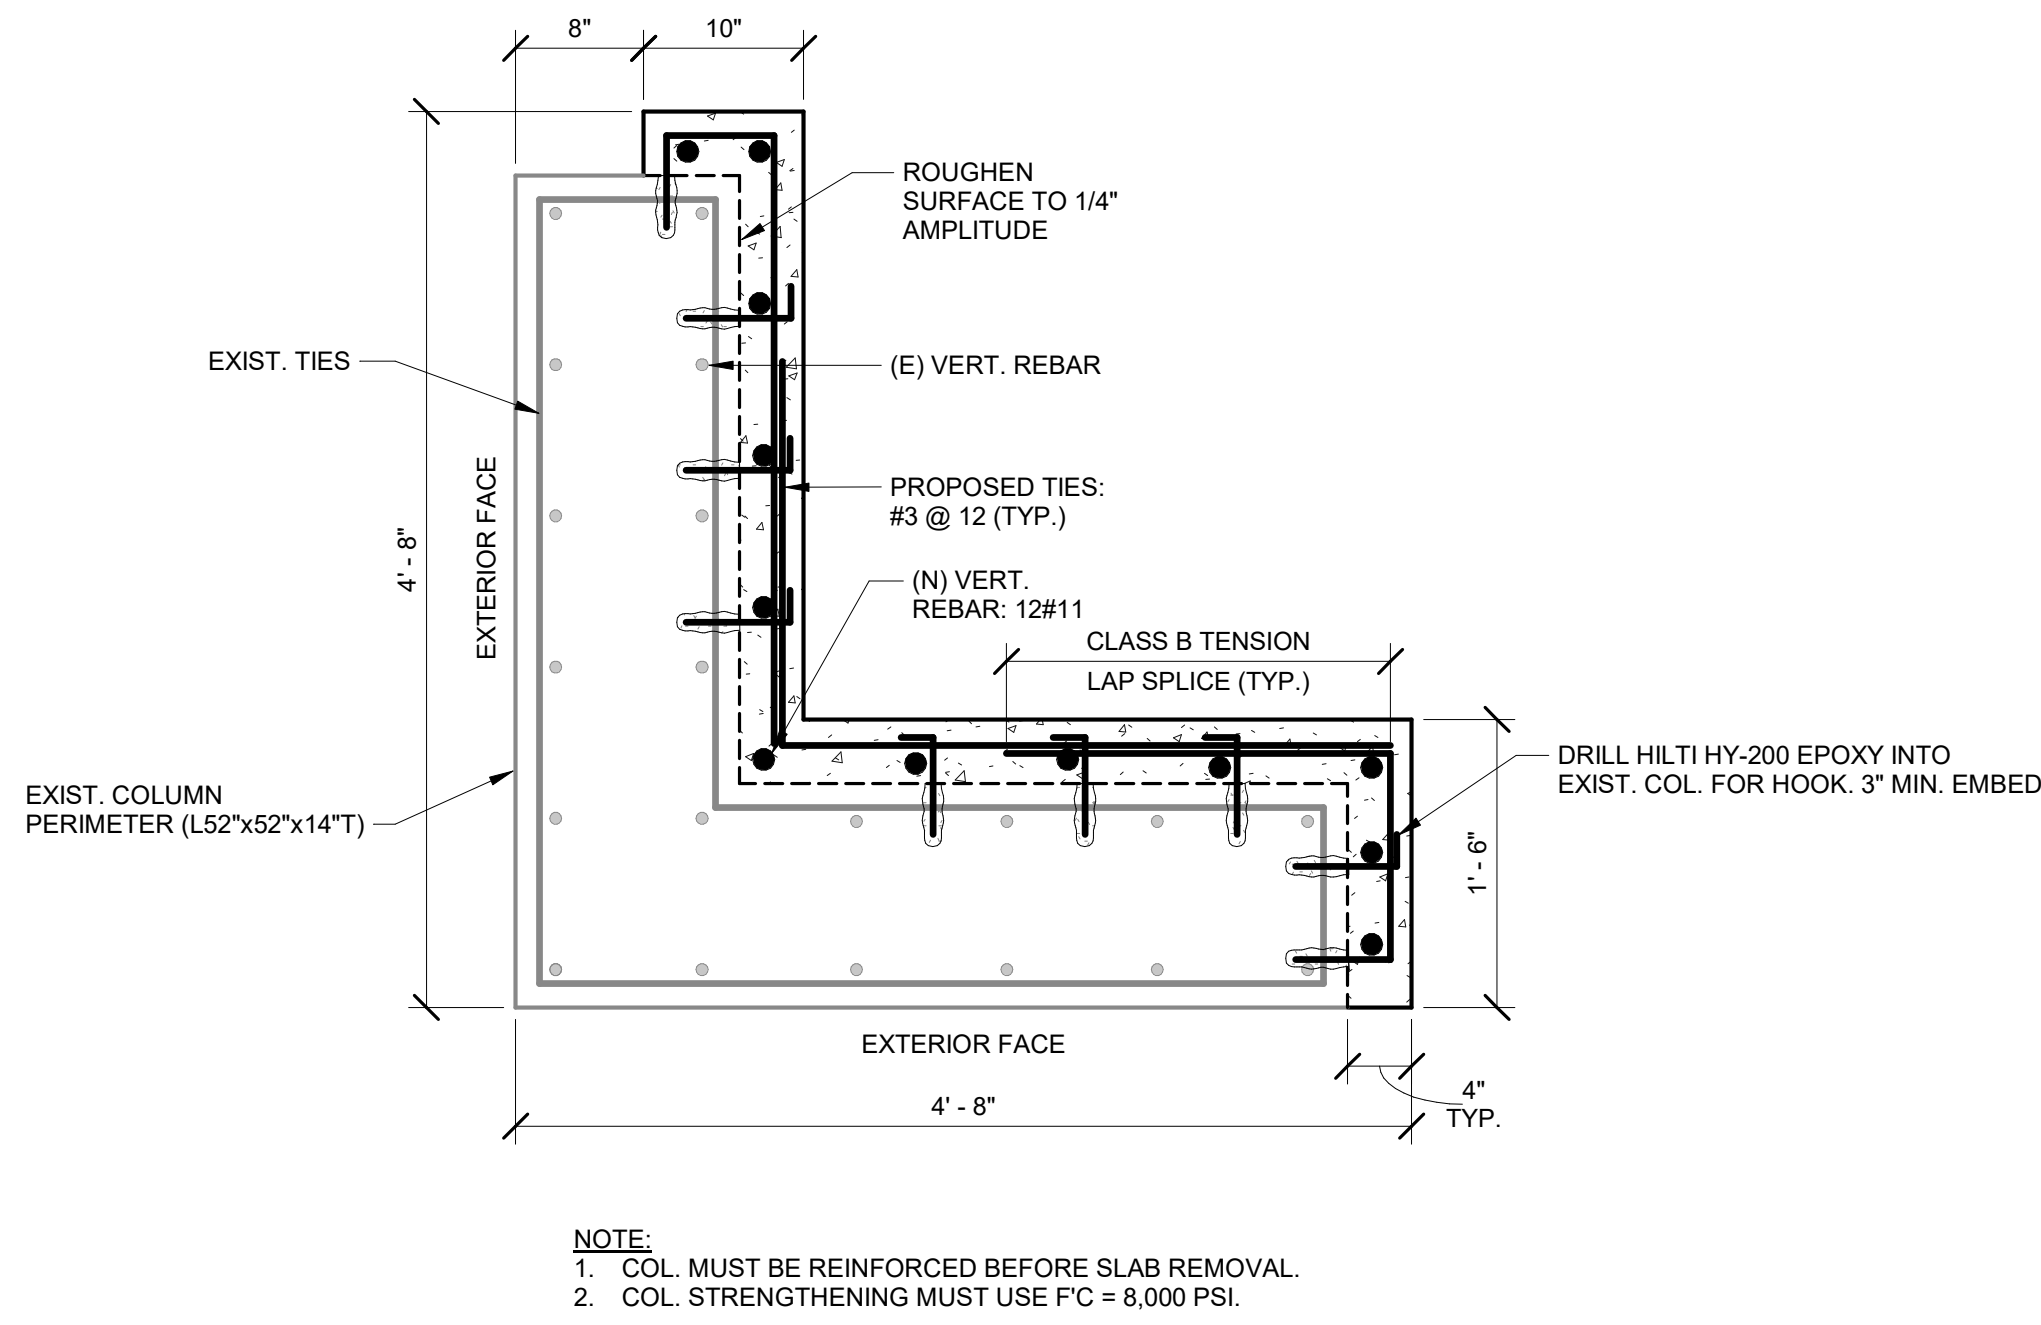

1 COL. STRENGTHENING - L56"x56"x18" (A-8 TOP)

S401 SCALE: 1" = 1'-0"


E

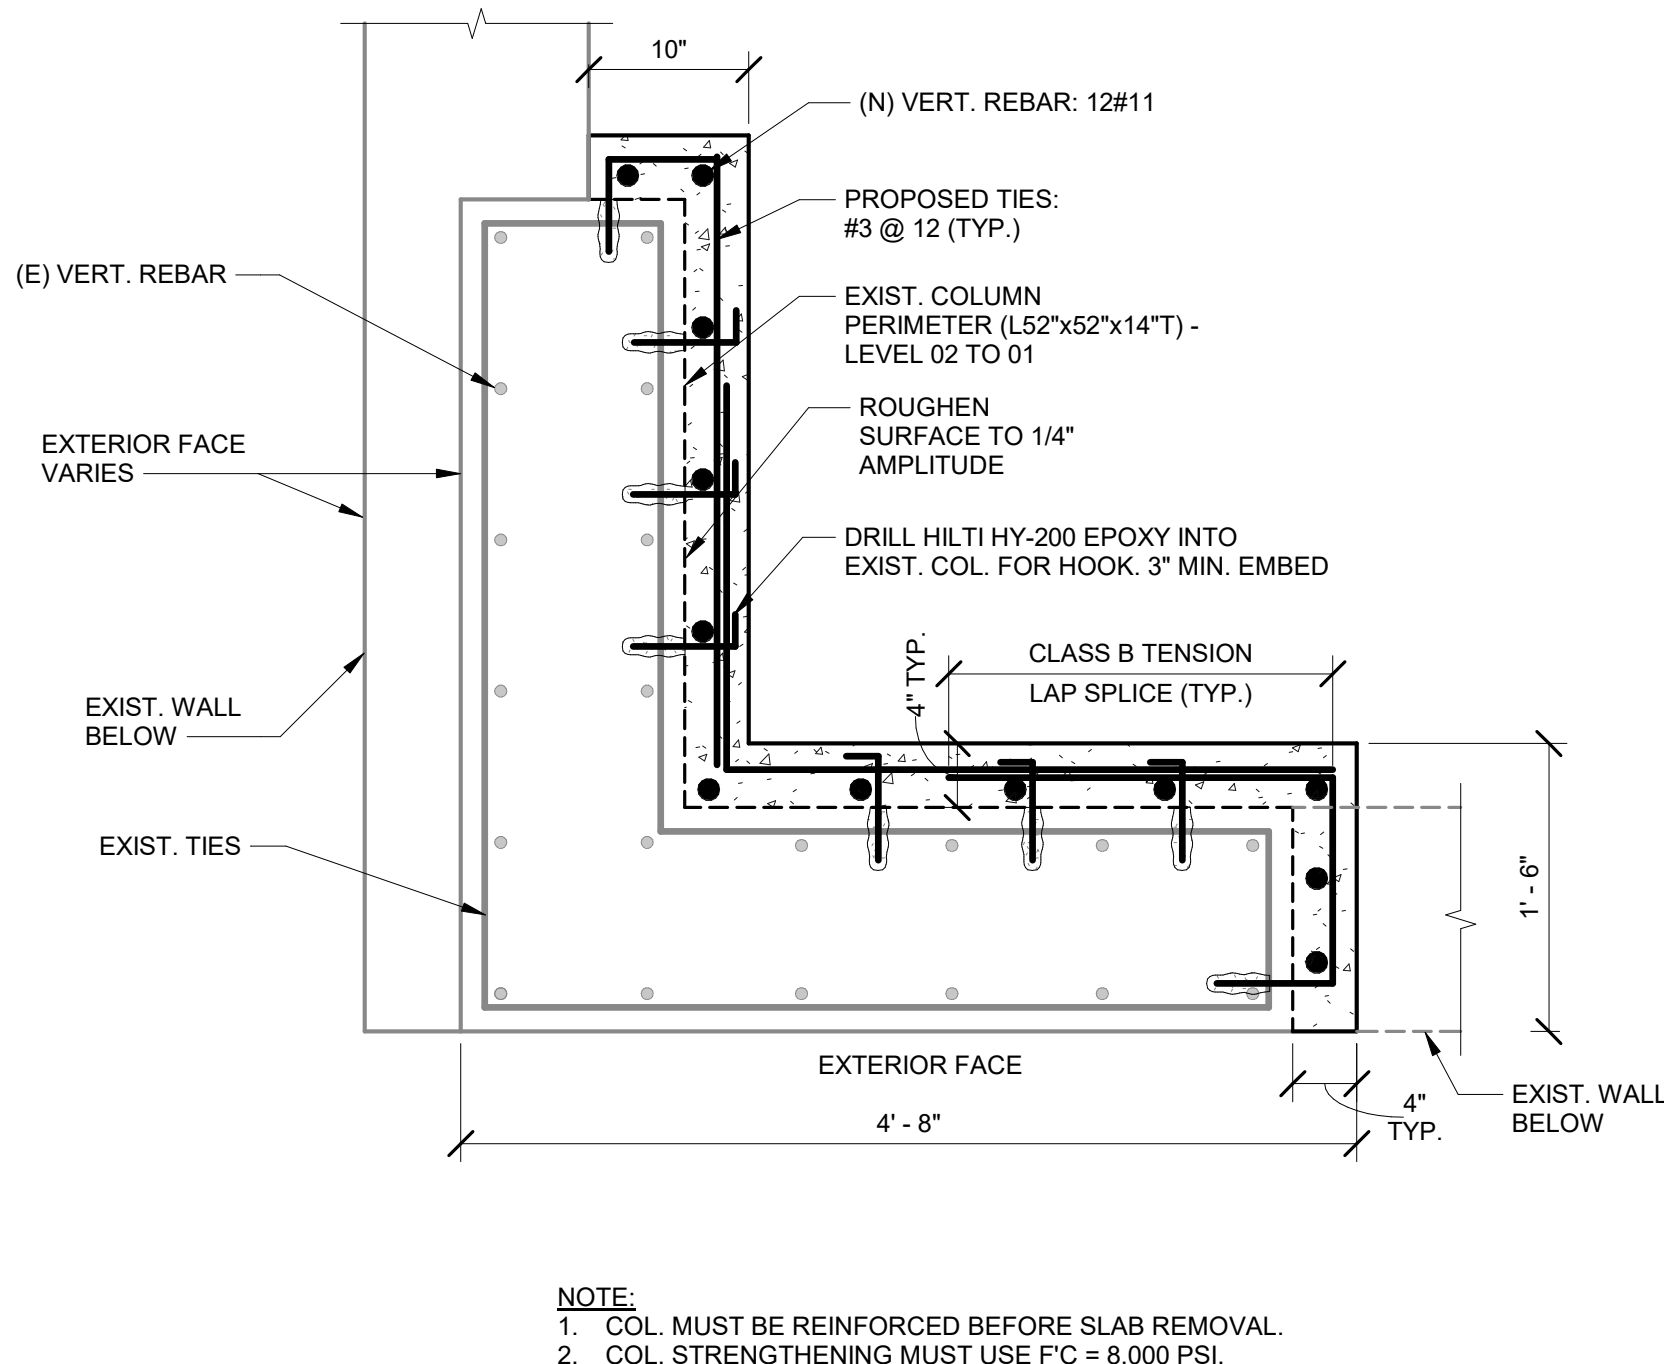

2 COL. STRENGTHENING - L56"x56"x18" (A-8 BOT.)

S401 SCALE: 1" = 1'-0"


2

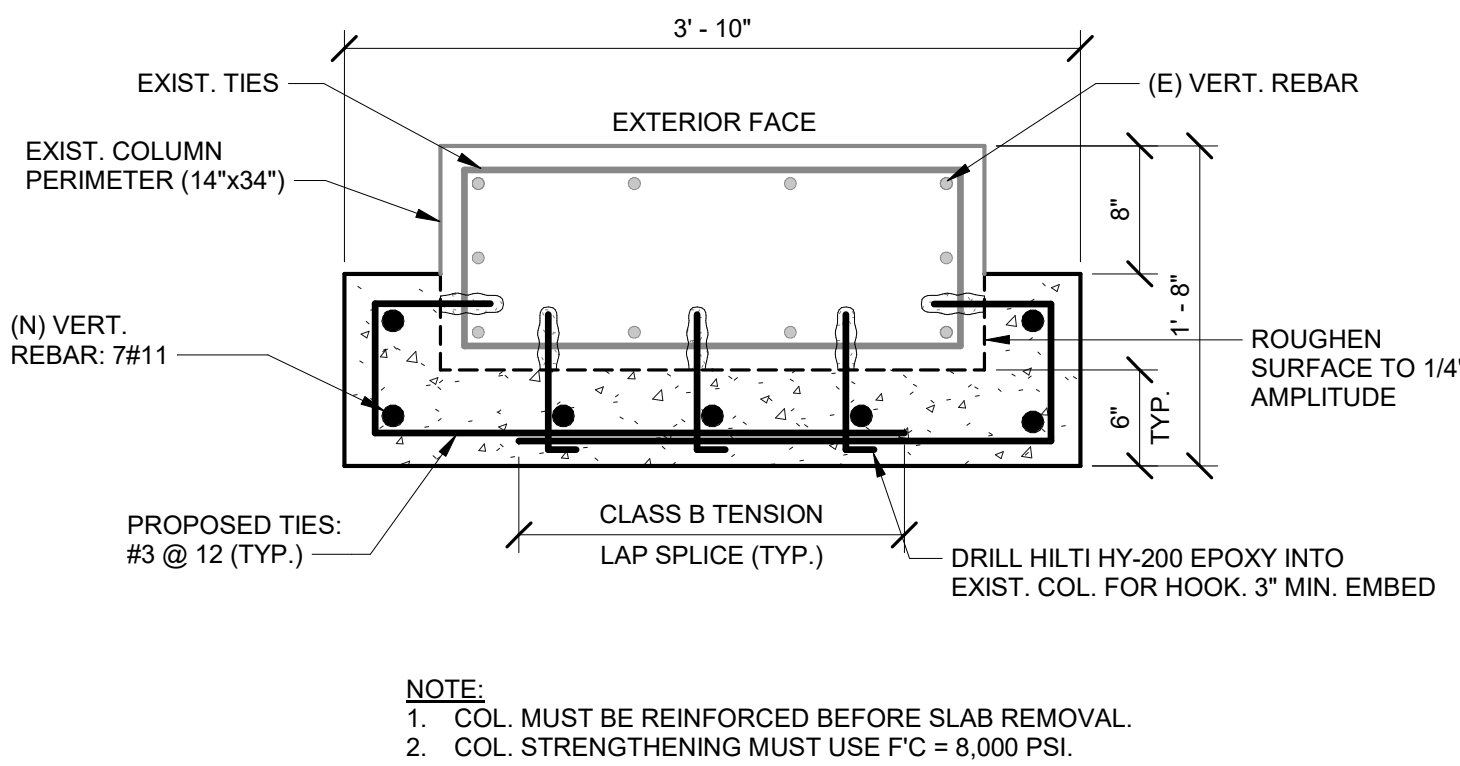

3 COL. STRENGTHENING - 14"x34"

S401 SCALE: 1" = 1'-0"


C

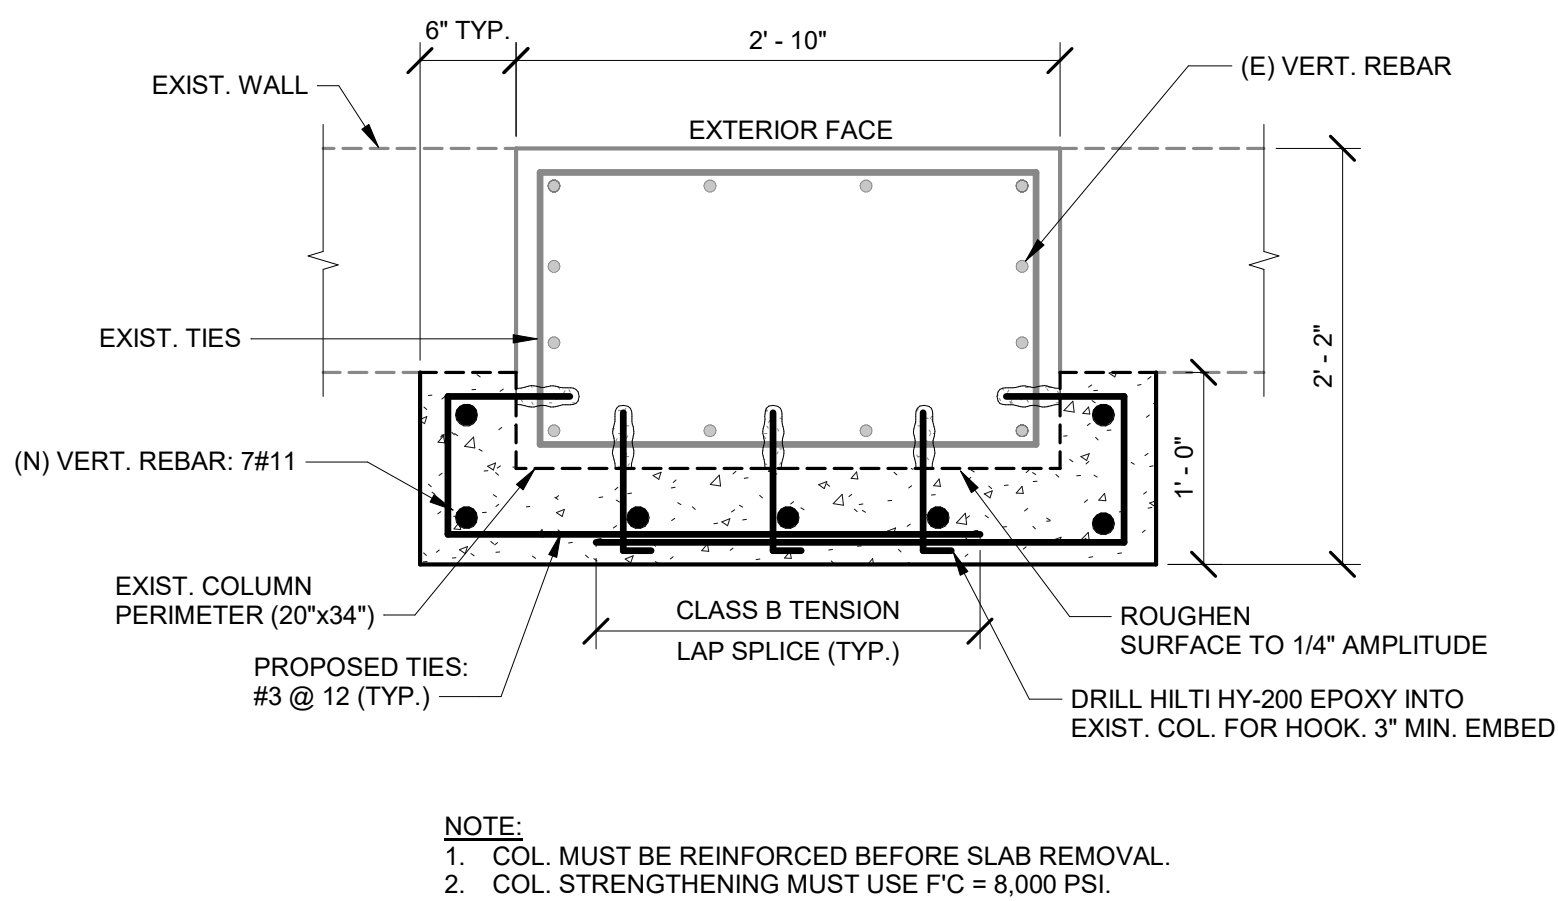

4 COL. STRENGTHENING - 20"x34"

S401 SCALE: 1" = 1'-0"


NOTE:
1. COL. MUST BE REINFORCED BEFORE SLAB REMOVAL.
2. COL. STRENGTHENING MUST USE F'C = 8,000 PSI.

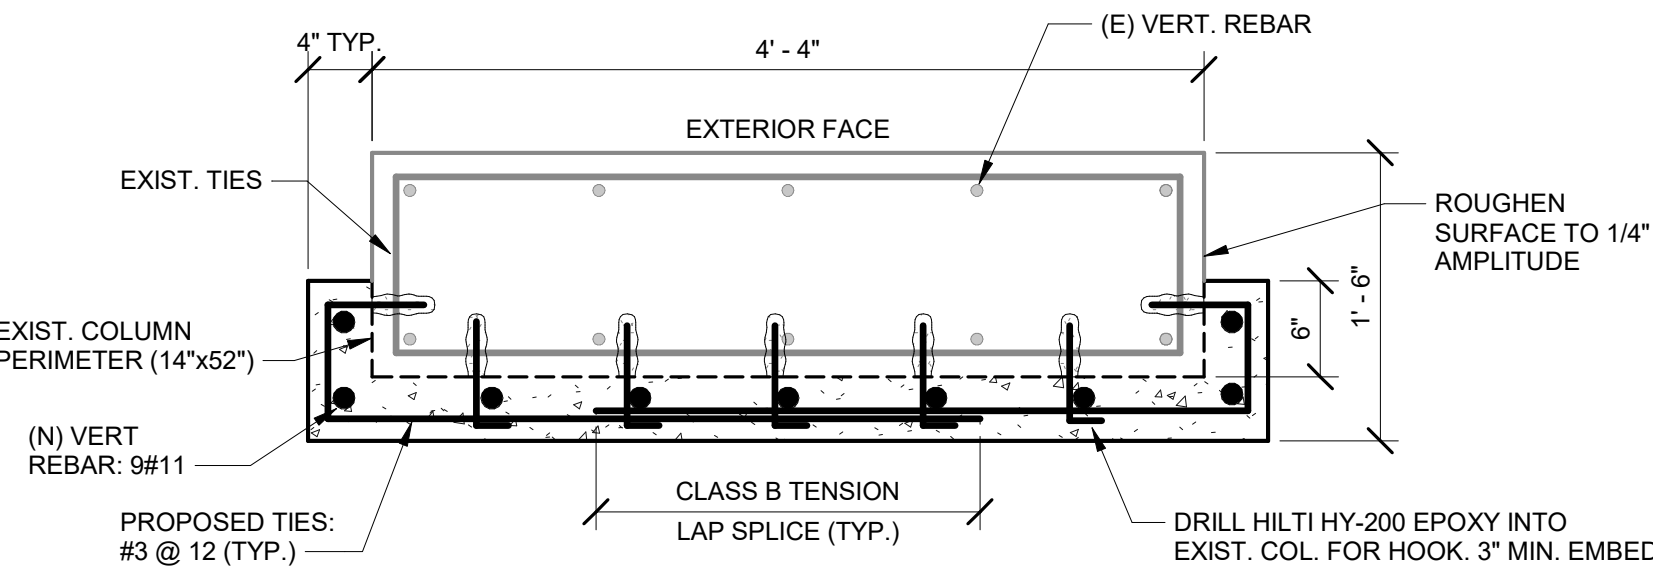

5 COL. STRENGTHENING - 24"x60" TOP

S401 SCALE: 1" = 1'-0"


NOTE:
1. COL. MUST BE REINFORCED BEFORE SLAB REMOVAL.
2. COL. STRENGTHENING MUST USE F'C = 8,000 PSI.

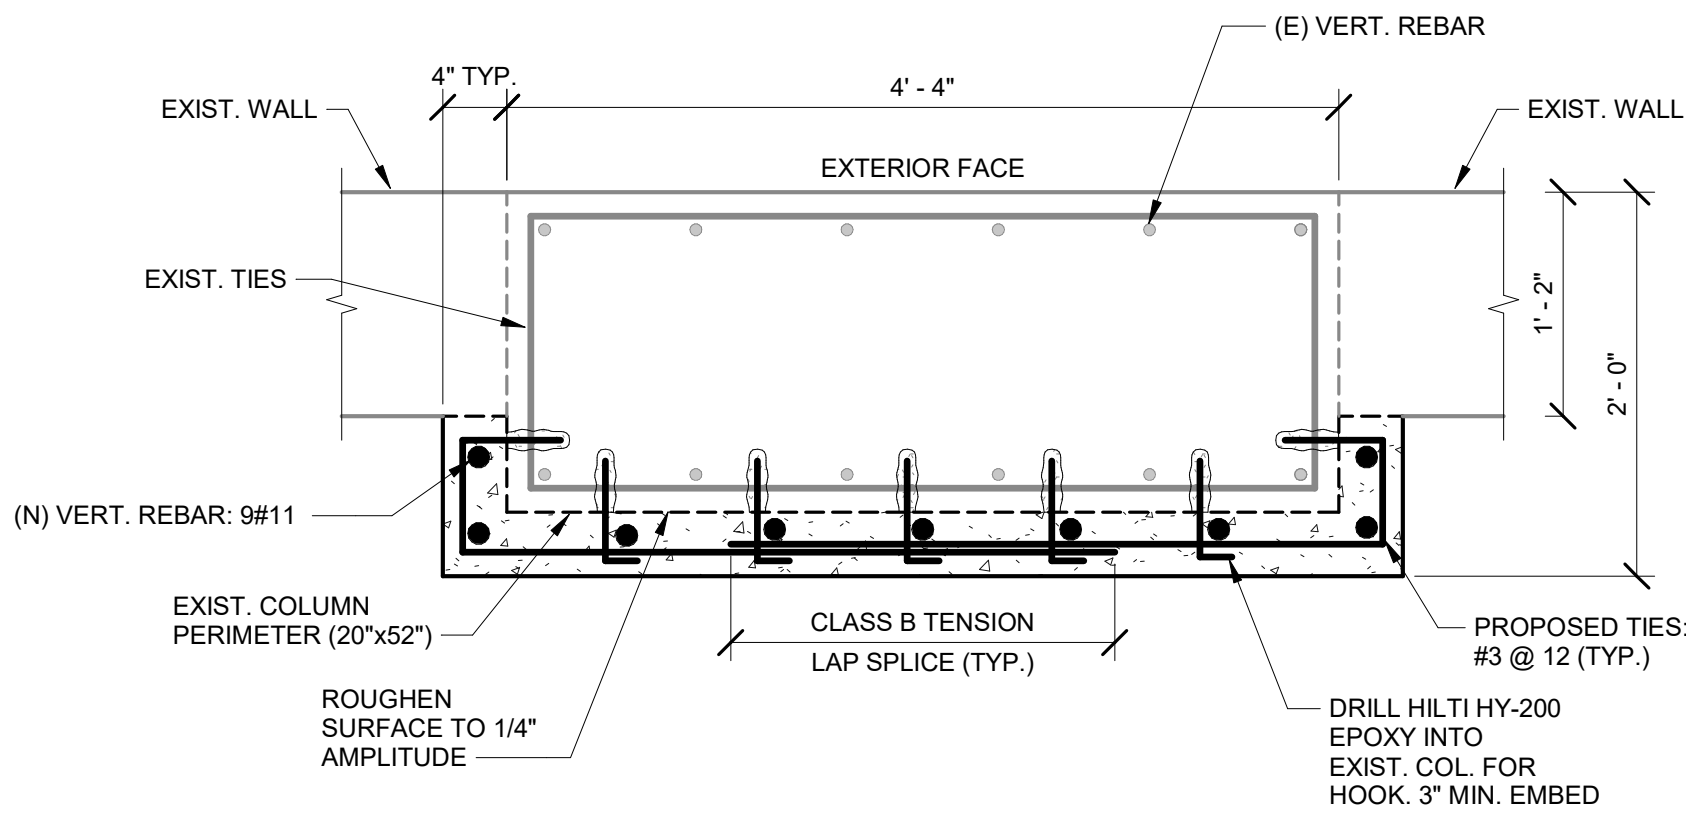

6 COL. STRENGTHENING - 24"x60" BOT.


S401 SCALE: 1" = 1'-0"

B

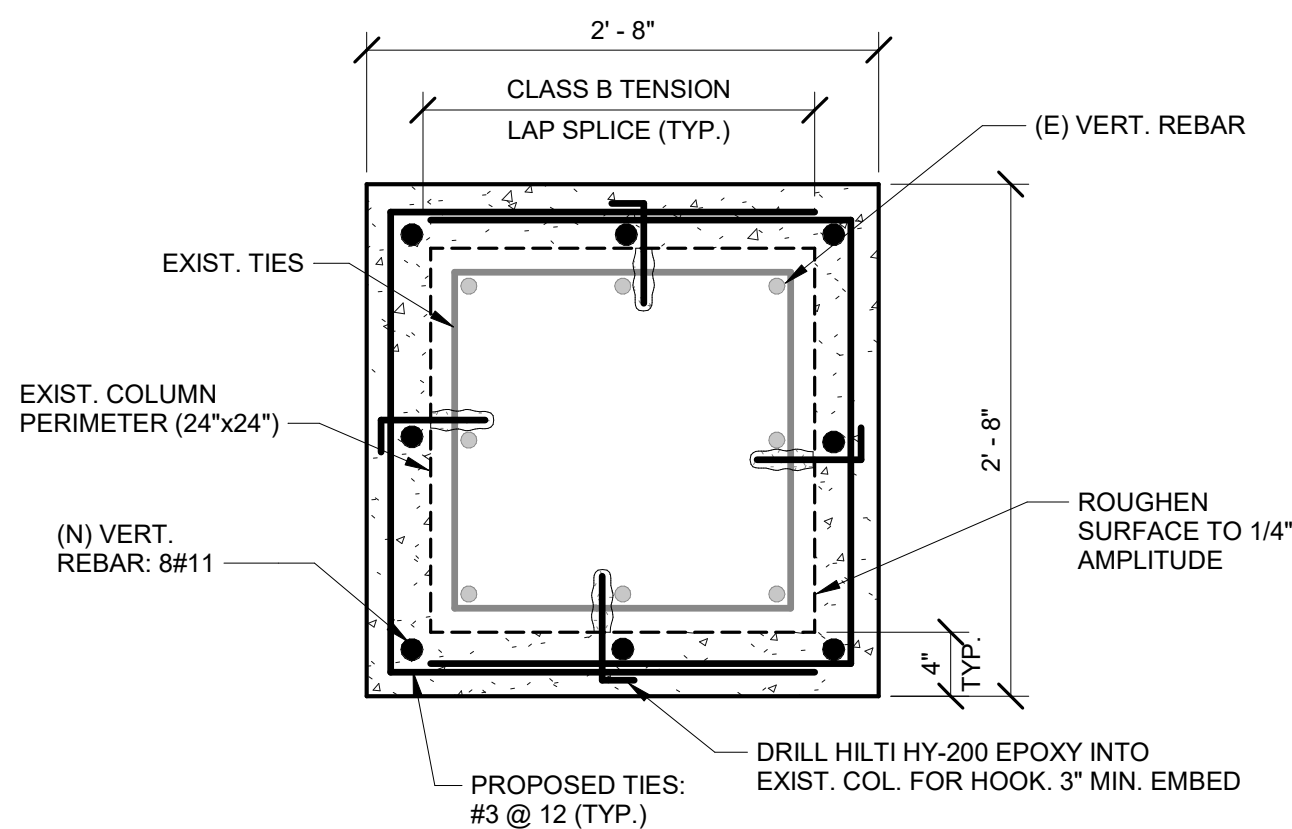

7 COL. STRENGTHENING - 32"x32"

S401 SCALE: 1" = 1'-0"

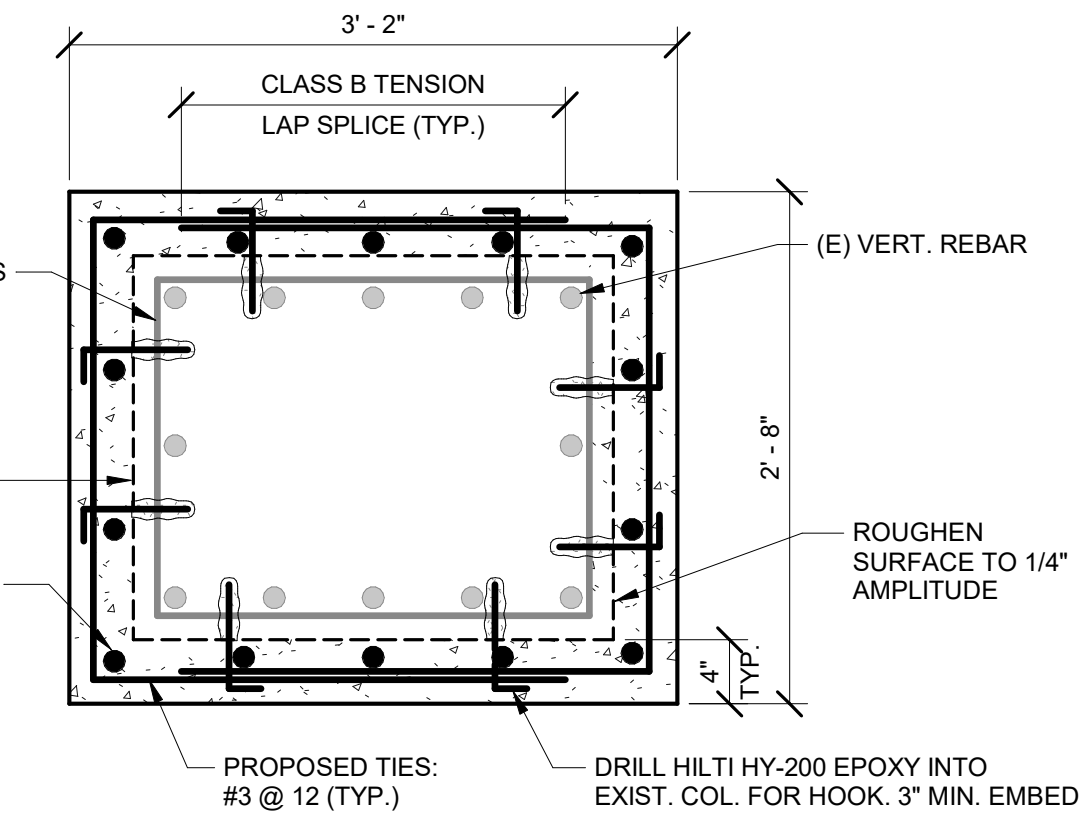


8 COL. STRENGTHENING - 32"x38"

S401 SCALE: 1" = 1'-0"

A

D

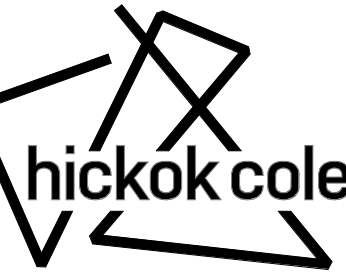

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



C

PROJECT NAME

1200 K St NW


CLIENT NAME

ADDRESS
1200 K St NW
Washington, DC 20005

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/29/2025	15% CD
4	11/21/2025	CAMP PERMIT SET

STAMP

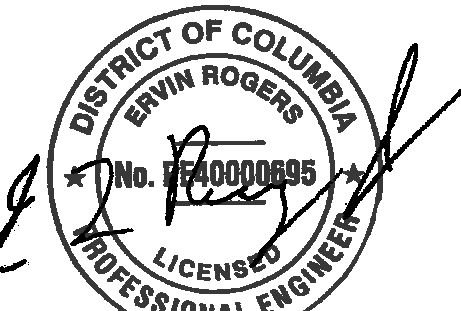

PROJECT NO.
24048

DRAWN BY
Author

SCALE
1" = 1'-0"

DRAWING TITLE
CONCRETE
SECTIONS AND
DETAILS

DRAWING NO.
S401

1/21/2025 4:04:21 PM

A

B


C

D

1 CONC. COL. ENLARGEMENT BEARING - GENERAL SECTION
S402 SCALE: 1" = 1'-0"

NOTE:


1. THE CONTRACTOR SHALL FIRST PERFORM THE ENLARGMENT OF ALL COLUMNS SHOWN ON THE DRAWINGS BEFORE REMOVING THE SECOND FLOOR SLAB. PROVIDE SHORING OF THE EDGE OF SLAB AROUND THE OPENING WHILE ENLARGING THE COLUMNS.

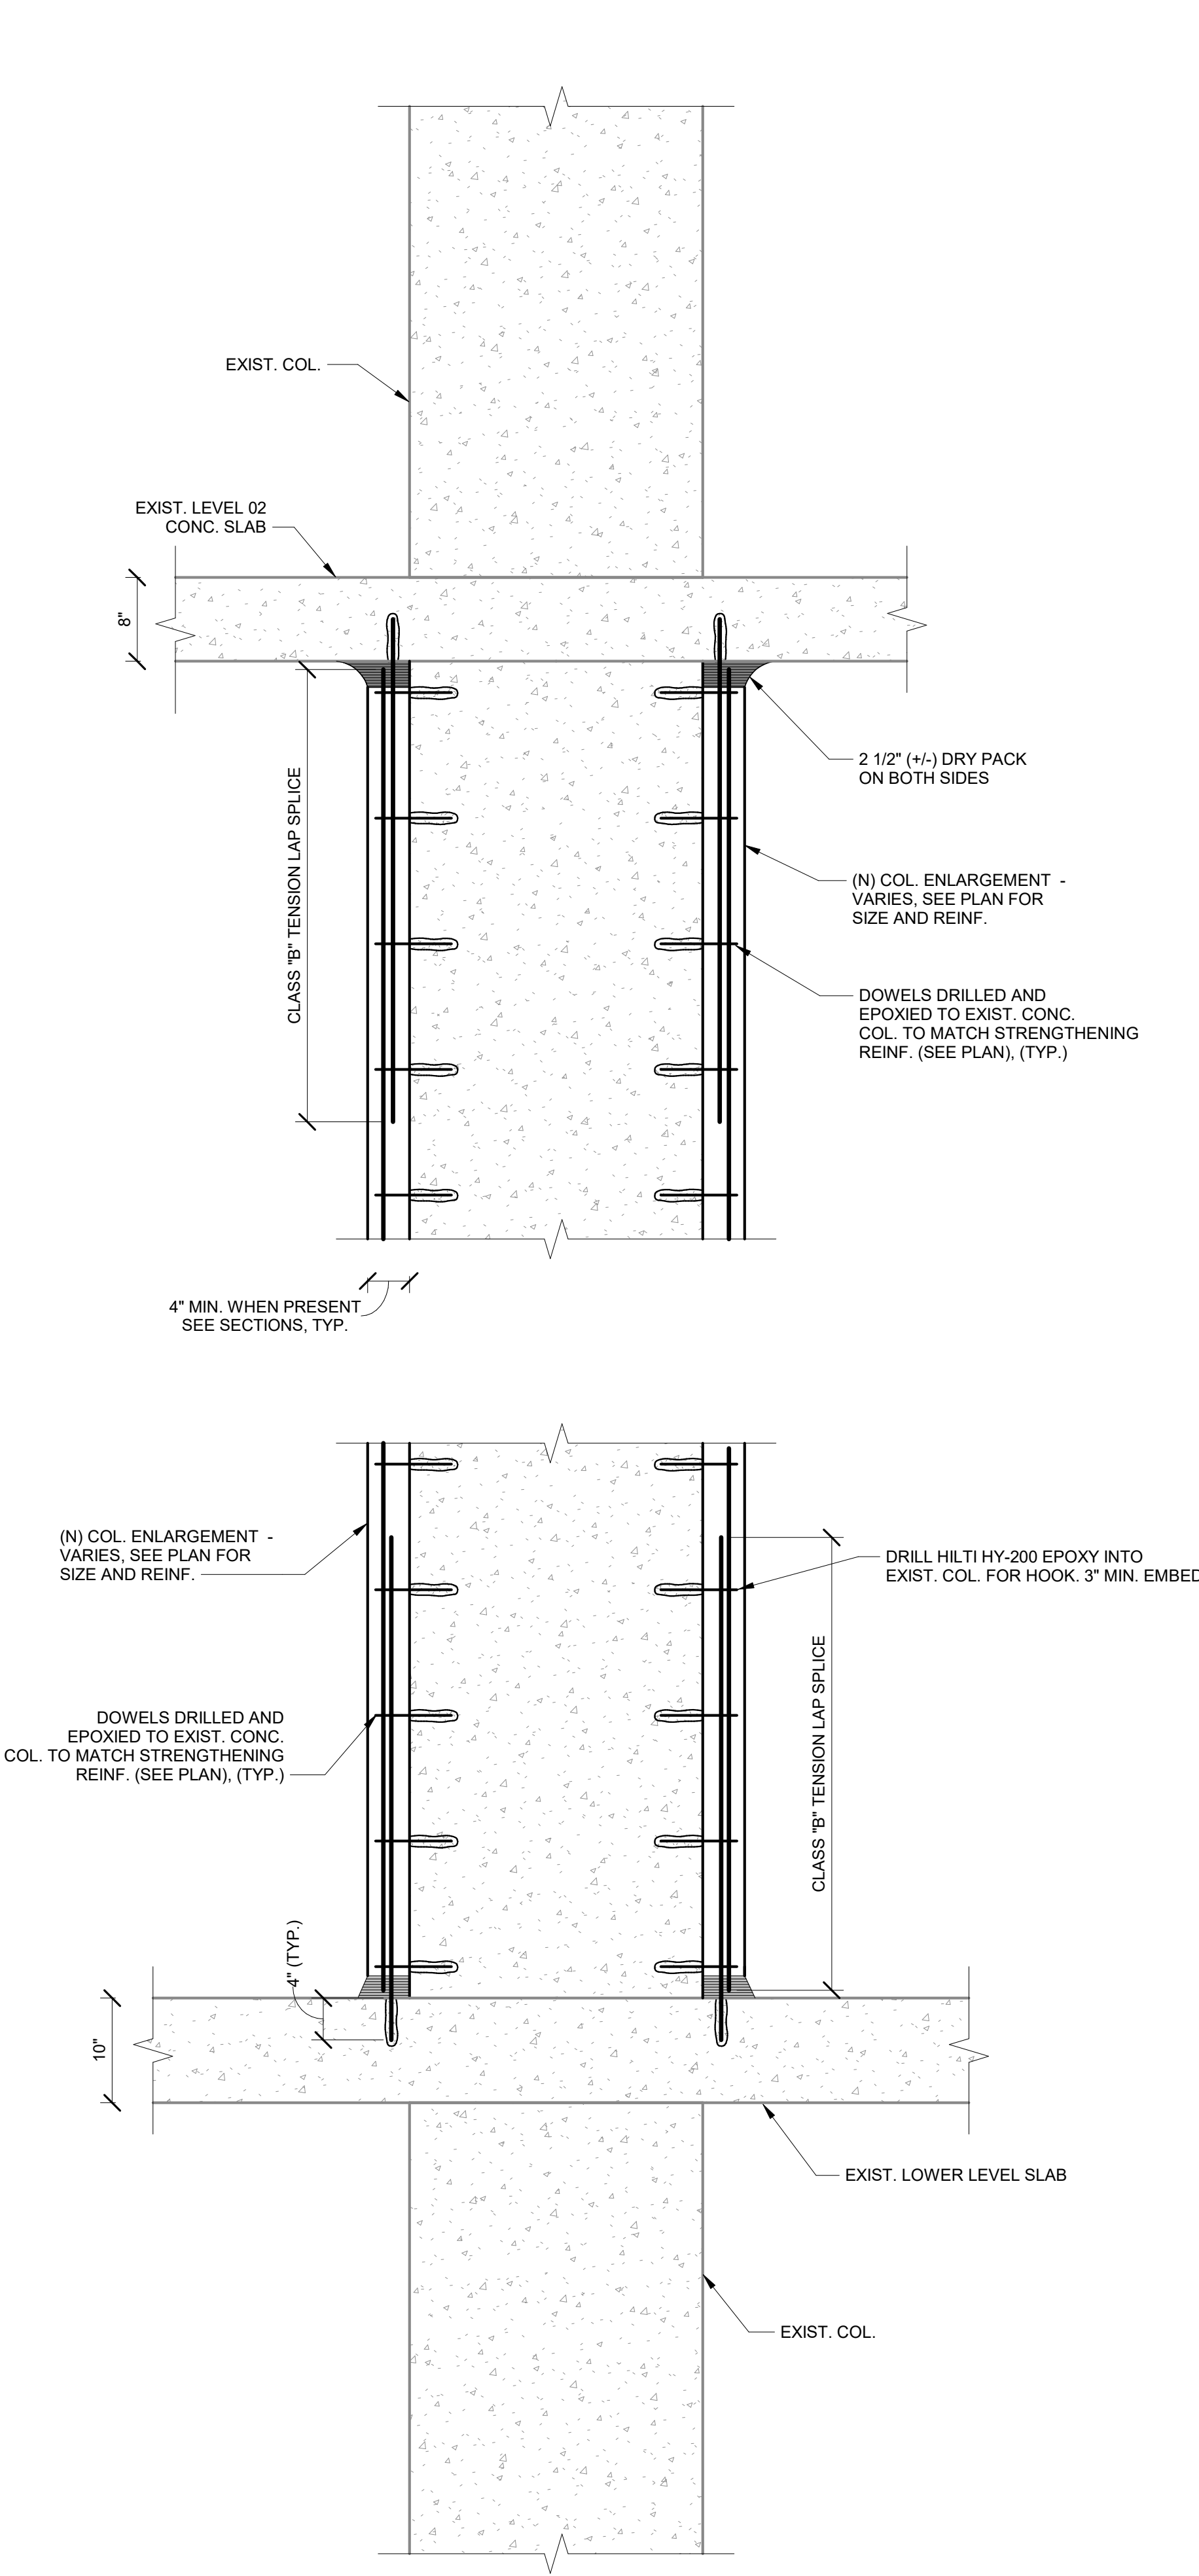

2 DISCONT. COL. ENLARGEMENT BEARING - GENERAL SECTION
S402 SCALE: 1" = 1'-0"

NOTE:

1. THE CONTRACTOR SHALL FIRST PERFORM THE ENLARGMENT OF ALL COLUMNS SHOWN ON THE DRAWINGS BEFORE REMOVING THE SECOND FLOOR SLAB. PROVIDE SHORING OF THE EDGE OF SLAB AROUND THE OPENING WHILE ENLARGING THE COLUMNS.

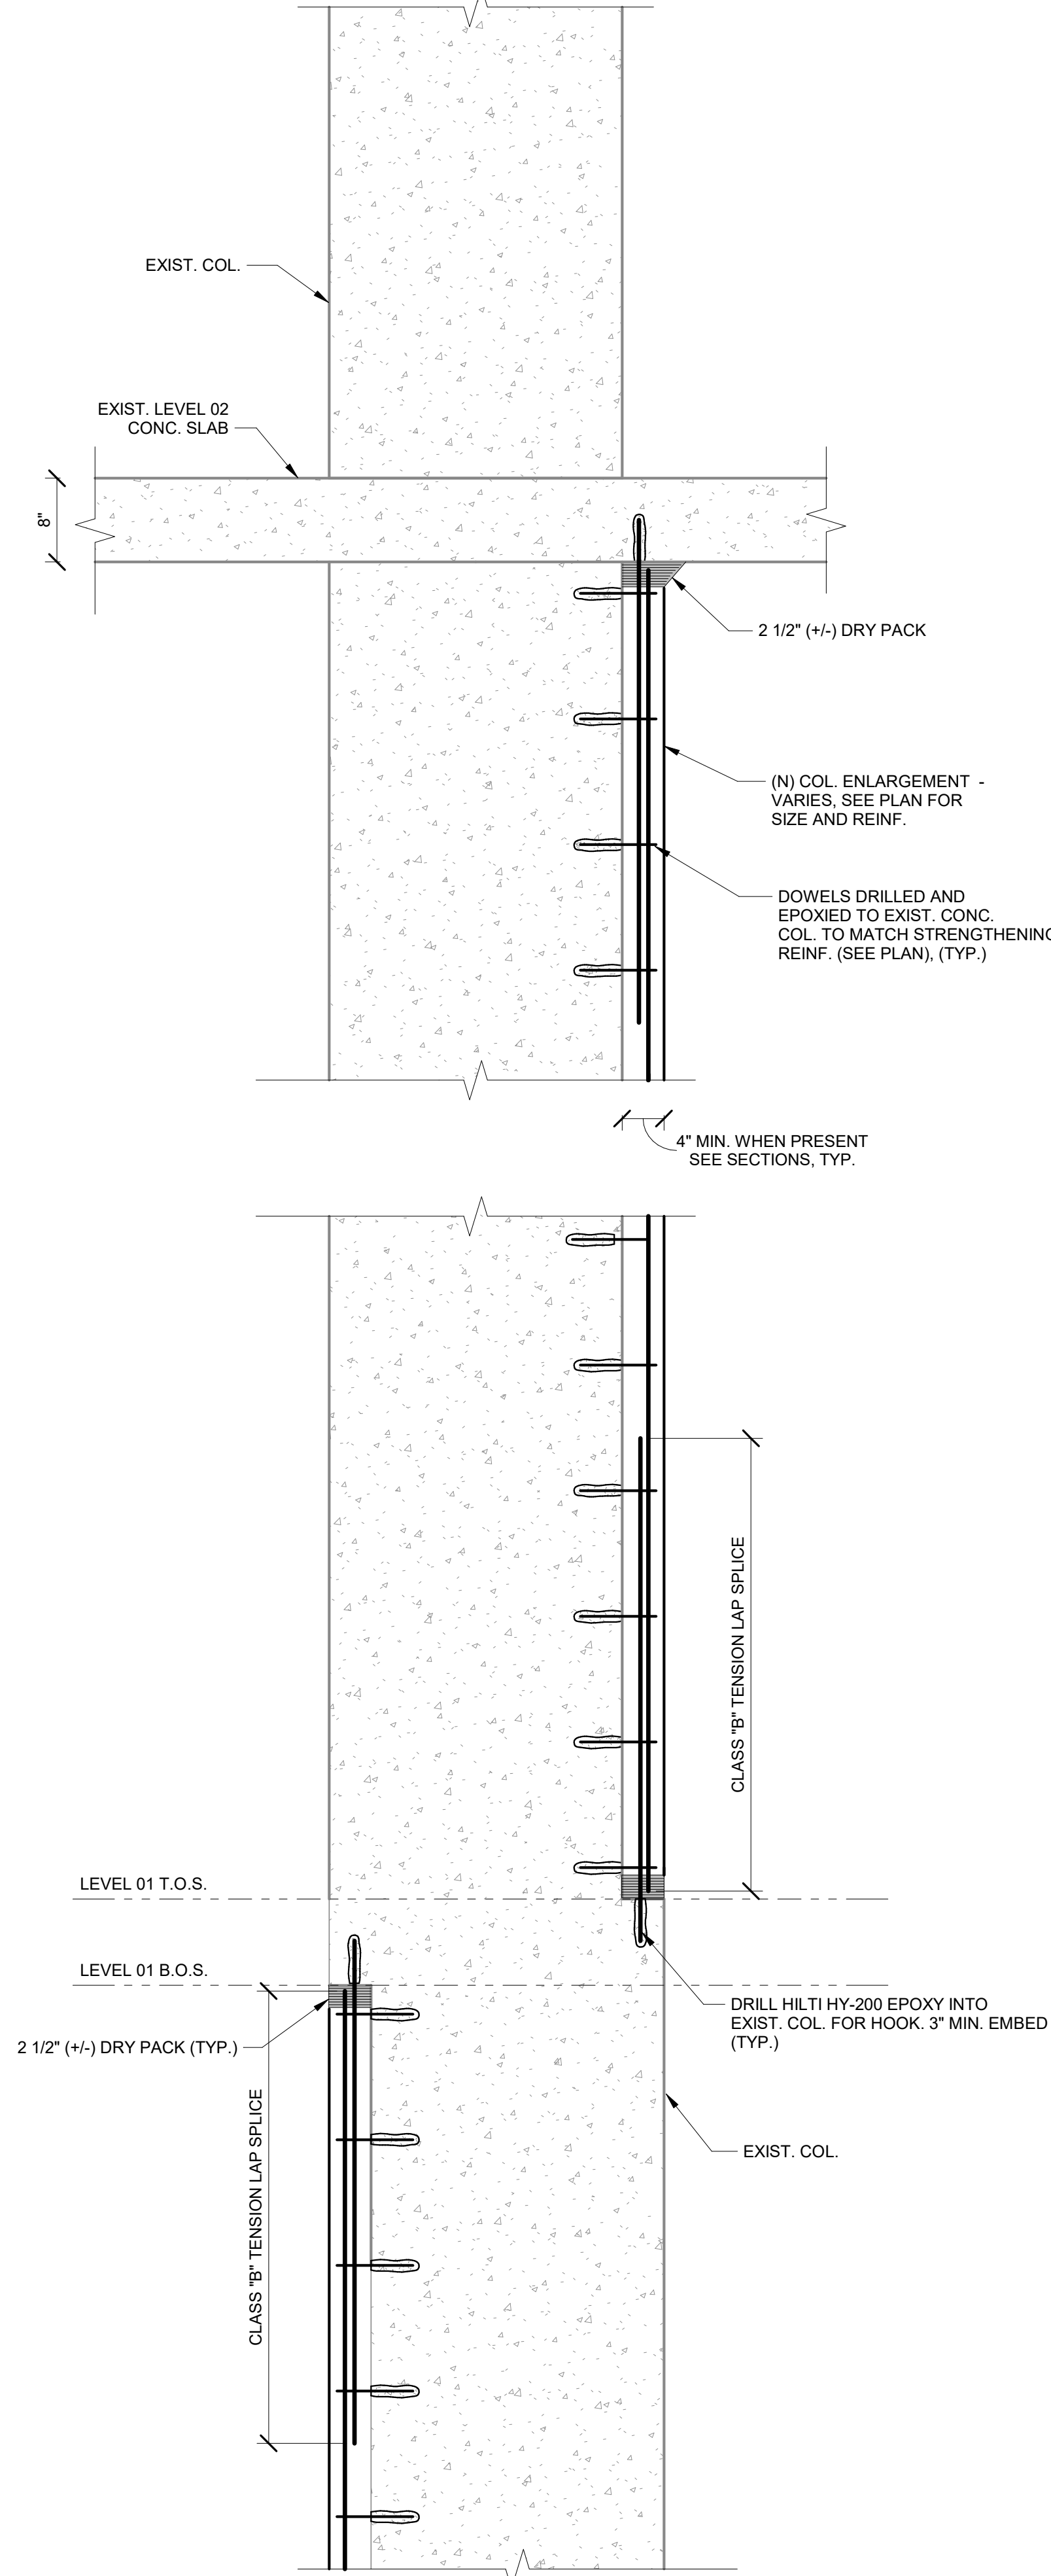

© 2025 Hickok Cole Architects, Inc.


DRAWING NO.
S402

DRAWING TITLE
**CONCRETE
SECTIONS AND
DETAILS**

SCALE
1" = 1'-0"

DRAWN BY
Author

PROJECT NO.
24048

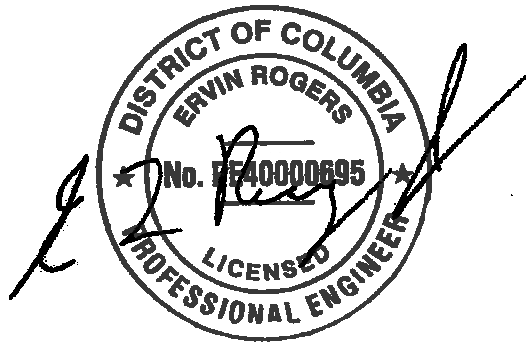

STAMP

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	60% PERMIT SET

ADDRESS
**1200 K St NW
Washington, DC 20005**

CLIENT NAME

PROJECT NAME
1200 K St NW


PROJECT DETAILS

CONSULTANTS



Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com




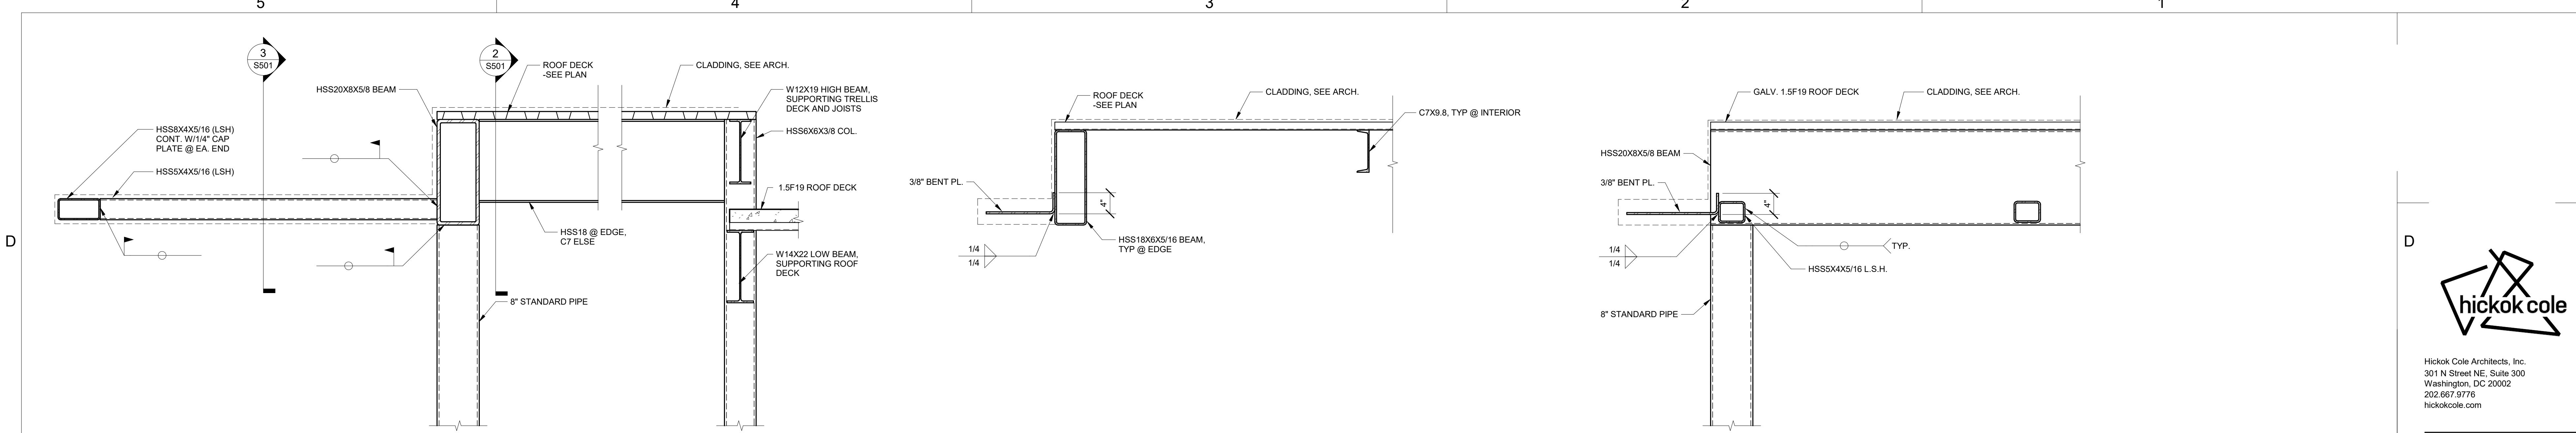

1 NORTH TRELLIS SECTION
S501 SCALE: 1" = 1'-0"


2 NORTH TRELLIS SECTION
S501 SCALE: 1" = 1'-0"

3 NORTH TRELLIS SECTION
S501 SCALE: 1" = 1'-0"

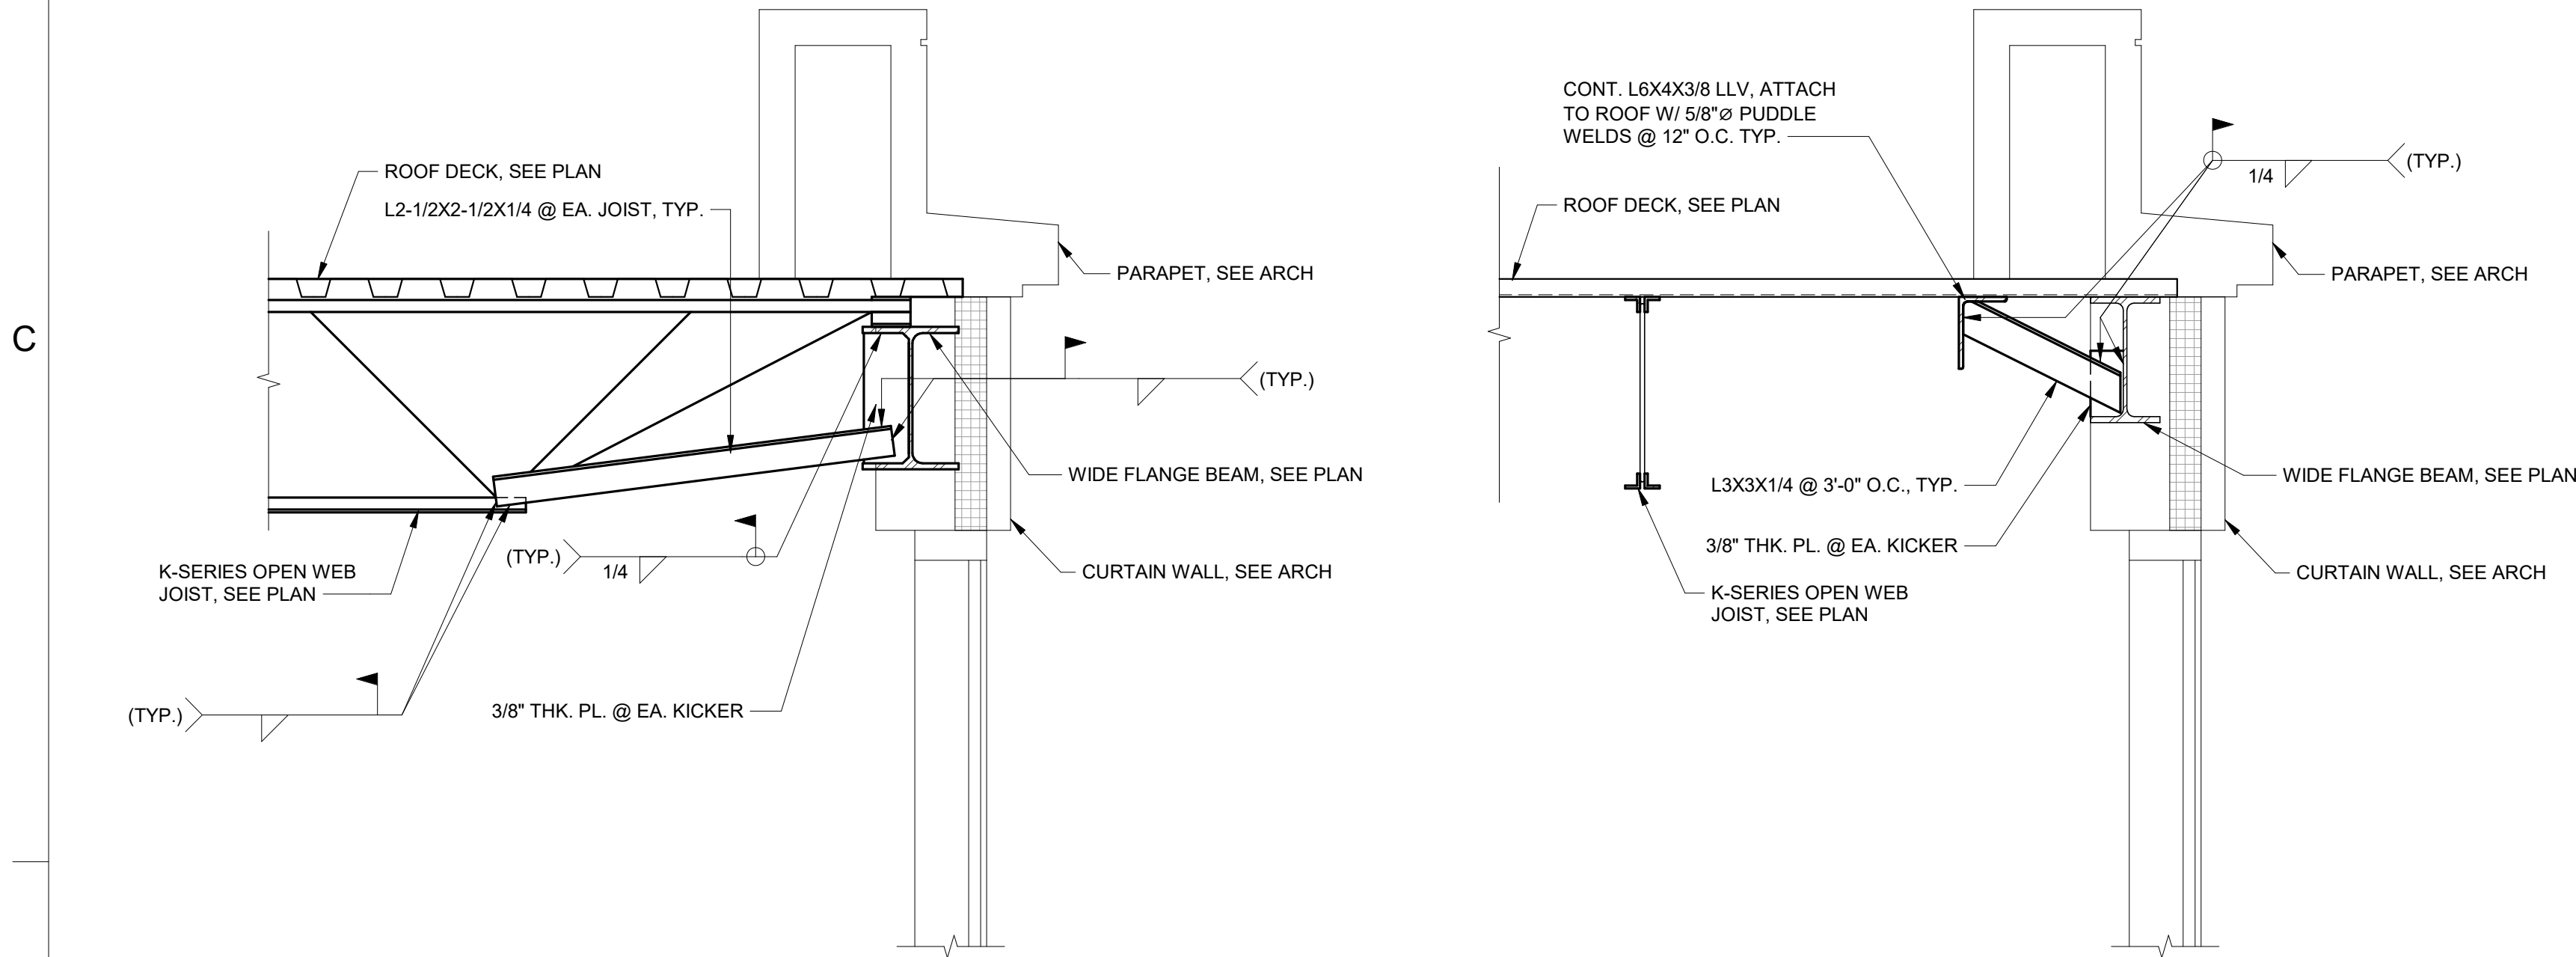


4 CURTAINWALL BRACING PARALLEL TO JOIST
S501 SCALE: 1" = 1'-0"


5 CURTAINWALL BRACING PERPENDICULAR TO JOISTS
S501 SCALE: 1" = 1'-0"

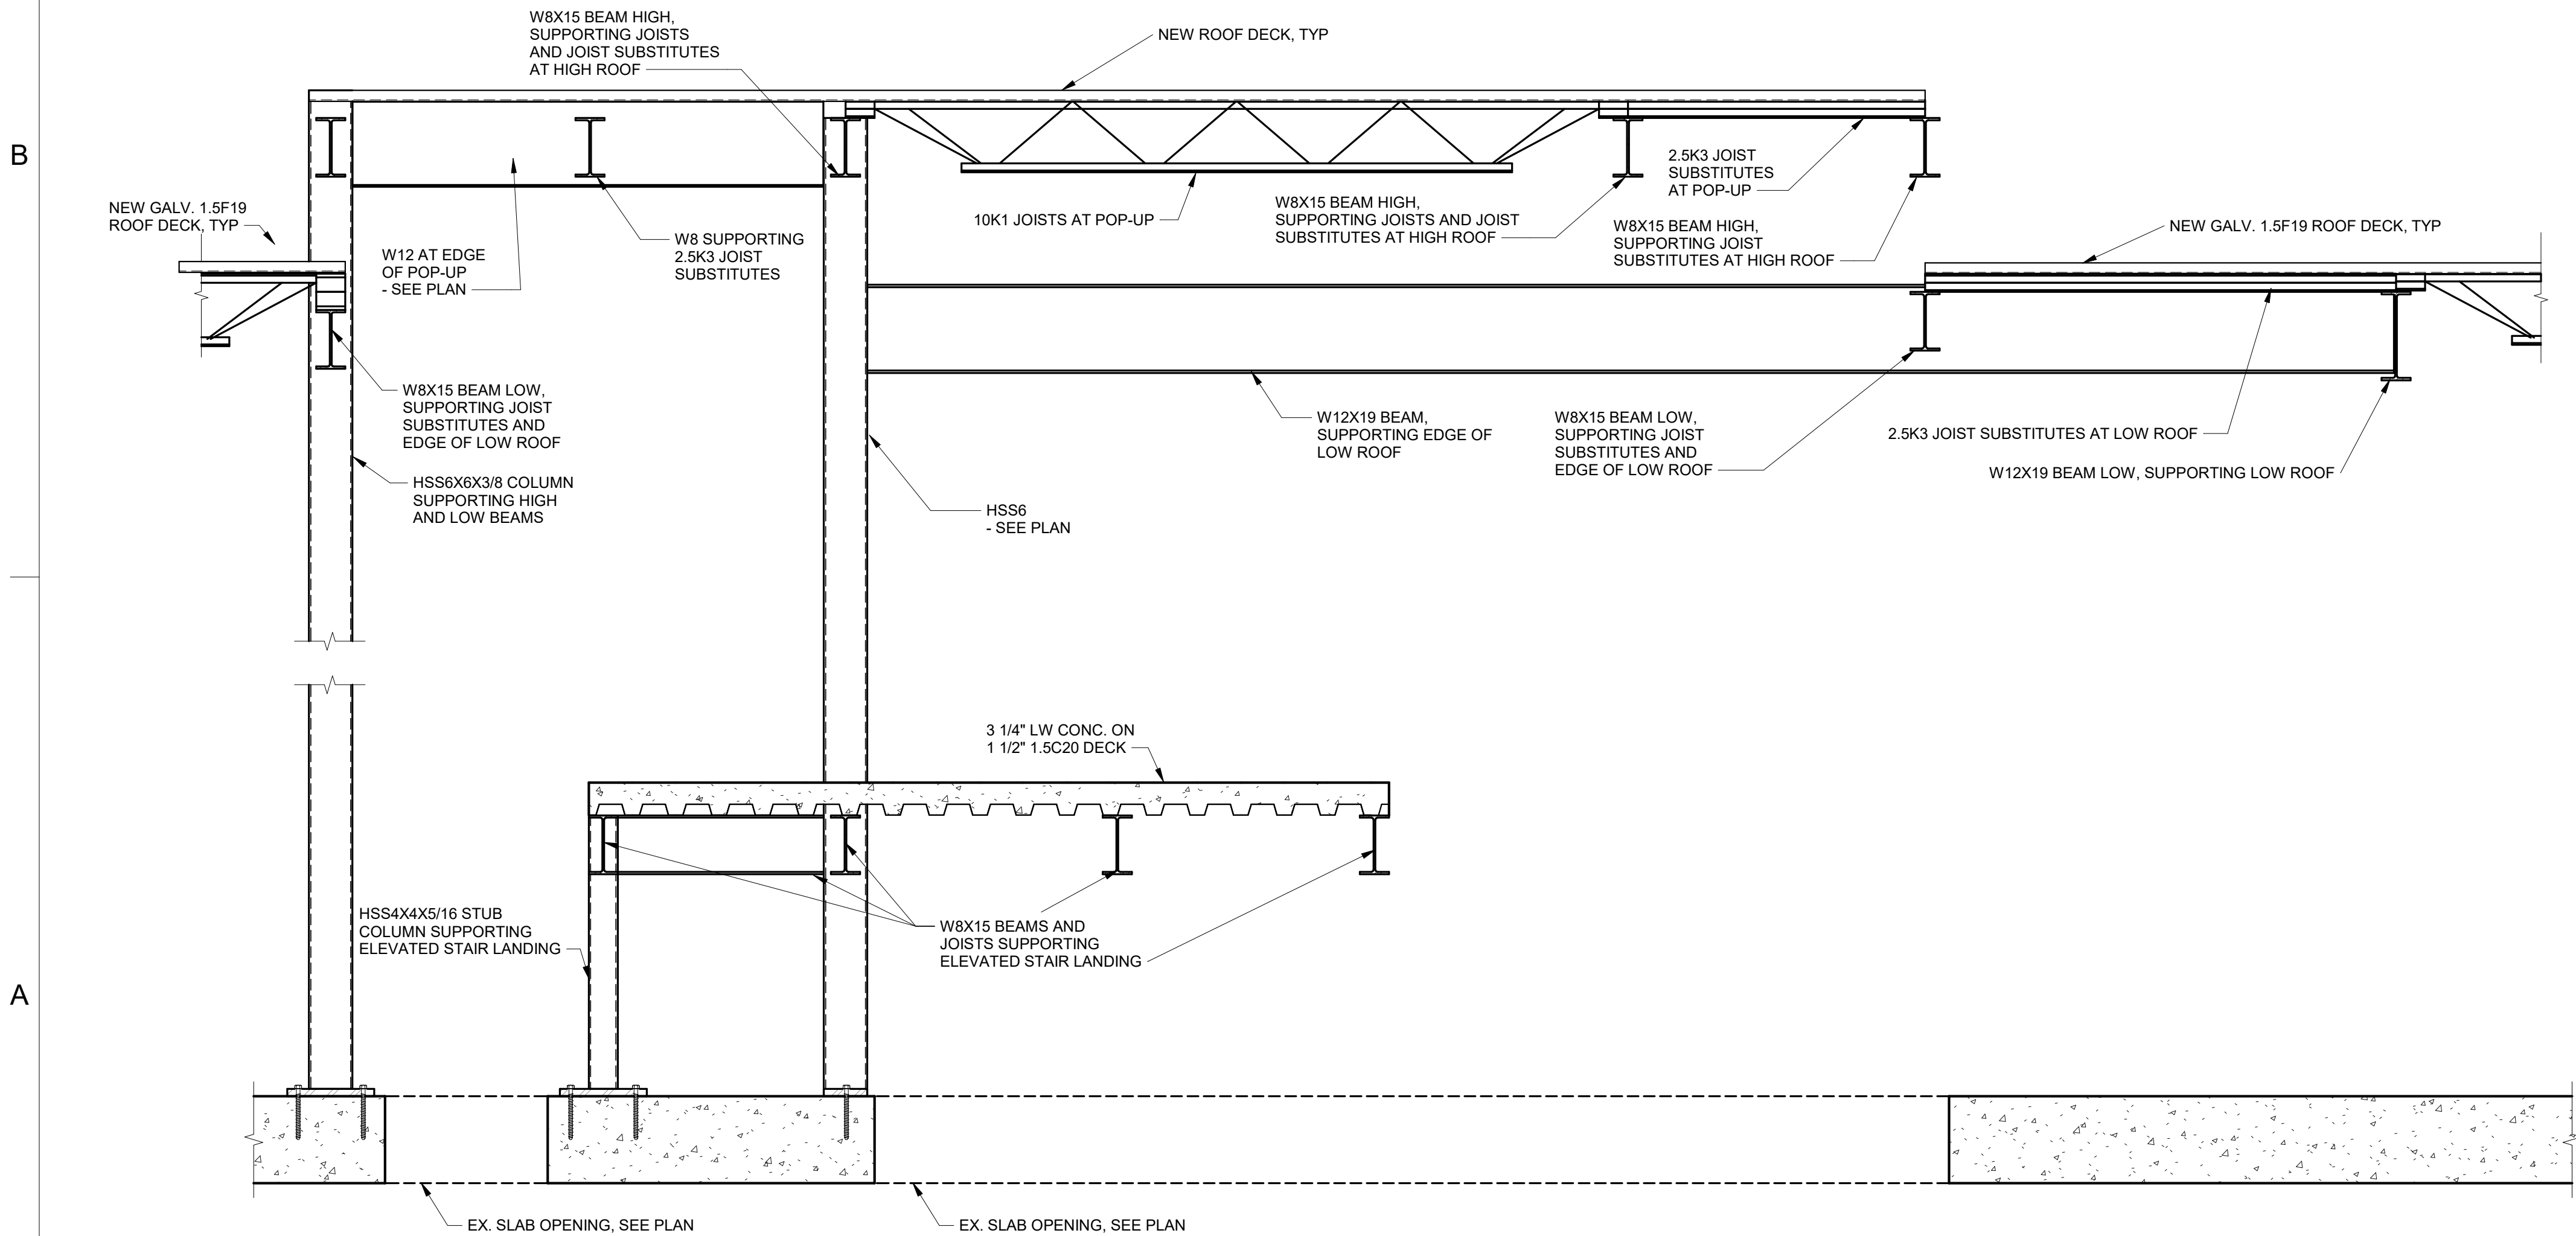

6 SECTION AT STAIR LANDING AND POP UP ROOF
S501 SCALE: 3/4" = 1'-0"

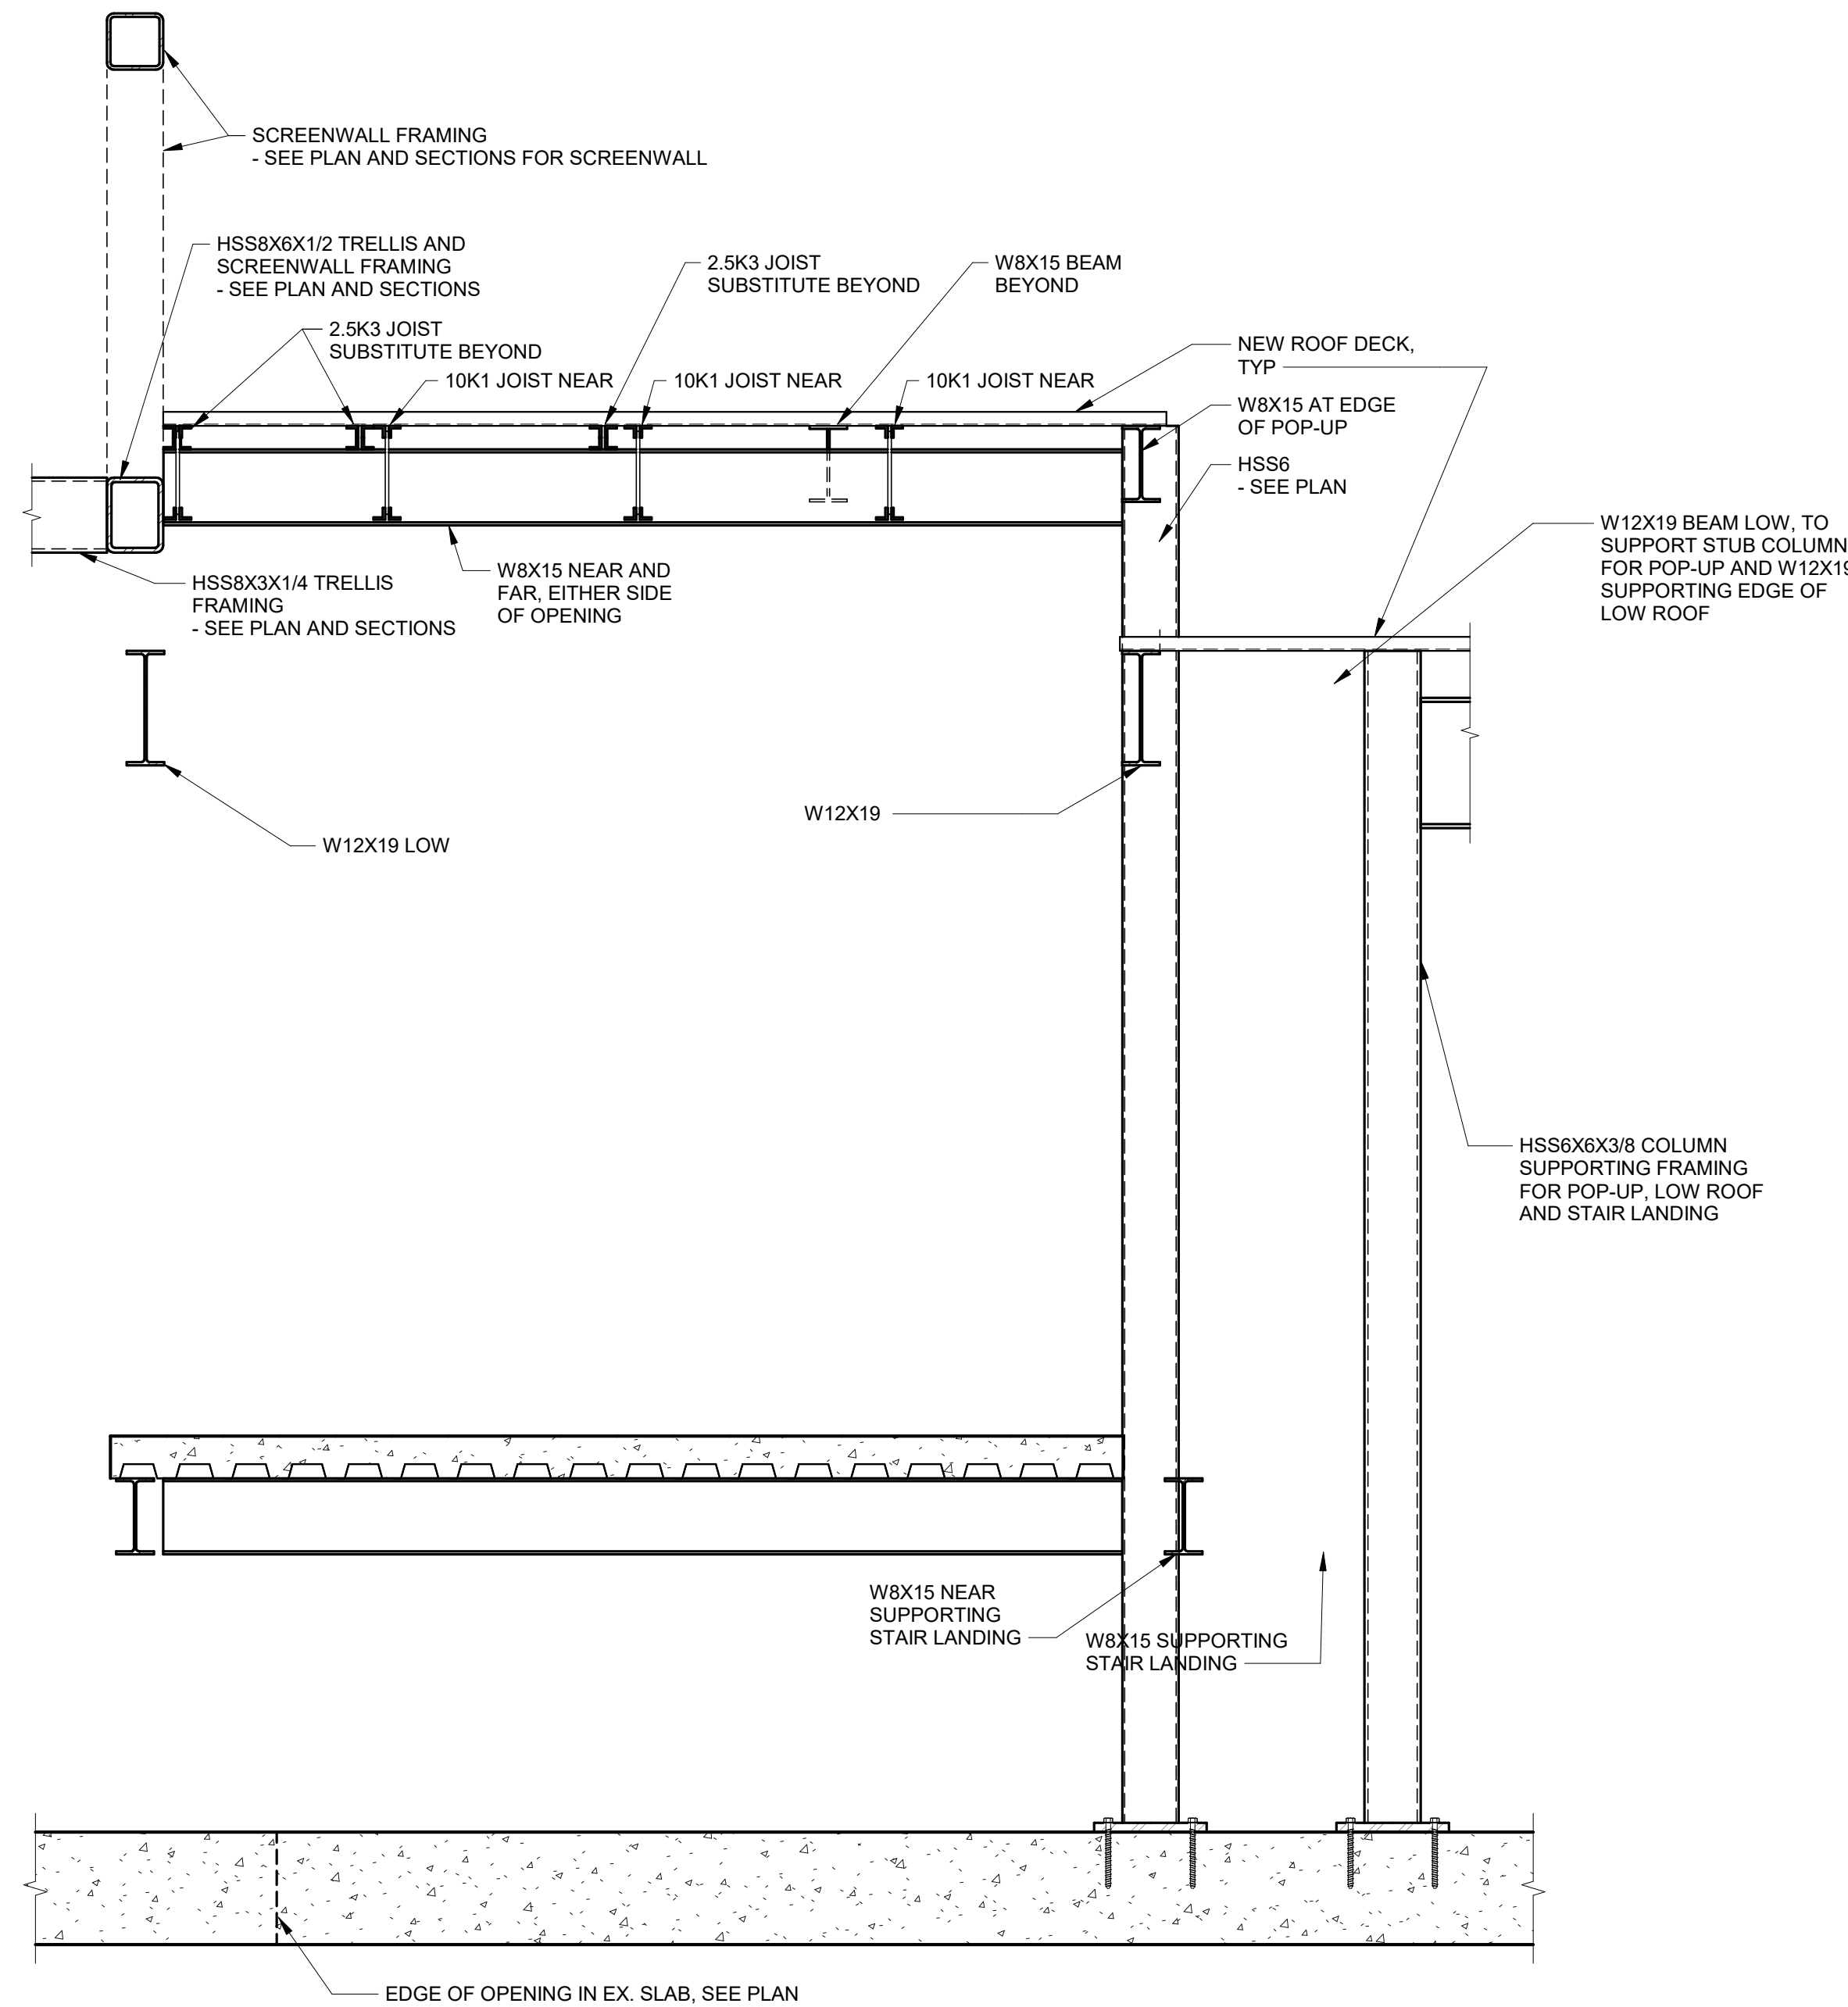

7 SECTION AT STAIR LANDING AND POP-UP ROOF
S501 SCALE: 3/4" = 1'-0"

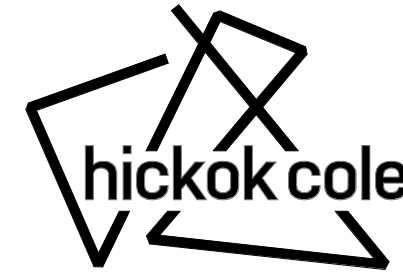

Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com

CONSULTANTS



PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	150% CD
4	11/21/2025	CARPENTRY SET

STAMP

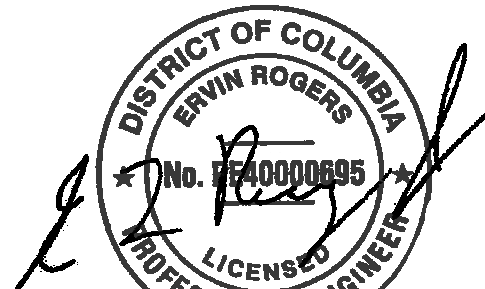

PROJECT NO.
24048

DRAWN BY
Author


SCALE
As Indicated

DRAWING TITLE
**STEEL SECTIONS
AND DETAILS**

DRAWING NO.


S501

D

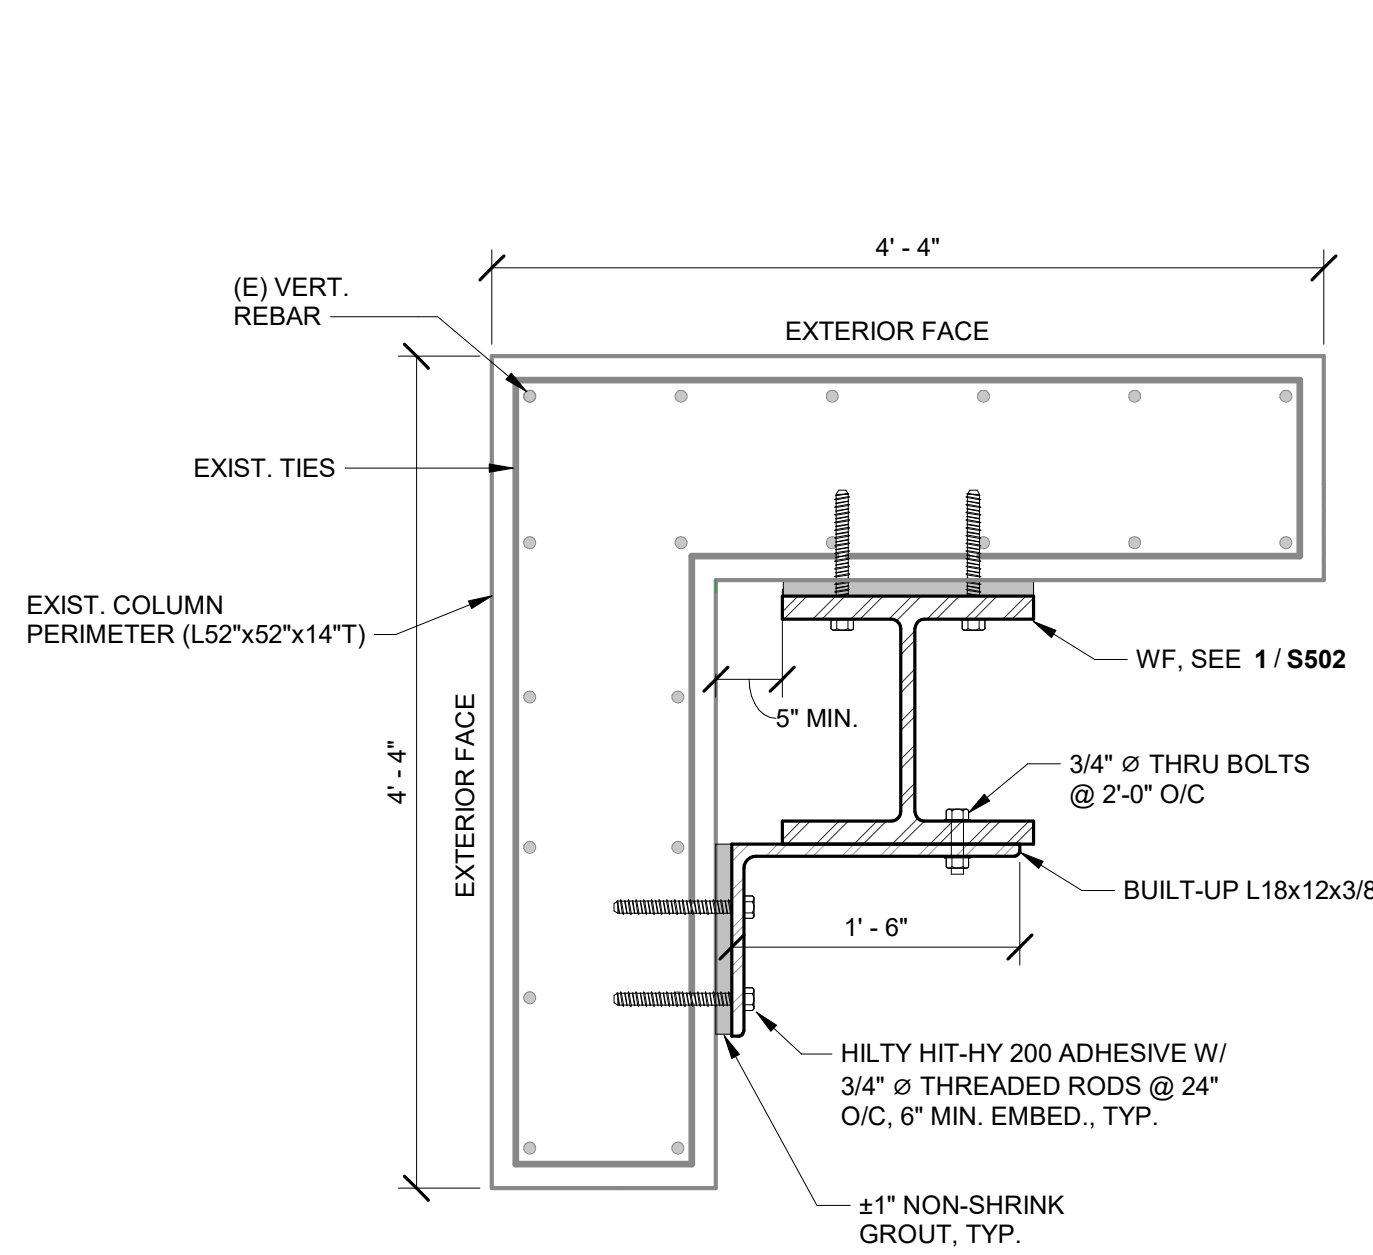


NOTE:
1. COL. MUST BE REINFORCED BEFORE SLAB REMOVAL.

1 COL STRENGTHENING A-1 W/ WF TOP
S503 SCALE: 1" = 1'-0"

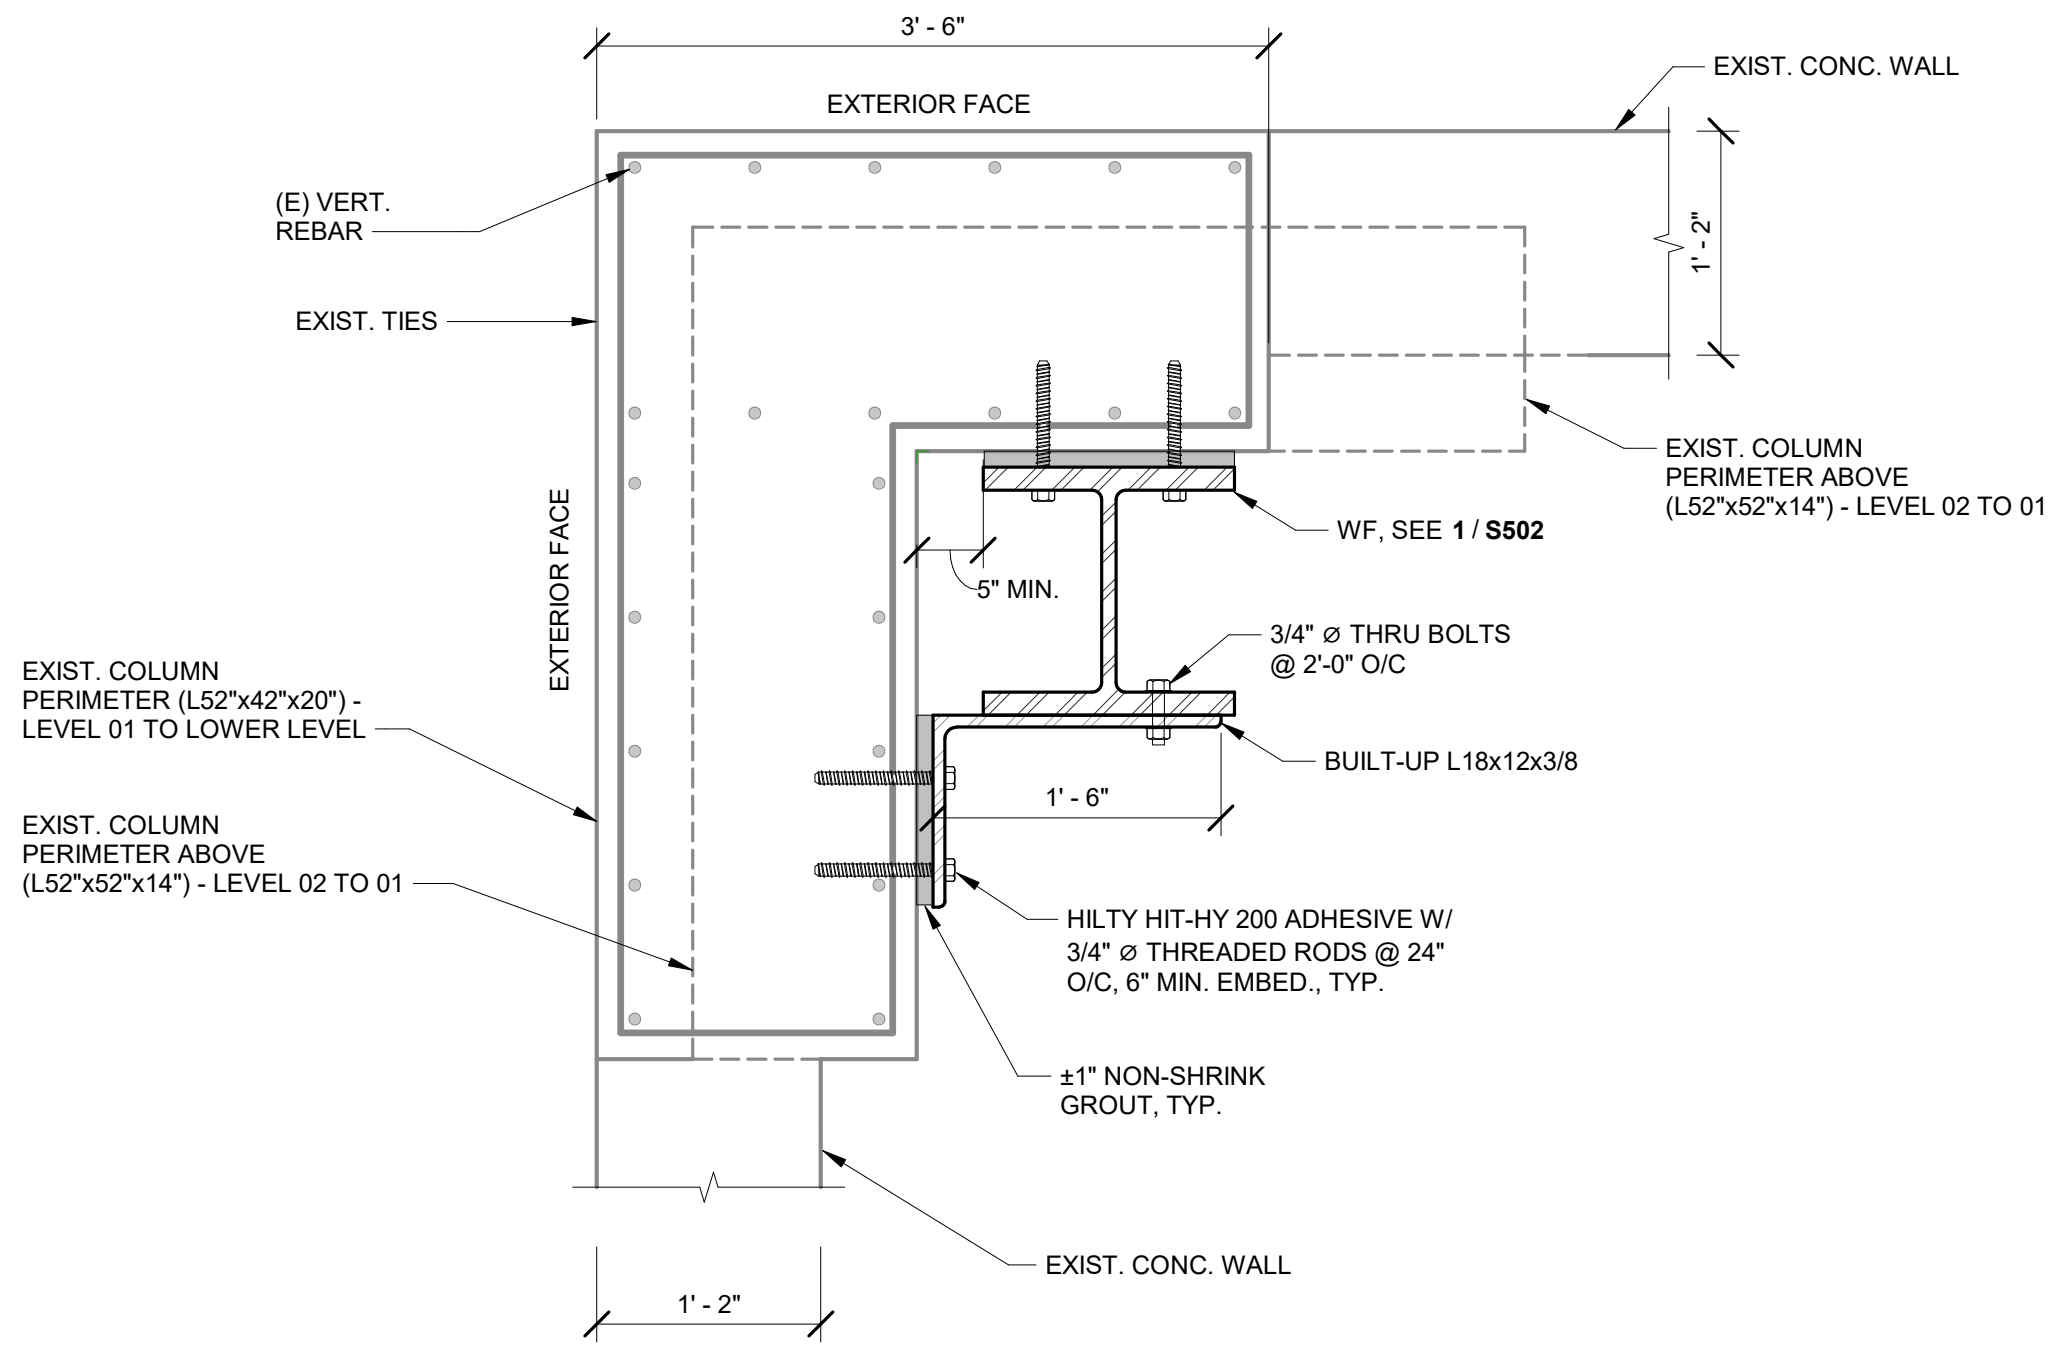


NOTE:
1. COL. MUST BE REINFORCED BEFORE SLAB REMOVAL.

2 COL STRENGTHENING A-1 W/ WF BOT.
S503 SCALE: 1" = 1'-0"

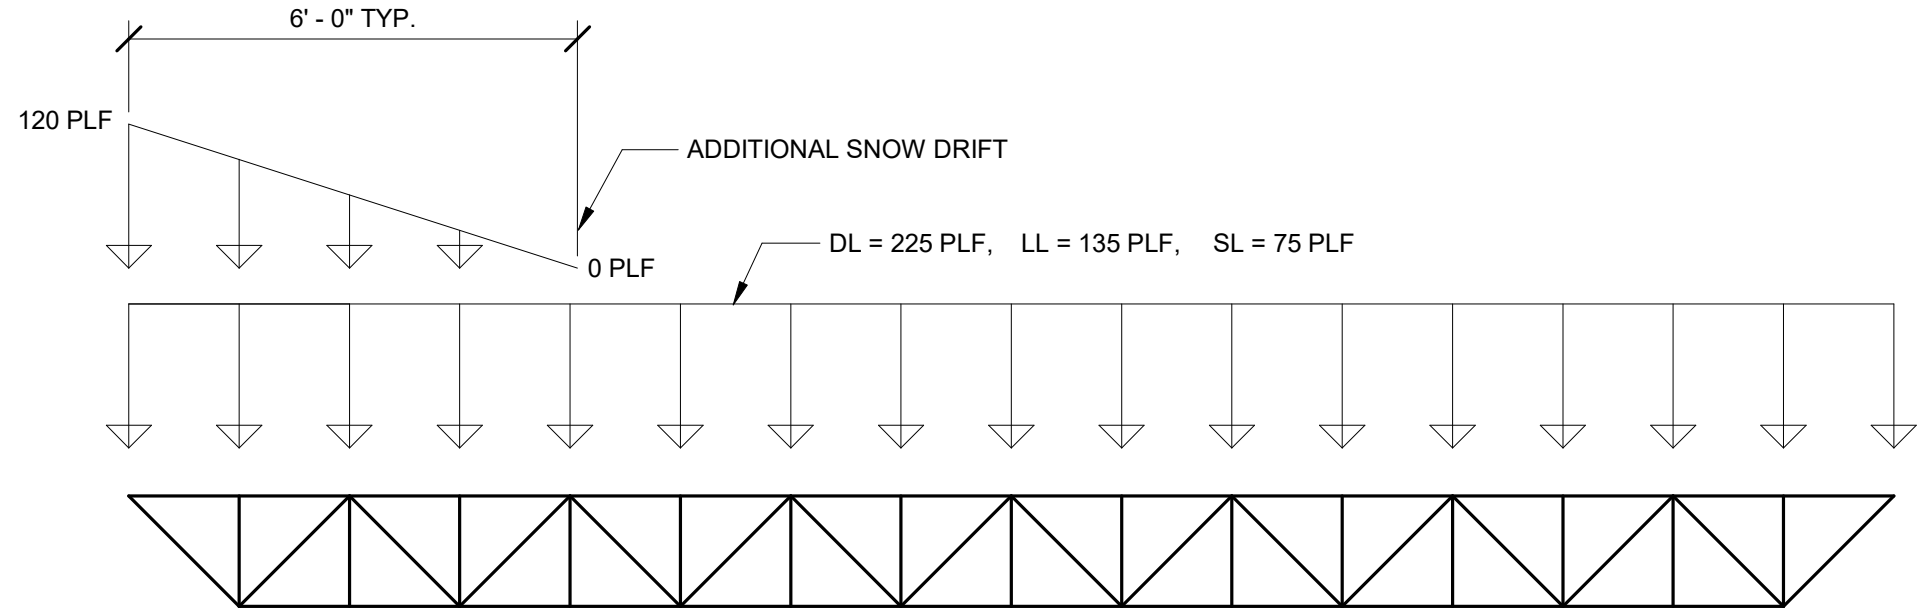


3 18KSP LOAD DIAGRAM
S503 SCALE: 1" = 1'-0"


C

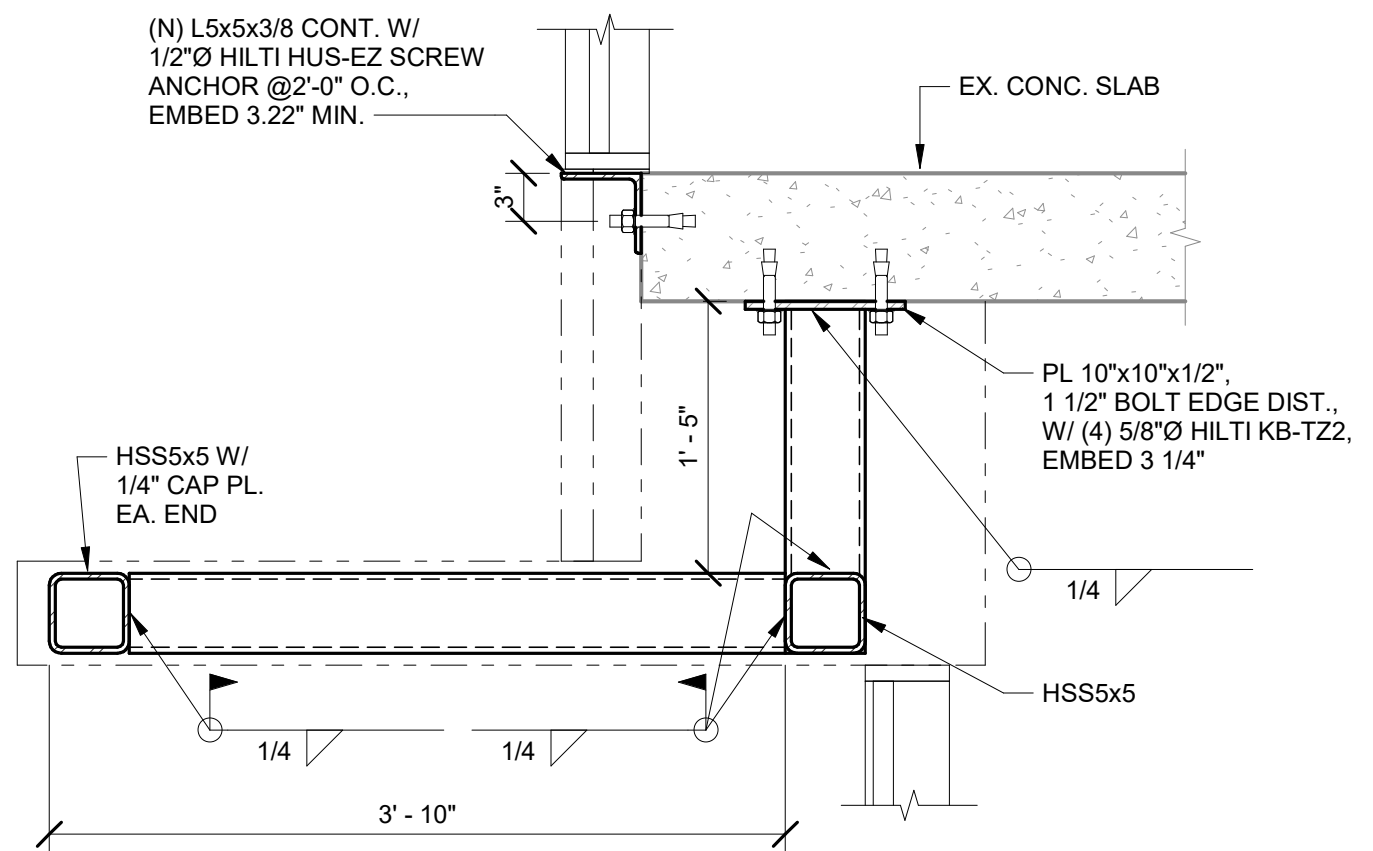


4 CANOPY FRAME DETAIL
S503 SCALE: 1" = 1'-0"

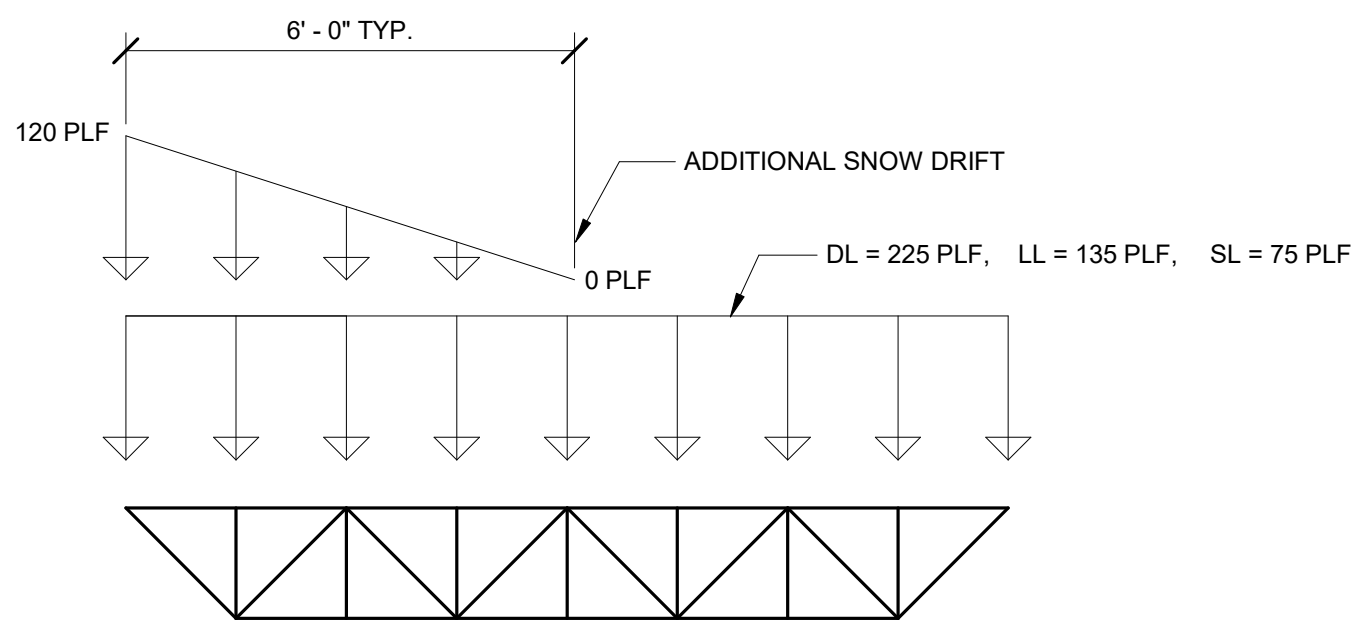


5 10KSP LOAD DIAGRAM
S503 SCALE: 1" = 1'-0"

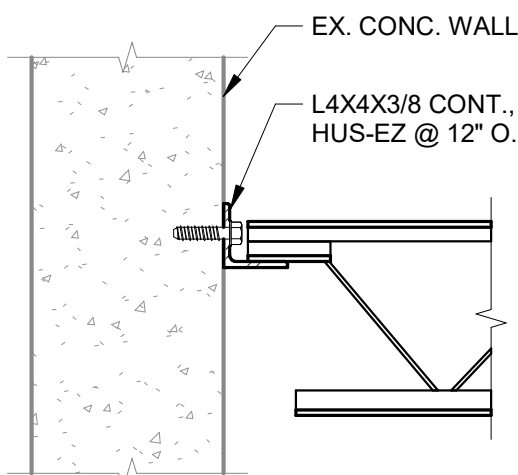

6 CONNECTION OF JOIST TO EX. WALL
S503 SCALE: 1" = 1'-0"

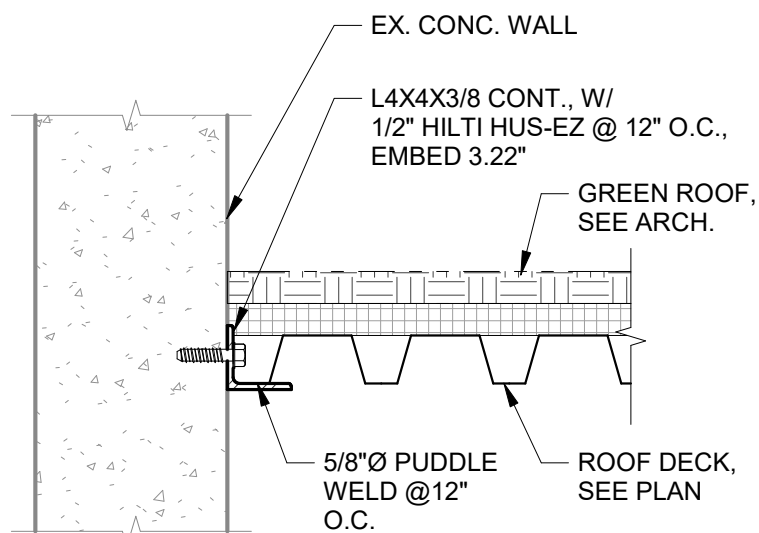

7 CONNECTION OF DECK SUPPORT TO EX. WALL
S503 SCALE: 1" = 1'-0"

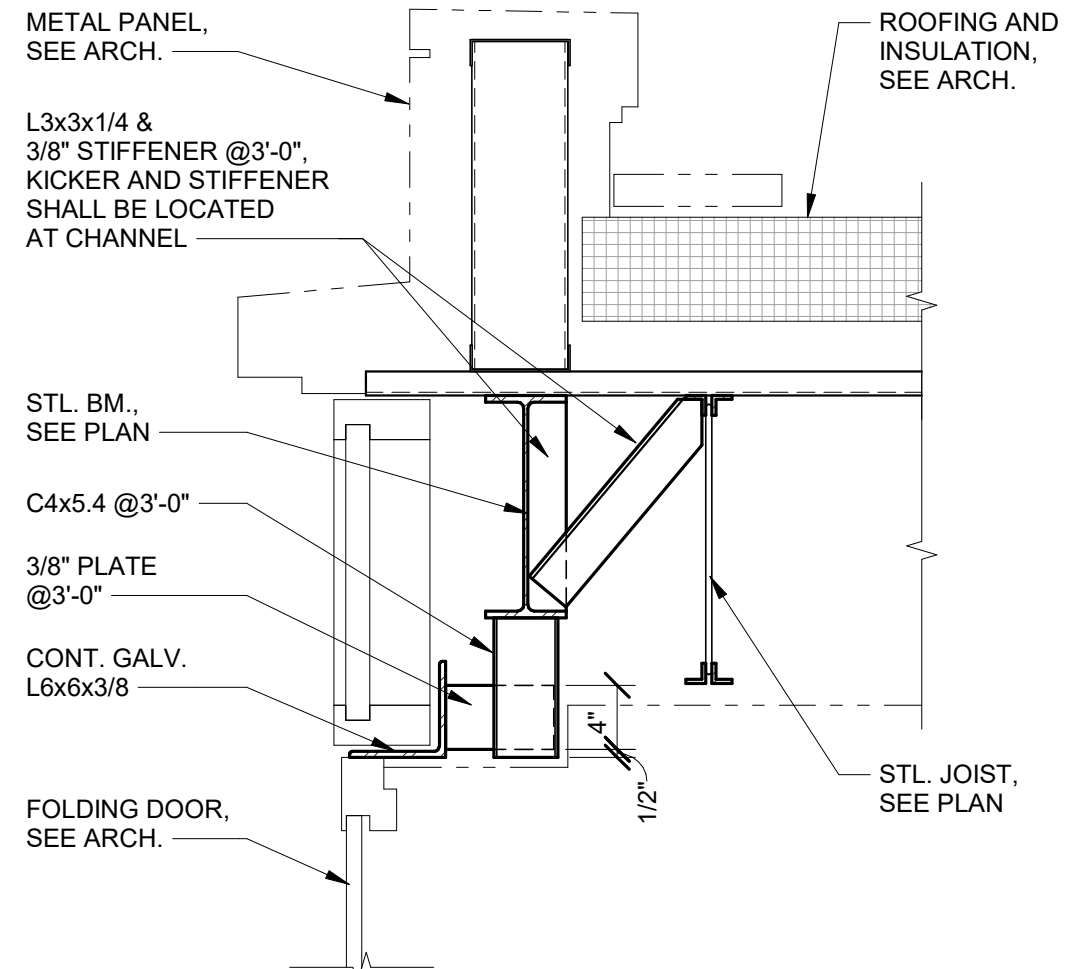

8 NANAWALL SUPPORT DETAIL
S503 SCALE: 1" = 1'-0"

B

A

D



Hickok Cole Architects, Inc.
301 N Street NE, Suite 300
Washington, DC 20002
202.667.9776
hickokcole.com



PROJECT DETAILS

PROJECT NAME
1200 K St NW


CLIENT NAME

ADDRESS
**1200 K St NW
Washington, DC 20005**

REVISIONS / NOTES

#	DATE	DESCRIPTION
1	03/17/2025	50% Design Development Set
2	05/08/2025	100% DD
3	08/28/2025	50% CD
4	11/21/2025	CONCEPT SET

STAMP

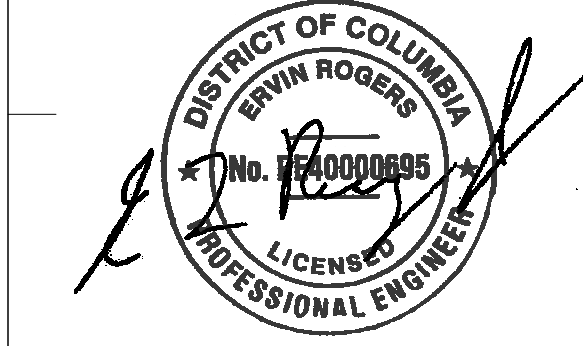

PROJECT NO.
24048

DRAWN BY
Author

SCALE
1" = 1'-0"

DRAWING TITLE
**STEEL SECTIONS
AND DETAILS**

DRAWING NO.
S503