



LEGEND

- Compliant Exit (≥ 900 mm)
- Non-Compliant Door (< 900 mm)
- Fire Extinguisher
- Smoke Detector
- Fire Hose Reel

■ NO SPRINKLER SYSTEM SHOWN (REQUIRED: 5-STOREY BUILDING)

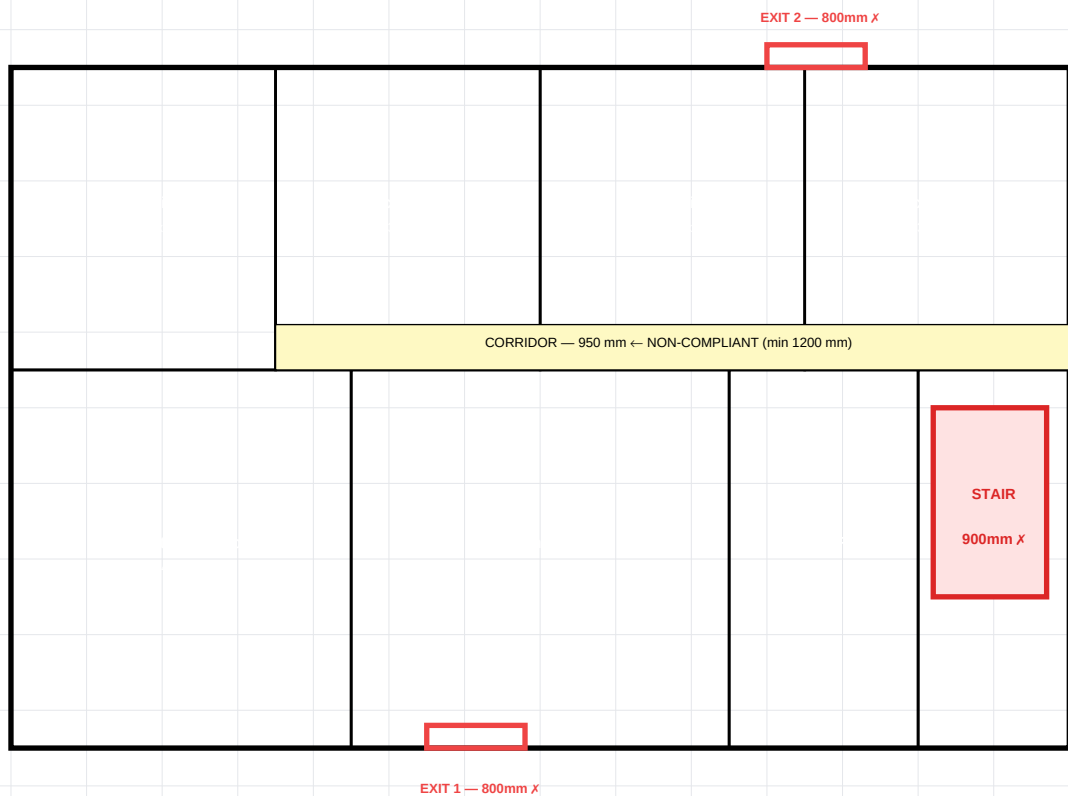

ELEVATION

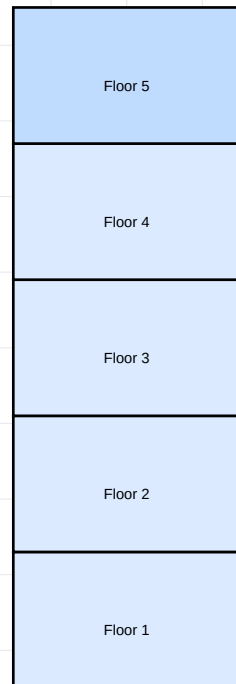

$\times$ No sprinkler system (5-storey building — mandatory per DCD Rule 5)

$\times$ Exit widths 800 mm — non-compliant (min 900 mm, recommended 1000 mm)

$\times$ Staircase width 900 mm — non-compliant (min 1200 mm)

$\times$ Corridor width 950 mm — non-compliant (min 1200 mm)



DUBAI CIVIL DEFENCE

BUILDING PLAN SUBMISSION

OFFICE BUILDING — TYPICAL FLOOR PLAN (FLOORS 1–5)

Business Bay Tower, Dubai | 5 Floors, 2400 m² GFA, Occ: 140/floor

Ref: DCD-TEST-FAIL-001

Test Scenario: FAIL — Multiple Critical Violations