


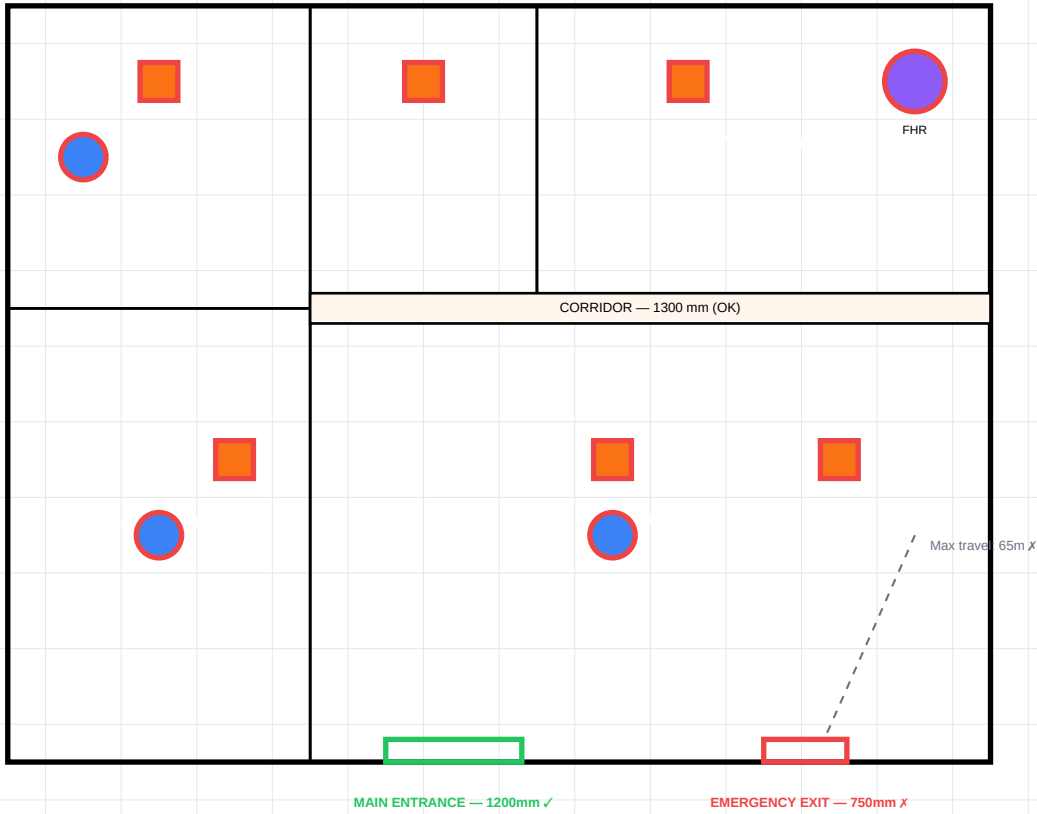


- LEGEND
- Compliant Exit (≥ 900 mm)
 - Non-Compliant Door (< 900 mm)
 - Fire Extinguisher
 - Smoke Detector
 - Fire Hose Reel

- ✓ Main entrance width 1200 mm
- ✓ Corridor width 1300 mm
- ✓ 6 smoke detectors provided

- ✗ Emergency exit width 750 mm (min 900 mm)
- ✗ Max travel distance 65 m exceeds limit (non-sprinklered: 45 m)

- ✗ High occupancy (440 pax) — 3rd exit required



DUBAI CIVIL DEFENCE

BUILDING PLAN SUBMISSION

RESTAURANT — GROUND FLOOR PLAN

DIFC Food & Beverage Outlet, Dubai | GF, 650 m², 440 covers + staff

Ref: DCD-TEST-PARTIAL-001

Test Scenario: FAIL — 3 Violations (exits + travel distance)