D4 panel coverage through n=45

The preregistered plan has 140 named D4 inputs at n=33–45: ten per n plus ten trace-zero inputs at n=33. The index audit matched 136 terminal records to distinct planned IDs. Fifty-nine carry an LFD-at-least-five lower bound. Seventy-seven other terminal records do not establish that lower bound. Four original n45 random inputs remain pending.

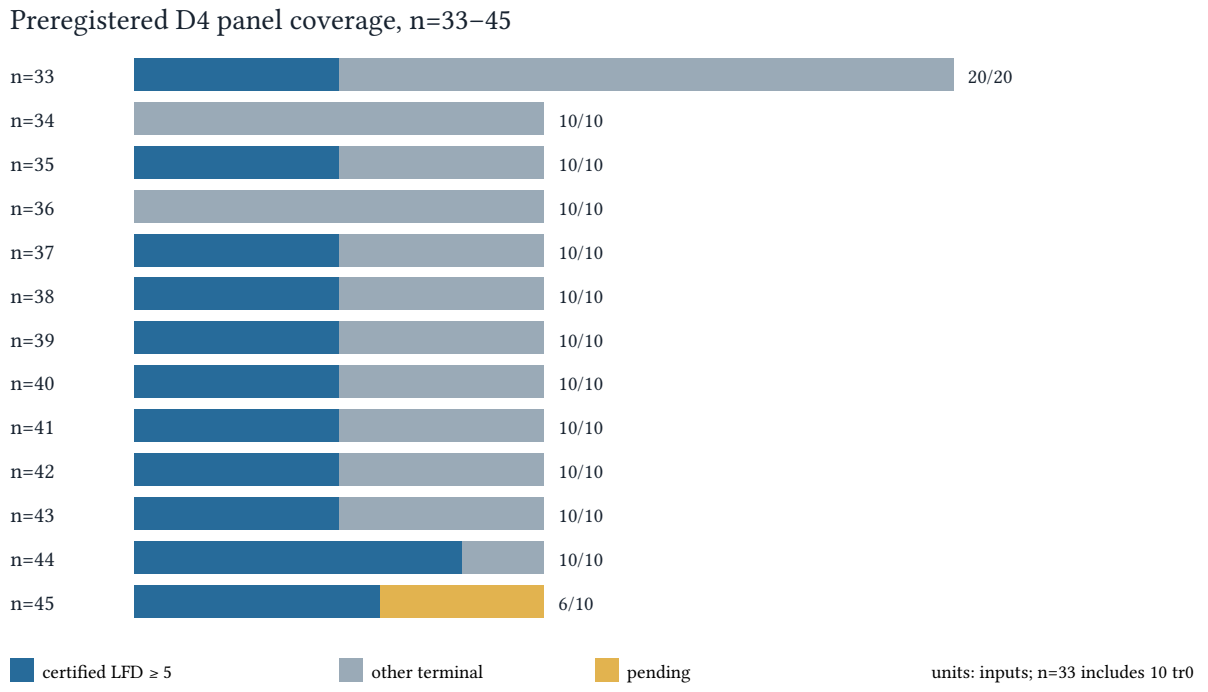

n=33: 20/20 terminal, 5 certified LFD≥5 n=34: 10/10 terminal, 0 certified LFD≥5 n=35: 10/10 terminal, 5 certified LFD≥5 n=36: 10/10 terminal, 0 certified LFD≥5 n=37: 10/10 terminal, 5 certified LFD≥5 n=38: 10/10 terminal, 5 certified LFD≥5 n=39: 10/10 terminal, 5 certified LFD≥5 n=40: 10/10 terminal, 5 certified LFD≥5 n=41: 10/10 terminal, 5 certified LFD≥5 n=42: 10/10 terminal, 5 certified LFD≥5 n=43: 10/10 terminal, 5 certified LFD≥5 n=44: 10/10 terminal, 8 certified LFD≥5 n=45: 6/10 terminal, 6 certified LFD≥5

The audit verifies plan, inventory, result and inference links and strict count-versus-codimension arithmetic. It does not rehash or replay every large certificate. Other terminal outcomes are inconclusive for this lower bound, not upper bounds.