



A TRAINING — learn normal behaviour from one fault-free year

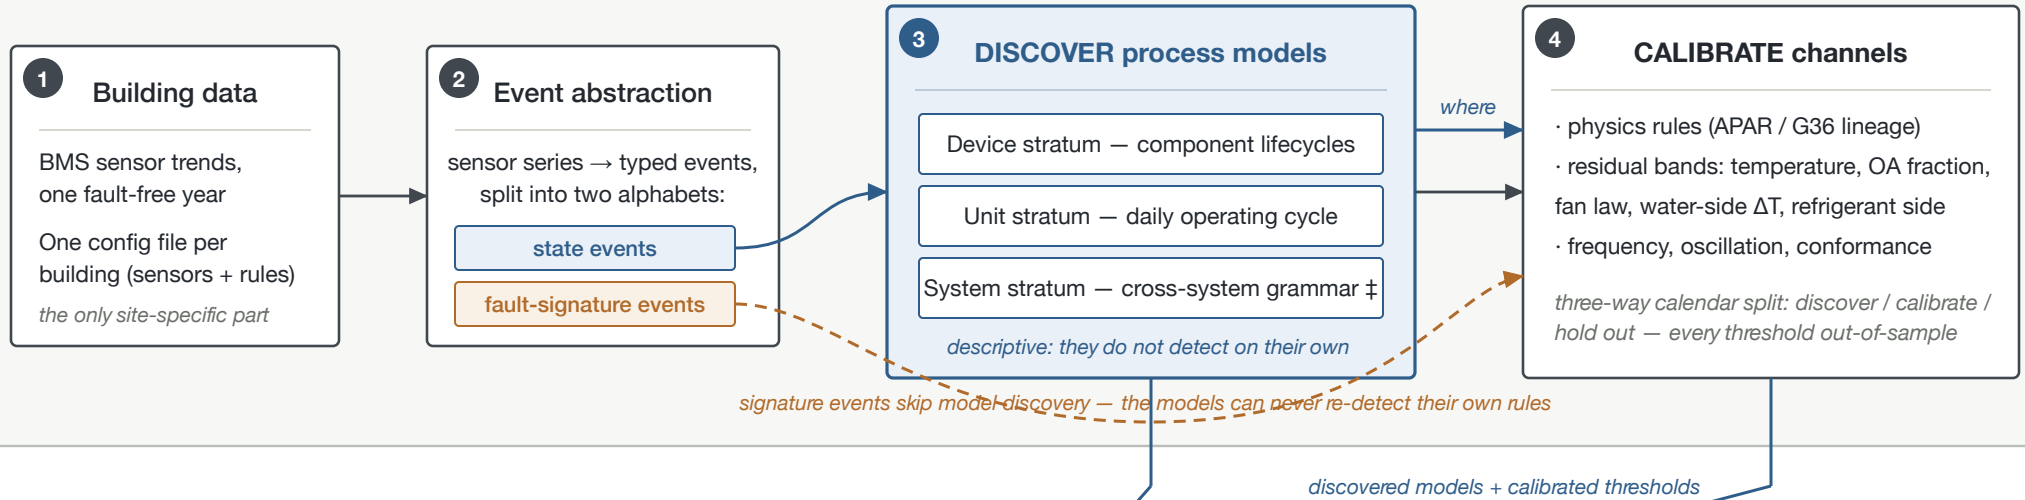

B DEPLOYMENT — score each new day

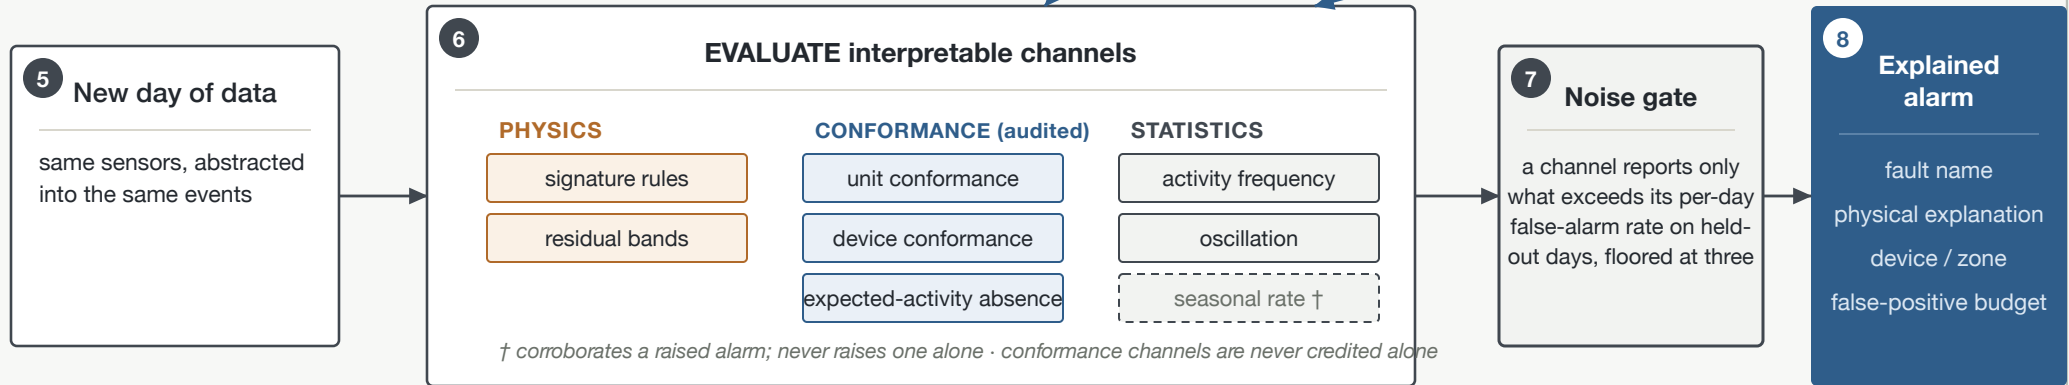

Validated on six LBNL systems — 13/14 · 26/30 · 25/29 · 50/55 · 43/47 · 20/24 scenarios at 0–9.4 % false-alarm days — and one measured rooftop unit (6.1 %)

□ discovered process models □ physics / fault-signature path - - - excluded from discovery
‡ used in the portability analysis, which found no transfer (X20/X21); the deployed channels come from the device and unit strata