

Annual Water Quality Report

City of Ashgrove Water Utility · Fiscal Year 2026

Contents

1. Summary	2
2. Lead & Turbidity Trends	2
3. Monitoring Site Results	2
4. Next Steps	3


1. Summary

All 14 monitoring sites across the Ashgrove distribution system remained below EPA action levels for lead and copper throughout FY2026. Average lead concentration fell for the fourth consecutive year, continuing the trend since the 2022 service-line replacement program began. Turbidity readings were stable and well within the 0.3 NTU treatment technique limit for 95% of monthly samples.

Lead levels at a four-year low

Average lead concentration across all sites dropped to 0.7 ppb in June, down from 1.4 ppb in January — well under the EPA action level of 15 ppb.

2. Lead & Turbidity Trends

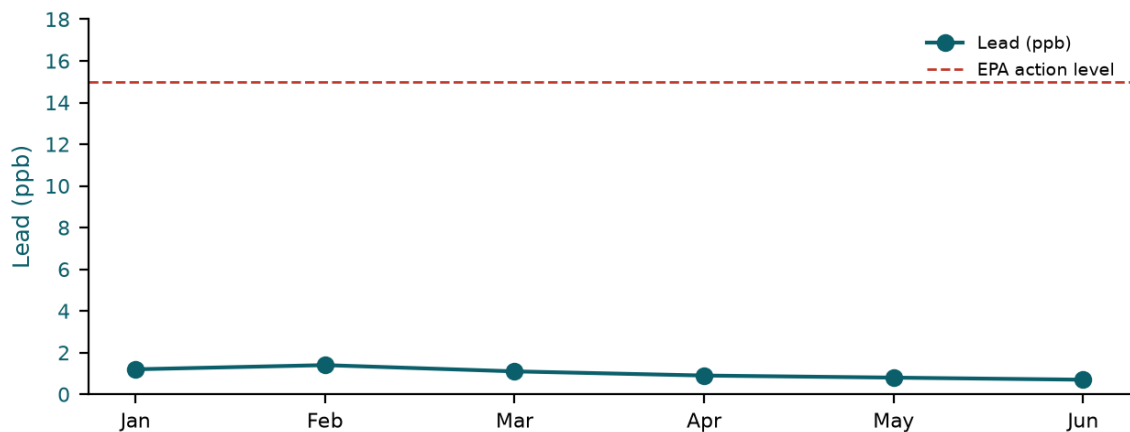

3. Monitoring Site Results

Site	District	Lead (ppb)	Copper (ppm)	Status
Site 01 — Elm & 3rd	Downtown	0.6	0.21	Compliant
Site 04 — Riverside Park	West End	0.9	0.34	Compliant
Site 07 — Maple Heights	North Hills	1.8	0.42	Compliant
Site 09 — Old Mill Rd	West End	2.4	0.51	Watch
Site 12 — Harbor District	Downtown	0.5	0.19	Compliant
Site 14 — Cedar Grove	North Hills	0.7	0.28	Compliant

Old Mill Rd site flagged for follow-up

Site 09 has trended upward for two consecutive quarters (1.6 to 2.4 ppb). Still well under the action level, but Operations has scheduled an out-of-cycle service line inspection for early Q3.

4. Next Steps

The utility will complete the final 6 service line replacements under the 2022 program by September 2026, closing out the program two months ahead of the original schedule. Routine quarterly sampling continues at all 14 sites, with the Old Mill Rd site added to monthly (rather than quarterly) monitoring pending the Q3 inspection results.