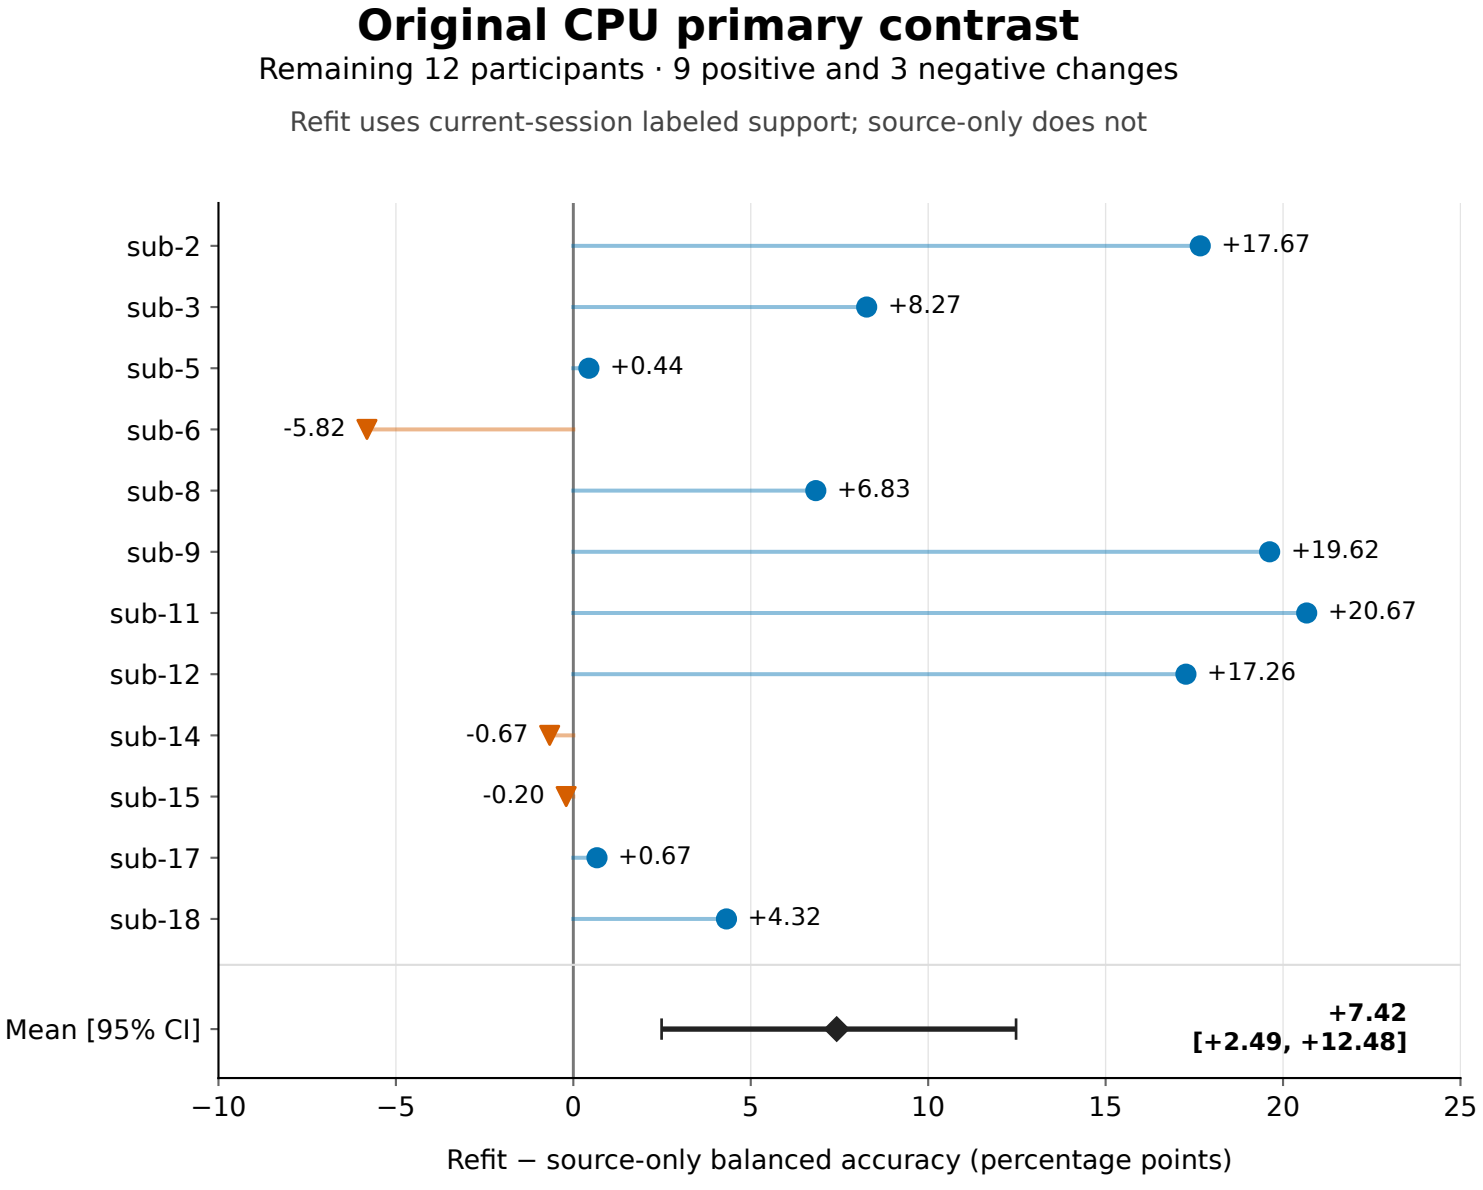
Original CPU primary contrast
Remaining 12 participants · 9 positive and 3 negative changes
Refit uses current-session labeled support; source-only does not
sub-2
sub-3
sub-5
sub-6
sub-8
sub-9
sub-11
sub-12
sub-14
sub-15
sub-17
sub-18
+17.67
+8.27
+0.44
-5.82
+6.83
+19.62
+20.67
+17.26
-0.67
-0.20
+0.67
+4.32
Mean [95% CI]
+7.42
[+2.49, +12.48]
−10
−5
0
5
10
15
20
25
Refit − source-only balanced accuracy (percentage points)
Five target sessions averaged per participant; original participant-bootstrap interval retained.