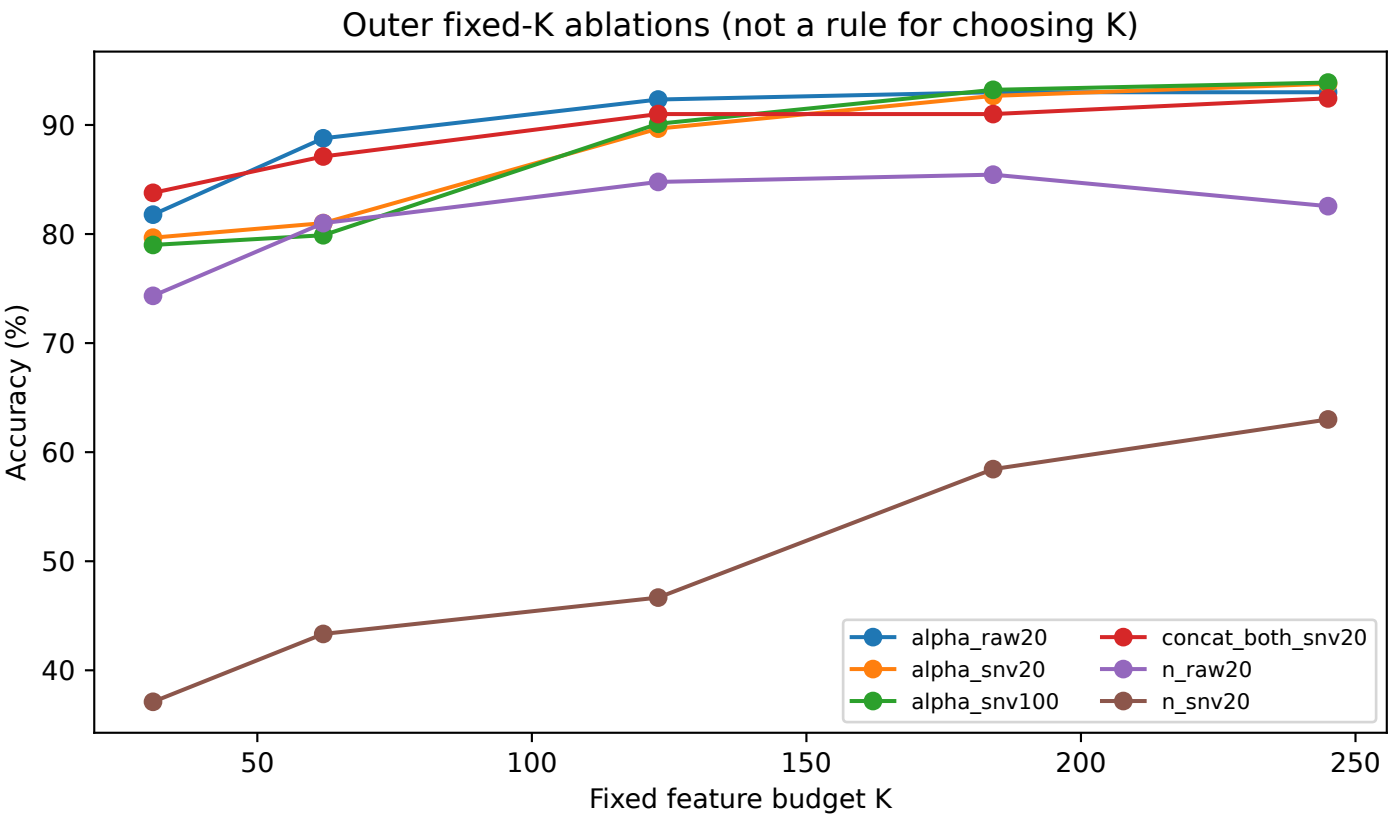
Outer fixed-K ablations (not a rule for choosing K)
Accuracy (%)
Fixed feature budget K
90
80
70
60
50
40
50
100
150
200
250
alpha_raw20
alpha_snv20
alpha_snv100
concat_both_snv20
n_raw20
n_snv20